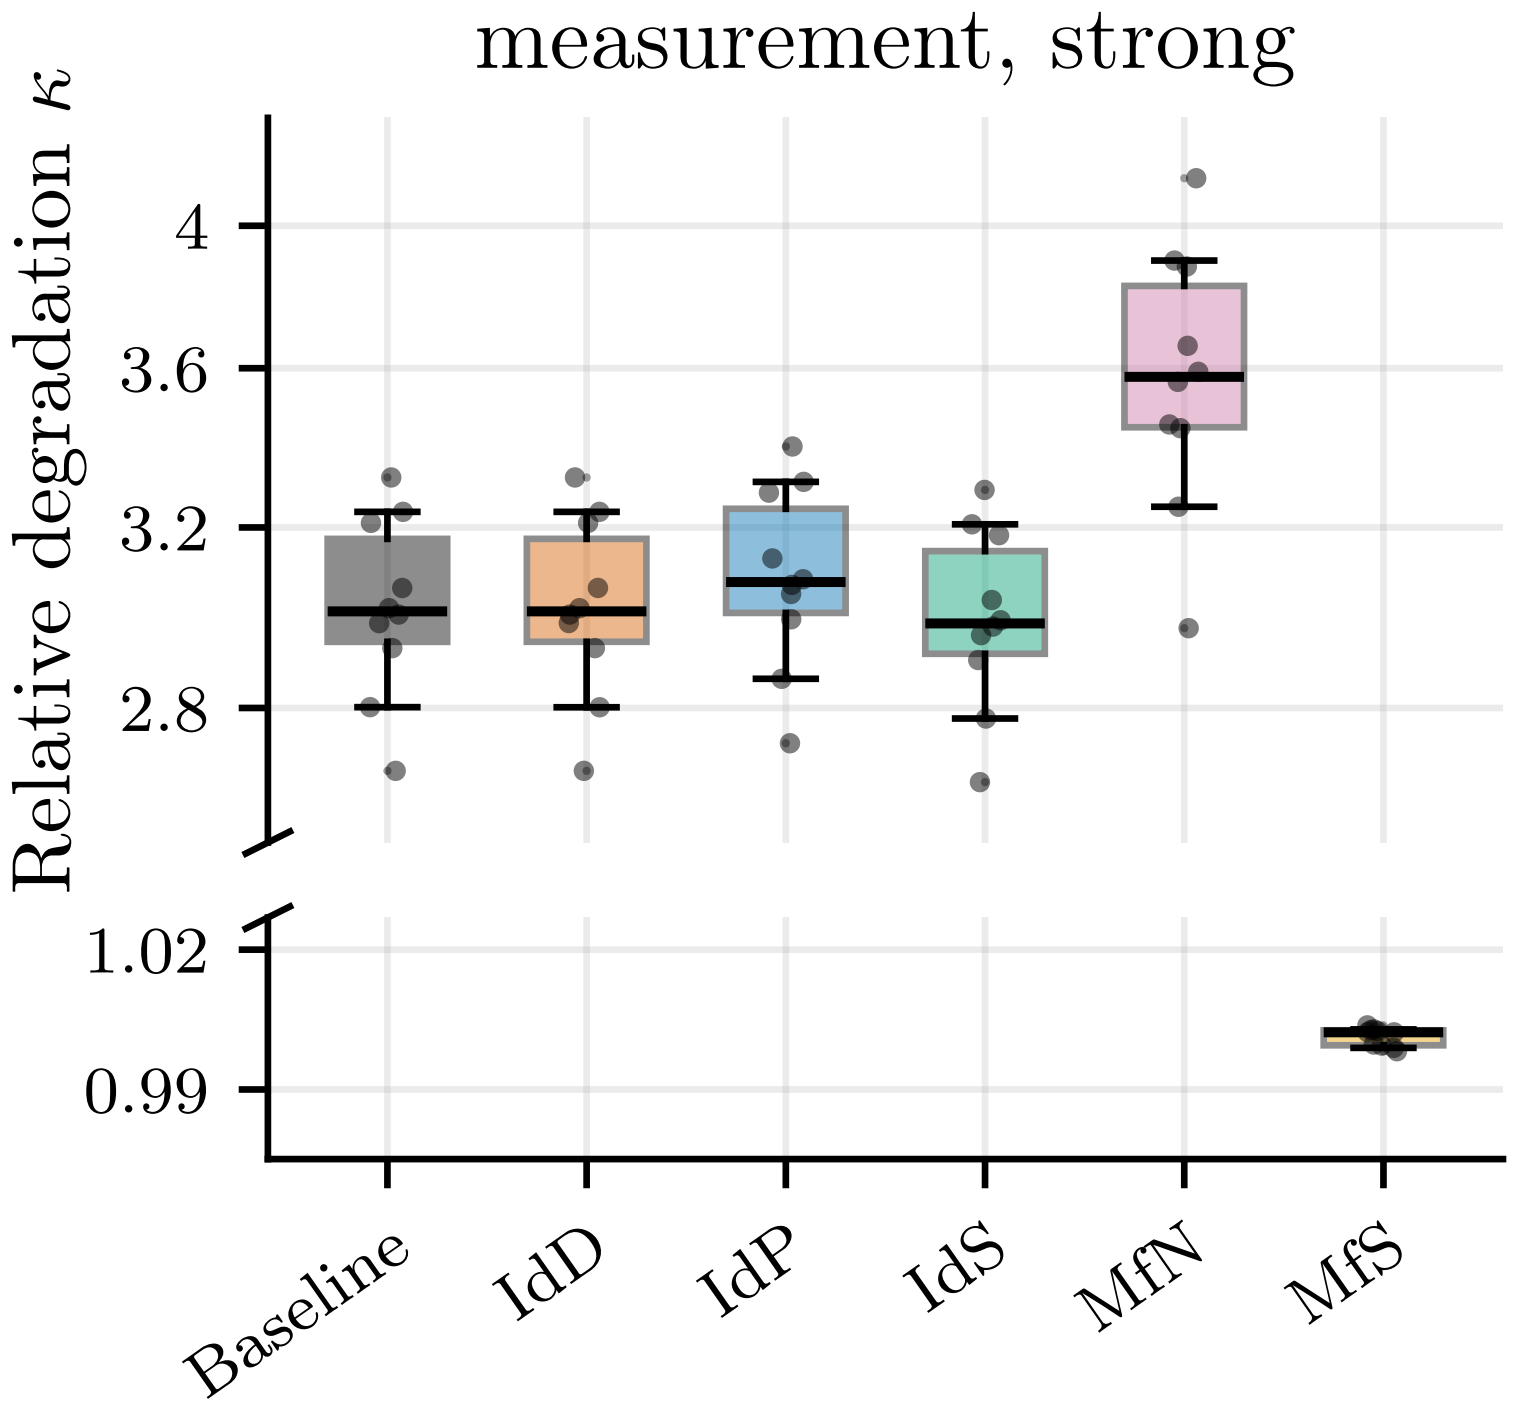

measurement, strong
Relative degradation κ
4
3.6
3.2
2.8
1.02
0.99
Baseline
IdD
IdP
IdS
MfN
MfS