


CUSTOMER: ERGO HOME ENERGY LTD						PANEL: GLVP (8 INPUTS)			
ADDRESS: 41-49, Nimeli CourtBlock B, 2408 Egkomi						SERIAL NO:			
P.O. Box 26774, 1647 Nicosia Cyprus						DRAWING NO: -			
TEL: +357 7777 14 11						ORDER NO: -			
E-MAIL: info@ergohomegroup.com						PROJECT CODE: -			
PROJECT: ANARITA 10MW						PROJECT START: -			
LOCATION: CYPRUS						PROJECT END: -			


SPECIFICATIONS	Enclosure		Electrical Characteristics				COMMENTS -		
	Type:	DKC CQE ITALY	Rated Current:		2000A				
	Color:	RAL7035	Voltage /Frequency:		800 VAC / 50Hz				
	Mounting:	Free Standing	Short Circuit Capacity:		50kA				
	Dimensions:	2100x1400x800mm (HxWxD)	Control Voltage:		230V AC				
	Protection Rate (IP):	IP54	Signalling Voltage:		-				
	Form Type:	Form 1	Construction Standard:		EN61439 / EN60947-2				


REVISIONS	No	Date	Description	Drawn	Date	Checked	Date	Approved	Date
	02	20/03/2023	EL. DRAWING 2ND VERSION FOR REVIEW	ALEXIOU A.	20/03/2023	ALEXIOU A.	20/03/2023	ALEXIOU A.	20/03/2023
	01	19/01/2023	EL. DRAWING 1ST VERSION FOR REVIEW	ALEXIOU A.	19/01/2023	ALEXIOU A.	19/01/2023	ILVIEF SA	19/01/2023

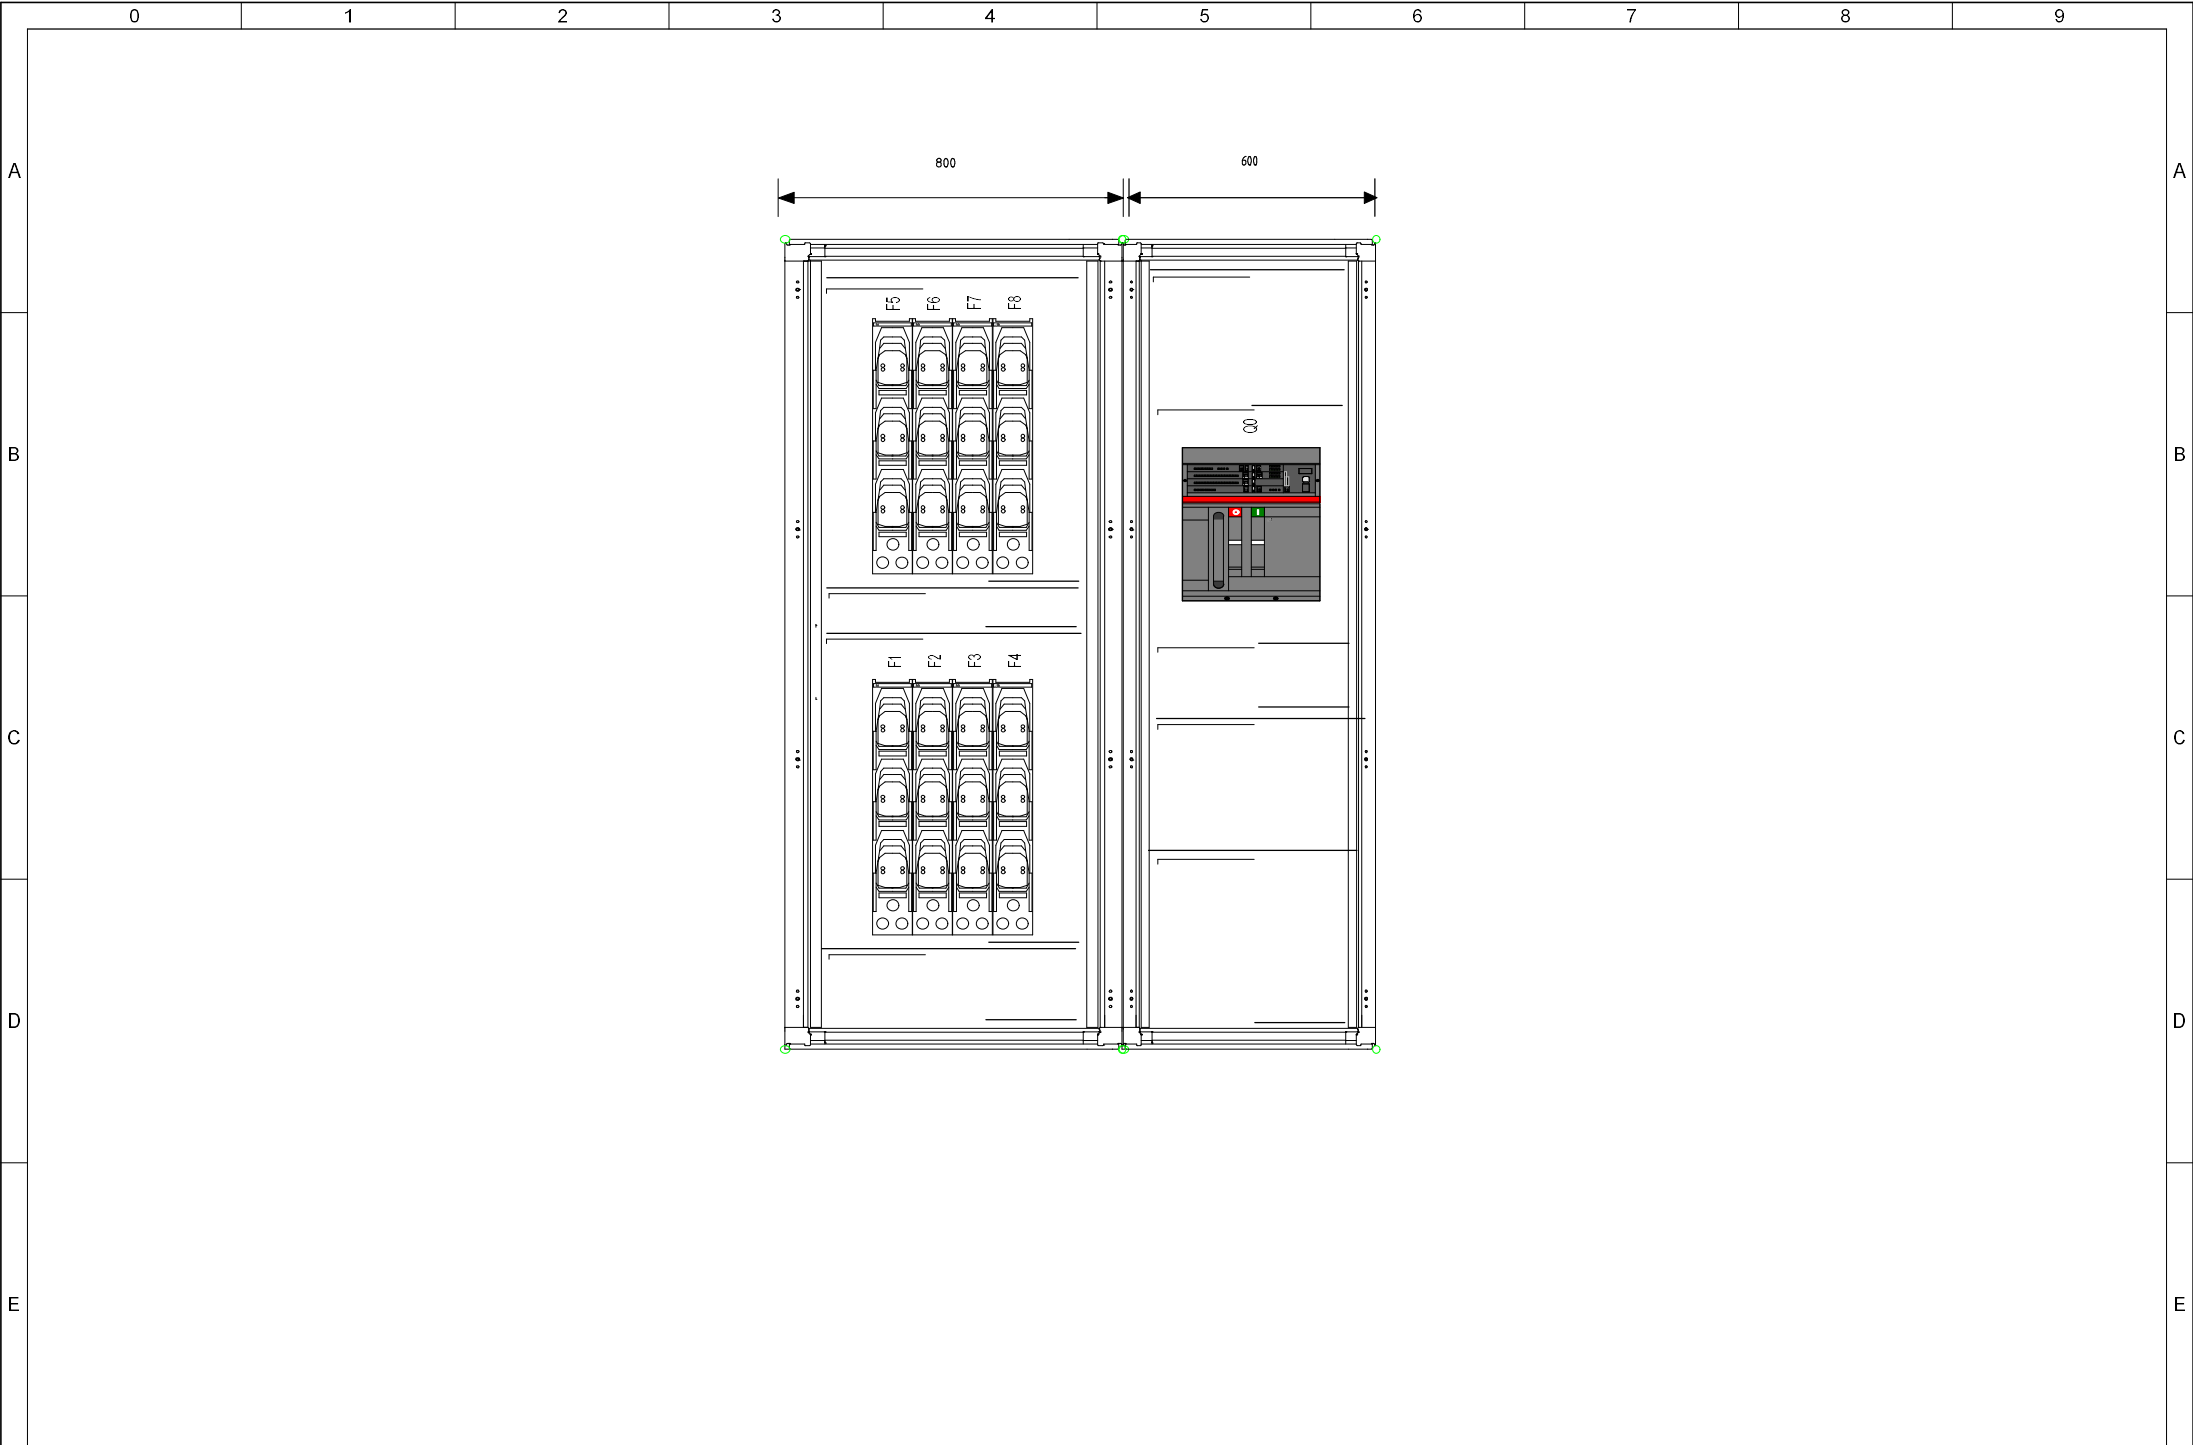


Studied	ILVIEF	Date	29/07/2020	PROJECT: ANARITA 10MW ELECTRICAL INDUSTRIAL APPLICATIONS 1ST INDUSTRIAL AREA OF VOLOS mail: info@ilvief.gr / website: www.ilvief.com	PAGE DESCRIPTION: LAYOUT 800VAC	DRAWING NUMBER:	PAGE:
Drawn	ALEXIOU A.		19/01/2023				1
Approved	ILVIEF SA		19/01/2023				- of: 4

SEE FILE: GLVP_ANARITA_12_INPUTS

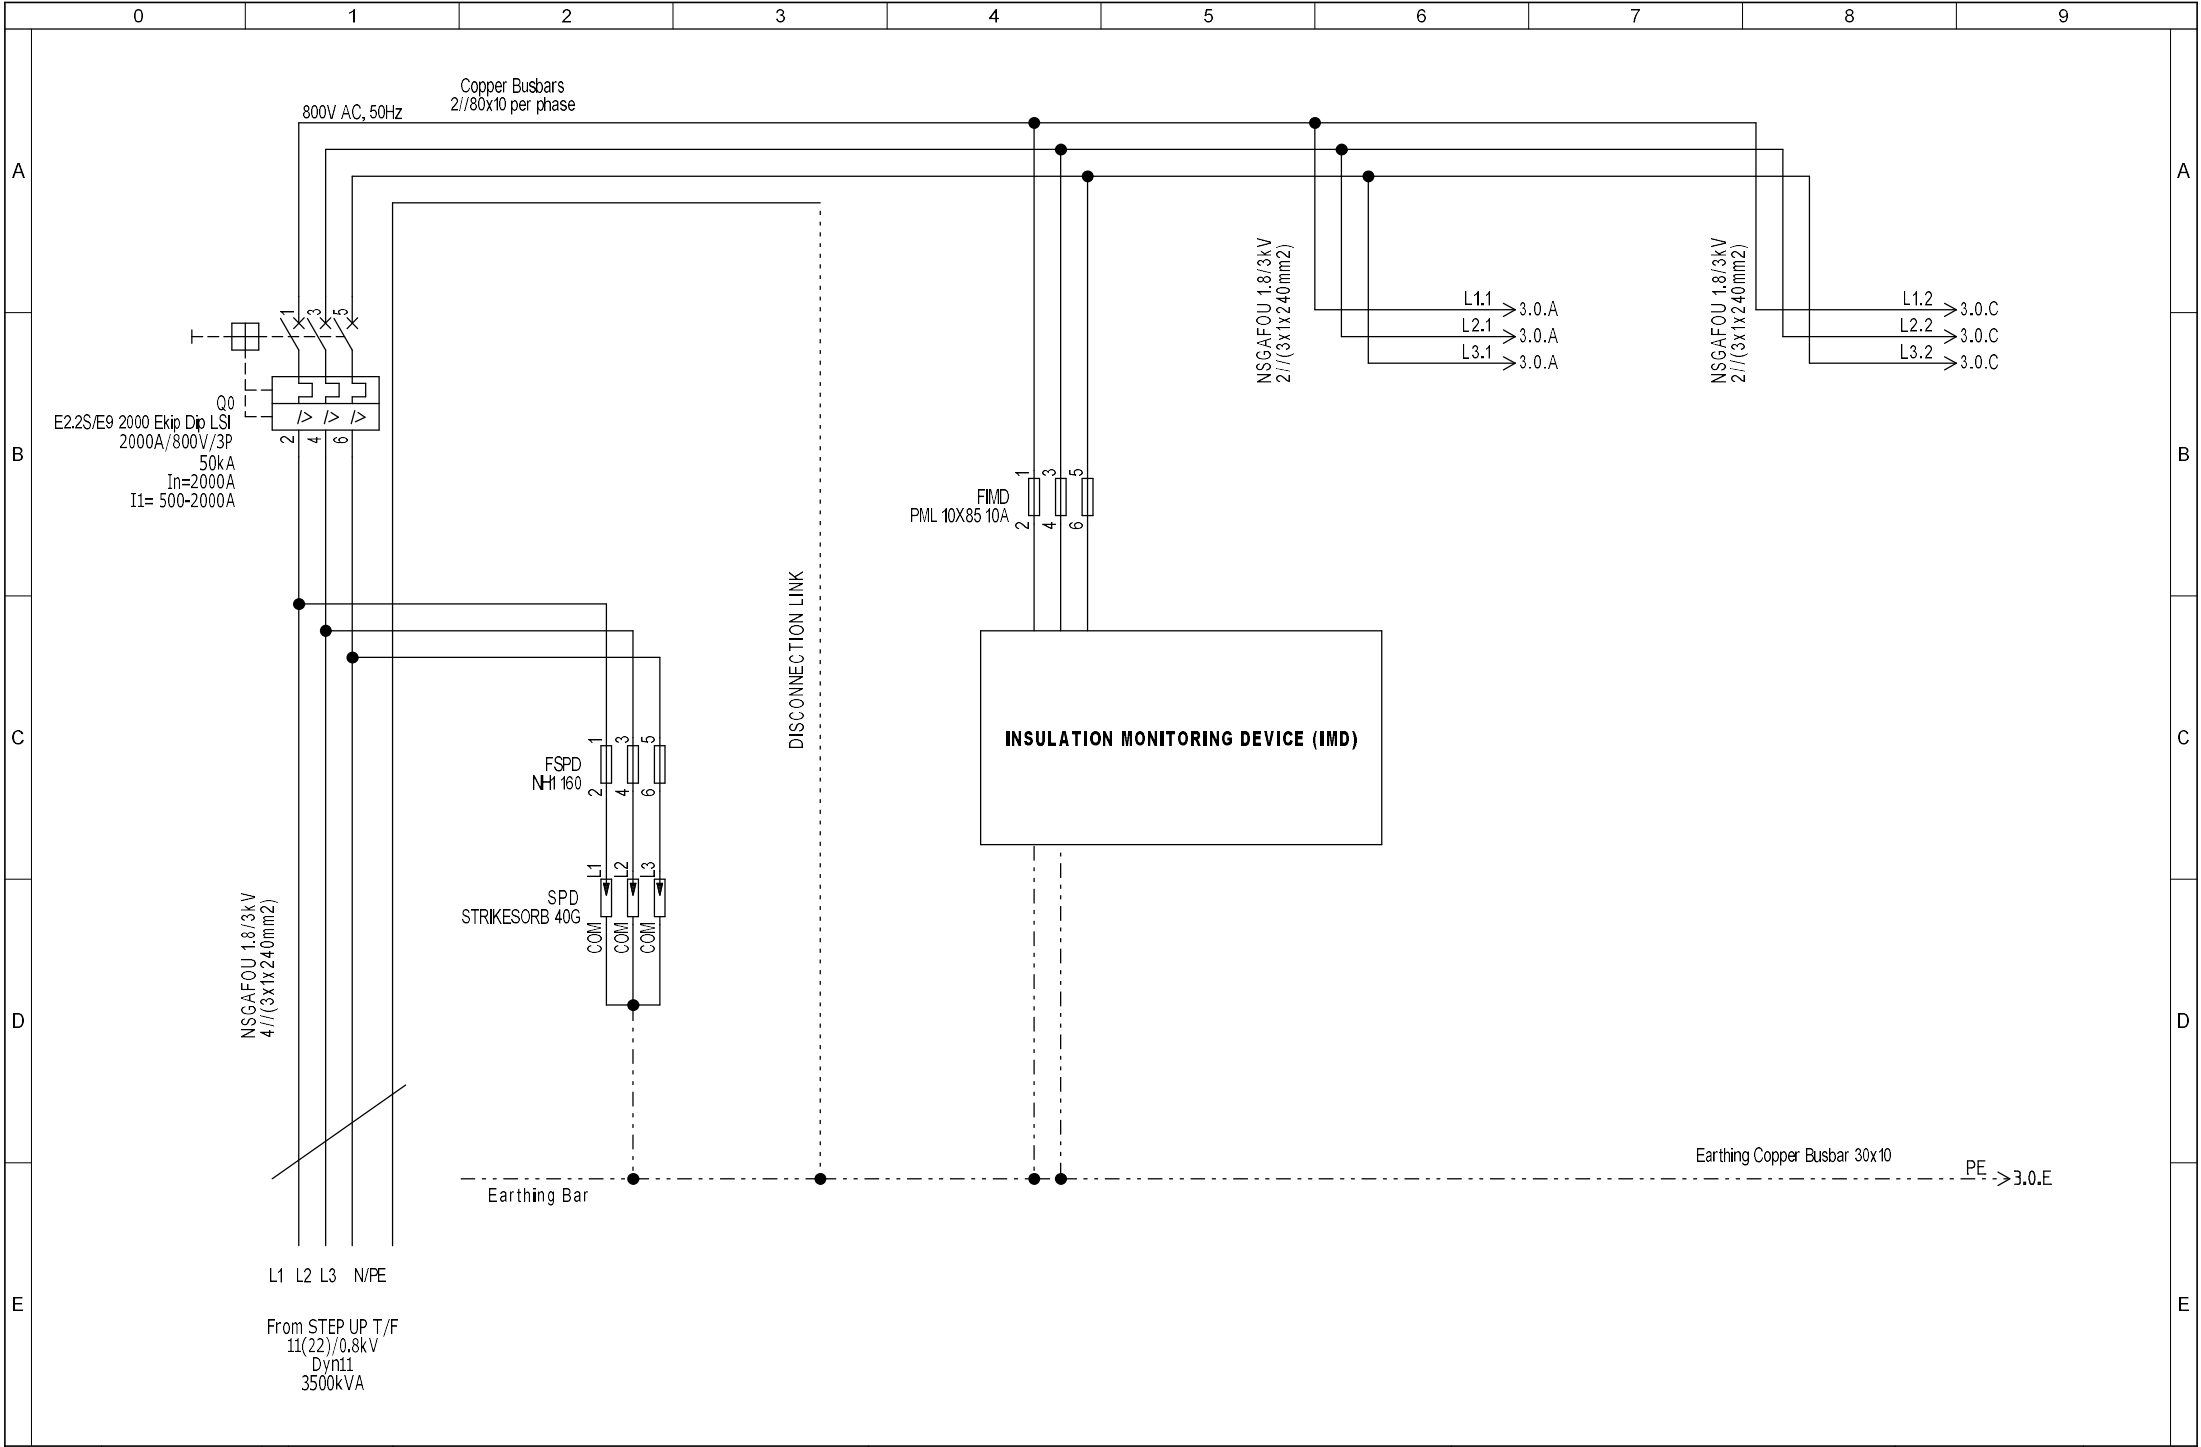

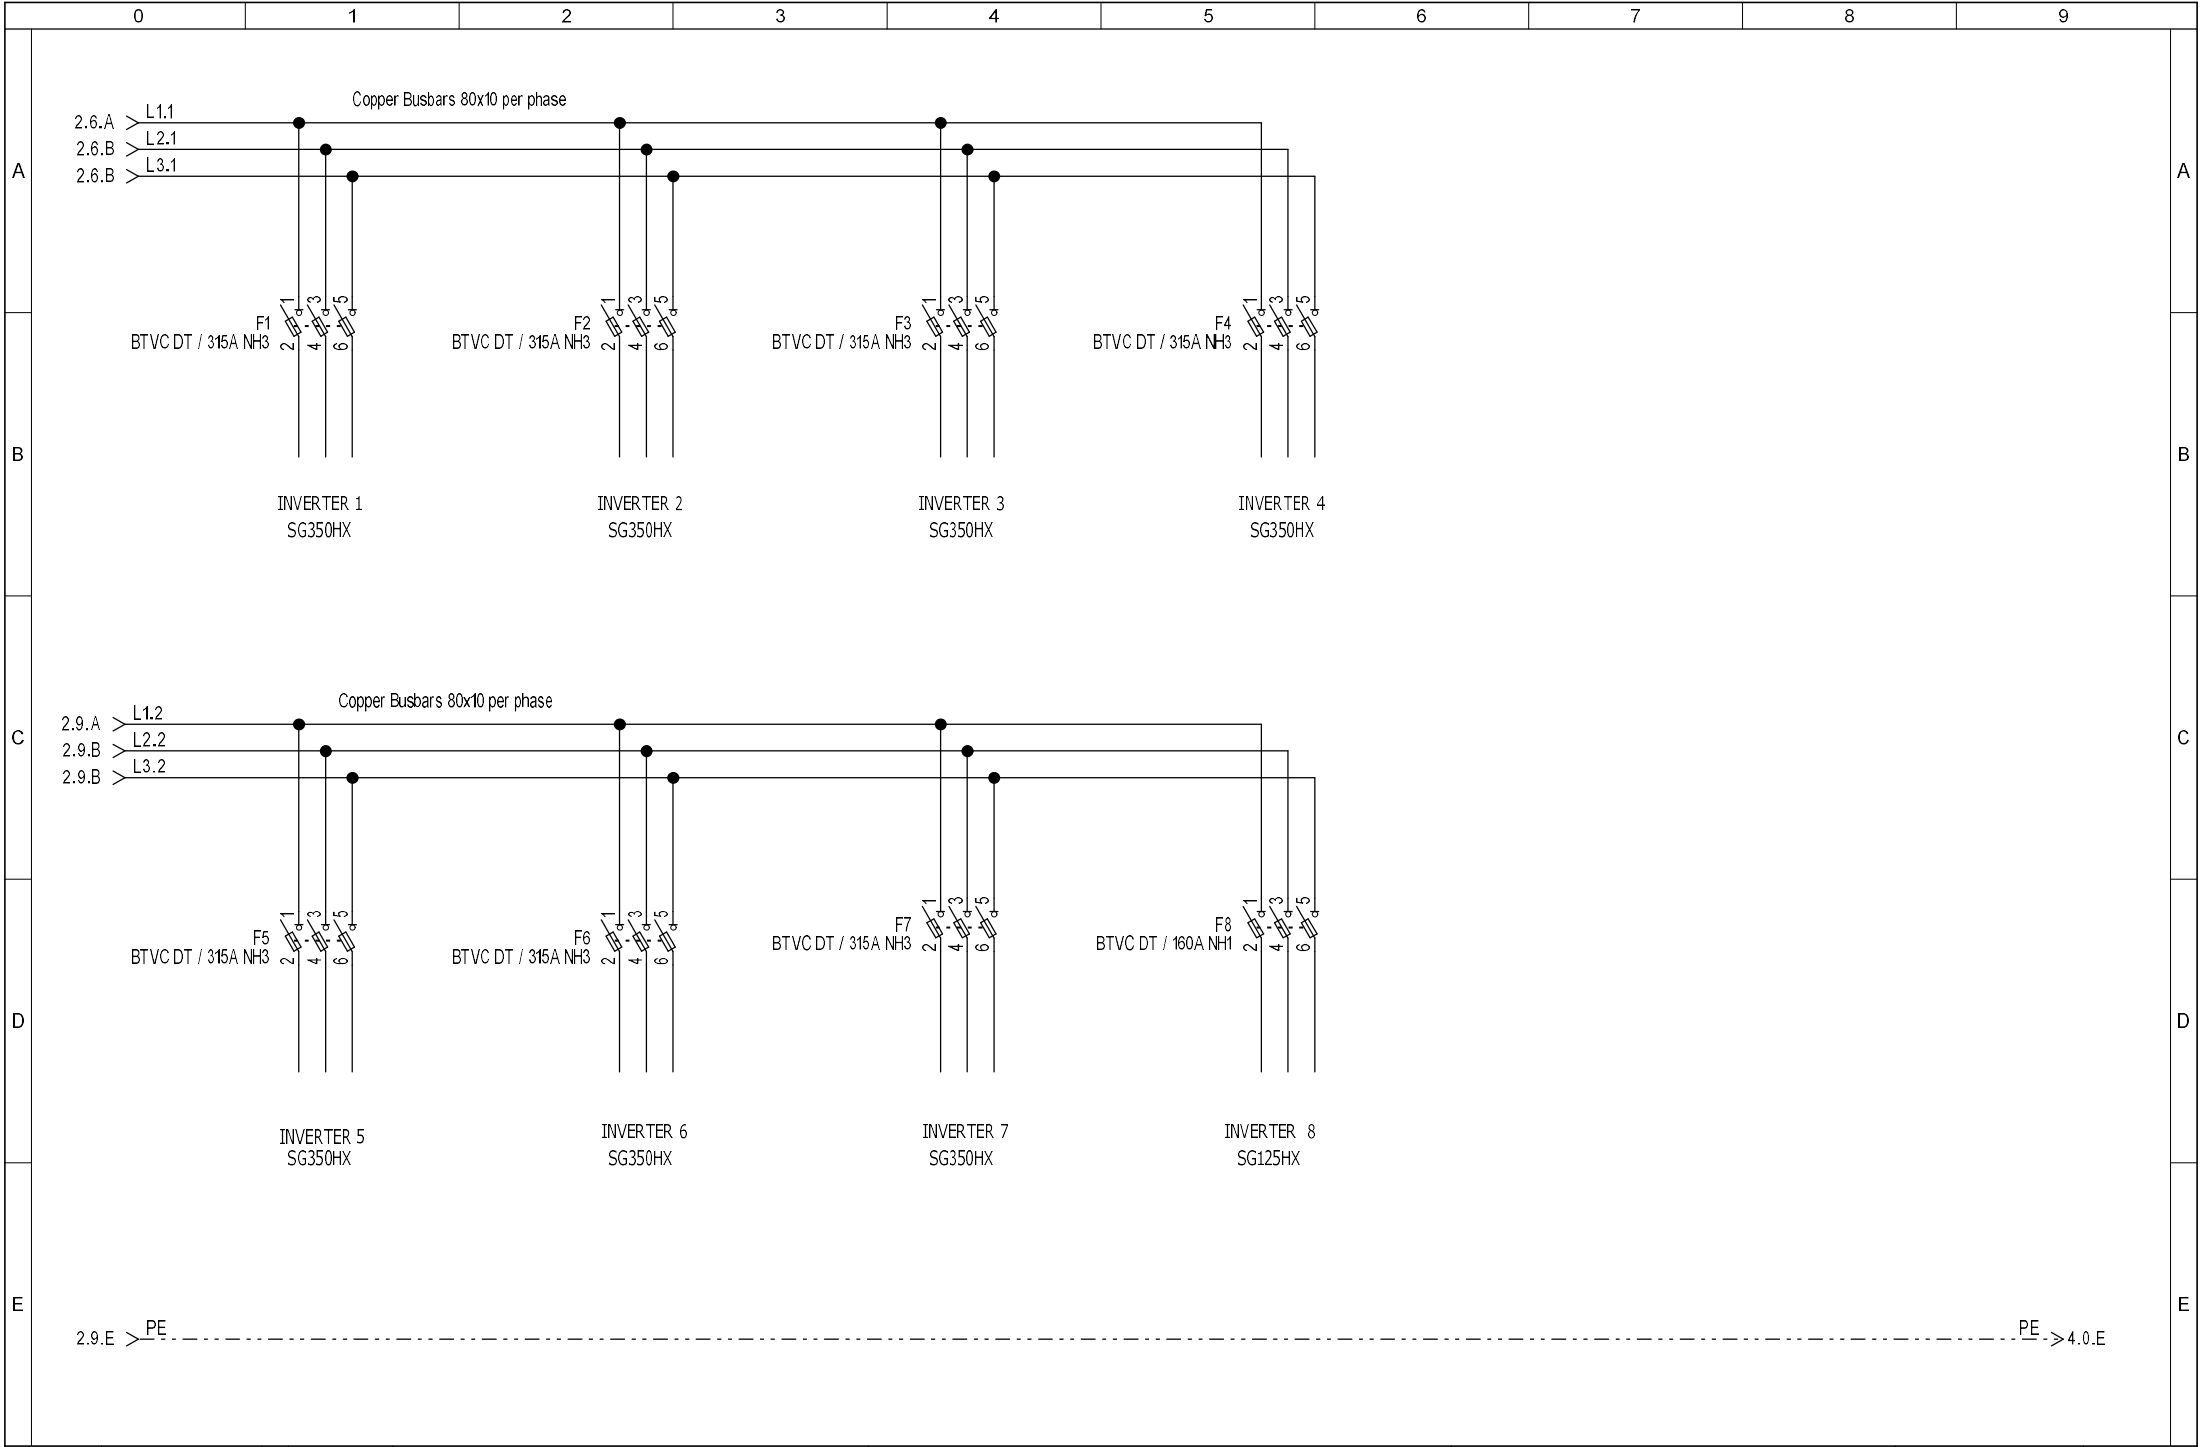

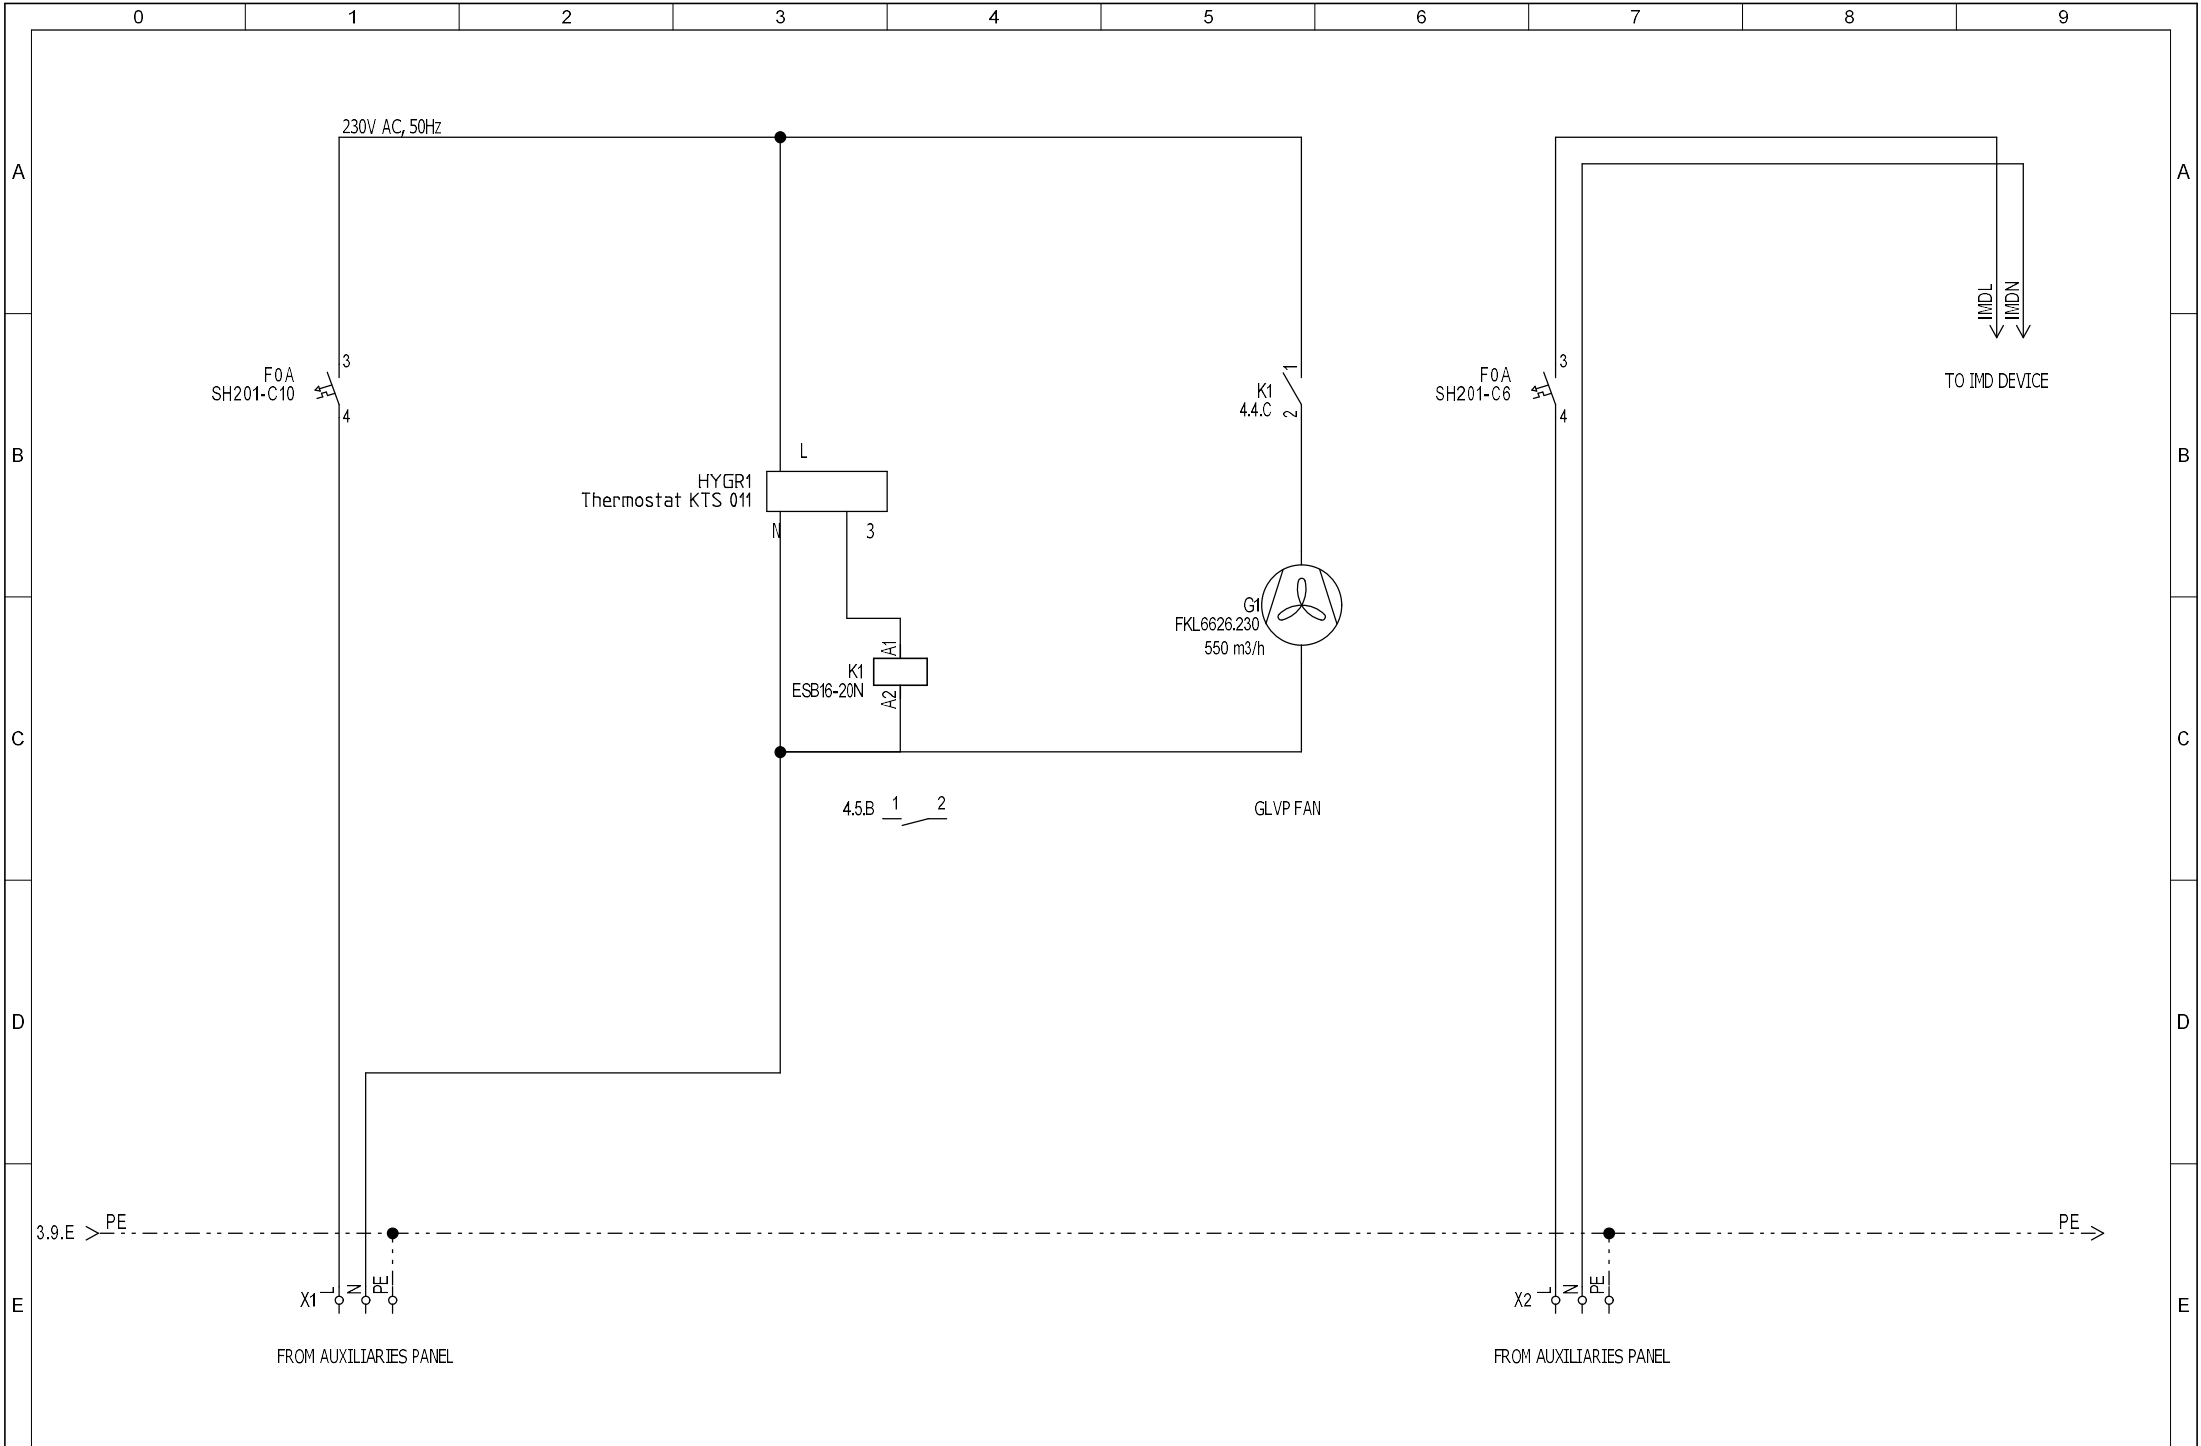

Studied	ILVIEF	Date	29/07/2020	PROJECT: ANARITA 10MW	PAGE DESCRIPTION:	DRAWING NUMBER:	PAGE:
Drawn	ALEXIOU A.		19/01/2023	ELECTRICAL INDUSTRIAL APPLICATIONS	POWER CIRCUIT		4
Approved	ILVIEF SA		19/01/2023	1ST INDUSTRIAL AREA OF VOLOS mail: info@ilvief.gr / website: www.ilvief.com	AUX. CIRCUIT	-	of: 4

SEE FILE: GLVP_ANARITA_12_INPUTS

Όνομα	Τύπος	Περιγραφή	Φύλλο / Κελί
-------	-------	-----------	--------------

[illegible]APXEIO SEE : GLVP_ANARITA_12_INPUTS