
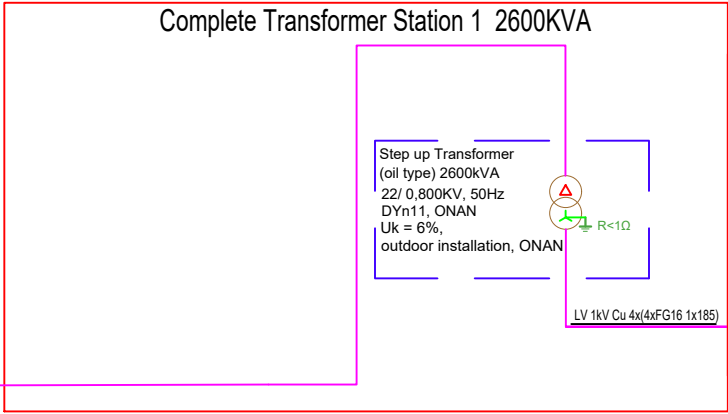
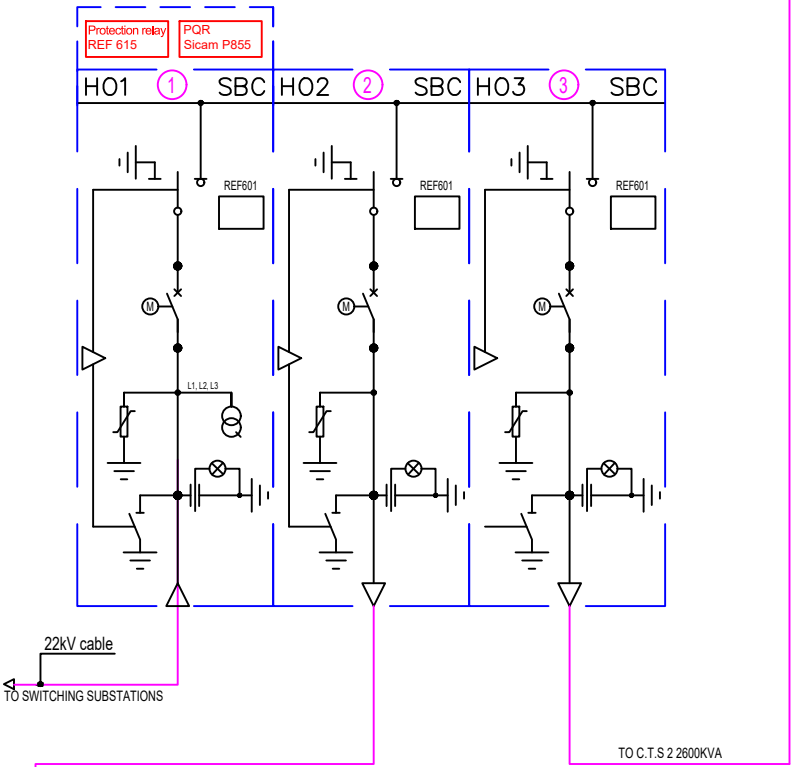


M1a MAIN: 1070048
M1b Check: 1070049
M2 Self Cons.: 1076571

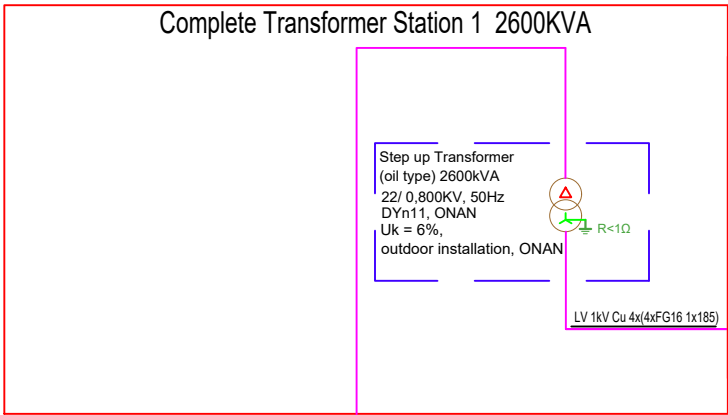

INV 1

ISOLATOR 3P/200A

SG 350 HX												
MPPT	1	2	3	4	5	6	7	8	9	10	11	12
STRING	A	B	A	B	A	B	A	B	A	B	A	B
No PV's	28	28	28	30	30	30	30	30	26	28	28	30

INV 2

ISOLATOR 3P/200A

SG 350 HX												
MPPT	1	2	3	4	5	6	7	8	9	10	11	12
STRING	A	B	A	B	A	B	A	B	A	B	A	B
No PV's	28	26	30	26	30	30	30	30	30	30	30	28

INV 3

ISOLATOR 3P/200A

SG 350 HX												
MPPT	1	2	3	4	5	6	7	8	9	10	11	12
STRING	A	B	A	B	A	B	A	B	A	B	A	B
No PV's	28	30	28	30	28	28	28	28	30	30	26	28

INV 4

ISOLATOR 3P/200A

SG 350 HX												
MPPT	1	2	3	4	5	6	7	8	9	10	11	12
STRING	A	B	A	B	A	B	A	B	A	B	A	B
No PV's	28	28	28	30	30	30	28	28	28	30	30	26

INV 5

ISOLATOR 3P/200A

SG 350 HX												
MPPT	1	2	3	4	5	6	7	8	9	10	11	12
STRING	A	B	A	B	A	B	A	B	A	B	A	B
No PV's	30	30	30	30	30	30	28	28	28	30	30	28

INV 6

ISOLATOR 3P/200A

SG 350 HX												
MPPT	1	2	3	4	5	6	7	8	9	10	11	12
STRING	A	B	A	B	A	B	A	B	A	B	A	B
No PV's	26	26	26	28	28	28	30	30	26	26	30	28

INV 7

ISOLATOR 3P/200A

SG 350 HX												
MPPT	1	2	3	4	5	6	7	8	9	10	11	12
STRING	A	B	A	B	A	B	A	B	A	B	A	B
No PV's	28	28	28	30	30	30	28	28	28	28	30	30

INV 8

ISOLATOR 3P/200A

SG 125 HX						
MPPT	1	2	3	4	5	6
STRING	A	B	A	B	A	B
No PV's	30	30	30	30	30	30

INV 1

ISOLATOR 3P/200A

SG 350 HX												
MPPT	1	2	3	4	5	6	7	8	9	10	11	12
STRING	A	B	A	B	A	B	A	B	A	B	A	B
No PV's	26	26	26	30	30	30	30	30	30	26	26	30

INV 2

ISOLATOR 3P/200A

SG 350 HX												
MPPT	1	2	3	4	5	6	7	8	9	10	11	12
STRING	A	B	A	B	A	B	A	B	A	B	A	B
No PV's	30	30	30	30	30	28	28	28	28	30	28	26

INV 3

ISOLATOR 3P/200A

SG 350 HX												
MPPT	1	2	3	4	5	6	7	8	9	10	11	12
STRING	A	B	A	B	A	B	A	B	A	B	A	B
No PV's	28	28	28	30	30	30	30	30	26	26	28	30

INV 4

ISOLATOR 3P/200A

SG 350 HX												
MPPT	1	2	3	4	5	6	7	8	9	10	11	12
STRING	A	B	A	B	A	B	A	B	A	B	A	B
No PV's	30	30	30	26	26	26	30	30	30	30	28	30

INV 5

ISOLATOR 3P/200A

SG 125 HX						
MPPT	1	2	3	4	5	6
STRING	A	B	A	B	A	B
No PV's	30	30	30	30	30	30

INV 6

ISOLATOR 3P/200A

SG 350 HX												
MPPT	1	2	3	4	5	6	7	8	9	10	11	12
STRING	A	B	A	B	A	B	A	B	A	B	A	B
No PV's	28	28	28	28	28	28	30	30	30	28	28	26

INV 7

ISOLATOR 3P/200A

SG 350 HX												
MPPT	1	2	3	4	5	6	7	8	9	10	11	12
STRING	A	B	A	B	A	B	A	B	A	B	A	B
No PV's	28	28	28	28	28	28	28	28	30	30	30	30

INV 8

ISOLATOR 3P/200A

SG 350 HX												
MPPT	1	2	3	4	5	6	7	8	9	10	11	12
STRING	A	B	A	B	A	B	A	B	A	B	A	B
No PV's	28	28	26	26	26	28	28	28	28	28	30	30



Thessalonikis 14 / Ergates
Industrial Estate/ 2643 / Nicosia
Tel : +357-22505404 Fax: +357-22256716
e-mail: energy_sales@ergohomegroup.com
Web : www.ergoenergy.com.cy

PROJECT NAME:
Anarita East 5MWp

TITLE:
TRANSFORMER 1 & 2 - SINGLE LINE DIAGRAM

CUSTOMER:

DRAWING: W-SLD

VERSION: W.3

TOTAL Wp:
5,006,760

MODULE No:
7,586

STUDY:
A. M.

CHECKED BY:
A. M.

SCALE:
No

DATE:
14-02-2024

NOTES: