


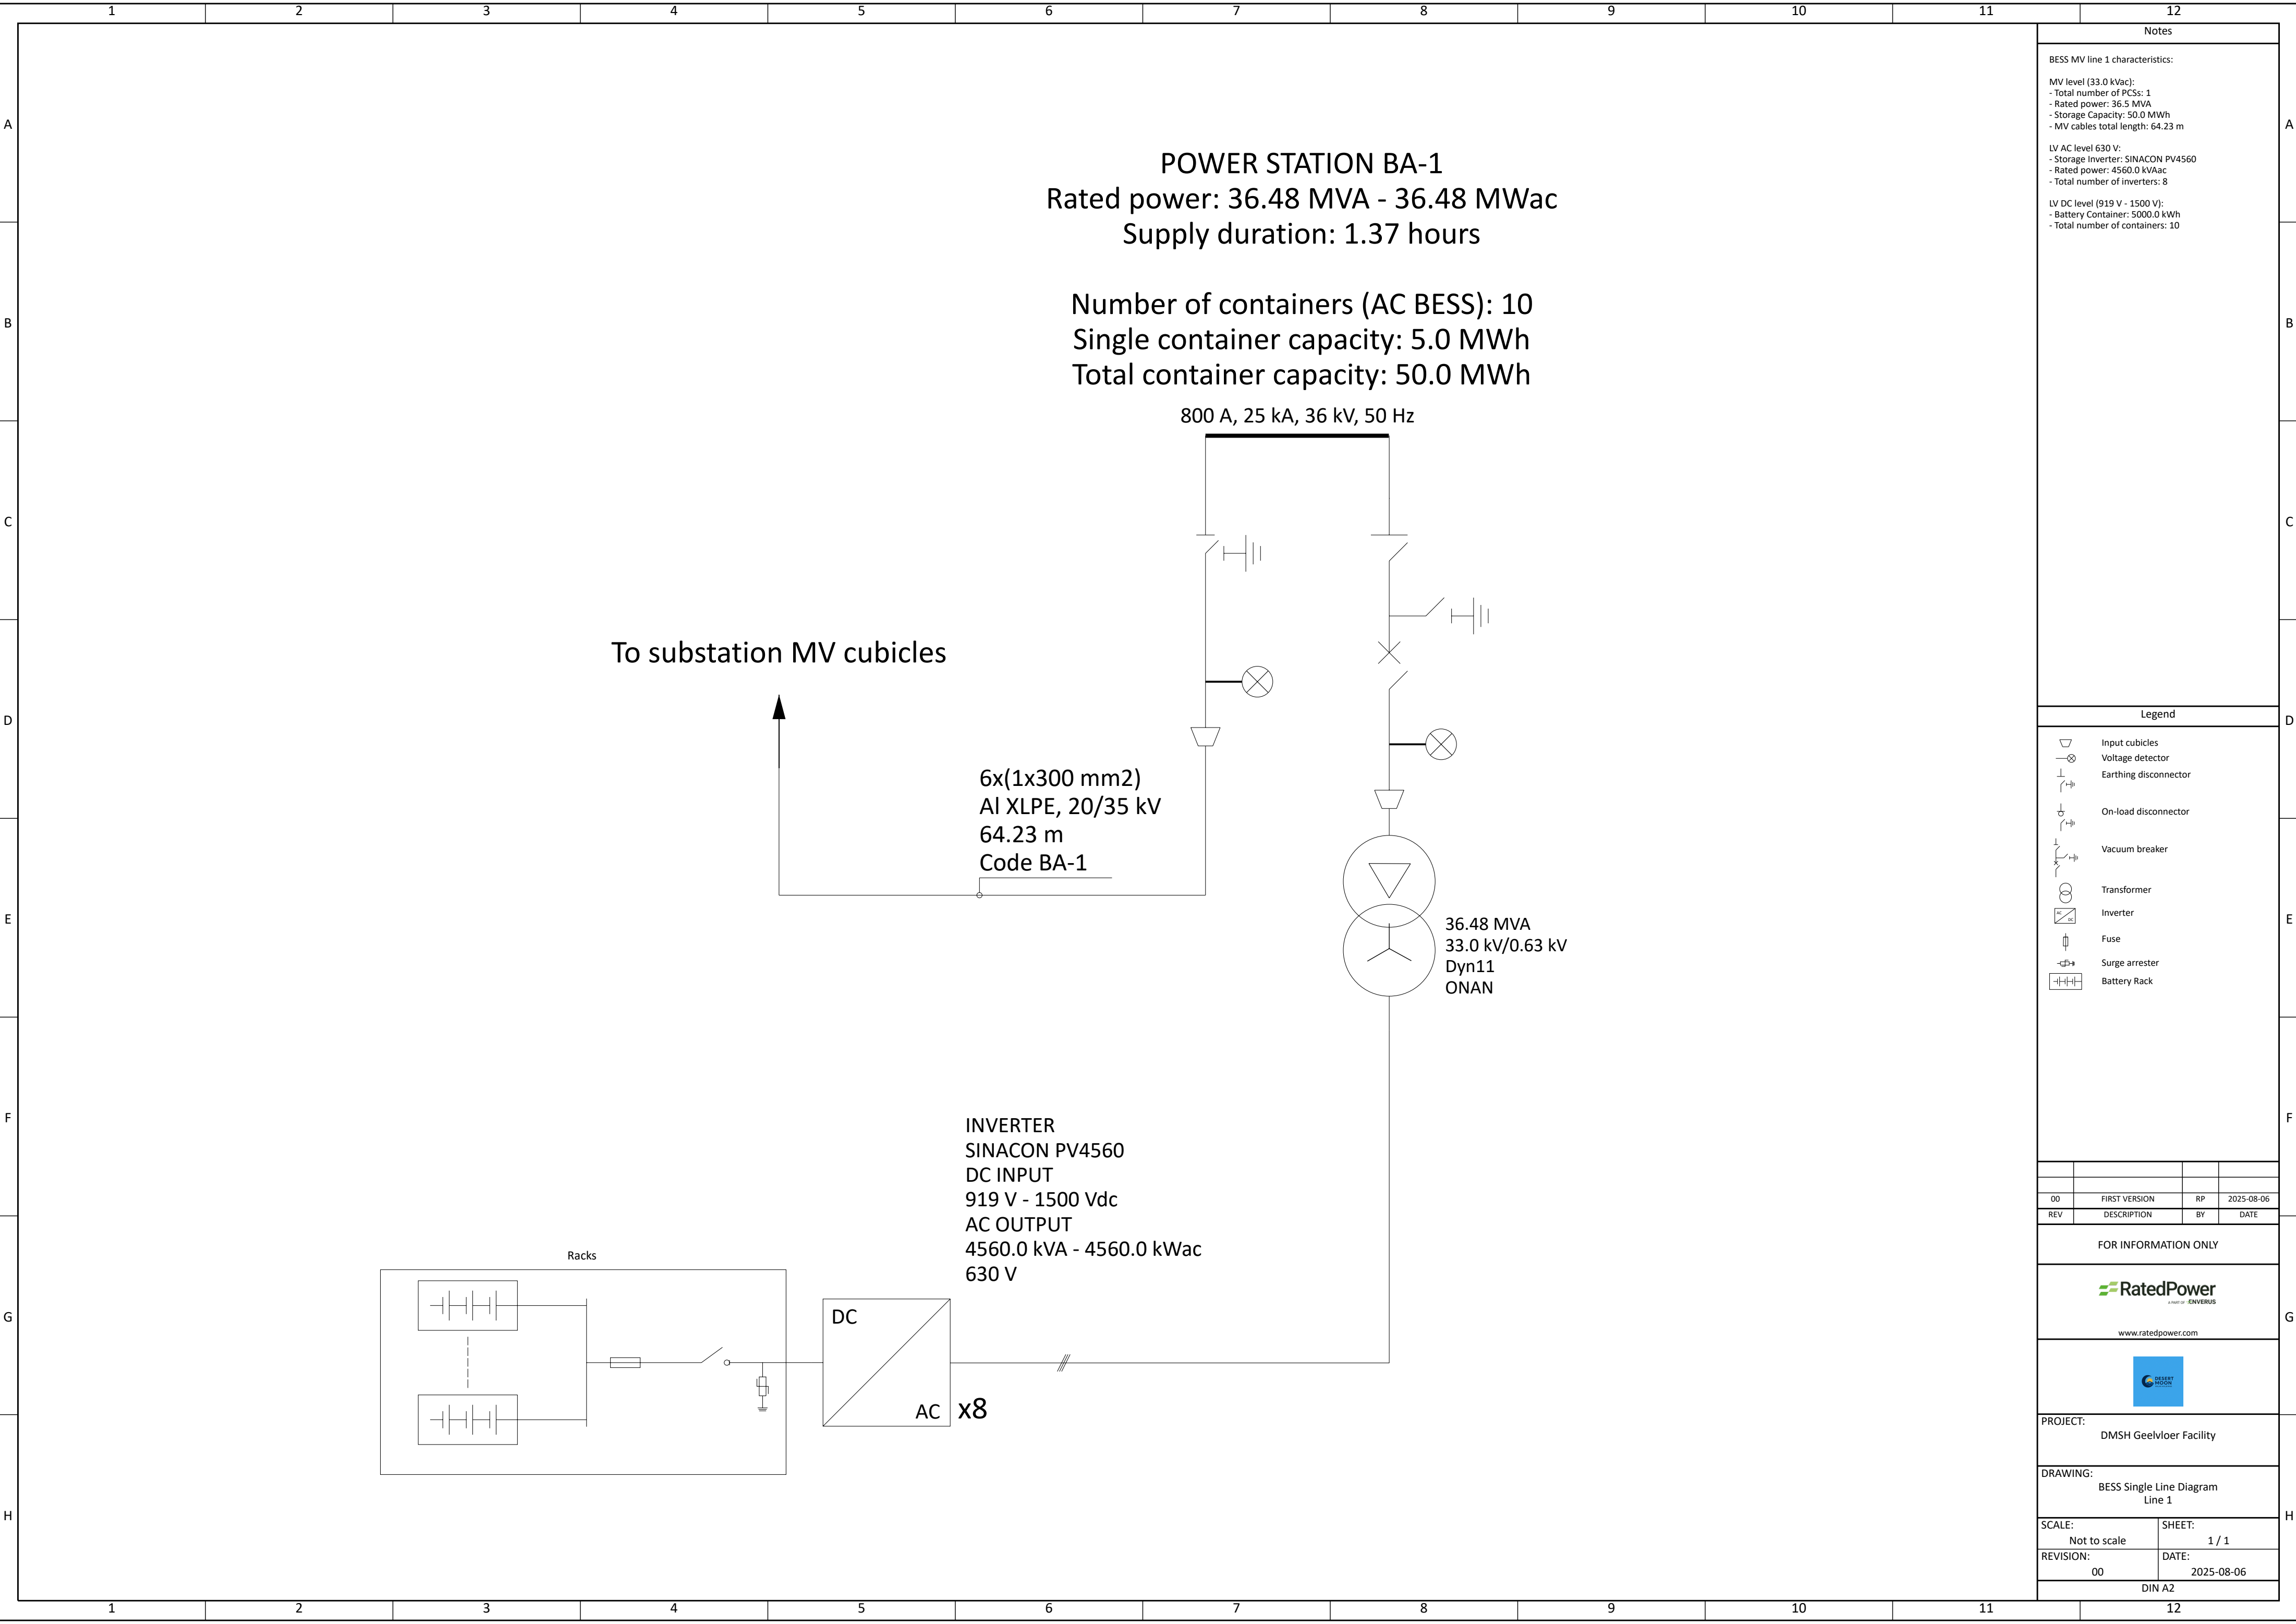

POWER STATION BA-1
Rated power: 36.48 MVA - 36.48 MWac
Supply duration: 1.37 hours

Number of containers (AC BESS): 10
Single container capacity: 5.0 MWh
Total container capacity: 50.0 MWh

800 A, 25 kA, 36 kV, 50 Hz

To substation MV cubicles

6x(1x300 mm2)
Al XLPE, 20/35 kV
64.23 m
Code BA-1

36.48 MVA
33.0 kV/0.63 kV
Dyn11
ONAN

INVERTER
SINACON PV4560
DC INPUT
919 V - 1500 Vdc
AC OUTPUT
4560.0 kVA - 4560.0 kWac
630 V

Racks

Legend

- Input cubicles
- Voltage detector
- Earthing disconnector
- On-load disconnector
- Vacuum breaker
- Transformer
- Inverter
- Fuse
- Surge arrester
- Battery Rack

FOR INFORMATION ONLY

RatedPower
a part of IONVERUS

www.ratedpower.com



PROJECT:
DMSH Geelvloer Facility

DRAWING:
BESS Single Line Diagram
Line 1

SCALE: Not to scale	SHEET: 1 / 1
REVISION: 00	DATE: 2025-08-06

DIN A2

Notes

- BESS MV line 1 characteristics:
- MV level (33.0 kVac):
- Total number of PCSs: 1
 - Rated power: 36.5 MVA
 - Storage Capacity: 50.0 MWh
 - MV cables total length: 64.23 m
- LV AC level 630 V:
- Storage Inverter: SINACON PV4560
 - Rated power: 4560.0 kVAac
 - Total number of inverters: 8
- LV DC level (919 V - 1500 V):
- Battery Container: 5000.0 kWh
 - Total number of containers: 10