


Grid: Summary Grid				
Generation	=	10,80 MW	0,00 Mvar	10,80 MVA
External Infeed	=	-10,41 MW	0,28 Mvar	1..
Inter Area Flow	=	0,00 MW	0,00 Mvar	
Load P(U)	=	0,00 MW	0,00 Mvar	0,00 MVA
Load P(Un)	=	0,00 MW	0,00 Mvar	0,00 MVA
Load P(Un-U)	=	0,00 MW	0,00 Mvar	
Motor Load P	=	0,00 MW	0,00 Mvar	0,00 MVA
Losses	=	0,39 MW	0,28 Mvar	
Line Charging	=		-0,13 Mvar	
Compensation ind.	=		0,00 Mvar	
Compensation cap.	=		0,00 Mvar	
Installed Capacity	=	8,64 MW		
Spinning Reserve	=	-2,16 MW		
Total Power Factor:				
Generation	=	1,00 [-]		
Load/Motor	=	0,00 / 0,00 [-]		

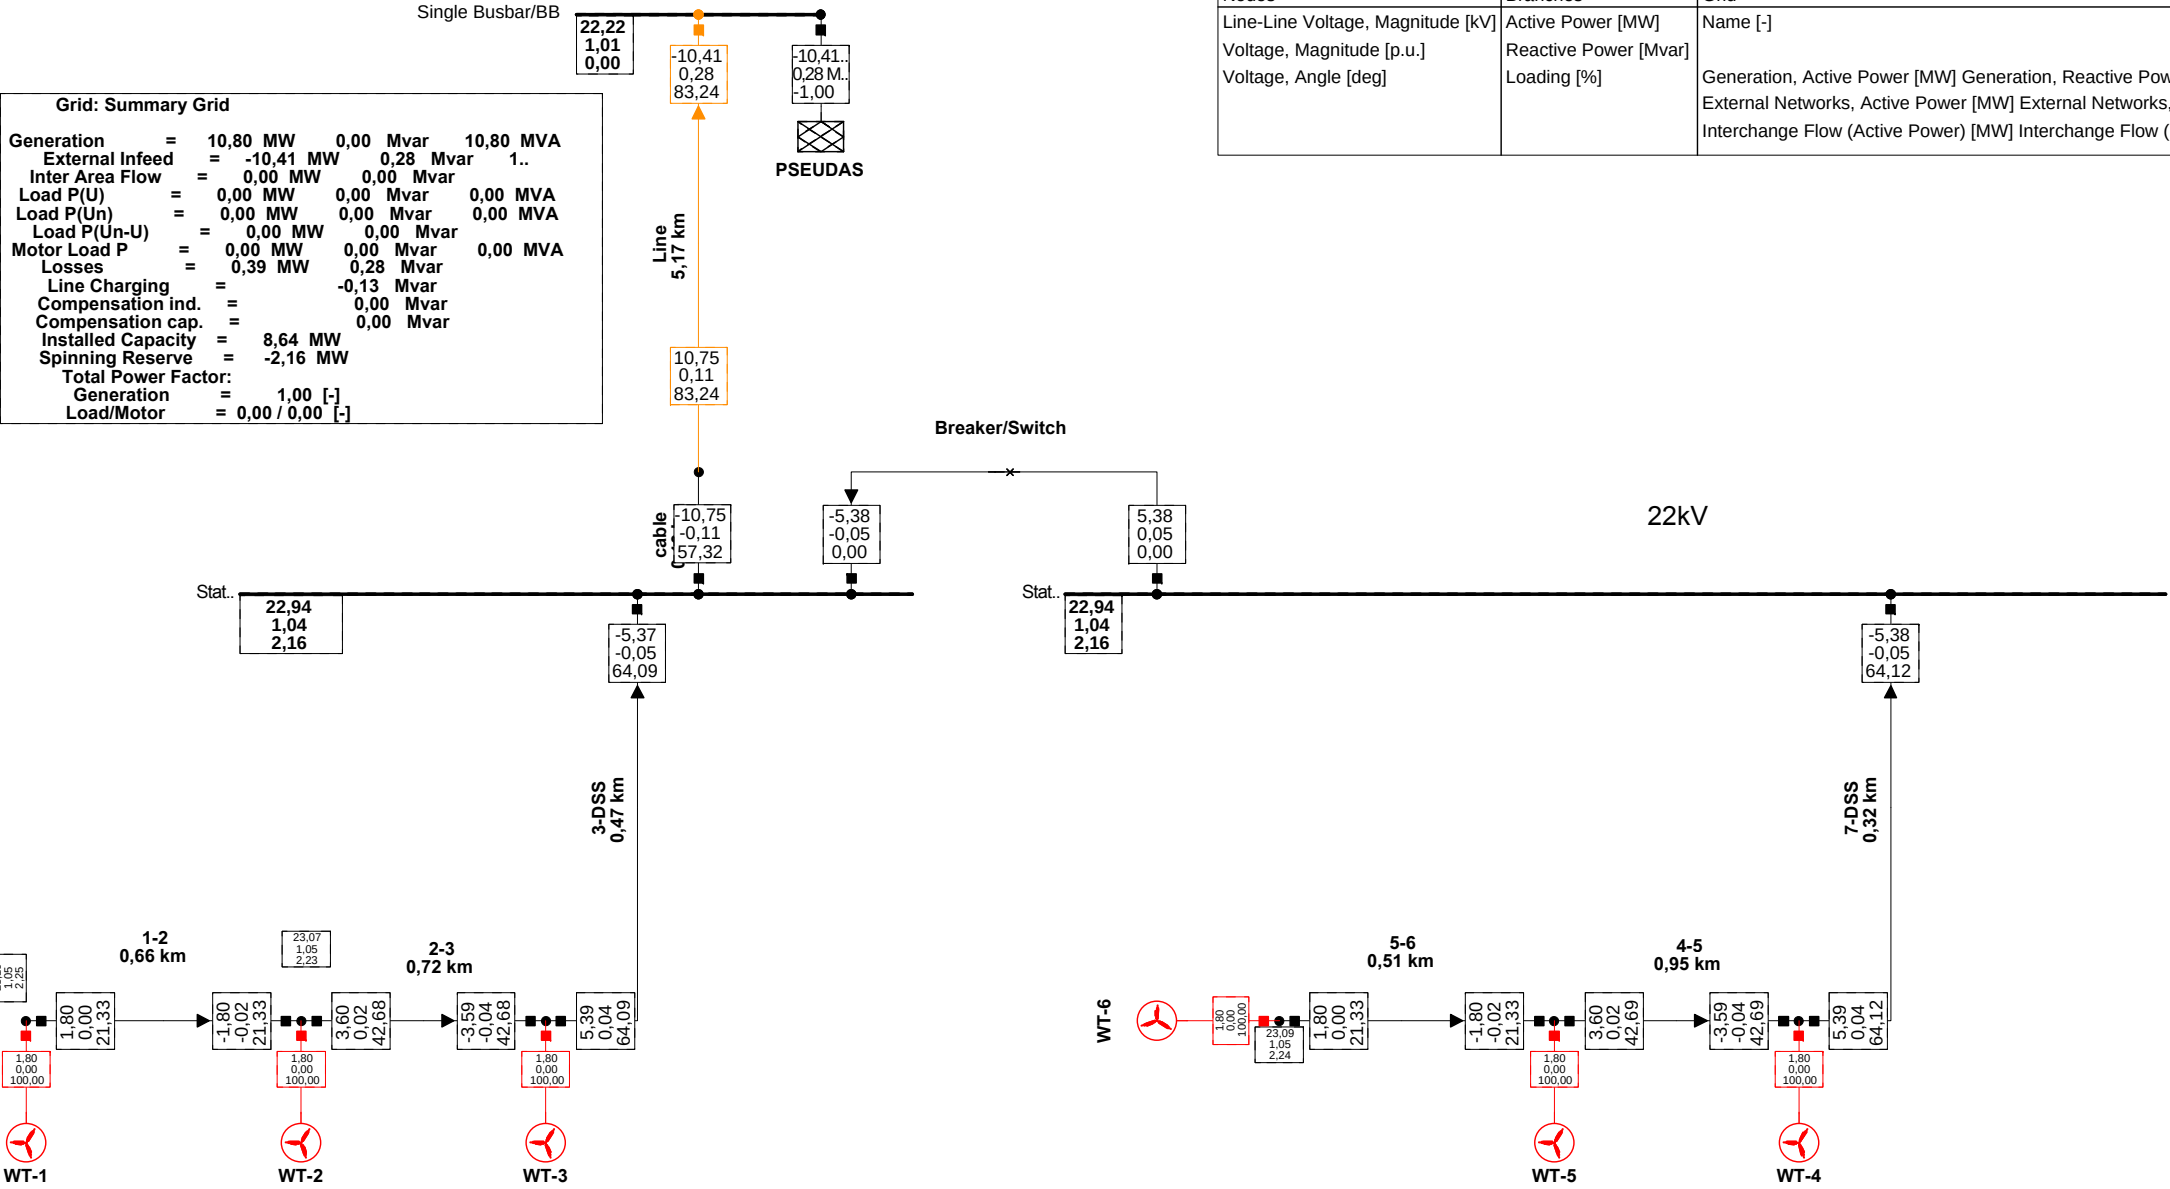

Load Flow Balanced		
Nodes	Branches	Grid
Line-Line Voltage, Magnitude [kV]	Active Power [MW]	Name [-]
Voltage, Magnitude [p.u.]	Reactive Power [Mvar]	Generation, Active Power [MW] Generation, Reactive Power [Mvar] Generation, Apparent Power [MVA]
Voltage, Angle [deg]	Loading [%]	External Networks, Active Power [MW] External Networks, Reactive Power [Mvar] External Networks, A
		Interchange Flow (Active Power) [MW] Interchange Flow (Reactive Power) [Mvar]

PowerFactory 15.1.6	AEOLIAN WINDFARM		Project:
	FAULT LEVEL CALCULATIONS		Graphic: Grid
			Date: 17/06/2014
			Annex: