


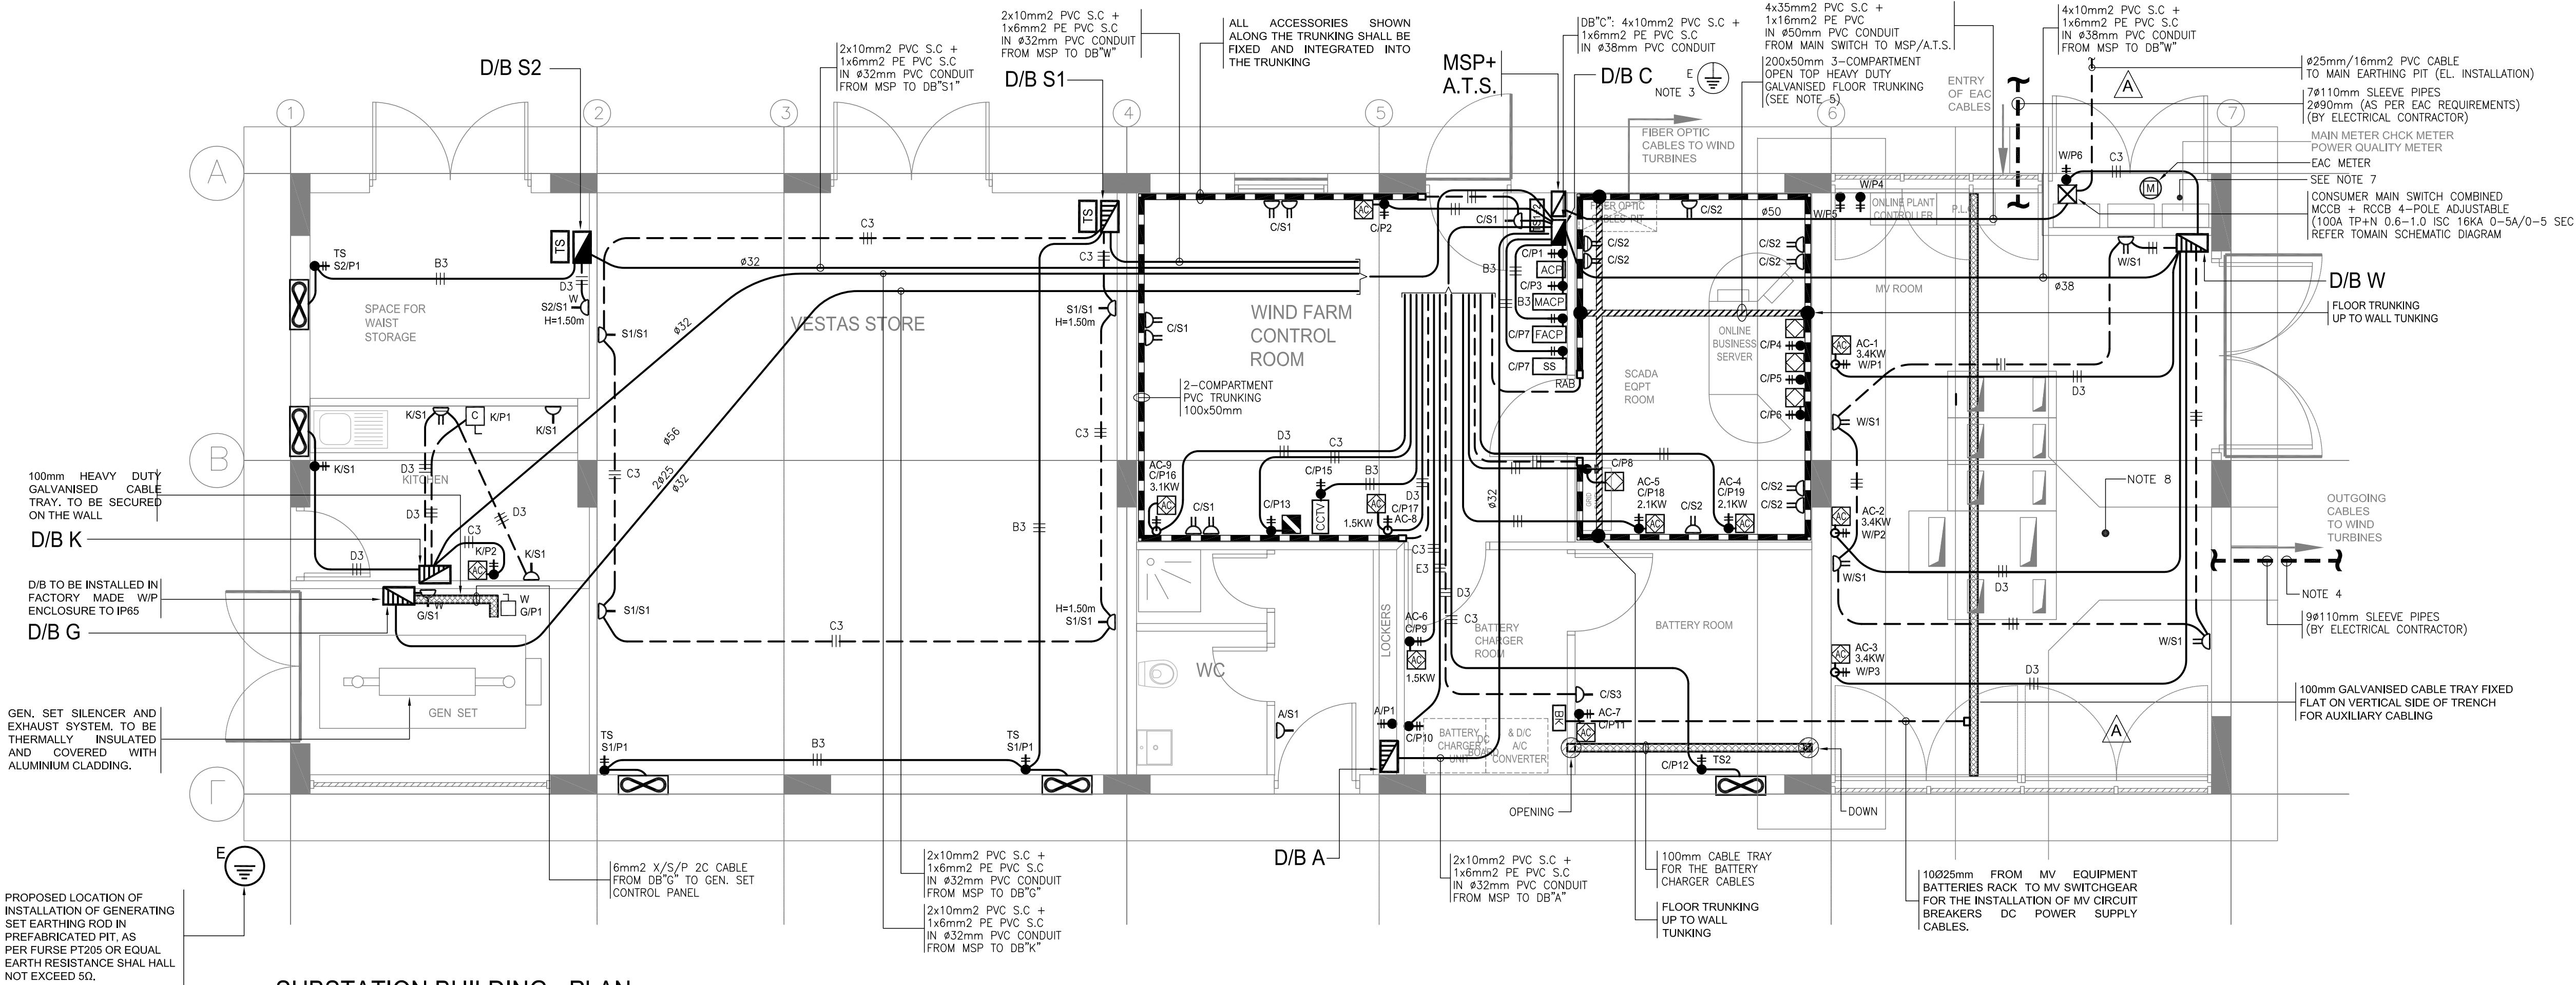

SUBSTATION BUILDING - PLAN
SMALL POWER INSTALLATIONS
SCALE 1:50

LEGEND FOR CONDUITS & CABLES

- #20mm PVC CONDUIT INSTALLED IN CEILING SLAB
- - - #20mm PVC CONDUIT INSTALLED IN FLOOR SLAB / SCREED
- RAB RECESSED AUXILIARY BOX
- B3 3x1.5mm² PVC S.C IN #20mm PVC CONDUIT
- B4 4x1.5mm² PVC S.C IN #20mm PVC CONDUIT
- B5 5x1.5mm² PVC S.C IN #20mm PVC CONDUIT
- ⓑ 1.5mm² PVC/PVC 2C+E IN #20mm PVC CONDUIT
- C3 2x2.5mm² PVC + 1x1.5mm² PVC S.C IN #20mm PVC CONDUIT
- ⓐ 2.5mm² PVC/PVC 2C +E IN #20mm PVC CONDUIT
- D3 2x4.0mm² PVC + 1x2.5mm² PVC S.C IN #20mm PVC CONDUIT
- E3 2x6.0mm² PVC + 1x4.0mm² PVC S.C IN #25mm PVC CONDUIT

SYMBOL LIST:

- SWITCHED SOCKET OUTLET 13A
- DOUBLE SWITCHED SOCKET OUTLET 13A
- ⊠ ELECTRICAL LOAD (GENERAL SYMBOL)
- ⊠ SPLIT UNIT AIR CONDITIONER
- ⊠ WATER HEATER
- ⊠ DISTRIBUTION BOARD SURFACE
- ⊠ DISTRIBUTION BOARD RECESSES
- ⊠ TIME SWITCH (REFER TO SPECIFICATION)
- ⊠ MAIN BUILDING DISTRIBUTOR (TELEPHONE INSTALLATION)
- ⊠ STRUCTURED CABLING CABINET (SIZE 19U) CAT6A
- ▶ STRUCTURED CABLING POINT CAT 6A
- 2 COMP. PVC TRUNKING (100mmX50mm)
- 3 COMP. OPEN TOP HEAVY DUTY GALVANISED FLOOR TRUNKING WITH COVER
- HEAVY DUTY GALVANISED CABLE TRAY (WIDTH AS INDICATED)

Rev.	NEW HV CABLE ROUTES	31/7/04	A.H.
	MODIFICATIONS	DATE	CHK

AS FITTED DRAWING

ALL INDICATED DIMENSIONS SUPERCEED MEASURED DIMENSIONS ON THE DRAWINGS. ALL DIMENSIONS SHALL BE CHECKED ON SITE PRIOR TO WORKS COMMENCEMENT. ALL DISCREPANCIES SHALL BE REPORTED TO THE ARCHITECTS FOR CLARIFICATIONS

Epyo / Project: T.P. AEOLIAN DYNAMICS WIND FARM

Backtting / Client: T.P. AEOLIAN DYNAMICS LTD

Παραγωγή / Description: SUBSTATION BUILDING POWER & STRUCTURE CABLING INSTALLATION

ΠΟΛΙΤΙΚΟΙ ΜΗΧΑΝΙΚΟΙ: EARTHQUAKE PROTECTED STRUCTURES
ΓΕΩΡΓΙΟΣ ΔΗΜΗΤΡΙΑΔΗΣ ΝΙΚΟΣ ΚΑΛΑΘΑΣ
Διοδωδισκου 9, 3115 Αγκωστή, Τηλ: 25770978 Φαξ: 25770979 email: gk_ges@ispdnet.com.cy
Αθηνών 111, 2035 Στρόβιλος, Τηλ.: 22495133 gk: 22495123 email: xanthi@ispdnet.com.cy

ΑΡΧΙΤΕΚΤΟΝΕΣ:

A:\2011\111111\11111\111\111728 - 1111\1111\OBJECT-5\55555\047020\new\050new.dwg

ELECTRICAL & MECHANICAL CONSULTING ENGINEERS
Eliofotou & Zinieris
MELTEC
ELIOFOTOUL, ZINIERIS STASIS PARTNERS
Mechanical Electrical Technology Consultants
77, STROVOLOS AVENUE, STROVOLOS CENTER, FLAT 401, 2018
STROVOLOS - NICOSIA
Tel. 22879813 Fax:22314043 e-mail : meltec@meltec-cy.com

Main Contractor

AGC Contractors Ltd.

TEL: +357 22358535 FAX: +357 22353409

ELECTRICAL CONTRACTOR:

A. ERACLEOUS
Electrical Installation Ltd

ERECTION COURT ERECHTHOU 3, STROVOLOS OFFICE 101
TEL. 22498364, 22498048, 22510680/1 FAX. 22317126

Project name, design stage: 7/2014

Author / scale: 1:50

drawn / checked by: G.P. K.Z.

no. copies / pr. number: no. copies / pr. number: no. copies / pr. number:

12/9/14 EWD/PSC-01