

Part III—Building Planning and Construction

CHAPTER 3

BUILDING PLANNING

User note:

About this chapter: Chapter 3 contains a wide array of building planning requirements that are critical to designing a safe and usable building. This includes, but is not limited to, requirements related to general structural design, fire-resistant construction, light, ventilation, sanitation, plumbing fixture clearances, minimum room area and ceiling height, safety glazing, means of egress, automatic fire sprinkler systems, smoke and carbon monoxide alarm systems, accessibility, solar energy systems, swimming pools, spas and hot tubs.

SECTION R301 DESIGN CRITERIA

R301.1 Application. Buildings and structures, and parts thereof, shall be constructed to safely support all loads, including dead loads, *live loads*, roof loads, flood loads, snow loads, wind loads and seismic loads as prescribed by this code. The construction of buildings and structures in accordance with the provisions of this code shall result in a system that provides a complete load path that meets the requirements for the transfer of loads from their point of origin through the load-resisting elements to the foundation. Buildings and structures constructed as prescribed by this code are deemed to comply with the requirements of this section.

R301.1.1 Alternative provisions. As an alternative to the requirements in Section R301.1, the following standards are permitted subject to the limitations of this code and the limitations therein. Where engineered design is used in conjunction with these standards, the design shall comply with the *International Building Code*.

1. AWC *Wood Frame Construction Manual* (WFCM).
2. AISI Standard for Cold-Formed Steel Framing—*Prescriptive Method for One- and Two-Family Dwellings* (AISI S230).
3. ICC Standard on the Design and Construction of Log Structures (ICC 400).

R301.1.2 Construction systems. The requirements of this code are based on platform and balloon-frame construction for light-frame buildings. The requirements for concrete and masonry buildings are based on a balloon framing system. Other framing systems must have equivalent detailing to ensure force transfer, continuity and compatible deformations.

R301.1.3 Engineered design. Where a building of otherwise conventional construction contains structural elements exceeding the limits of Section R301 or otherwise not conforming to this code, these elements shall be designed in accordance with accepted engineering practice. The extent of such design need only demonstrate

compliance of nonconventional elements with other applicable provisions and shall be compatible with the performance of the conventional framed system. Engineered design in accordance with the *International Building Code* is permitted for buildings and structures, and parts thereof, included in the scope of this code.

R301.1.4 Intermodal shipping containers. Intermodal shipping containers that are repurposed for use as buildings or structures shall be designed in accordance with the structural provisions in Section 3115 of the *International Building Code*.

R301.2 Climatic and geographic design criteria. Buildings shall be constructed in accordance with the provisions of this code as limited by the provisions of this section. Additional criteria shall be established by the local jurisdiction and set forth in Table R301.2.

R301.2.1 Wind design criteria. Buildings and portions thereof shall be constructed in accordance with the wind provisions of this code using the ultimate design wind speed in Table R301.2 as determined from Figure R301.2(2). The structural provisions of this code for wind loads are not permitted where wind design is required as specified in Section R301.2.1.1. Where different construction methods and structural materials are used for various portions of a building, the applicable requirements of this section for each portion shall apply. Where not otherwise specified, the wind loads listed in Table R301.2.1(1) adjusted for height and exposure using Table R301.2.1(2) shall be used to determine design load performance requirements for wall coverings, curtain walls, roof coverings, exterior windows, skylights, garage doors and exterior doors. Asphalt shingles shall be designed for wind speeds in accordance with Section R905.2.4. Metal roof shingles shall be designed for wind speeds in accordance with Section R905.4.4. A continuous load path shall be provided to transmit the applicable uplift forces in Section R802.11 from the *roof assembly* to the foundation. Where ultimate design wind speeds in Figure R301.2(2) are less than the lowest wind speed indicated in the prescriptive provisions of this code, the lowest wind speed indicated in the prescriptive provisions of this code shall be used.

BUILDING PLANNING

R301.2.1.1 Wind limitations and wind design required. The wind provisions of this code shall not apply to the design of buildings where wind design is required in accordance with Figure R301.2.1.1, or where the ultimate design wind speed, V_{ulw} , in Figure R301.2(2) equals or exceeds 140 miles per hour (225 kph) in a special wind region.

Exceptions:

1. For concrete construction, the wind provisions of this code shall apply in accordance with the limitations of Sections R404 and R608.
2. For structural insulated panels, the wind provisions of this code shall apply in accordance with the limitations of Section R610.
3. For cold-formed steel *light-frame construction*, the wind provisions of this code shall apply in accordance with the limitations of Sections R505, R603 and R804.

In regions where wind design is required in accordance with Figure R301.2.1.1 or where the ultimate design wind speed, V_{ulw} , in Figure R301.2(2) equals or exceeds 140 miles per hour (225 kph) in a special wind region, the design of buildings for wind loads shall be in accordance with one or more of the following methods:

1. AWC *Wood Frame Construction Manual* (WFCM).
2. ICC *Standard for Residential Construction in High-Wind Regions* (ICC 600).
3. ASCE *Minimum Design Loads for Buildings and Other Structures* (ASCE 7).
4. AISI *Standard for Cold-Formed Steel Framing—Prescriptive Method for One- and Two-Family Dwellings* (AISI S230).
5. *International Building Code*.

The elements of design not addressed by the methods in Items 1 through 5 shall be in accordance with the provisions of this code.

Where ASCE 7 or the *International Building Code* is used for the design of the building, the wind speed map and exposure category requirements as specified in ASCE 7 and the *International Building Code* shall be used.

R301.2.1.1 Sunrooms. *Sunrooms* shall comply with AAMA/NPEA/NSA 2100. For the purpose of applying the criteria of AAMA/NPEA/NSA 2100 based on the intended use, *sunrooms* shall be identified as one of the following categories by the permit applicant, *design professional* or the property *owner* or owner's agent in the *construction documents*. Component and cladding pressures shall be used for the design of elements that do not qualify as main windforce-resisting systems. Main windforce-resisting system pressures shall be used for the design of elements assigned to provide support and stability for the overall *sunroom*.

Category I: A thermally isolated *sunroom* with walls that are open or enclosed with insect

screening or 0.5 mm (20 mil) maximum thickness plastic film. The space is nonhabitable and unconditioned.

Category II: A thermally isolated *sunroom* with enclosed walls. The openings are enclosed with translucent or transparent plastic or glass. The space is nonhabitable and unconditioned.

Category III: A thermally isolated *sunroom* with enclosed walls. The openings are enclosed with translucent or transparent plastic or glass. The *sunroom* fenestration complies with additional requirements for air infiltration resistance and water penetration resistance. The space is nonhabitable and unconditioned.

Category IV: A thermally isolated *sunroom* with enclosed walls. The *sunroom* is designed to be heated or cooled by a separate temperature control or system and is thermally isolated from the primary structure. The *sunroom* fenestration complies with additional requirements for water penetration resistance, air infiltration resistance and thermal performance. The space is nonhabitable and conditioned.

Category V: A *sunroom* with enclosed walls. The *sunroom* is designed to be heated or cooled and is open to the main structure. The *sunroom* fenestration complies with additional requirements for water penetration resistance, air infiltration resistance and thermal performance. The space is habitable and conditioned.

R301.2.1.2 Protection of openings. Exterior glazing in buildings located in *windborne debris regions* shall be protected from windborne debris. Glazed opening protection for windborne debris shall meet the requirements of the Large Missile Test of ASTM E1886 and ASTM E1996 as modified in Section 301.2.1.2.1. Garage door glazed opening protection for windborne debris shall meet the requirements of an *approved* impact-resisting standard or ANSI/DASMA 115.

Exception: *Wood structural panels* with a thickness of not less than $\frac{7}{16}$ inch (11 mm) and a span of not more than 8 feet (2438 mm) shall be permitted for opening protection. Panels shall be precut and attached to the framing surrounding the opening containing the product with the glazed opening. Panels shall be predrilled as required for the anchorage method and shall be secured with the attachment hardware provided. Attachments shall be designed to resist the component and cladding loads determined in accordance with either Table R301.2.1(1) or ASCE 7, with the permanent corrosion-resistant attachment hardware provided and anchors permanently installed on the building. Attachment in accordance with Table R301.2.1.2 is permitted for buildings with a mean roof height of 45 feet (13 728 mm) or less where the ultimate design wind speed, V_{ulw} is 180 mph (290 kph) or less.

**TABLE R301.2
CLIMATIC AND GEOGRAPHIC DESIGN CRITERIA**

GROUND SNOW LOAD ^d	WIND DESIGN			SEISMIC DESIGN CATEGORY ^e			SUBJECT TO DAMAGE FROM WEATHERING ^f			ICE BARRIER UNDERLAYMENT REQUIRED ^g	FLOOD HAZARDS ^h	AIR FREEZING INDEX ⁱ	MEAN ANNUAL TEMP ^j
	Speed ^d (mph)	Topographic effects ^k	Special wind region ^l	Windborne debris zone ^m	Altitude correction factor ^e	Coincident wet bulb	Indoor winter design dry-bulb temperature	Frost line depth ^b	Termite ^c				
—	—	—	—	—	—	—	—	—	—	—	—	—	—
Elevation	Altitude correction factor ^e	Coincident wet bulb	Indoor winter design dry-bulb temperature	Indoor winter design dry-bulb temperature	Indoor winter design dry-bulb temperature	Indoor winter design dry-bulb temperature	Indoor winter design dry-bulb temperature	Heating temperature difference					
Latitude	Daily range	Indoor summer design relative humidity	Indoor summer design relative humidity	Indoor summer design dry-bulb temperature	Indoor summer design dry-bulb temperature	Indoor summer design dry-bulb temperature	Indoor summer design dry-bulb temperature	Indoor summer design dry-bulb temperature	Cooling temperature difference				
—	—	—	—	—	—	—	—	—	—	—	—	—	

For SI: 1 pound per square foot = 0.0479 kPa, 1 mile per hour = 0.447 m/s.

a. Where weathering requires a higher strength concrete or grade of masonry than necessary to satisfy the structural requirements of this code, the frost line depth strength required for weathering shall govern. The weathering column shall be filled in with the weathering index, "negligible," "moderate" or "severe" for concrete as determined from Figure R301.2(1). The grade of masonry units shall be determined from ASTM C34, ASTM C55, ASTM C62, ASTM C73, ASTM C90, ASTM C129, ASTM C145, ASTM C216 or ASTM C652.

b. Where the frost line depth requires deeper footings than indicated in Figure R403.1(1), the frost line depth strength required for weathering shall govern. The jurisdiction shall fill in the frost line depth column with the minimum depth of footing below finish grade.

c. The jurisdiction shall fill in this part of the table to indicate the need for protection depending on whether there has been a history of local subterranean termite damage.

d. The jurisdiction shall fill in this part of the table with the wind speed from the basic wind speed map [Figure R301.2(2)]. Wind exposure category shall be determined on a site-specific basis in accordance with Section R301.2.1.4.

e. The jurisdiction shall fill in this section of the table to establish the design criteria using Table 10A from ACCA Manual J or established criteria determined by the jurisdiction.

f. The jurisdiction shall fill in this part of the table with the seismic design category determined from Section R301.2.2.1.

g. The jurisdiction shall fill in this part of the table with: the date of the jurisdiction's entry into the National Flood Insurance Program (date of adoption of the first code or ordinance for management of flood hazard areas); and the title and date of the currently effective Flood Insurance Study or other flood hazard study

h. In accordance with Sections R905.1.2, R905.4.3.1, R905.5.3.1, R905.6.3.1, R905.7.3.1 and R905.8.3.1, where there has been a history of local damage from the effects of ice damming, the jurisdiction shall fill in this part of the table with "YES." Otherwise, the jurisdiction shall fill in this part of the table with "NO."


i. The jurisdiction shall fill in this part of the table with the 100-year return period air freezing index (BF-days) from Figure R403.3(2) or from the 100-year (99 percent) value on the National Climatic Data Center data table "Air Freezing Index-USA Method (Base 32°F)."
j. The jurisdiction shall fill in this part of the table with the mean annual temperature from the National Climatic Data Center data table "Air Freezing Index-USA Method (Base 32°F)."
k. In accordance with Section R301.2.1.5, where there is local historical data documenting structural damage to buildings due to topographic wind speed-up effects, the jurisdiction shall fill in this part of the table with "YES." Otherwise, the jurisdiction shall indicate "NO" in this part of the table.

l. In accordance with Figure R301.2(2), where there is local historical data documenting unusual wind conditions, the jurisdiction shall fill in this part of the table with "YES" and identify any specific requirements. Otherwise, the jurisdiction shall indicate "NO" in this part of the table.

m. In accordance with Section R301.2.1.2, the jurisdiction shall indicate "NO" in this part of the table.

n. The jurisdiction shall fill in these sections of the table to establish the design criteria using Table 1a or 1b from ACCA Manual J or established criteria determined by the jurisdiction.

o. The jurisdiction shall fill in this section of the table using the Ground Snow Loads in Figures R301.2(3) and R301.2(4).

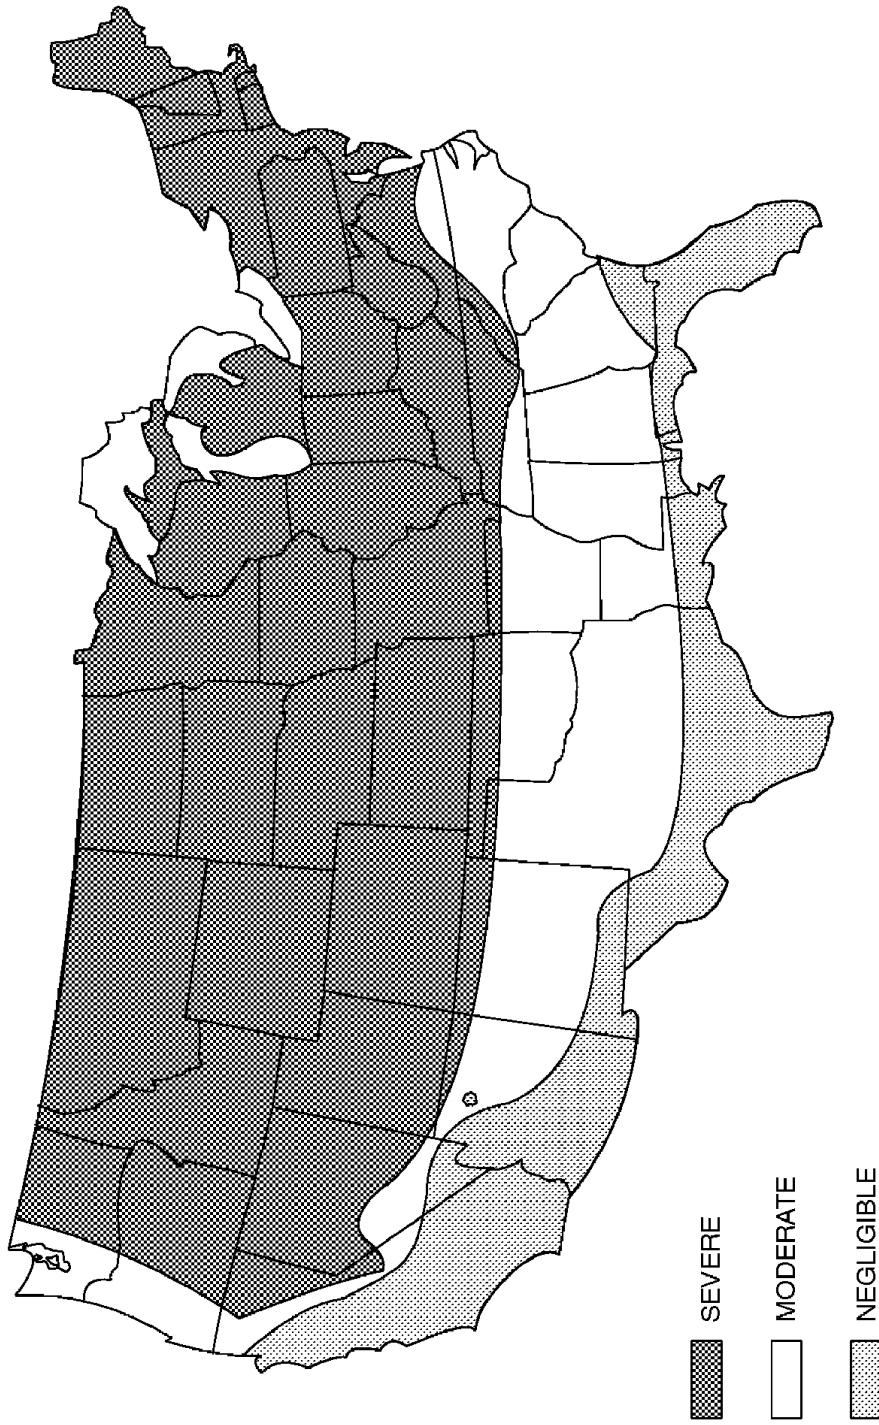

- a. Alaska and Hawaii are classified as severe and negligible, respectively.
- b. Lines defining areas are approximate only. Local conditions may be more or less severe than indicated by region classification. A severe classification is where weather conditions result in significant snowfall combined with extended periods during which there is little or no natural thawing, causing deicing salts to be used extensively.

FIGURE R301.2(1)
WEATHERING PROBABILITY MAP FOR CONCRETE^{a,b}


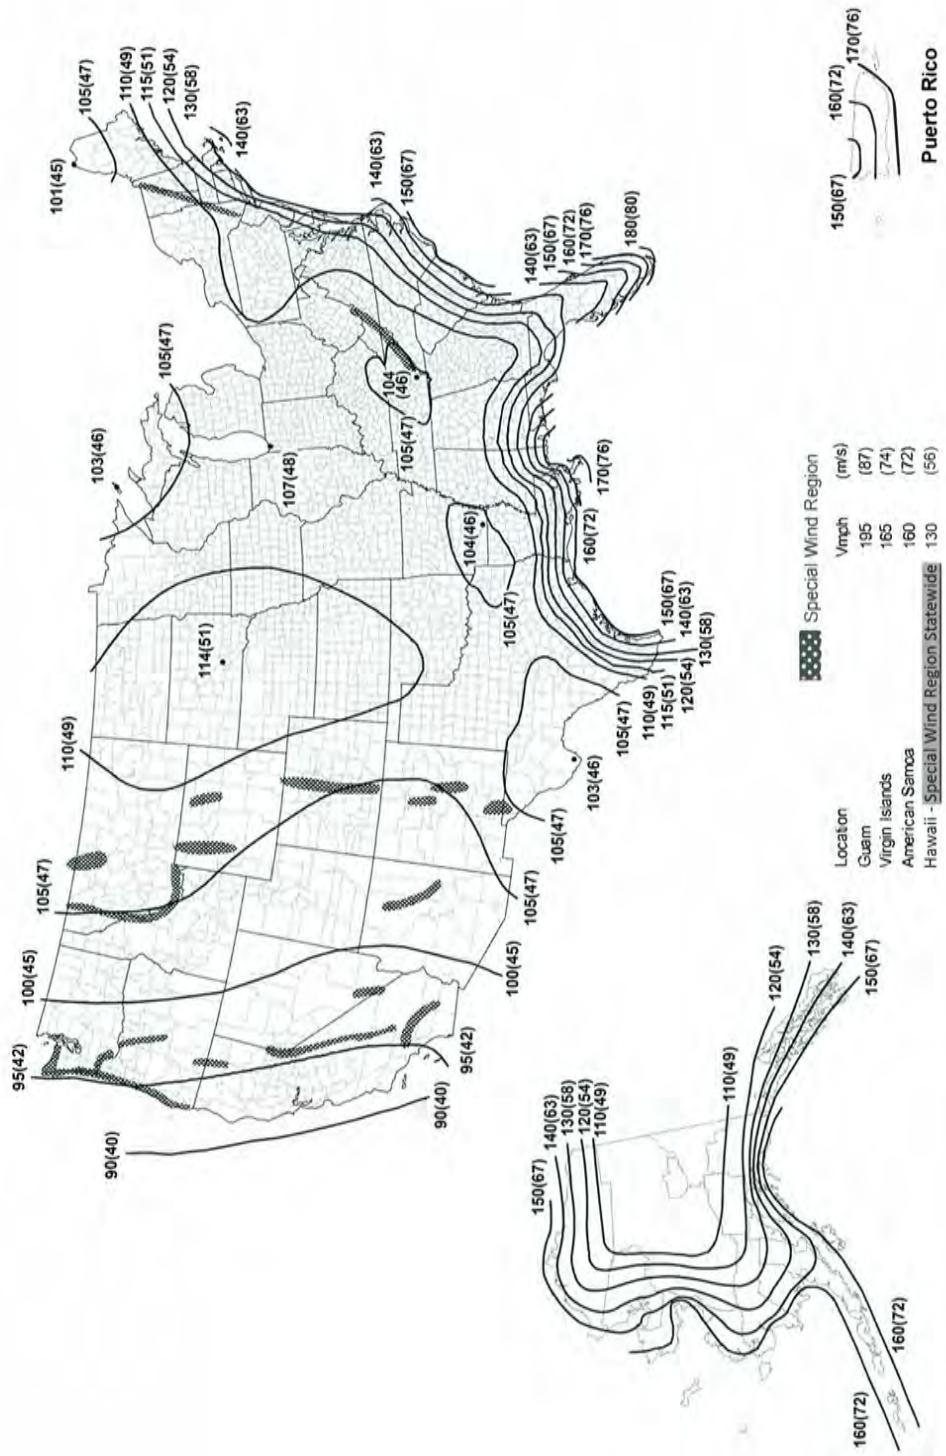


FIGURE R301.2(2)
ULTIMATE DESIGN WIND SPEEDS

2021 INTERNATIONAL RESIDENTIAL CODE®

BUILDING PLANNING

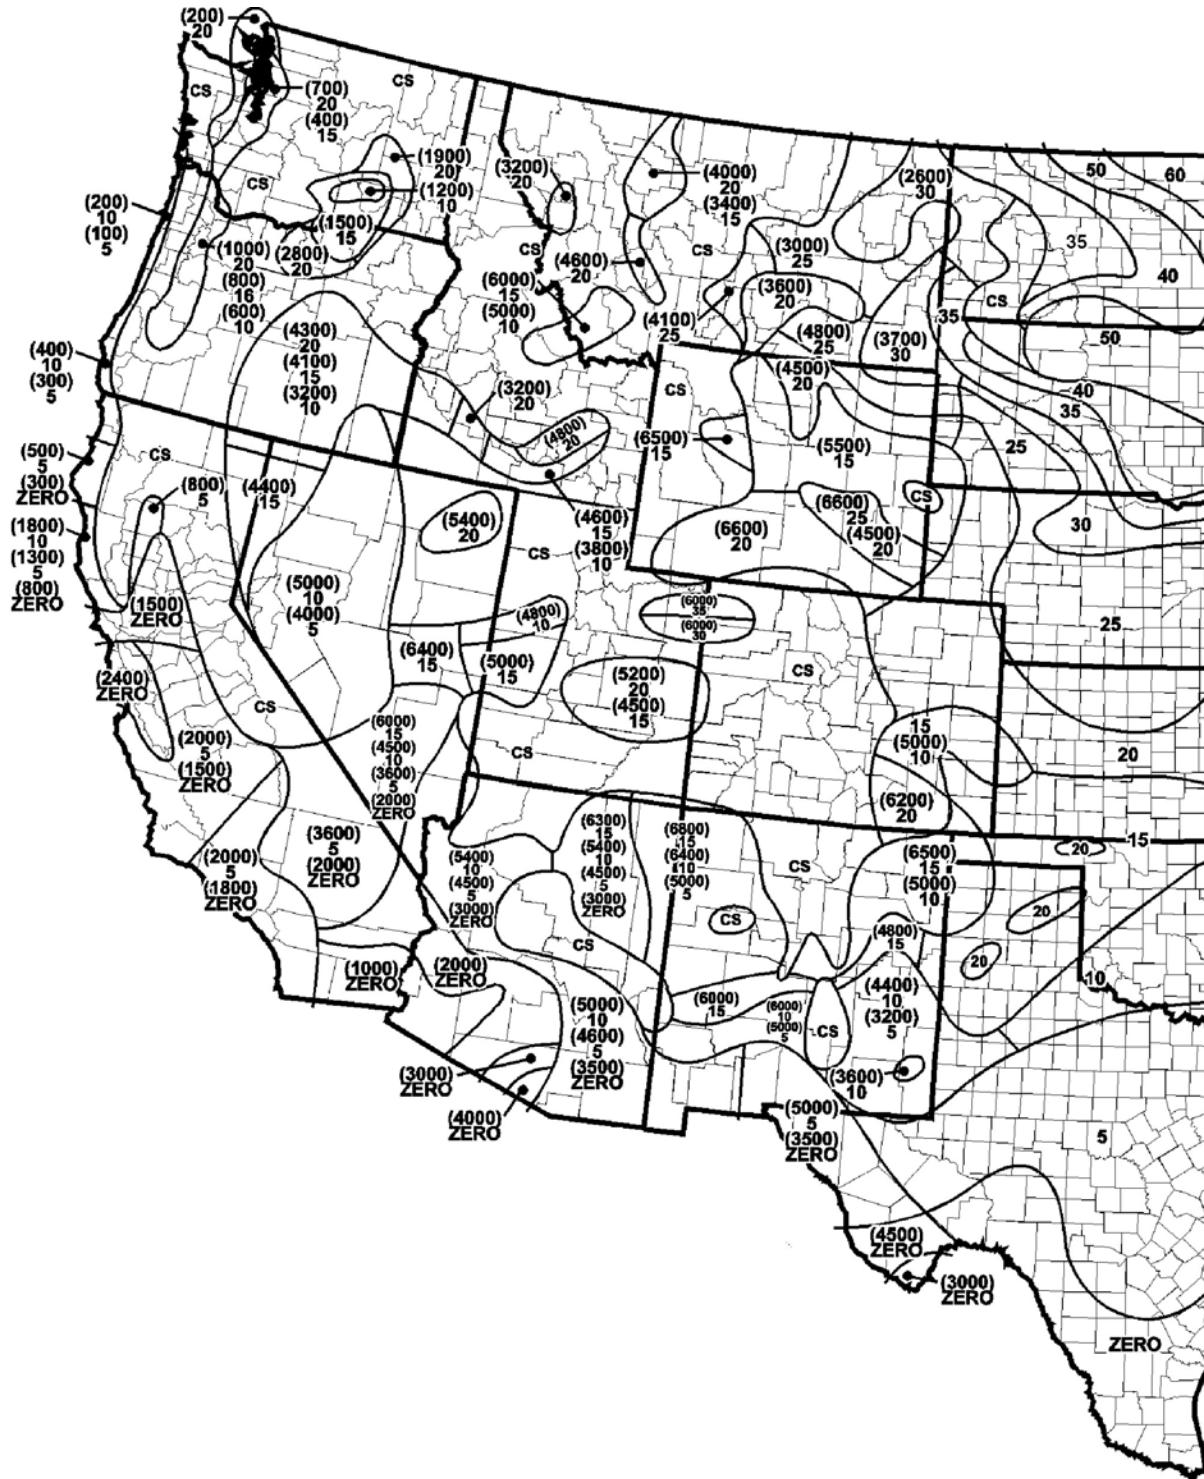

For SI: 1 foot = 34.8 mm, 1 pound per square foot = 0.0479 kPa, 1 mile = 1.61 km.

- a. In CS areas, site-specific case studies are required to establish ground snow loads. Extreme local variations in ground snow loads in these areas preclude mapping at this scale.
- b. Numbers in parentheses represent the upper elevation limits in feet for the ground snow load values presented below. Site-specific case studies are required to establish ground snow loads at elevations not covered.

FIGURE R301.2(3)
GROUND SNOW LOADS, P_g , FOR THE UNITED STATES (lb/ft²)




For SI: 1 foot = 304.8 mm, 1 pound per square foot = 0.0479 kPa, 1 mile = 1.61 km.

- a. In CS areas, site-specific case studies are required to establish ground snow loads. Extreme local variations in ground snow loads in these areas preclude mapping at this scale.


b. Numbers in parentheses represent the upper elevation limits in feet for the ground snow load values presented below. Site-specific case studies are required to establish ground snow loads at elevations not covered.

FIGURE R301.2(4)
GROUND SNOW LOADS, P_g , FOR THE UNITED STATES (lb/ft²)


BUILDING PLANNING

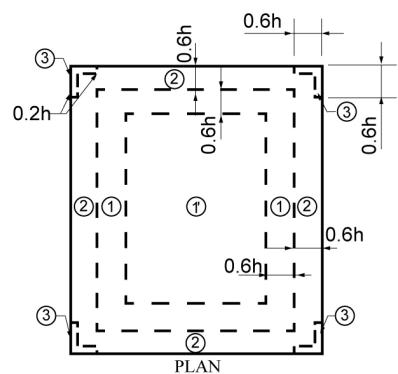



Gable and Flat Roofs $\theta \leq 7^\circ$

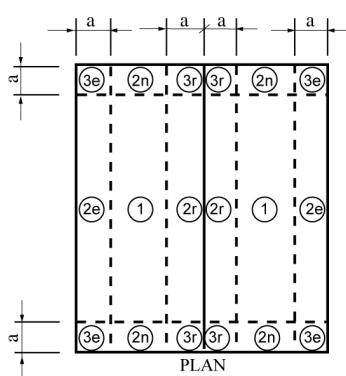

Gable and Flat Roofs $7^\circ < \theta \leq 45^\circ$

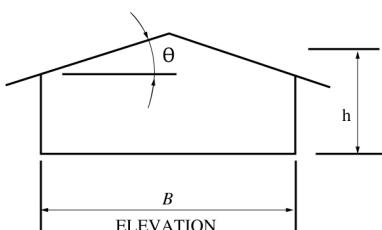

Hip Roofs $7^\circ < \theta \leq 45^\circ$

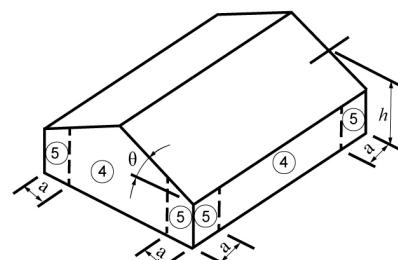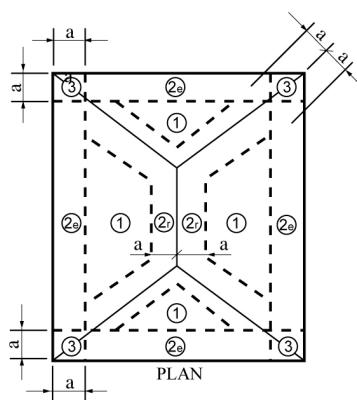

Walls

Hip Roofs $7^\circ < \theta \leq 45^\circ$

For SI: 1 foot = 304.8 mm, 1 degree = 0.0175 rad.

Note: $a = 4$ feet in all cases.

FIGURE R301.2.1
COMPONENT AND CLADDING PRESSURE ZONES

TABLE R301.2.1(1)
COMPONENT AND CLADDING LOADS FOR A BUILDING WITH A MEAN ROOF HEIGHT OF 30 FEET LOCATED IN EXPOSURE B (ASD) (psf)^{a, b, c, d, e, f, g}

		ULTIMATE DESIGN WIND SPEED, V_{ult}																										
		90.0 95.0 105.0 115.0 130.0 150.0 170.0 95.0 105.0 115.0 130.0 150.0 170.0																										
		EFFECTIVE WIND AREAS (square feet)		Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg																	
Flat and gable roof 0 to 7 degrees	1	10.0	3.6	-13.9	4.0	-15.5	4.4	-17.2	4.8	-19.0	5.3	-20.8	5.8	-22.7	6.3	-24.8	7.4	-29.1	8.6	-33.7	9.9	-38.7	11.2	-44.0	12.7	-49.7	14.2	-55.7
	1	20.0	3.3	-13.0	3.7	-14.5	4.1	-16.0	4.5	-17.7	5.0	-19.4	5.4	-21.2	5.9	-23.1	7.0	-27.1	8.1	-31.4	9.3	-36.1	10.5	-41.1	11.9	-46.4	13.3	-52.0
	1	50.0	3.0	-11.8	3.4	-13.1	3.8	-14.5	4.1	-16.0	4.5	-17.6	5.0	-19.2	5.4	-20.9	6.3	-24.5	7.4	-28.4	8.4	-32.6	9.6	-37.1	10.8	-41.9	12.2	-47.0
	1	100.0	2.8	-10.8	3.1	-12.1	3.5	-13.4	3.8	-14.7	4.2	-16.2	4.6	-17.7	5.0	-19.2	5.9	-22.6	6.8	-26.2	7.8	-30.0	8.9	-34.2	10.0	-38.6	11.3	-43.3
	2	10.0	3.6	-18.4	4.0	-20.5	4.4	-22.7	4.8	-25.0	5.3	-27.4	5.8	-30.0	6.3	-32.7	7.4	-38.3	8.6	-44.5	9.9	-51.0	11.2	-58.1	12.7	-65.6	14.2	-73.5
	2	20.0	3.3	-17.2	3.7	-19.2	4.1	-21.2	4.5	-23.4	5.0	-25.7	5.4	-28.1	5.9	-30.6	7.0	-35.9	8.1	-41.6	9.3	-47.8	10.5	-54.3	11.9	-61.4	13.3	-68.8
	2	50.0	3.0	-15.6	3.4	-17.4	3.8	-19.3	4.1	-21.3	4.5	-23.3	5.0	-25.5	5.4	-27.8	6.3	-32.6	7.4	-37.8	8.4	-43.4	9.6	-49.4	10.8	-55.8	12.2	-62.5
	2	100.0	2.8	-14.4	3.1	-16.1	3.5	-17.8	3.8	-19.7	4.2	-21.6	4.6	-23.6	5.0	-25.7	5.9	-30.1	6.8	-35.0	7.8	-40.1	8.9	-45.7	10.0	-51.5	11.3	-57.8
	3	10.0	3.6	-25.0	4.0	-27.9	4.4	-30.9	4.8	-34.1	5.3	-37.4	5.8	-40.9	6.3	-44.5	7.4	-52.2	8.6	-60.6	9.9	-69.6	11.2	-79.1	12.7	-89.4	14.2	-100.2
	3	20.0	3.3	-22.6	3.7	-25.2	4.1	-28.0	4.5	-30.8	5.0	-33.8	5.4	-37.0	5.9	-40.3	7.0	-47.2	8.1	-54.8	9.3	-62.9	10.5	-71.6	11.9	-80.8	13.3	-90.6
Gable roof > 7 to 20 degrees	3	50.0	3.0	-19.4	3.4	-21.7	3.8	-24.0	4.1	-26.5	4.5	-29.0	5.0	-31.7	5.4	-34.6	6.3	-40.6	7.4	-47.0	8.4	-54.0	9.6	-61.4	10.8	-69.4	12.2	-77.8
	3	100.0	2.8	-17.4	3.1	-19.0	3.5	-21.0	3.8	-23.2	4.2	-25.5	4.6	-27.8	5.0	-30.3	5.9	-35.6	6.8	-41.2	7.8	-47.3	8.9	-53.9	10.0	-60.8	11.3	-68.2
	1,2e	10.0	5.4	-16.2	6.0	-18.0	6.7	-19.9	7.4	-22.0	8.1	-24.1	8.8	-26.4	9.6	-28.7	11.3	-33.7	13.1	-39.1	15.0	-44.9	17.1	-51.0	19.3	-57.6	21.6	-64.6
	1,2e	20.0	4.9	-16.2	5.4	-18.0	6.0	-19.9	6.6	-22.0	7.2	-24.1	7.9	-26.4	8.6	-28.7	10.1	-33.7	11.7	-39.1	13.5	-44.9	15.3	-51.0	17.3	-57.6	19.4	-64.6
	1,2e	50.0	4.1	-9.9	4.6	-11.0	5.1	-12.2	5.6	-13.4	6.1	-14.7	6.7	-16.1	7.3	-17.5	8.6	-20.6	10.0	-23.8	11.4	-27.4	13.0	-31.1	14.7	-35.2	16.4	-39.4
	1,2e	100.0	3.6	-5.0	4.0	-5.6	4.4	-6.2	4.8	-6.9	5.3	-7.5	5.8	-8.2	6.3	-9.0	7.4	-10.5	8.6	-12.2	9.9	-14.0	11.2	-15.9	12.7	-18.0	14.2	-20.2
	2n, 2t, 3e	10.0	5.4	-23.6	6.0	-26.3	6.7	-29.1	7.4	-32.1	8.1	-35.2	8.8	-38.5	9.6	-41.9	11.3	-49.2	13.1	-57.0	15.0	-65.4	17.1	-74.5	19.3	-84.1	21.6	-94.2
	2n, 2t, 3e	20.0	4.9	-20.3	5.4	-22.7	6.0	-25.1	6.6	-27.7	7.2	-30.4	7.9	-33.2	8.6	-36.2	10.1	-42.4	11.7	-49.2	13.5	-56.5	15.3	-64.3	17.3	-72.6	19.4	-81.4
	2n, 2t, 3e	50.0	4.1	-16.0	4.6	-17.9	5.1	-19.8	5.6	-21.8	6.1	-24.0	6.7	-26.2	7.3	-28.5	8.6	-33.5	10.0	-38.8	11.4	-44.6	13.0	-50.7	14.7	-57.2	16.4	-64.2
	2n, 2t, 3e	100.0	3.6	-12.8	4.0	-14.3	4.4	-15.8	4.8	-17.4	5.3	-19.1	5.8	-20.9	6.3	-22.8	7.4	-26.7	8.6	-31.0	9.9	-35.6	11.2	-40.5	12.7	-45.7	14.2	-51.3
Gable roof > 20 to 27 degrees	3t	10.0	5.4	-28.0	6.0	-30.2	6.7	-34.6	7.4	-38.1	8.1	-41.8	8.8	-45.7	9.6	-49.8	11.3	-58.4	13.1	-67.8	15.0	-77.8	17.1	-88.5	19.3	-99.9	21.6	-112.0
	3t	20.0	4.9	-24.0	5.4	-26.7	6.0	-29.6	6.6	-32.7	7.2	-35.9	7.9	-39.2	8.6	-42.7	10.1	-50.1	11.7	-58.1	13.5	-66.7	15.3	-75.9	17.3	-85.6	19.4	-96.0
	3t	50.0	4.1	-18.7	4.6	-20.8	5.1	-23.1	5.6	-25.4	6.1	-27.9	6.7	-30.5	7.3	-33.2	8.6	-39.0	10.0	-45.2	11.4	-51.9	13.0	-59.0	14.7	-66.6	16.4	-74.7
	3t	100.0	3.6	-14.7	4.0	-16.3	4.4	-18.1	4.8	-20.0	5.3	-21.9	5.8	-24.0	6.3	-26.1	7.4	-30.6	8.6	-35.5	9.9	-40.8	11.2	-46.4	12.7	-52.3	14.2	-58.7
	1,2e	10.0	6.5	-12.4	7.3	-13.9	8.0	-15.4	8.9	-16.9	9.7	-18.6	10.6	-20.3	11.6	-22.1	13.6	-26.0	15.8	-30.1	18.1	-34.6	20.6	-39.3	23.3	-44.4	26.1	-49.9
	1,2e	20.0	5.6	-12.4	6.3	-13.9	7.0	-15.4	7.7	-16.9	8.4	-18.6	9.2	-20.3	10.0	-22.1	11.7	-26.0	13.6	-30.1	15.6	-34.6	17.8	-39.3	20.1	-44.4	22.5	-49.8
	2n, 2t, 3e	10.0	6.5	-19.9	7.3	-22.1	8.0	-24.5	8.9	-27.0	9.7	-29.7	10.6	-32.4	11.6	-35.3	13.6	-41.4	15.8	-48.0	18.1	-55.2	20.6	-62.8	23.3	-70.8	26.1	-79.4
	2n, 2t, 3e	20.0	5.6	-17.4	6.3	-19.4	7.0	-21.5	7.7	-23.7	8.4	-26.0	9.2	-28.4	10.0	-31.0	11.7	-36.3	13.6	-42.1	15.6	-48.4	17.8	-55.0	20.1	-62.1	22.5	-69.6
	2n, 2t, 3e	50.0	4.4	-14.2	5.0	-15.8	5.5	-17.5	6.1	-19.3	6.6	-21.1	7.3	-23.1	7.9	-25.2	9.3	-29.5	10.8	-34.2	12.3	-39.3	14.0	-44.7	15.9	-50.5	17.8	-56.6
Gable roof > 20 to 27 degrees	2n, 2t, 3e	100.0	3.6	-11.7	4.0	-13.0	4.4	-14.5	4.8	-15.9	5.3	-17.5	5.8	-19.1	6.3	-20.8	7.4	-24.4	8.6	-28.3	9.9	-32.5	11.2	-37.0	12.7	-41.8	14.2	-46.8
	3t	10.0	6.5	-23.6	7.3	-26.3	8.0	-29.1	8.9	-32.1	9.7	-35.2	10.6	-38.5	11.6	-41.9	13.6	-49.2	15.8	-57.0	18.1	-65.4	20.6	-74.5	23.3	-84.1	26.1	-94.2
	3t	20.0	5.6	-19.9	6.3	-22.1	7.0	-24.5	7.7	-27.0	8.4	-29.7	9.2	-32.4	10.0	-35.3	11.7	-41.4	13.6	-48.0	15.6	-55.2	17.8	-62.8	20.1	-70.8	22.5	-79.4
	3t	50.0	4.4	-14.7	5.0	-16.3	5.5	-18.1	6.1	-20.0	6.6	-21.9	7.3	-24.0	7.9	-26.1	9.3	-30.6	10.8	-35.5	12.3	-40.8	14.0	-46.4	15.9	-52.3	17.8	-58.7
	3t	100.0	3.6	-14.7	4.0	-16.3	4.4	-18.1	4.8	-20.0	5.3	-21.9	5.8	-24.0	6.3	-26.1	7.4	-30.6	8.6	-35.5	9.9	-40.8	11.2	-46.4	12.7	-52.3	14.2	-58.7

(continued)

BUILDING PLANNING

**TABLE R301.2.1(1)—continued
COMPONENT AND CLADDING LOADS FOR A BUILDING WITH A MEAN ROOF HEIGHT OF 30 FEET LOCATED IN EXPOSURE B (ASD) (psf)^{a,b,c,d,e,f,g}**

	ZONE	EFFECTIVE WIND AREAS (square feet)	ULTIMATE DESIGN WIND SPEED, V_{ult}																	
			90.0	95.0	105.0	115.0	130.0	150.0	170.0	95.0	105.0	115.0	130.0	150.0	170.0	170.0	170.0	170.0	170.0	
		Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	
1,2e, 2r	10.0	8.0	-14.7	8.9	-16.3	9.9	-18.1	10.9	-20.0	12.0	-21.9	13.1	-24.0	14.2	-26.1	16.7	-30.6	19.4	-35.5	22.2
1,2e, 2r	20.0	7.1	-12.4	7.9	-13.9	8.8	-15.4	9.7	-16.9	10.6	-18.6	11.6	-20.3	12.6	-22.1	14.8	-26.0	17.2	-30.1	19.8
1,2e, 2r	50.0	5.9	-9.5	6.6	-10.6	7.3	-11.7	8.1	-12.9	8.9	-14.2	9.7	-15.5	10.5	-16.9	12.4	-19.8	14.3	-22.9	16.5
1,2e, 2r	100.0	5.0	-7.3	5.6	-8.1	6.2	-9.0	6.9	-9.9	7.5	-10.8	8.2	-11.9	9.0	-12.9	10.5	-15.1	12.2	-17.6	14.0
2h, 3r	10.0	8.0	-16.2	8.9	-18.0	9.9	-19.9	10.9	-22.0	12.0	-24.1	13.1	-26.4	14.2	-28.7	16.7	-33.7	19.4	-39.1	22.2
2h, 3r	20.0	7.1	-14.4	7.9	-16.1	8.8	-17.8	9.7	-19.7	10.6	-21.6	11.6	-23.6	12.6	-25.7	14.8	-30.1	17.2	-34.9	19.8
2h, 3r	50.0	5.9	-12.2	6.6	-13.5	7.3	-15.0	8.1	-16.5	8.9	-18.2	9.7	-19.9	10.5	-21.6	12.4	-25.4	14.3	-29.4	16.5
2h, 3r	100.0	5.0	-10.4	5.6	-11.6	6.2	-12.9	6.9	-14.2	7.5	-15.6	8.2	-17.1	9.0	-18.6	10.5	-21.8	12.2	-25.3	14.0
3e	10.0	8.0	-19.9	8.9	-22.1	9.9	-24.5	10.9	-27.0	12.0	-29.7	13.1	-32.4	14.2	-35.3	16.7	-41.4	19.4	-48.0	22.2
3e	20.0	7.1	-17.6	7.9	-19.6	8.8	-21.8	9.7	-24.0	10.6	-26.3	11.6	-28.8	12.6	-31.3	14.8	-36.8	17.2	-42.7	19.8
3e	50.0	5.9	-14.7	6.6	-16.3	7.3	-18.1	8.1	-20.0	8.9	-21.9	9.7	-24.0	10.5	-26.1	12.4	-30.6	14.3	-35.5	16.6
3e	100.0	5.0	-12.4	5.6	-13.9	6.2	-15.4	6.9	-16.9	7.5	-18.6	8.2	-20.3	9.0	-22.1	10.5	-26.0	12.2	-30.1	14.0
1	10.0	6.5	-14.7	7.3	-16.3	8.0	-18.1	8.9	-20.0	9.7	-21.9	10.6	-24.0	11.6	-26.1	13.6	-30.6	15.8	-35.5	18.1
1	20.0	5.6	-14.7	6.3	-16.3	7.0	-18.1	7.7	-20.0	8.4	-21.9	9.2	-24.0	10.0	-26.1	12.4	-30.6	14.3	-35.5	18.7
1	50.0	4.4	-11.3	5.0	-12.6	5.5	-14.0	6.1	-15.4	6.6	-16.9	7.3	-18.5	7.9	-20.2	9.3	-23.7	10.8	-27.4	12.3
1	100.0	3.6	-8.7	4.0	-9.7	4.4	-10.8	4.8	-11.9	5.3	-13.1	5.8	-14.3	6.3	-15.5	7.4	-18.2	8.6	-21.2	9.9
2r	10.0	6.5	-19.1	7.3	-21.3	8.0	-23.6	8.9	-26.0	9.7	-28.6	10.6	-31.2	11.6	-34.0	13.6	-39.9	15.8	-46.3	18.1
2r	20.0	5.6	-17.2	6.3	-19.2	7.0	-21.3	7.7	-23.4	8.4	-25.7	9.2	-28.1	10.0	-30.6	11.7	-35.9	13.6	-41.7	15.6
2r	50.0	4.4	-14.7	5.0	-16.4	5.5	-18.2	6.1	-20.0	6.6	-22.0	7.3	-24.0	7.9	-26.1	9.3	-30.7	10.8	-35.6	12.3
2r	100.0	3.6	-12.8	4.0	-14.3	4.4	-15.8	4.8	-17.4	5.3	-19.1	5.8	-20.9	6.3	-22.8	7.4	-26.7	8.6	-31.0	9.9
2e, 3	10.0	6.5	-20.6	7.3	-22.9	8.0	-25.4	8.9	-28.0	9.7	-30.8	10.6	-33.6	11.6	-36.6	13.6	-43.0	15.8	-49.8	18.1
2e, 3	20.0	5.6	-18.5	6.3	-20.6	7.0	-22.9	7.7	-25.2	8.4	-27.7	9.2	-30.3	10.0	-32.9	11.7	-38.7	13.6	-44.8	15.6
2e, 3	50.0	4.4	-15.8	5.0	-17.6	5.5	-19.5	6.1	-21.5	6.6	-23.6	7.3	-25.8	7.9	-28.0	9.3	-32.9	10.8	-38.2	12.3
2e, 3	100.0	3.6	-13.7	4.0	-15.3	4.0	-16.9	4.8	-18.7	5.3	-20.5	5.8	-22.4	6.3	-24.4	7.4	-28.6	8.6	-33.2	9.9
1	10.0	6.5	-11.7	7.3	-13.0	8.0	-14.5	8.9	-15.9	9.7	-17.5	10.6	-19.1	11.6	-20.8	13.6	-24.4	15.8	-28.3	18.1
1	20.0	5.6	-10.4	6.3	-11.6	7.0	-12.8	7.7	-14.1	8.4	-15.5	9.2	-16.9	10.0	-18.4	11.7	-21.6	13.6	-25.1	15.6
1	50.0	4.4	-8.6	5.0	-9.6	5.5	-10.6	6.1	-11.7	6.6	-12.8	7.3	-14.0	7.9	-15.3	9.3	-17.9	10.8	-20.8	12.3
Hipped roof > 7 to 20 degrees ^g	100.0	3.6	-7.3	4.0	-8.1	4.4	-9.0	4.8	-9.9	5.3	-10.8	5.8	-11.9	6.3	-12.9	7.4	-15.1	8.6	-17.6	9.9
2e, 2t, 3	10.0	6.5	-16.2	7.3	-18.0	8.0	-19.9	8.9	-22.0	9.7	-24.1	10.6	-26.4	11.6	-28.7	13.6	-33.7	15.8	-39.1	18.1
2e, 2t, 3	20.0	5.6	-14.4	6.3	-16.1	7.0	-17.8	7.7	-19.7	8.4	-21.6	9.2	-23.6	10.0	-25.7	11.7	-30.1	13.6	-34.9	15.6
2e, 2t, 3	50.0	4.4	-12.2	5.0	-13.5	5.5	-15.0	6.1	-16.5	6.6	-18.2	7.3	-19.9	7.9	-21.6	9.3	-25.4	10.8	-29.4	12.3
2e, 2t, 3	100.0	3.6	-10.4	4.0	-11.6	4.4	-12.9	4.8	-14.2	5.3	-15.6	5.8	-17.1	6.3	-18.6	7.4	-21.8	8.6	-25.3	9.9

(continued)

BUILDING PLANNING**TABLE R301.2.1(1)—continued
COMPONENT AND CLADDING LOADS FOR A BUILDING WITH A MEAN ROOF HEIGHT OF 30 FEET LOCATED IN EXPOSURE B (ASD) (psf)^{a, b, c, d, e, f, g}**

	ZONE	EFFECTIVE WIND AREAS (square feet)	ULTIMATE DESIGN WIND SPEED, V_{air}																										
			90.0		95.0		105.0		115.0		130.0		170.0																
			Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg															
	1	10.0	6.2	-12.4	6.9	-13.9	7.7	-15.4	8.5	-16.9	9.3	-18.6	10.2	-20.3	11.1	-22.1	13.0	-26.0	15.1	-30.1	17.3	-34.6	19.7	-39.3	22.2	-44.4	24.9	-49.8	
1	20.0	5.4	-11.0	6.0	-12.3	6.7	-13.6	7.4	-15.0	8.1	-16.5	8.9	-18.0	9.6	-19.6	11.3	-23.0	13.1	-26.7	15.1	-30.7	17.1	-34.9	19.4	-39.4	21.7	-44.4	24.9	-49.8
1	50.0	4.4	-9.2	4.9	-10.2	5.4	-11.3	5.9	-12.5	6.5	-13.7	7.1	-15.0	7.7	-16.3	9.1	-19.2	10.5	-22.2	12.1	-25.5	13.8	-29.0	15.5	-32.8	17.4	-36.7	24.9	-49.8
1	100.0	3.6	-7.8	4.0	-8.7	4.4	-9.6	4.8	-10.6	5.3	-11.6	5.8	-12.7	6.3	-13.8	7.4	-16.2	8.6	-18.8	9.9	-21.6	11.2	-24.6	12.7	-27.8	14.2	-31.1	24.9	-49.8
2e	10.0	6.2	-14.8	6.9	-16.5	7.7	-18.3	8.5	-20.2	9.3	-22.1	10.2	-24.2	11.1	-26.3	13.0	-30.9	15.1	-35.9	17.3	-41.2	19.7	-46.8	22.2	-52.9	24.9	-59.3		
2e	20.0	5.4	-11.7	6.0	-13.0	6.7	-14.5	7.4	-15.9	8.1	-17.5	8.9	-19.1	9.6	-20.8	11.3	-24.4	13.1	-28.3	15.1	-32.5	17.1	-37.0	19.4	-41.8	21.7	-46.8		
2e	50.0	4.4	-7.3	4.9	-8.1	5.4	-9.0	5.9	-9.9	6.5	-10.8	7.1	-11.9	7.7	-12.9	9.1	-15.1	10.5	-17.6	12.1	-20.2	13.8	-22.9	15.5	-25.9	17.4	-29.0		
2e	100.0	3.6	-7.3	4.0	-8.1	4.4	-9.0	4.8	-9.9	5.3	-10.8	5.8	-11.9	6.3	-12.9	7.4	-15.1	8.6	-17.6	9.9	-20.2	11.2	-22.9	12.7	-25.9	14.2	-29.0		
2r	10.0	6.2	-18.7	6.9	-20.9	7.7	-23.1	8.5	-25.5	9.3	-28.0	10.2	-30.6	11.1	-33.3	13.0	-39.1	15.1	-45.4	17.3	-52.1	19.7	-59.2	22.2	-66.9	24.9	-75.0		
2r	20.0	5.4	-15.7	6.0	-17.5	6.7	-19.4	7.4	-21.4	8.1	-23.5	8.9	-25.7	9.6	-28.0	11.3	-32.8	13.1	-38.1	15.1	-43.7	17.1	-49.8	19.4	-56.2	21.7	-63.0		
2r	50.0	4.4	-11.7	4.9	-13.1	5.4	-14.5	5.9	-16.0	6.5	-17.5	7.1	-19.2	7.7	-20.9	9.1	-24.5	10.5	-28.4	12.1	-32.6	13.8	-37.1	15.5	-41.9	17.4	-47.0		
2r	100.0	3.6	-8.7	4.0	-9.7	4.4	-10.8	4.8	-11.9	5.3	-13.1	5.8	-14.3	6.3	-15.5	7.4	-18.2	8.6	-21.2	9.9	-24.3	11.2	-27.6	12.7	-31.2	14.2	-35.0		
3	10.0	6.2	-20.0	6.9	-22.3	7.7	-24.7	8.5	-27.2	9.3	-29.9	10.2	-32.7	11.1	-35.6	13.0	-41.7	15.1	-48.4	17.3	-55.6	19.7	-63.2	22.2	-71.4	24.9	-80.0		
3	20.0	5.4	-15.0	6.0	-16.8	6.7	-18.6	7.4	-20.5	8.1	-22.5	8.9	-24.6	9.6	-26.7	11.3	-31.4	13.1	-36.4	15.1	-41.8	17.1	-47.5	19.4	-53.7	21.7	-60.2		
3	50.0	4.4	-8.7	4.9	-9.7	5.4	-10.8	5.9	-11.9	6.5	-13.1	7.1	-14.3	7.7	-15.5	9.1	-18.2	10.5	-21.2	12.1	-24.3	13.8	-27.6	15.5	-31.2	17.4	-35.0		
3	100.0	3.6	-8.7	4.0	-9.7	4.4	-10.8	4.8	-11.9	5.3	-13.1	5.8	-14.3	6.3	-15.5	7.4	-18.2	8.6	-21.2	9.9	-24.3	11.2	-27.6	12.7	-31.2	14.2	-35.0		
4	10.0	8.7	-9.5	9.7	-10.6	10.8	-11.7	11.9	-12.9	13.1	-14.2	14.3	-15.5	15.5	-16.9	18.2	-19.8	21.2	-22.9	24.3	-26.3	27.6	-30.0	31.2	-33.8	35.0	-37.9		
4	20.0	8.3	-9.1	9.3	-10.1	10.3	-11.2	11.4	-12.4	12.5	-13.6	13.6	-14.8	14.8	-16.2	17.4	-19.0	20.2	-22.0	23.2	-25.3	26.4	-28.7	29.8	-32.4	33.4	-36.4		
4	50.0	7.8	-8.6	8.7	-9.5	9.7	-10.6	10.7	-11.7	11.7	-12.8	12.8	-14.0	13.9	-15.2	16.3	-17.9	18.9	-20.7	21.7	-23.8	24.7	-27.1	27.9	-30.6	31.3	-34.3		
4	100.0	7.4	-8.2	8.3	-9.1	9.2	-10.1	10.1	-11.1	11.1	-12.2	12.1	-13.3	13.2	-14.5	15.5	-17.1	18.0	-19.8	20.6	-22.7	23.5	-25.8	26.5	-29.2	29.7	-32.7		
4	500.0	6.5	-7.3	7.3	-8.1	8.0	-9.0	8.9	-9.9	9.7	-10.8	10.6	-11.9	11.6	-12.9	13.5	-15.1	15.8	-17.6	18.1	-20.2	20.6	-22.9	23.3	-25.9	26.1	-29.0		
Wall	5	10.0	8.7	-11.7	9.7	-13.0	10.8	-14.5	11.9	-15.9	13.1	-17.5	14.3	-19.1	15.5	-20.8	18.2	-24.4	21.2	-28.3	24.3	-32.5	27.6	-37.0	31.2	-41.8	35.0	-46.8	
5	20.0	8.3	-10.9	9.3	-12.2	10.3	-13.5	11.4	-14.9	12.5	-16.3	13.6	-17.8	14.8	-19.4	17.4	-22.8	20.2	-26.4	23.2	-30.3	26.4	-34.5	29.8	-39.0	33.4	-43.7		
5	50.0	7.8	-9.9	8.7	-11.0	9.7	-12.2	10.7	-13.4	11.7	-14.7	12.8	-16.1	13.9	-17.5	16.3	-20.6	18.9	-23.9	21.7	-27.4	24.7	-31.2	27.9	-35.2	31.3	-39.5		
5	100.0	7.4	-9.1	8.3	-10.1	9.2	-11.2	10.1	-12.4	11.1	-13.6	12.1	-14.8	13.2	-16.1	15.5	-19.0	18.0	-22.0	20.6	-25.2	23.5	-28.7	26.5	-32.4	29.7	-36.3		
5	500.0	6.5	-7.3	7.3	-8.1	8.0	-9.0	8.9	-9.9	9.7	-10.8	10.6	-11.9	11.6	-12.9	13.6	-15.1	15.8	-17.6	18.1	-20.2	20.6	-22.9	23.3	-25.9	26.1	-29.0		

For SI: 1 foot = 304.8 mm, 1 square foot = 0.0929 m², 1 mile per hour = 0.447 m/s, 1 pound per square foot = 0.0479 kPa.

- a. The effective wind area shall be equal to the span length multiplied by an effective width. This width shall be not less than one-third the span length. For cladding fasteners, the effective wind areas shall not be greater than the area that is tributary to an individual fastener.

- b. For effective areas between those given, the load shall be interpolated or the load associated with the lower effective areas shall be used.

- c. Table values shall be adjusted for height and exposure by multiplying by the adjustment coefficient in Table R301.2.1(2).

- d. See Figure R318-4 for locations of termite infestation probability zones.

- e. Plus and minus signs signify pressures acting toward and away from the building surfaces.

- f. Positive and negative design wind pressures shall not be less than 10 psf.

- g. Where the ratio of the building mean roof height to the building length or width is less than 0.8, uplift loads shall be permitted to be calculated in accordance with ASCE 7.

BUILDING PLANNING

R301.2.1.2.1 Application of ASTM E1996. The text of Section 2.2 of ASTM E1996 shall be substituted as follows:

2.2 ASCE Standard:

ASCE 7-10 American Society of Civil Engineers *Minimum Design Loads for Buildings and Other Structures*

The text of Section 6.2.2 of ASTM E1996 shall be substituted as follows:

6.2.2 Unless otherwise specified, select the wind zone based on the ultimate design wind speed, V_{ult} , as follows:

6.2.2.1 Wind Zone 1—130 mph \leq ultimate design wind speed, $V_{ult} < 140$ mph.

6.2.2.2 Wind Zone 2—140 mph \leq ultimate design wind speed, $V_{ult} < 150$ mph at greater than 1 mile

(1.6 km) from the coastline. The coastline shall be measured from the mean high-water mark.

6.2.2.3 Wind Zone 3—150 mph (67 m/s) \leq ultimate design wind speed, $V_{ult} \leq 170$ mph (76 m/s), or 140 mph (54 m/s) \leq ultimate design wind speed, $V_{ult} \leq 170$ mph (76 m/s) and within 1 mile (1.6 km) of the coastline. The coastline shall be measured from the mean high-water mark.

6.2.2.4 Wind Zone 4—ultimate design wind speed, $V_{ult} > 170$ mph (76 m/s).

R301.2.1.3 Wind speed conversion. Where referenced documents are based on nominal design wind speeds and do not provide the means for conversion between ultimate design wind speeds and nominal design wind speeds, the ultimate design wind speeds, V_{ult} , of Figure R301.2(2) shall be converted to nominal design wind speeds, V_{asd} , using Table R301.2.1.3.

TABLE R301.2.1(2)
HEIGHT AND EXPOSURE ADJUSTMENT COEFFICIENTS FOR Table R301.2.1(1)

MEAN ROOF HEIGHT	EXPOSURE		
	B	C	D
15	0.82	1.21	1.47
20	0.89	1.29	1.55
25	0.94	1.35	1.61
30	1.00	1.40	1.66
35	1.05	1.45	1.70
40	1.09	1.49	1.74
45	1.12	1.53	1.78
50	1.16	1.56	1.81
55	1.19	1.59	1.84
60	1.22	1.62	1.87

TABLE R301.2.1.2
WINDBORNE DEBRIS PROTECTION FASTENING SCHEDULE FOR WOOD STRUCTURAL PANELS^{a, b, c, d}

FASTENER TYPE	FASTENER SPACING (inches) ^{a, b}		
	Panel span \leq 4 feet	4 feet $<$ panel span \leq 6 feet	6 feet $<$ panel span \leq 8 feet
No. 8 wood-screw-based anchor with 2-inch embedment length	16	10	8
No. 10 wood-screw-based anchor with 2-inch embedment length	16	12	9
1/4-inch lag-screw-based anchor with 2-inch embedment length	16	16	16

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 pound = 4,448 N, 1 mile per hour = 0.447 m/s.

- a. This table is based on 180 mph ultimate design wind speeds, V_{ult} , and a 45-foot mean roof height.
- b. Fasteners shall be installed at opposing ends of the wood structural panel. Fasteners shall be located not less than 1 inch from the edge of the panel.
- c. Anchors shall penetrate through the exterior wall covering with an embedment length of not less than 2 inches into the building frame. Fasteners shall be located not less than 2 1/2 inches from the edge of concrete block or concrete.
- d. Panels attached to masonry or masonry/stucco shall be attached using vibration-resistant anchors having an ultimate withdrawal capacity of not less than 1,500 pounds.

TABLE R301.2.1.3
WIND SPEED CONVERSIONS^a

V_{ult}	110	115	120	130	140	150	160	170	180	190	200
V_{asd}	85	89	93	101	108	116	124	132	139	147	155

For SI: 1 mile per hour = 0.447 m/s.

- a. Linear interpolation is permitted.

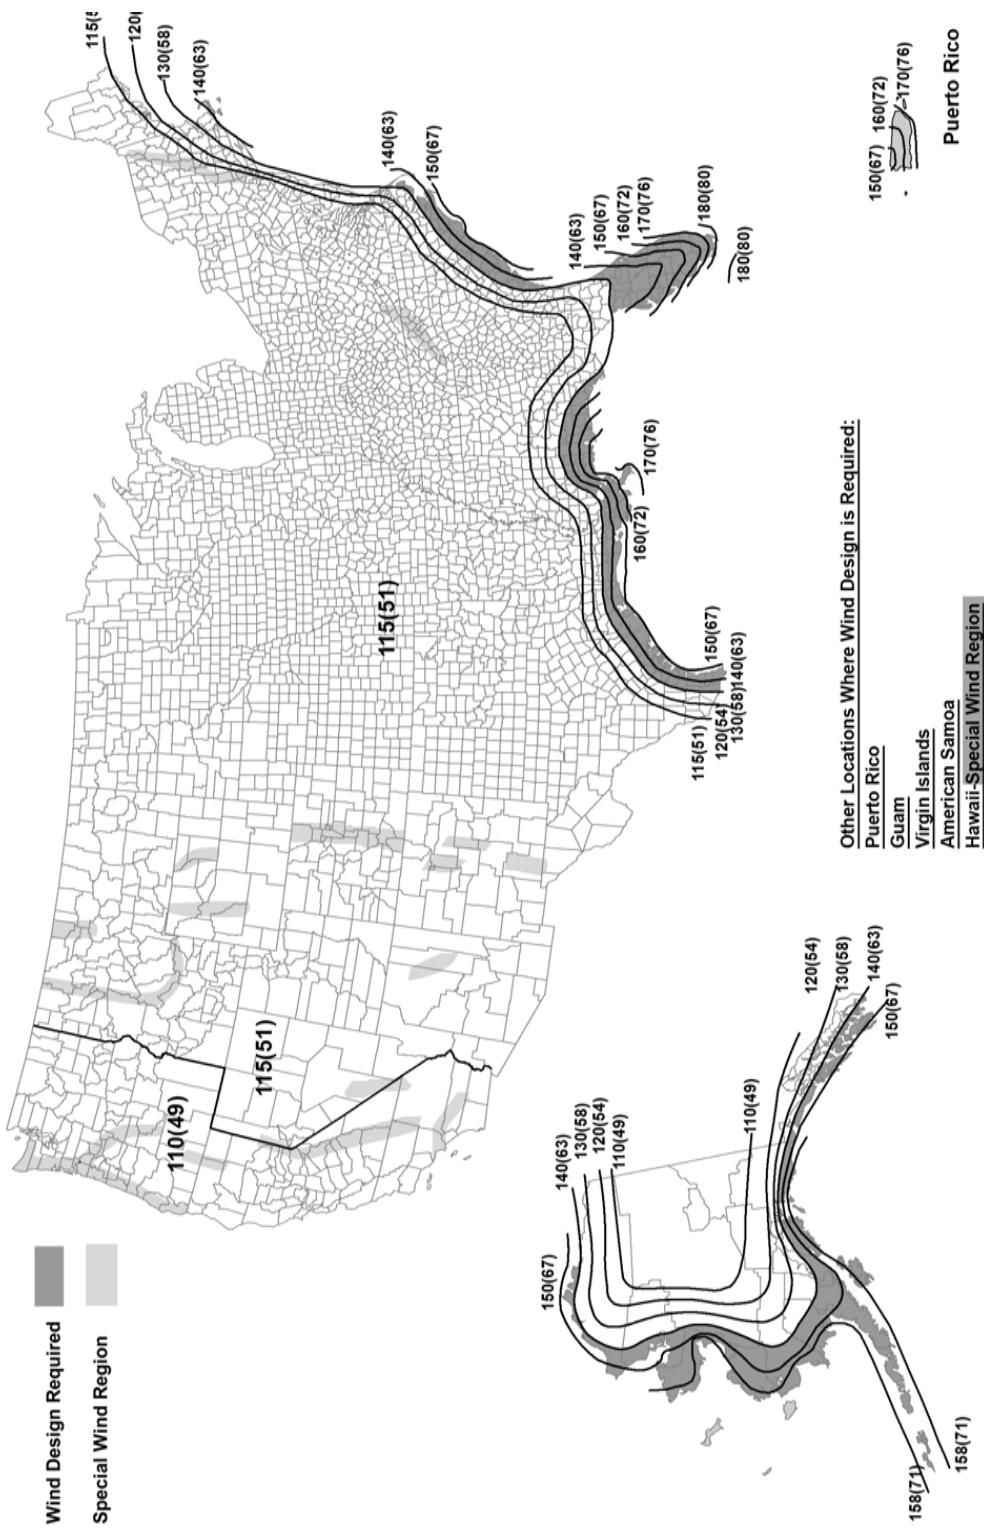


FIGURE R301.2.1.1
REGIONS WHERE WIND DESIGN IS REQUIRED

BUILDING PLANNING

R301.2.1.4 Exposure category. For each wind direction considered, an exposure category that adequately reflects the characteristics of ground surface irregularities shall be determined for the site at which the building or structure is to be constructed. For a site located in the transition zone between categories, the category resulting in the largest wind forces shall apply. Account shall be taken of variations in ground surface roughness that arise from natural topography and vegetation as well as from constructed features. For a site where multiple detached one- and two-family *dwellings*, townhouses or other structures are to be constructed as part of a subdivision or master-planned community, or are otherwise designated as a developed area by the authority having *jurisdiction*, the exposure category for an individual structure shall be based on the site conditions that will exist at the time when all adjacent structures on the site have been constructed, provided that their construction is expected to begin within 1 year of the start of construction for the structure for which the exposure category is determined. For any given wind direction, the exposure in which a specific building or other structure is sited shall be assessed as being one of the following categories:

1. Exposure B. Urban and suburban areas, wooded areas or other terrain with numerous closely spaced obstructions having the size of single-family *dwellings* or larger. Exposure B shall be assumed unless the site meets the definition of another type exposure.
2. Exposure C. Open terrain with scattered obstructions, including surface undulations or other irregularities, having heights generally less than 30 feet (9144 mm) extending more than 1,500 feet (457 m) from the building site in any quadrant. This exposure shall apply to any building located within Exposure B type terrain where the building is directly adjacent to open areas of Exposure C type terrain in any quadrant for a distance of more than 600 feet (183 m). This category includes flat, open country and grasslands.
3. Exposure D. Flat, unobstructed areas exposed to wind flowing over open water, smooth mud flats, salt flats and unbroken ice for a distance of not less than 5,000 feet (1524 m). This exposure shall apply only to those buildings and other structures exposed to the wind coming from over the unobstructed area. Exposure D extends downwind from the edge of the unobstructed area a distance of 600 feet (183 m) or 20 times the height of the building or structure, whichever is greater.

R301.2.1.5 Topographic wind effects. In areas designated in Table R301.2 as having local historical data documenting structural damage to buildings caused by wind speed-up at isolated *hills*, ridges and escarpments that are abrupt changes from the general topography of the area, topographic wind effects shall be considered in the design of the building in accordance with Section R301.2.1.5.1 or in accordance with the provisions of ASCE 7. See Figure R301.2.1.5.1(1) for topographic features for wind speed-up effect.

In these designated areas, topographic wind effects shall apply only to buildings sited on the top half of an isolated *hill*, *ridge* or escarpment where all of the following conditions exist:

1. The average slope of the top half of the *hill*, *ridge* or escarpment is 10 percent or greater.
2. The *hill*, *ridge* or escarpment is 60 feet (18 288 mm) or greater in height for Exposure B, 30 feet (9144 mm) or greater in height for Exposure C, and 15 feet (4572 mm) or greater in height for Exposure D.
3. The *hill*, *ridge* or escarpment is isolated or unobstructed by other topographic features of similar height in the upwind direction for a distance measured from its high point of 100 times its height or 2 miles (3.2 km), whichever is less. See Figure R301.2.1.5.1(3) for upwind obstruction.
4. The *hill*, *ridge* or escarpment protrudes by a factor of two or more above the height of other upwind topographic features located in any quadrant within a radius of 2 miles (3.2 km) measured from its high point.

R301.2.1.5.1 Simplified topographic wind speed-up method. As an alternative to the ASCE 7 topographic wind provisions, the provisions of Section R301.2.1.5.1 shall be permitted to be used to design for wind speed-up effects, where required by Section R301.2.1.5.

Structures located on the top half of isolated *hills*, ridges or escarpments meeting the conditions of Section R301.2.1.5 shall be designed for an increased basic wind speed as determined by Table R301.2.1.5.1. On the high side of an escarpment, the increased basic wind speed shall extend horizontally downwind from the edge of the escarpment 1.5 times the horizontal length of the upwind slope (1.5L) or 6 times the height of the escarpment (6H), whichever is greater. See Figure R301.2.1.5.1(2) for where wind speed increase is applied.

TABLE R301.2.1.5.1
ULTIMATE DESIGN WIND SPEED MODIFICATION FOR TOPOGRAPHIC WIND EFFECT^{a, b}

ULTIMATE DESIGN WIND SPEED FROM FIGURE R301.2(2) (mph)	AVERAGE SLOPE OF THE TOP HALF OF HILL, RIDGE OR ESCARPMENT (percent)						
	0.10	0.125	0.15	0.175	0.20	0.23	0.25
	Required ultimate design wind speed-up, modified for topographic wind speed-up (mph)						
95	114	119	123	127	131	137	140
100	120	125	129	134	138	144	147
105	126	131	135	141	145	151	154
110	132	137	142	147	152	158	162
115	138	143	148	154	159	165	169
120	144	149	155	160	166	172	176
130	156	162	168	174	179	NA	NA
140	168	174	181	NA	NA	NA	NA
150	180	NA	NA	NA	NA	NA	NA

For SI: 1 mile per hour = 0.447 m/s, 1 foot = 304.8 mm.

NA = Not Applicable.

a. Table applies to a feature height of 500 feet or less and dwellings sited a distance equal or greater than half the feature height.

b. Where the ultimate design wind speed as modified by Table R301.2.1.5.1 equals or exceeds 140 miles per hour, the building shall be considered as "wind design required" in accordance with Section R301.2.1.1.

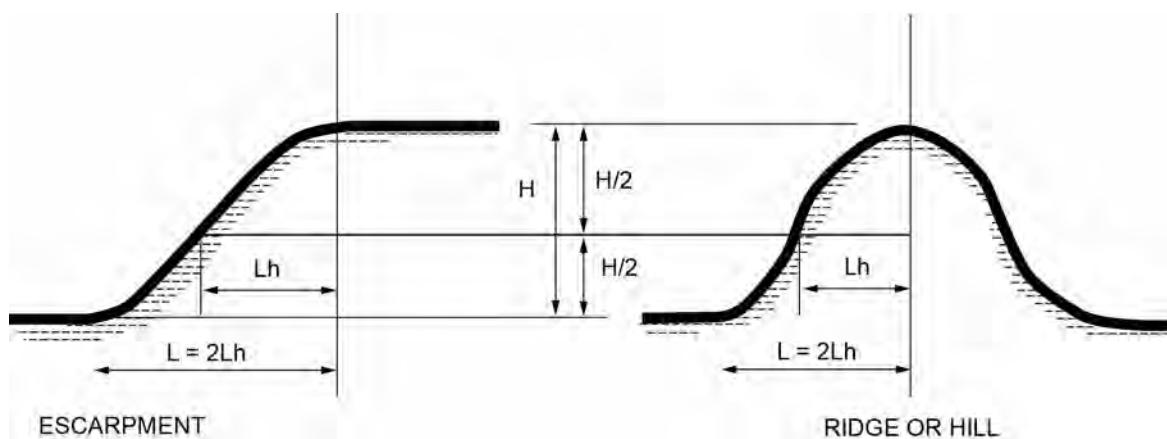


FIGURE R301.2.1.5.1(1)
TOPOGRAPHIC FEATURES FOR WIND SPEED-UP EFFECT

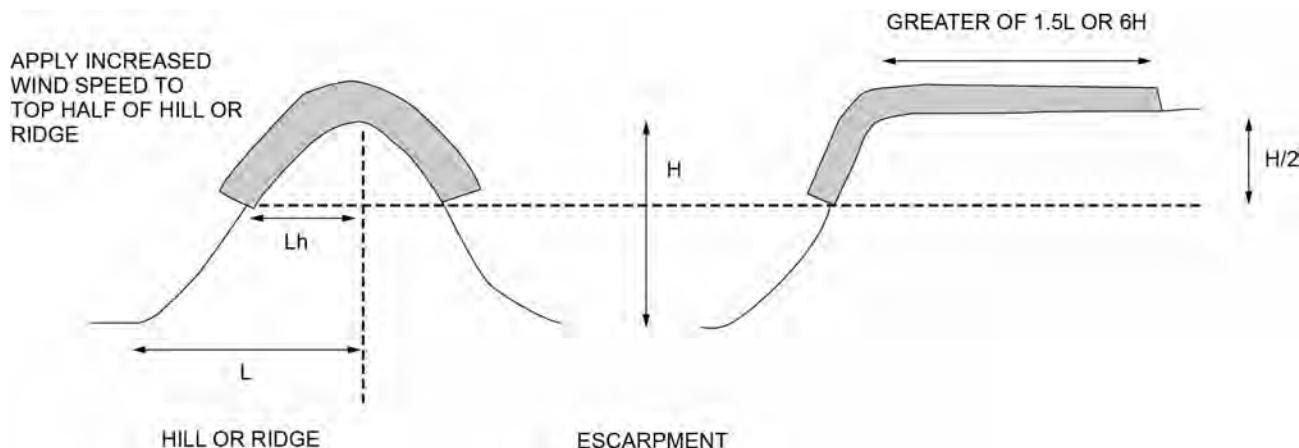
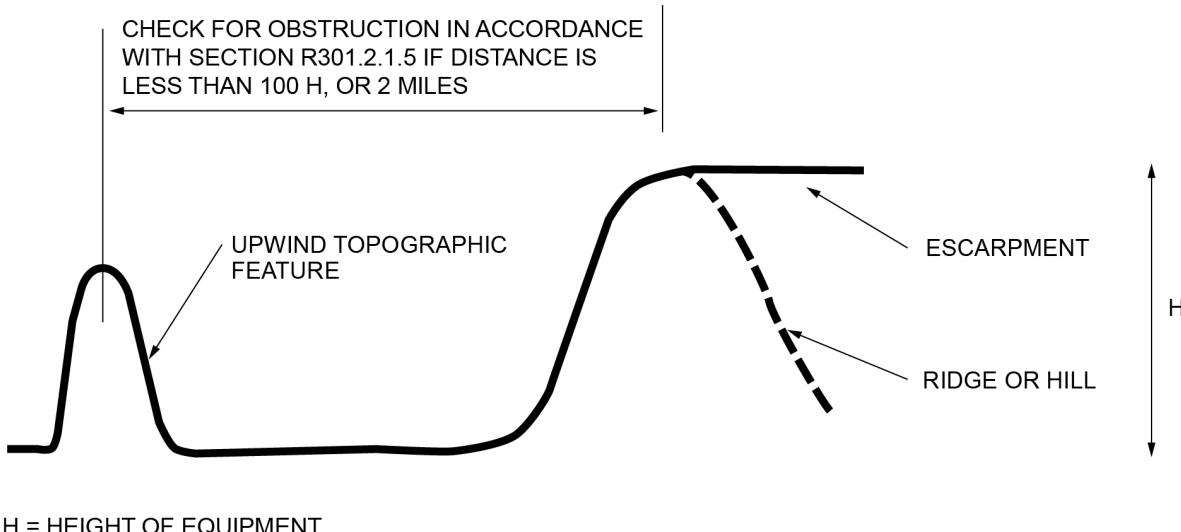


FIGURE R301.2.1.5.1(2)
ILLUSTRATION OF WHERE ON A TOPOGRAPHIC FEATURE, WIND SPEED INCREASE IS APPLIED

BUILDING PLANNING**FIGURE R301.2.1.5.1(3)
UPWIND OBSTRUCTION**

R301.2.2 Seismic provisions. Buildings in *Seismic Design Categories C, D₀, D₁ and D₂* shall be constructed in accordance with the requirements of this section and other seismic requirements of this code. The seismic provisions of this code shall apply as follows:

1. *Townhouses in Seismic Design Categories C, D₀, D₁ and D₂.*
2. *Detached one- and two-family dwellings in Seismic Design Categories, D₀, D₁ and D₂.*


Buildings in Seismic Design Category E shall be designed to resist seismic loads in accordance with the *International Building Code*, except where the seismic design category is reclassified to a lower seismic design category in accordance with Section R301.2.2.1. Components of buildings not required to be designed to resist seismic loads shall be constructed in accordance with the provisions of this code.

R301.2.2.1 Determination of seismic design category. Buildings shall be assigned a seismic design category in accordance with Figures R301.2.2.1(1) through R301.2.2.1(6).

R301.2.2.1.1 Alternate determination of seismic design category. If soil conditions are determined by the building official to be Site Class A, B, or D, the seismic design category and short-period design spectral response accelerations, S_{DS} , for a site shall be allowed to be determined in accordance with Figures R301.2.2.1.1(1) through R301.2.2.1.1(6), or Section 1613.2 of the *International Building Code*. The value of S_{DS} determined in accordance with Section 1613.2 of the *International Building Code* is permitted to be used to set the seismic design category in accordance with Table R301.2.2.1.1, and to interpolate between values in Tables R602.10.3(3) and R603.9.2(1) and other seismic design requirements of this code.

R301.2.2.1.2 Alternative determination of Seismic Design Category E. Buildings located in Seismic Design Category E in accordance with Figures R301.2.2.1(1) through R301.2.2.1(6), or Figures R301.2.2.1.1(1) through R301.2.2.1.1(6) where applicable, are permitted to be reclassified as being in Seismic Design Category D₂ provided that one of the following is done:

1. A more detailed evaluation of the seismic design category is made in accordance with the provisions and maps of the *International Building Code*. Buildings located in Seismic Design Category E in accordance with Table R301.2.2.1.1, but located in Seismic Design Category D in accordance with the *International Building Code*, shall be permitted to be designed using the Seismic Design Category D₂ requirements of this code.
2. Buildings located in Seismic Design Category E that conform to the following additional restrictions are permitted to be constructed in accordance with the provisions for Seismic Design Category D₂ of this code:
 - 2.1. All exterior shear wall lines or *braced wall panels* are in one plane vertically from the foundation to the uppermost story.
 - 2.2. Floors shall not cantilever past the *exterior walls*.
 - 2.3. The building is within the requirements of Section R301.2.2.6 for being considered as regular.

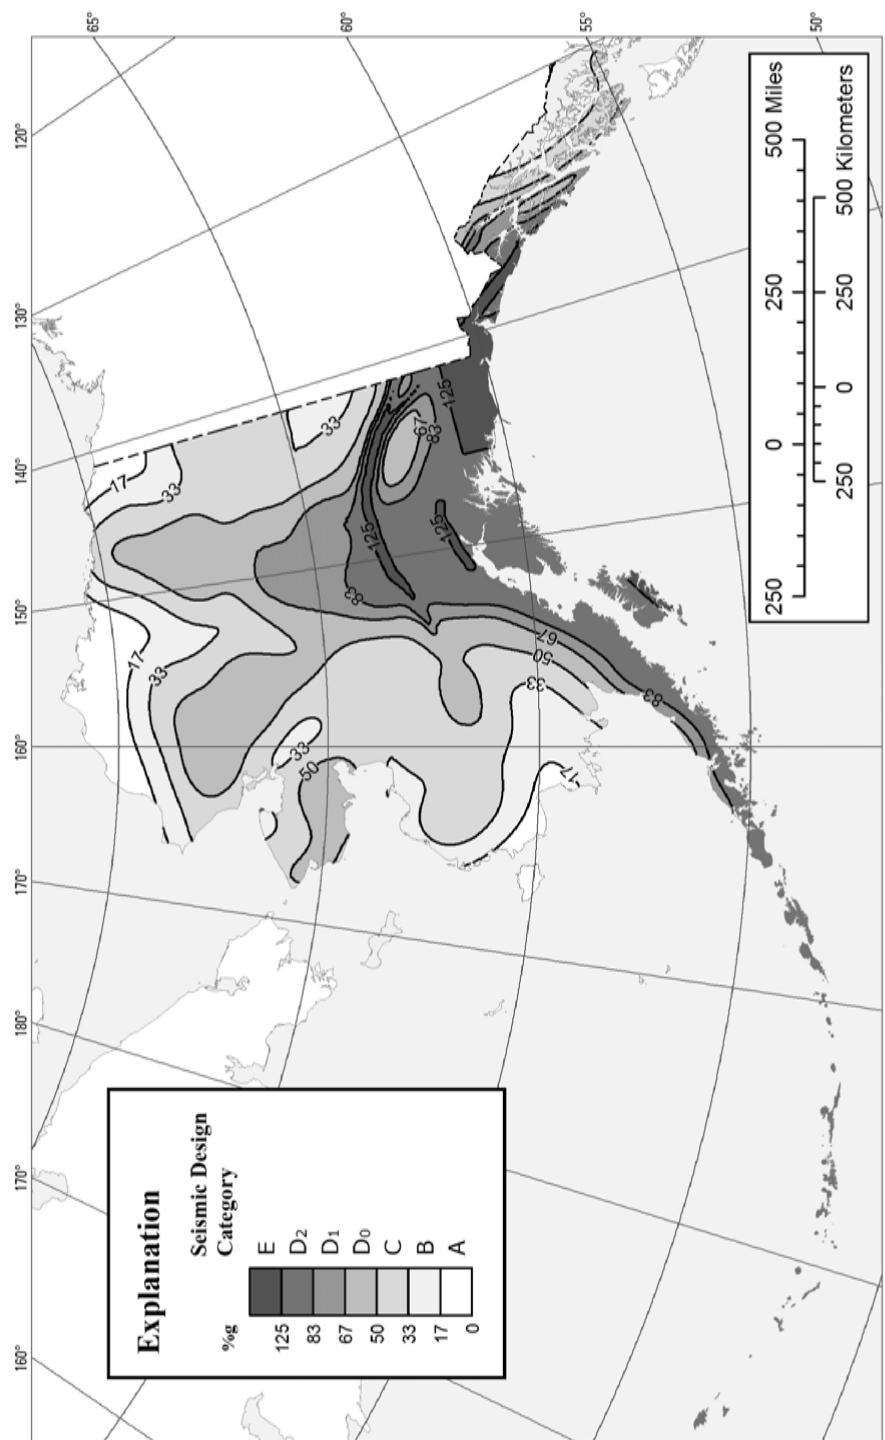

REFERENCES

- Building Seismic Safety Council. 2015. NEHRP Recommended Seismic Provisions for New Buildings and Other Structures (FEMA-P-650). Federal Emergency Management Agency, Washington, DC.
- Huang, Wei-Nan, Whittaker, A. S., and Liao, Nicolas. 2008. Maximum spectral demands in the near-fault region. Earthquake Spectra Volume 24, Issue 1, pp. 319-341.
- Liao, Nicolas, Ellingwood, B. R., Hamberger, R. O., Hooper, J. D., Kimball, J. X., and Kitcher, C. A., 2007. Risk-targeted versus current Seismic Design Maps for the Contaminated United States. Structural Engineers Association of California 2007 Convention Proceedings, pp. 165-175.
- Wesson, Robert L., Boyd, Oliver S., Mueller, Charles S., Butle, Charles G., Fankel, Arthur D., Petersen, Mark D., 2007. Revision of time-independent probabilistic seismic hazard maps for Alaska. U.S. Geological Survey Open-File Report 2007-1043.

**FIGURE R301.2.2.1(1)
SEISMIC DESIGN CATEGORIES—ALASKA^a**

a. The seismic design categories and corresponding short-period design spectral response accelerations, S_{d5} , shown in Figures R301.2.2.1(1) through 301.2.2.1(6) are based on soil Site Class D, used as an assumed default, as defined in Section 1613.2.2 of the *International Building Code*.


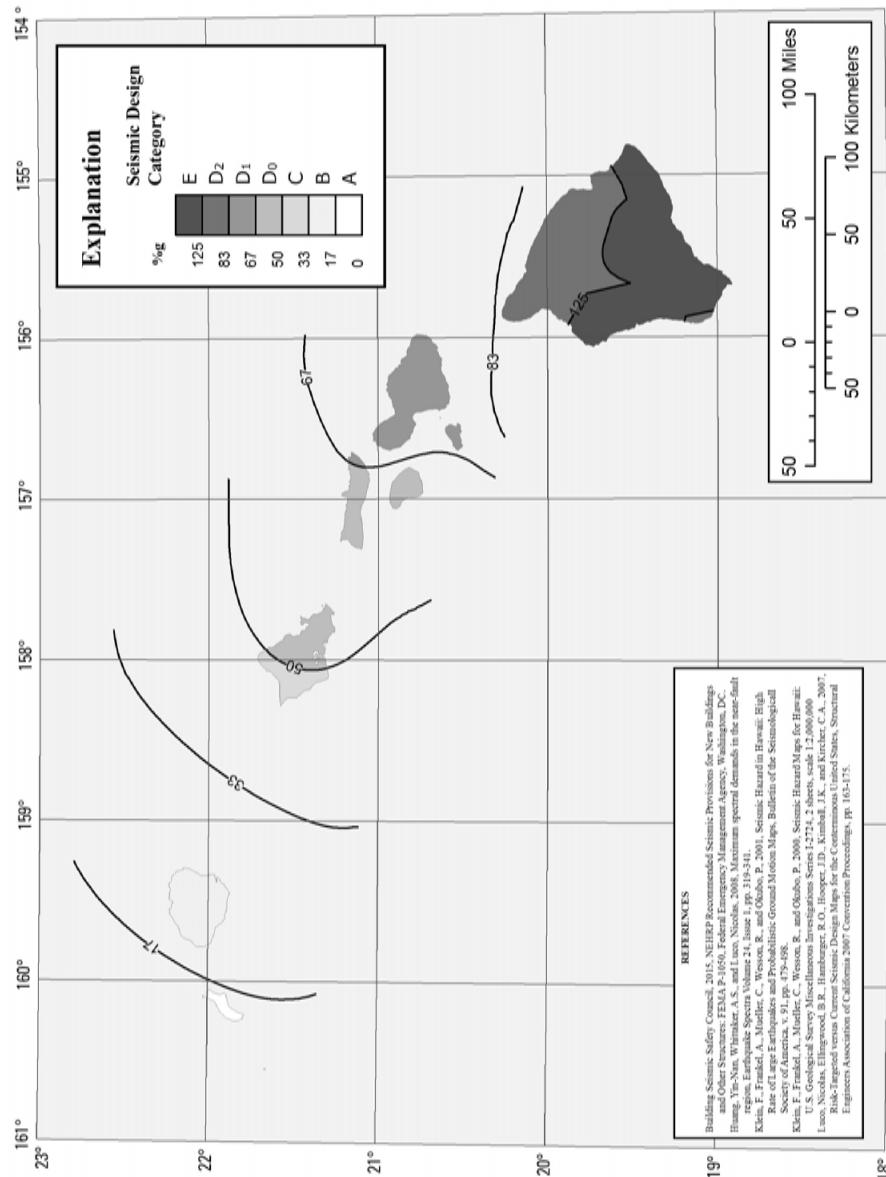


FIGURE R301.2.2.1(2)
SEISMIC DESIGN CATEGORIES—HAWAII^a

- a. The seismic design categories and corresponding short-period design spectral response accelerations, S_{D5} , shown in Figures R301.2.2.1(1) through 301.2.2.1(6) are based on soil Site Class D, used as an assumed default, as defined in Section 1613.2.2 of the *International Building Code*.

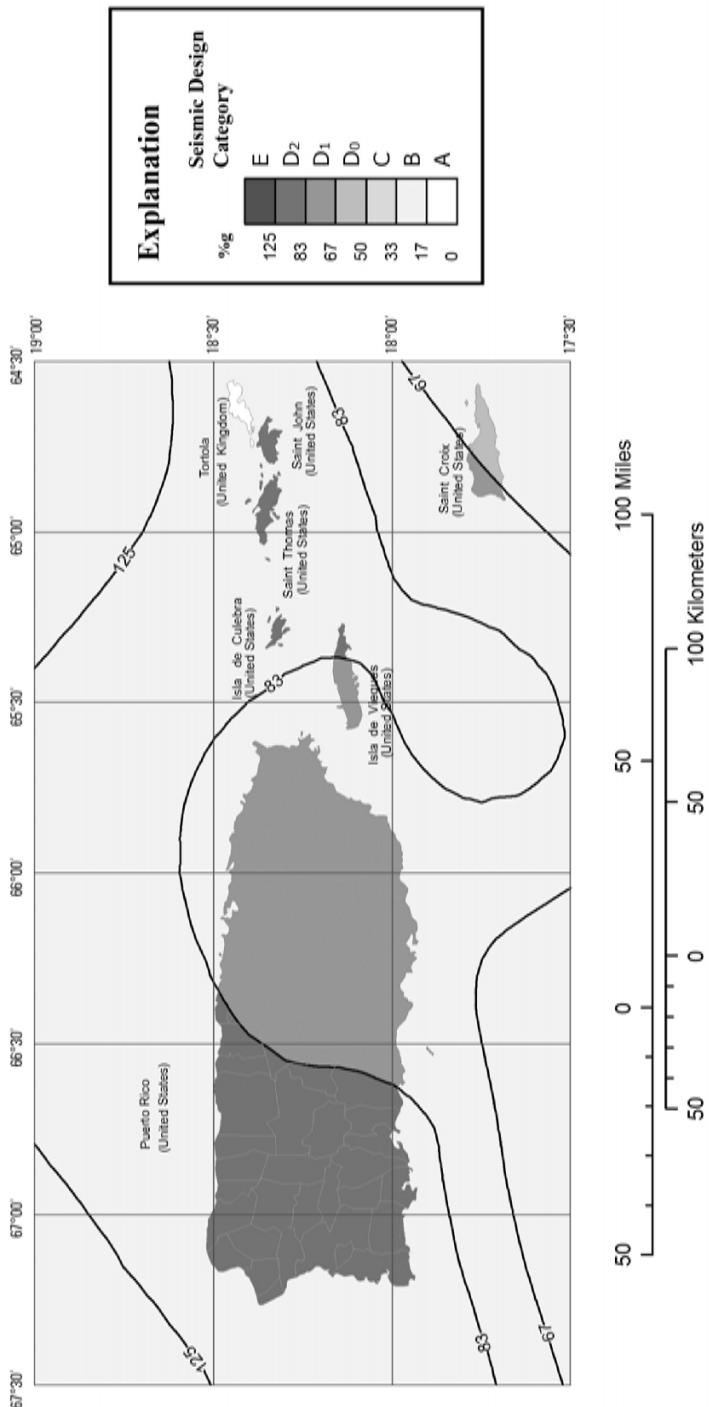

REFERENCES


- Building Seismic Safety Council, 2015. NEHRP Recommended Seismic Provisions for New Buildings and Other Structures: FEMA P-600. Federal Emergency Management Agency, Washington, DC.
- Huang, Yen-Nan, Whittaker, A. S., and Liao, Nicolas, 2008. Maximum spectral demands in the near-fault region. Earthquake Spectra Volume 24, Issue 1, PP. 319-341.
- Liao, Nicolas, Ellingwood, B. R., Hamberger, R. O., Hooper, J.D., Kirbilash, J.K., and Kiebler, C.A., 2007. Risk-Targeted Versus Current Seismic Maps for the Contiguous United States, Structural Engineers Association of California 2007 Convention Proceedings, PP. 165-175.
- Musler, C., Frankel, A., Petersen, M., and Liersecker, E., 2003. Documentation for 2003 USGS Seismic Hazard Maps for Puerto Rico and the U.S. Virgin Islands, U.S. Geological Survey Open-File Report 03-379.

Map prepared by U.S. Geological Survey in collaboration with the Federal Emergency Management Agency (FEMA)-Standards Building Seismic Safety Council's (BSSC) Code Resource Support Committee (CRSC).

- a. The seismic design categories and corresponding short-period design spectral response accelerations, S_{DyS} , shown in Figures R301.2.2.1(1) through 301.2.2.1(6) are based on soil Site Class D, used as an assumed default, as defined in Section 1613.2.2 of the *International Building Code*.


FIGURE R301.2.2.1(3)
SEISMIC DESIGN CATEGORIES—PUERTO RICO^a

BUILDING PLANNING

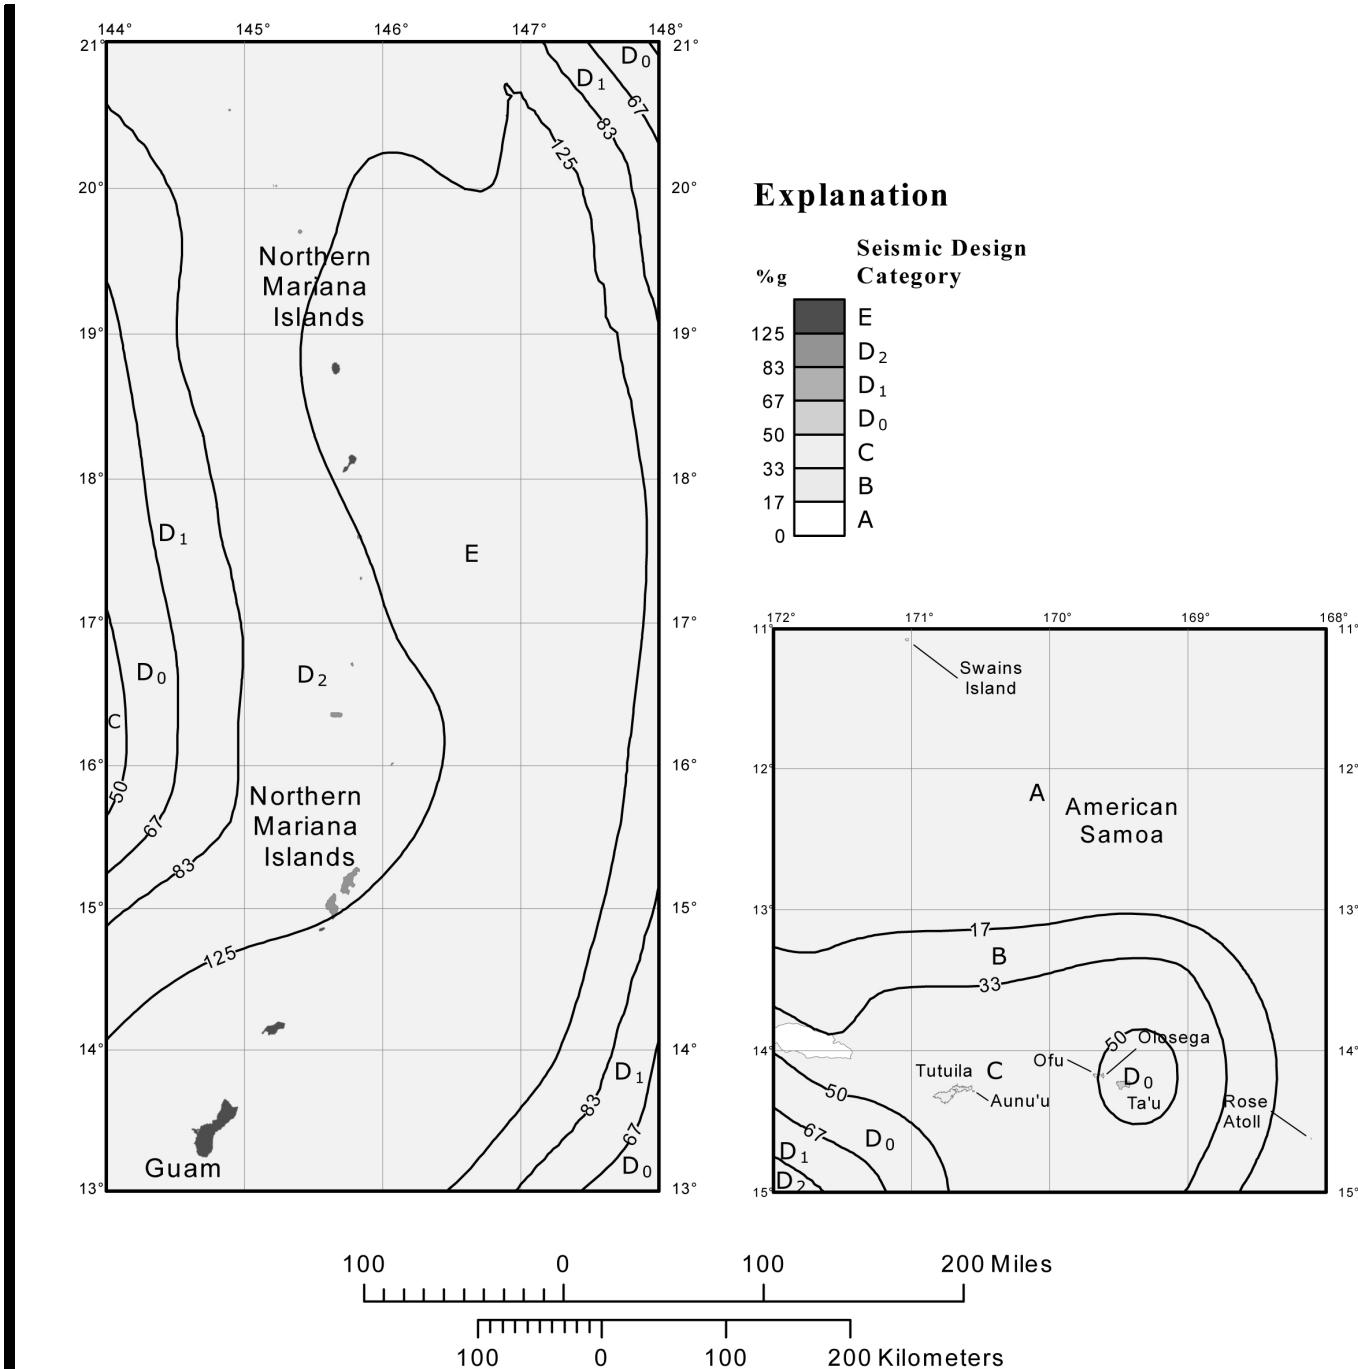


a. The seismic design categories and corresponding short-period design spectral response accelerations, S_{D5} , shown in Figures R301.2.2.1(1) through 301.2.2.1(6) are based on soil Site Class D, used as an assumed default, as defined in Section 1613.2.2 of the *International Building Code*.

FIGURE R301.2.2.1(4)
SEISMIC DESIGN CATEGORIES—NORTHERN MARIANA ISLANDS AND AMERICAN SAMOA^a

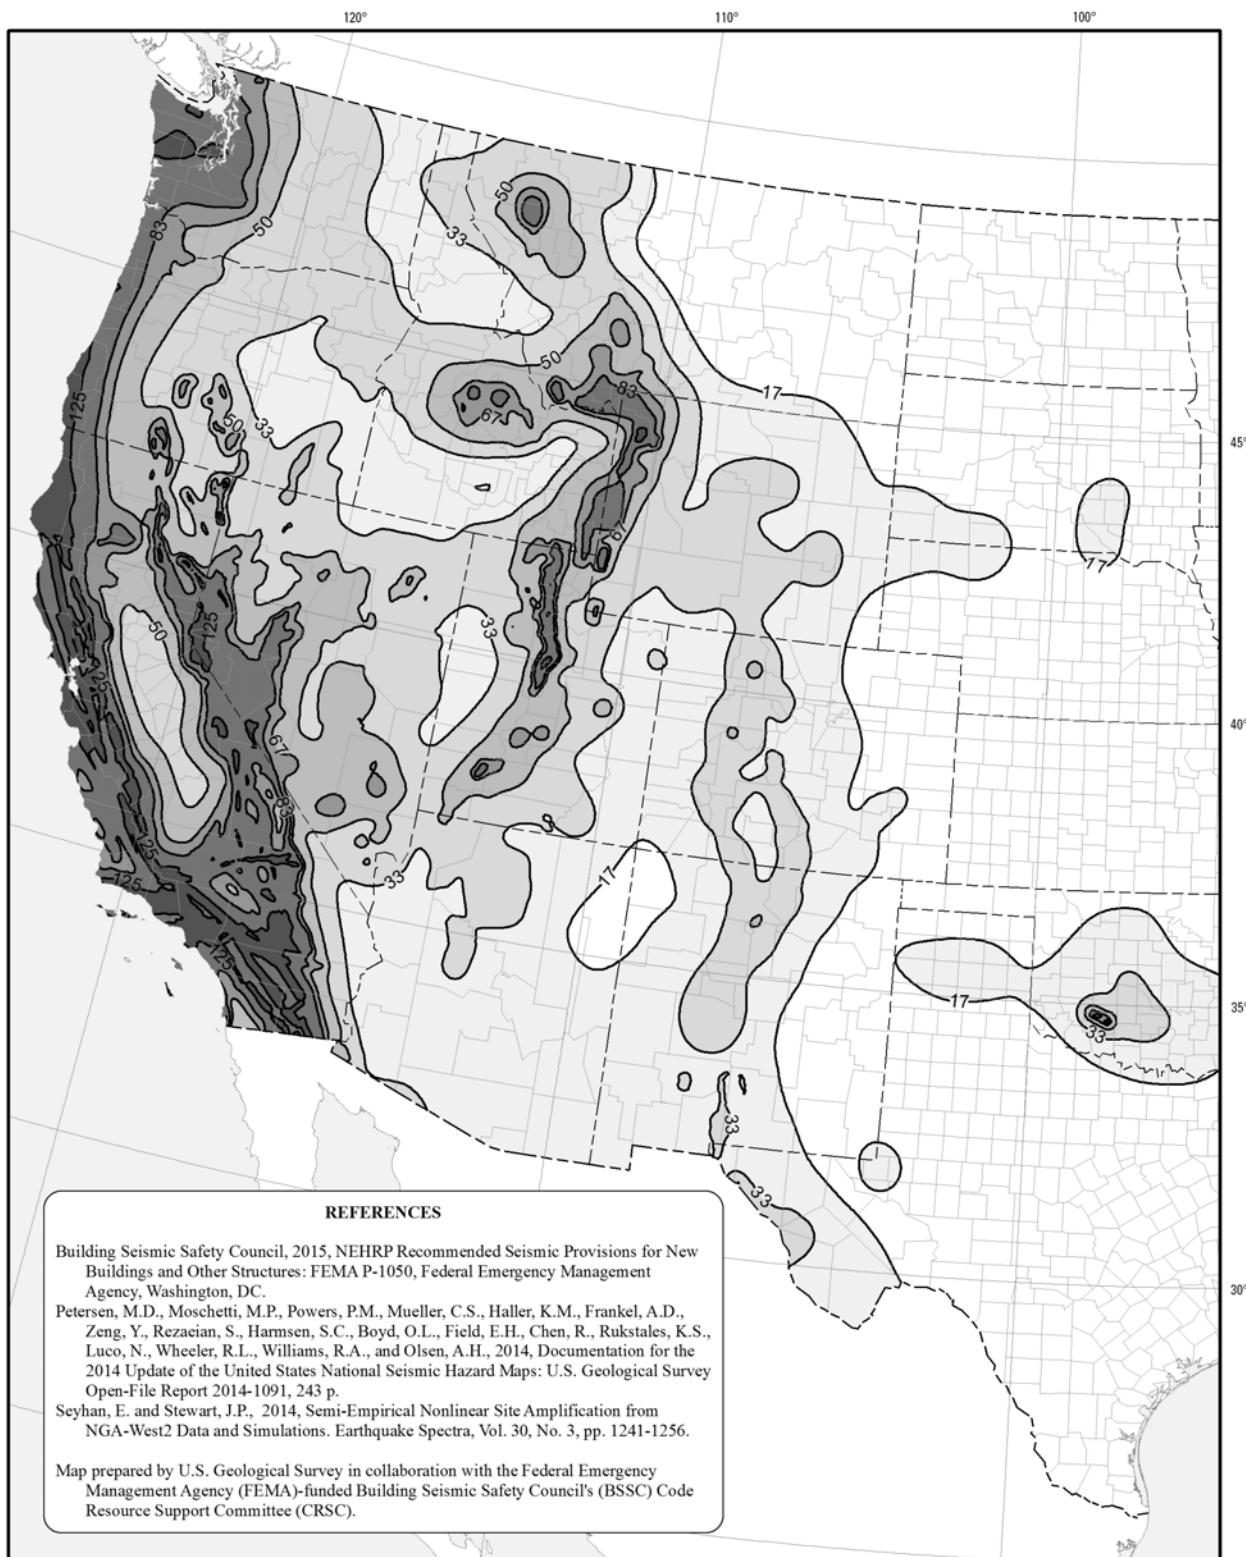BUILDING PLANNING


- a. The seismic design categories and corresponding short-period design spectral response accelerations, S_{DS} , shown in Figures R301.2.2.1(1) through 301.2.2.1(6) are based on soil Site Class D, used as an assumed default, as defined in Section 1613.2.2 of the *International Building Code*.

FIGURE R301.2.2.1(5)
SEISMIC DESIGN CATEGORIES—UNITED STATES^a

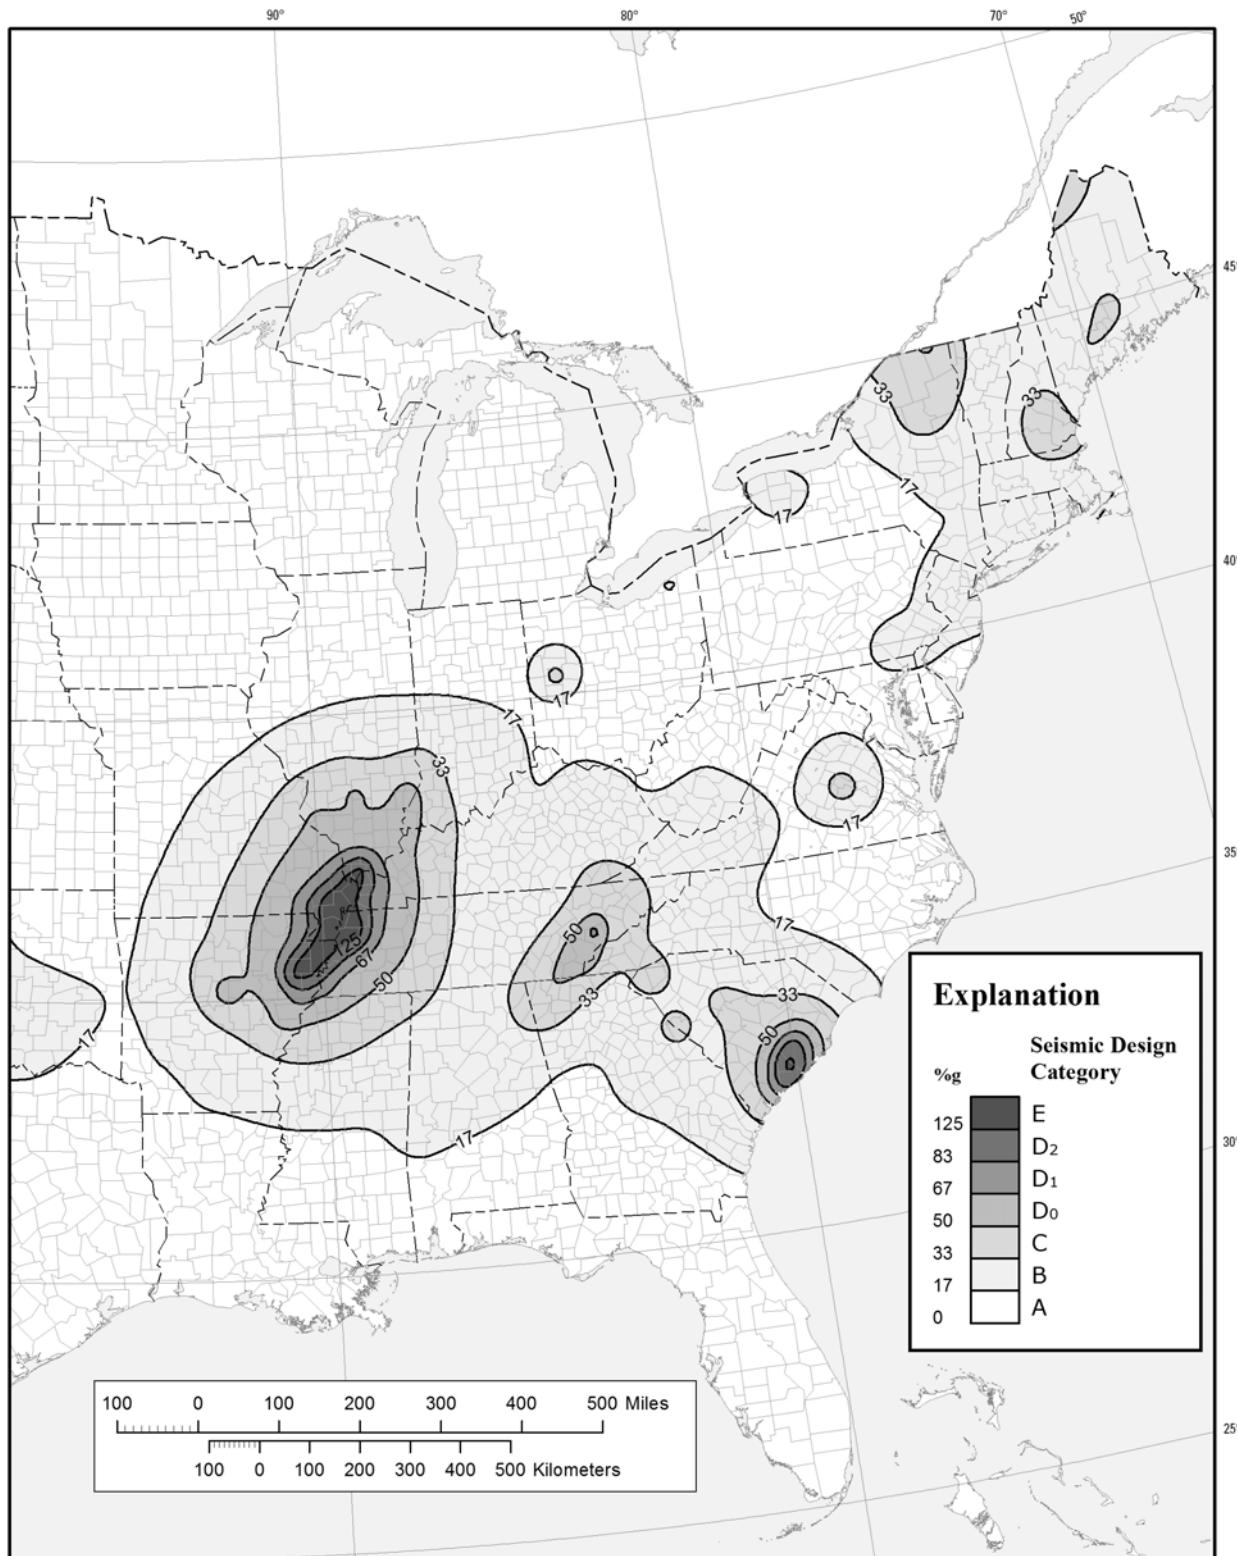

- a. The seismic design categories and corresponding short-period design spectral response accelerations, S_{Dg} , shown in Figures R301.2.2.1(1) through 301.2.2.1(6), are based on soil Site Class D, used as an assumed default, as defined in Section 1613.2.2 of the *International Building Code*.

FIGURE R301.2.2.1(6)
SEISMIC DESIGN CATEGORIES—UNITED STATES^a

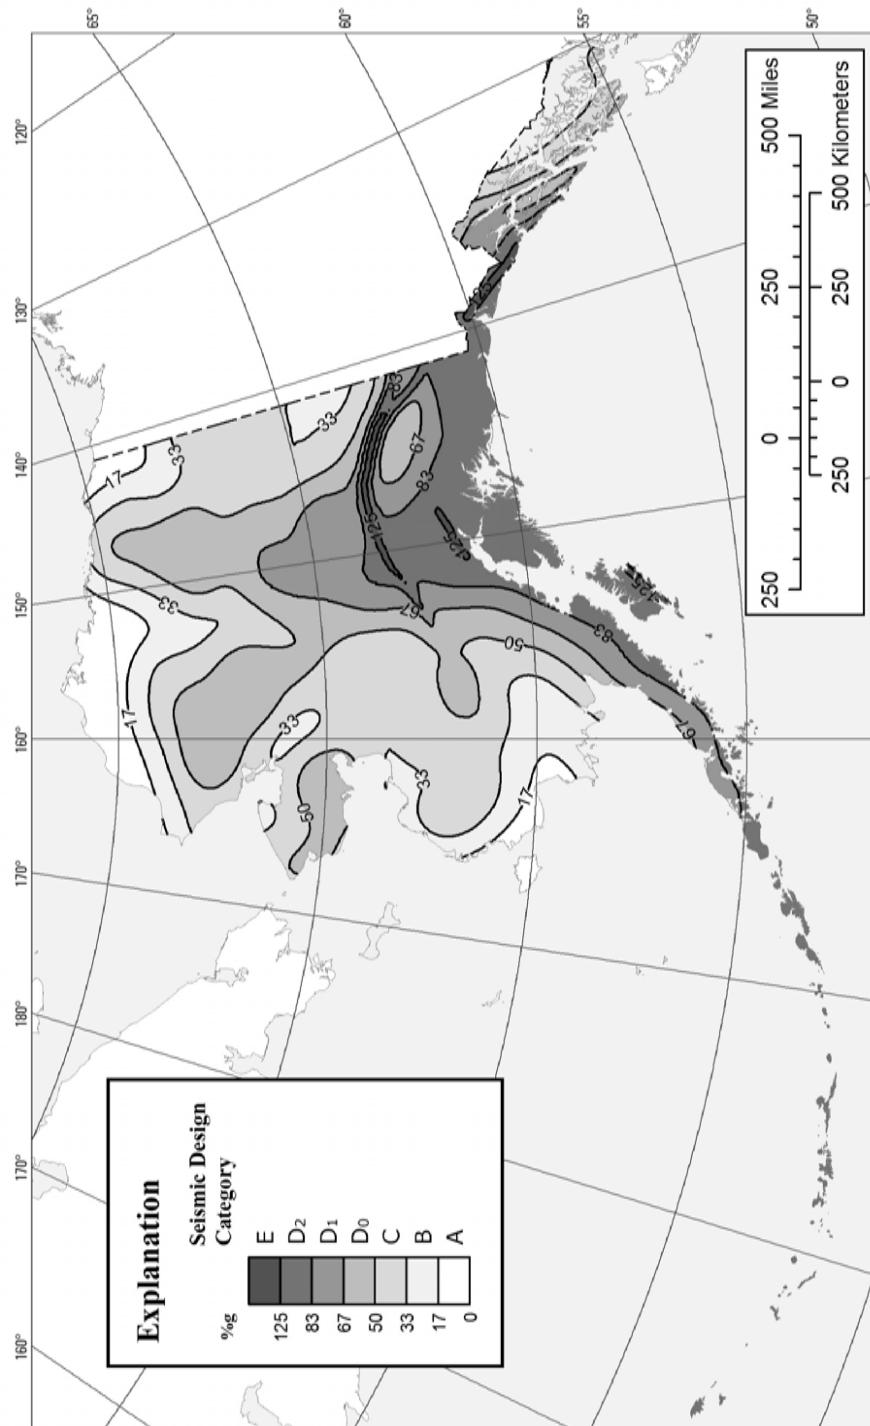


Map prepared by U.S. Geological Survey in collaboration with the Federal Emergency Management Agency (FEMA)-funded Building Seismic Safety Council's (BSSC) Code Resource Support Committee (CRSC).

Building Seismic Safety Council. 2015. NEHRP Recommended Seismic Provisions for New Buildings and Other Structures (FEMA P-606). Federal Emergency Management Agency, Washington, DC.
 Huang, Yin-Nien, and Wilcock, A.S., and Liao, Nicolas. 2008. Maximum spectral demands in the near-fault region. Earthquake Spectra, Volume 24, Issue 1, pp. 319-341.
 Lieno, Nicolas, Ellingwood, B.R., Hambberger, R.O., Hooper, J.D., Kimball, J.K., and Kitcher, C.A., 2007, Risk Targeted versus Current Seismic Design Maps for the Conterminous United States, Structural Engineering Association of California 2007 Conference Proceedings, pp. 165-175.
 Wesson, Robert L., Boyd, Oliver S., Mueller, Charles S., Bufe, Charles G., Franklin, Arthur D., Petersen, Mark D., 2007, Revision of site-independent probabilistic seismic hazard maps for Alaska: U.S. Geological Survey Open-File Report 2007-1043.

- a. The seismic design categories and corresponding short-period design spectral response accelerations, S_{D5} , shown in Figures R301.2.2.1(1) through 301.2.2.1(6) are permitted to be used where soil conditions are determined by the building official to be Site Class A, B or D.


**FIGURE R301.2.2.1(1)
ALTERNATE SEISMIC DESIGN CATEGORIES—ALASKA^a**

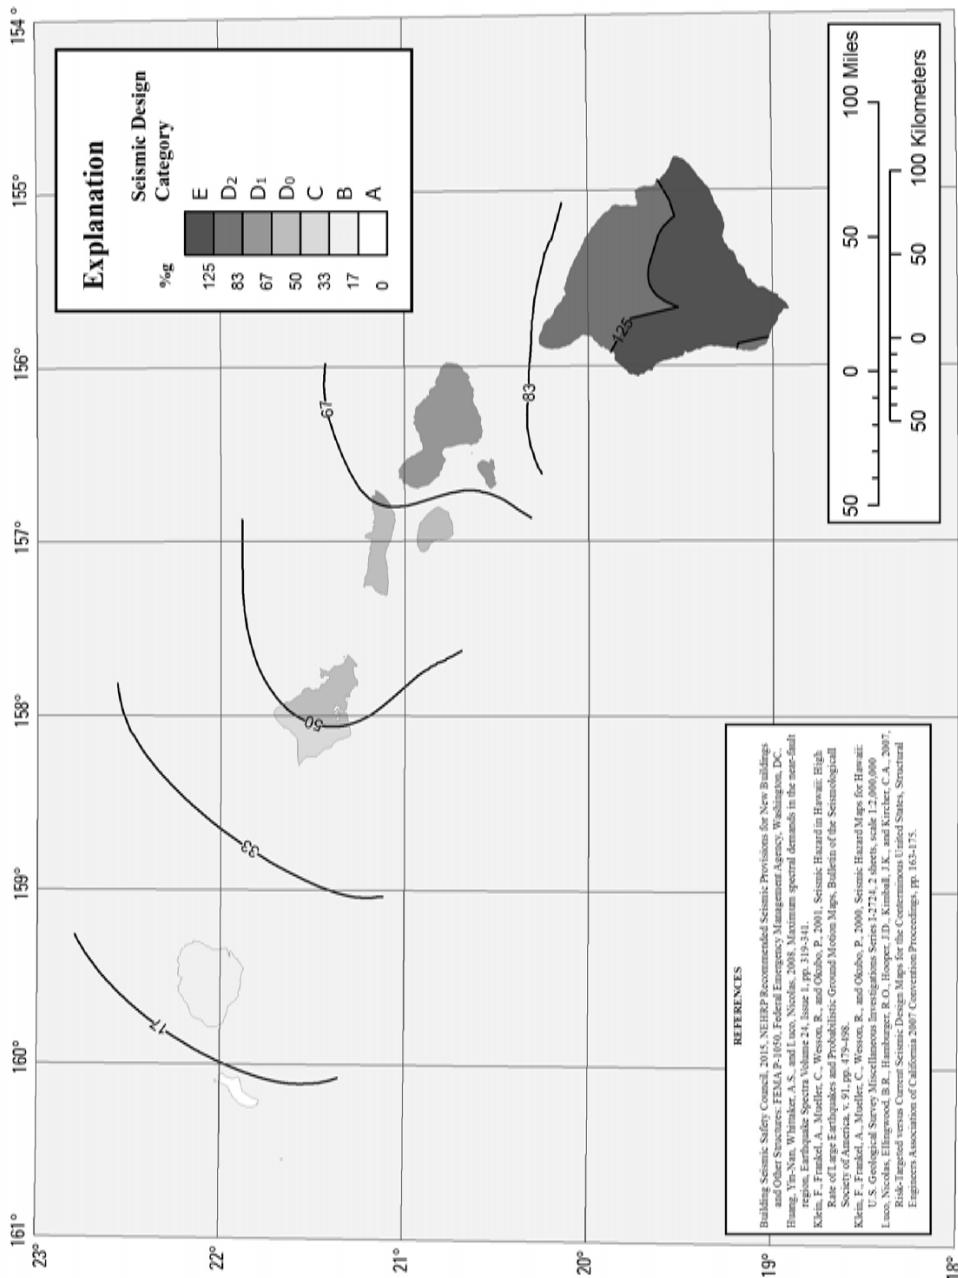

Map prepared by U.S. Geological Survey in collaboration with the Federal Emergency Management Agency's (FEMA)-funded B Building Seismic Survey Committee's (BSSC) Code Resource Support Committee (CRSC).

- a. The seismic design categories and corresponding short-period design spectral response accelerations, S_{DSS} , shown in Figures R301.2.2.1.1(1) through 301.2.2.1.1(6) are permitted to be used where soil conditions are determined by the building official to be Site Class A, B or D.

**FIGURE R301.2.2.1.1(2)
ALTERNATE SEISMIC DESIGN CATEGORIES—HAWAII^a**

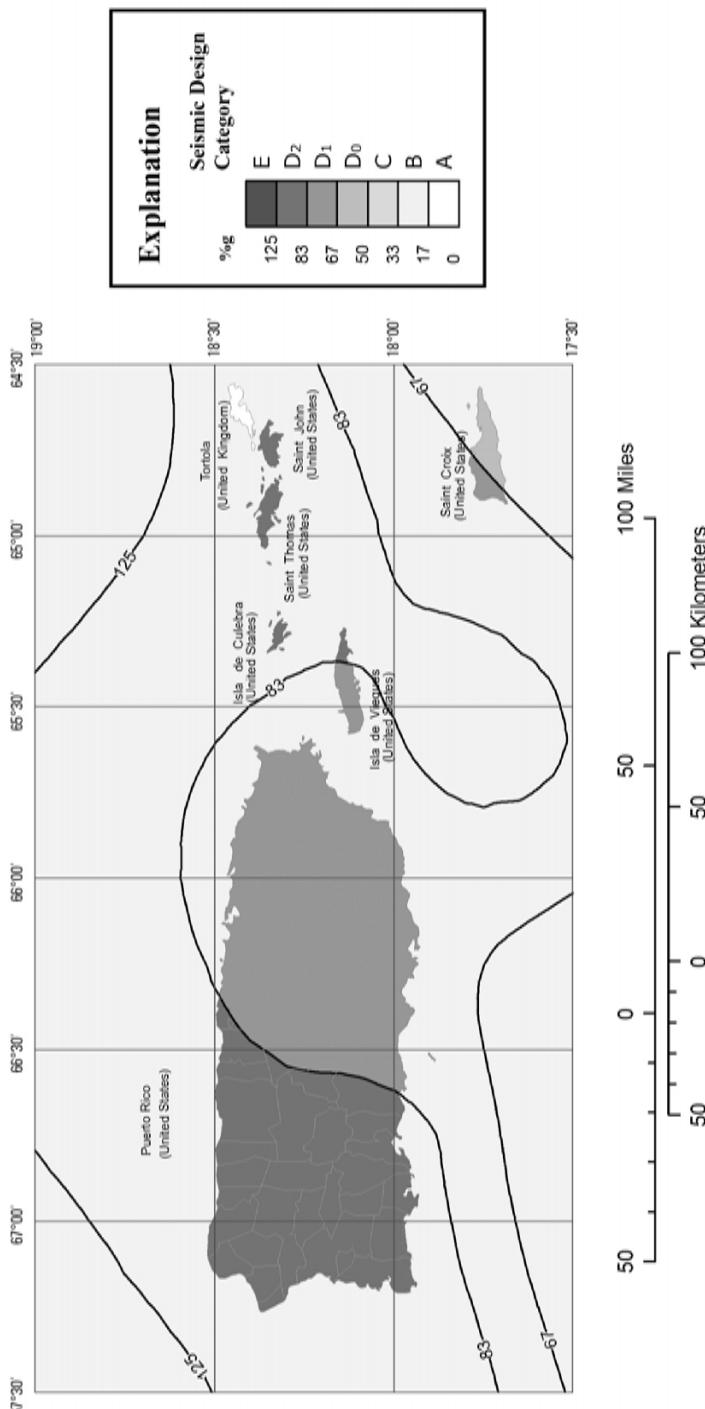
**REFERENCES**

- Building Seismic Safety Council. 2015. NEHRP Recommended Seismic Provisions for New Buildings and Other Structures. FEMA P-650. Federal Emergency Management Agency, Washington, DC.
- Huang, Yen-Nan, Whittaker, A. S., and Luo, Nicolas. 2008. Maximum spectral demands in the near-fault region. Earthquake Spectra Volume 24, Issue 1, pp. 319-341.
- Luo, Nicolas, Ellingwood, B. R., Hamburger, R. O., Hooper, J.D., Kimball, J.K., and Kieffer, C.A., 2007. Risk-Informed versus Current Seismic Design Maps for the Contiguous United States. Structural Engineers Association of California 2007 Convention Proceedings, pp. 165-175.
- Musler, C., Frankel, A., Petersen, M., and Liersecker, E., 2003. Documentation for 2003 USGS Seismic Hazard Maps for Puerto Rico and the U.S. Virgin Islands. U.S. Geological Survey Open-File Report 03-579.

- a. The seismic design categories and corresponding short-period design spectral response accelerations, S_{Dg} , shown in Figures R301.2.2.1.1(1) through 301.2.2.1.1(6) are permitted to be used where soil conditions are determined by the building official to be Site Class A, B or D.


**FIGURE R301.2.2.1.13
ALTERNATE SEISMIC DESIGN CATEGORIES—PUERTO RICO^a**

BUILDING PLANNING

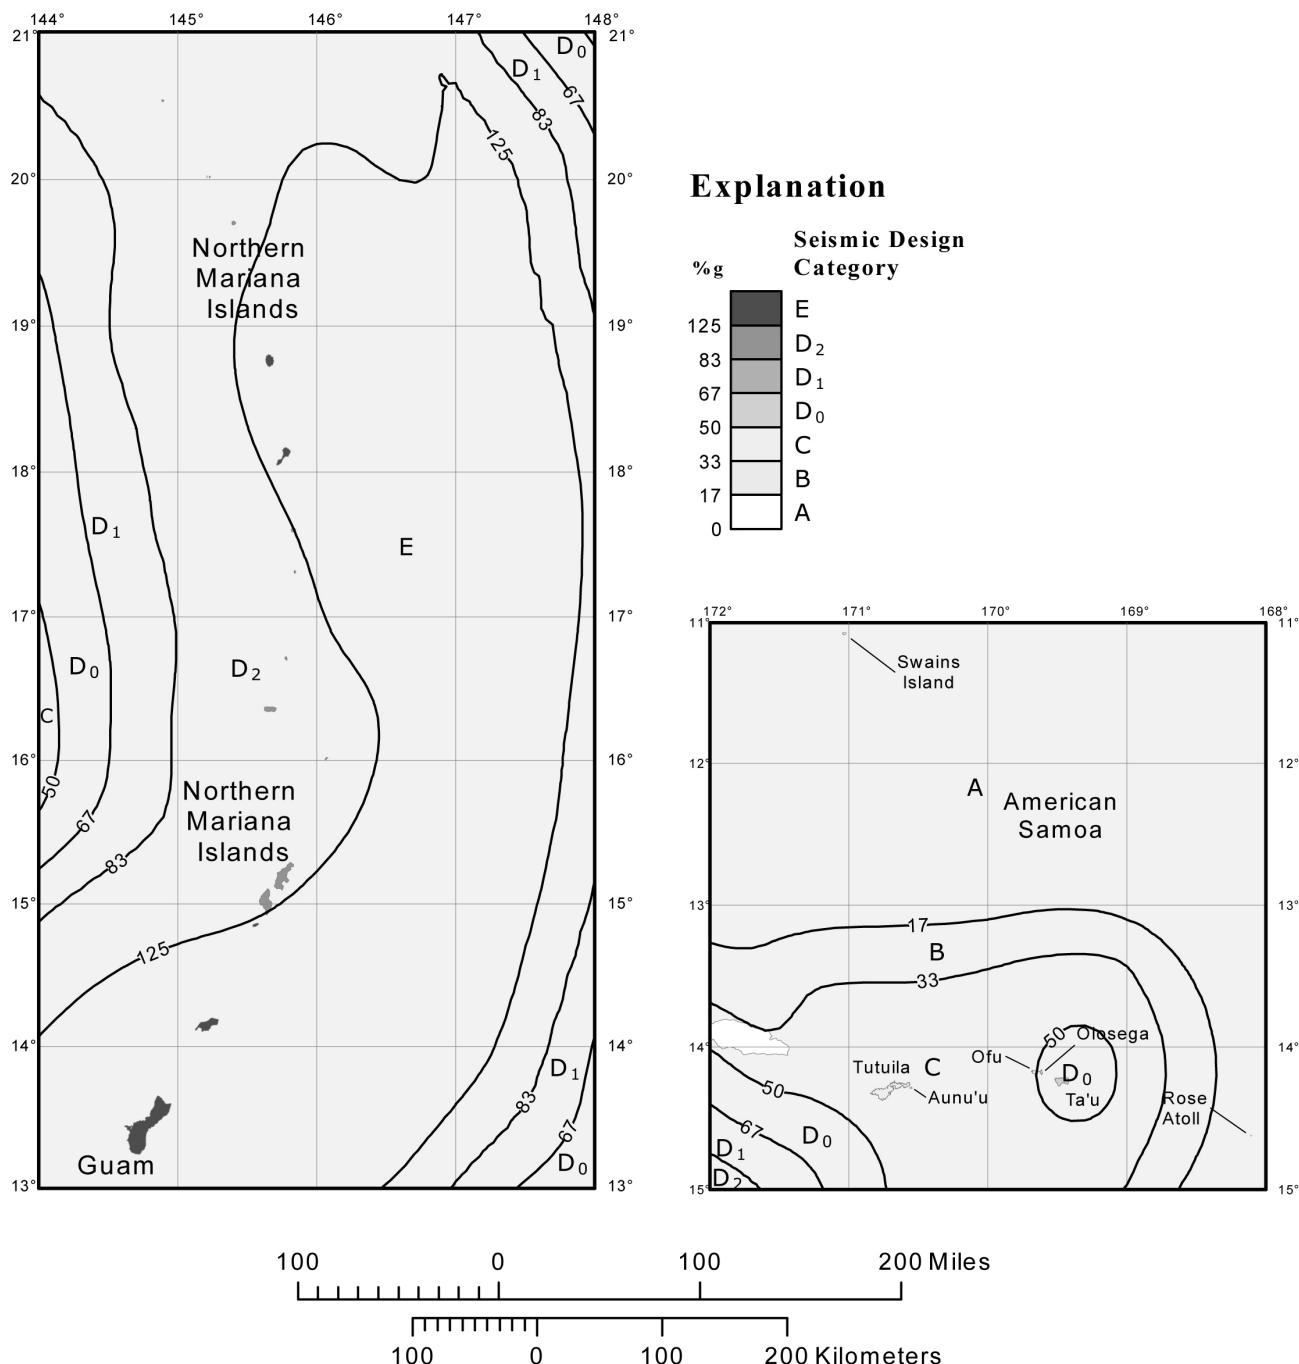

- a. The seismic design categories and corresponding short-period design spectral response accelerations, S_{DS} , shown in Figures R301.2.2.1.1(1) through 301.2.2.1.1(6) are permitted to be used where soil conditions are determined by the building official to be Site Class A, B or D.


FIGURE R301.2.2.1.1(4)
ALTERNATE SEISMIC DESIGN CATEGORIES—NORTHERN MARIANA ISLANDS AND AMERICAN SAMOA^a

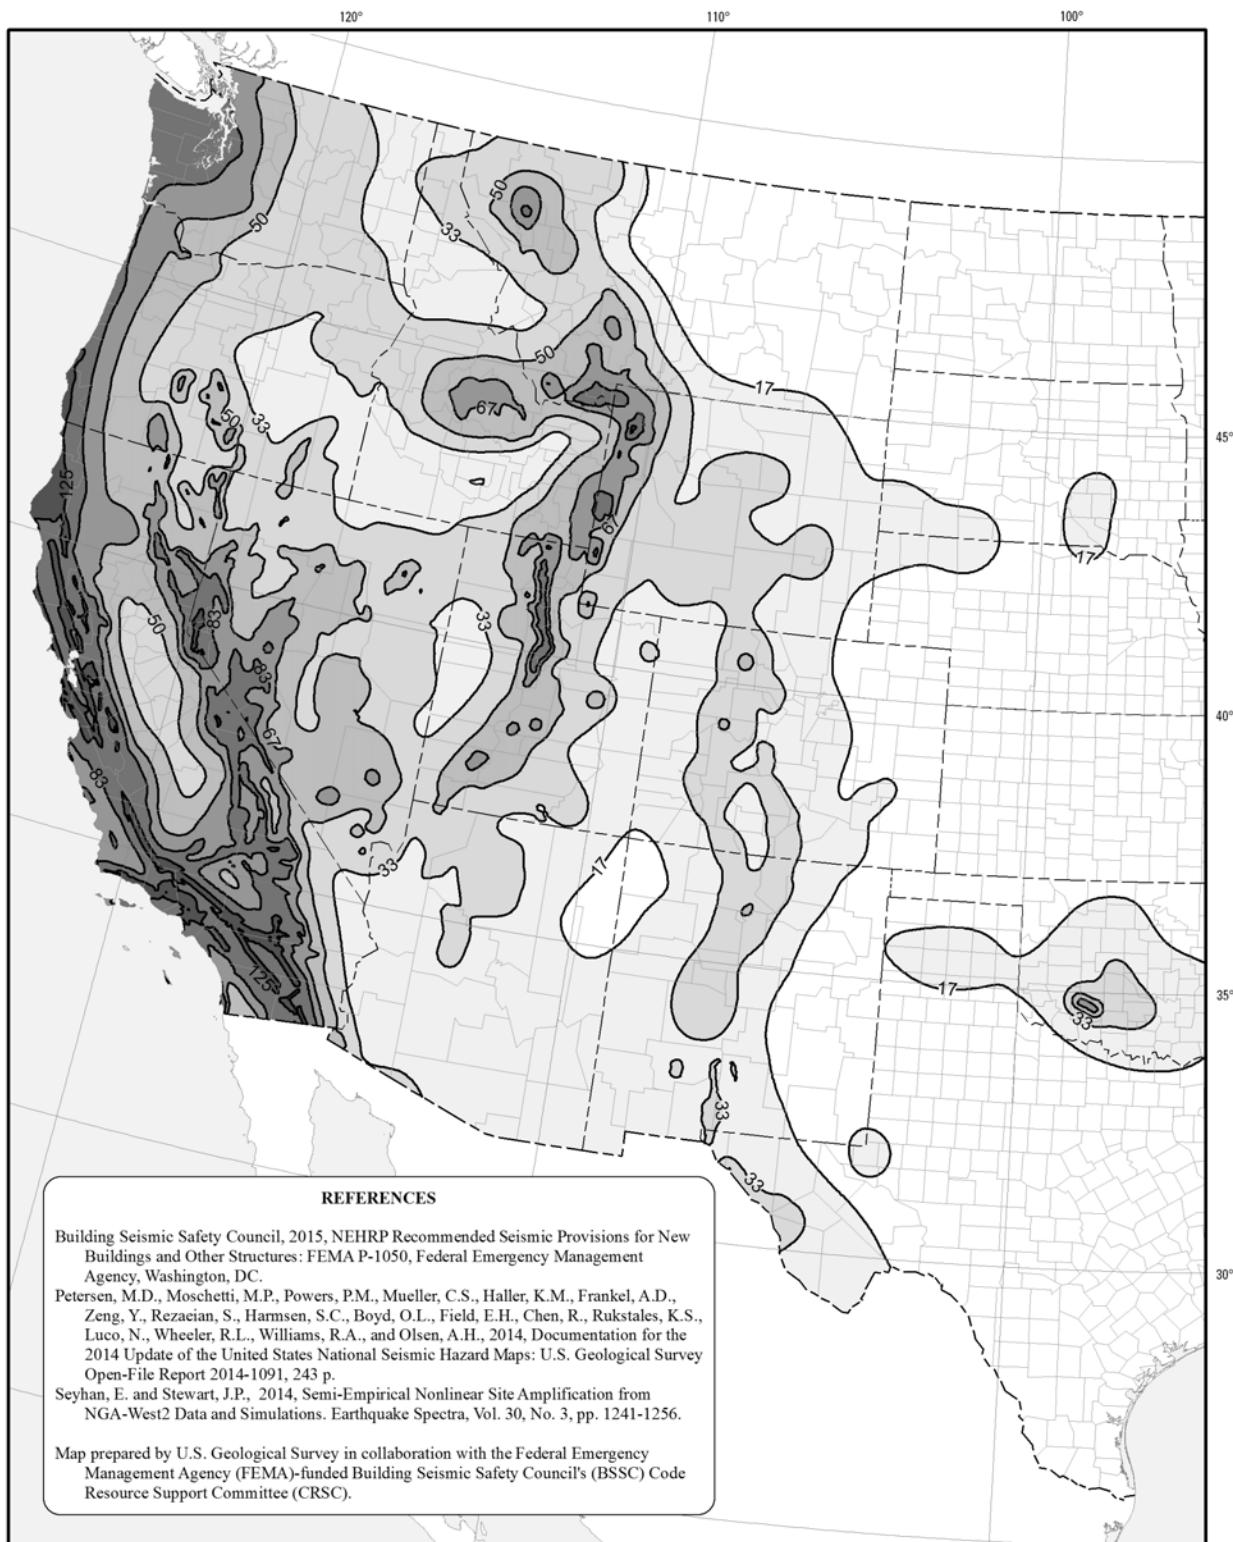

- a. The seismic design categories and corresponding short-period design spectral response accelerations, S_{DS} , shown in Figures R301.2.2.1.1(1) through 301.2.2.1.1(6) are permitted to be used where soil conditions are determined by the building official to be Site Class A, B or D.

FIGURE R301.2.2.1.1(5)
ALTERNATE SEISMIC DESIGN CATEGORIES—UNITED STATES^a

BUILDING PLANNING

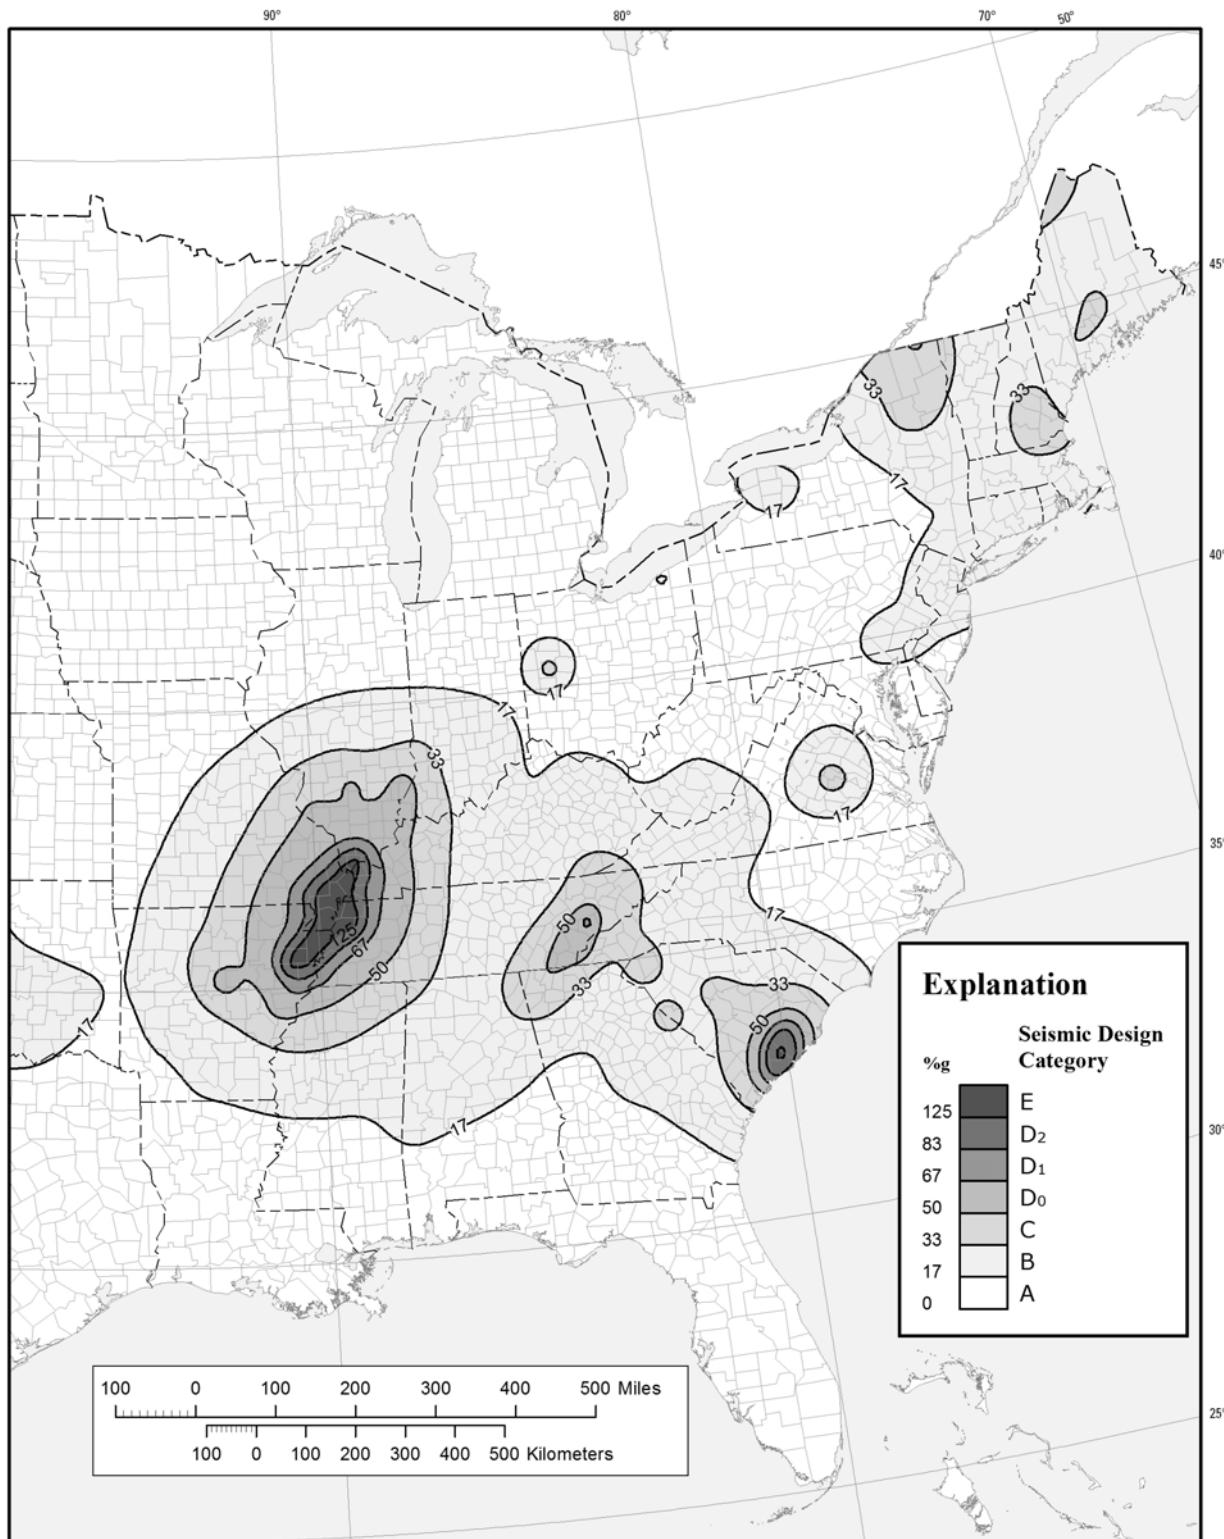

- a. The seismic design categories and corresponding short-period design spectral response accelerations, S_{DS} , shown in Figures R301.2.2.1.1(1) through 301.2.2.1.1(6) are permitted to be used where soil conditions are determined by the building official to be Site Class A, B or D.

FIGURE R301.2.2.1.1(6)
ALTERNATE SEISMIC DESIGN CATEGORIES—UNITED STATES^a

**TABLE R301.2.2.1.1
SEISMIC DESIGN CATEGORY DETERMINATION**

CALCULATED S_{DS}	SEISMIC DESIGN CATEGORY
$S_{DS} \leq 0.17g$	A
$0.17g < S_{DS} \leq 0.33g$	B
$0.33g < S_{DS} \leq 0.50g$	C
$0.50g < S_{DS} \leq 0.67g$	D ₀
$0.67g < S_{DS} \leq 0.83g$	D ₁
$0.83g < S_{DS} \leq 1.25g$	D ₂
$1.25g < S_{DS}$	E

R301.2.2.2 Weights of materials. Average dead loads shall not exceed 15 pounds per square foot (720 Pa) for the combined roof and ceiling assemblies (on a horizontal projection) or 10 pounds per square foot (480 Pa) for floor assemblies, except as further limited by Section R301.2.2. Dead loads for walls above *grade* shall not exceed:

1. Fifteen pounds per square foot (720 Pa) for exterior light-frame wood walls.
2. Fourteen pounds per square foot (670 Pa) for exterior light-frame cold-formed steel walls.
3. Ten pounds per square foot (480 Pa) for interior light-frame wood walls.
4. Five pounds per square foot (240 Pa) for interior light-frame cold-formed steel walls.
5. Eighty pounds per square foot (3830 Pa) for 8-inch-thick (203 mm) masonry walls.
6. Eighty-five pounds per square foot (4070 Pa) for 6-inch-thick (152 mm) concrete walls.
7. Ten pounds per square foot (480 Pa) for SIP walls.

Exceptions:

1. Roof and ceiling dead loads not exceeding 25 pounds per square foot (1190 Pa) shall be permitted provided that the wall bracing amounts in Section R602.10.3 are increased in accordance with Table R602.10.3(4).
2. Light-frame walls with stone or masonry veneer shall be permitted in accordance with the provisions of Sections R702.1 and R703.
3. Fireplaces and chimneys shall be permitted in accordance with Chapter 10.

R301.2.2.3 Stone and masonry veneer. Anchored stone and masonry veneer shall comply with the requirements of Sections R702.1 and R703.

R301.2.2.4 Masonry construction. Masonry construction in *Seismic Design Categories* D₀ and D₁ shall comply with the requirements of Section R606.12.1. Masonry construction in Seismic Design Category D₂ shall comply with the requirements of Section R606.12.4.

R301.2.2.5 Concrete construction. Buildings with exterior above-grade concrete walls shall comply with PCA 100 or shall be designed in accordance with ACI 318.

Exception: Detached one- and two-family dwellings in Seismic Design Category C with exterior above-grade concrete walls are allowed to comply with the requirements of Section R608.

R301.2.2.6 Irregular buildings. The seismic provisions of this code shall not be used for structures, or portions thereof, located in *Seismic Design Categories* C, D₀, D₁ and D₂ and considered to be irregular in accordance with this section. A building or portion of a building shall be considered to be irregular where one or more of the conditions defined in Items 1 through 8 occur. Irregular structures, or irregular portions of structures, shall be designed in accordance with accepted engineering practice to the extent the irregular features affect the performance of the remaining structural system. Where the forces associated with the irregularity are resisted by a structural system designed in accordance with accepted engineering practice, the remainder of the building shall be permitted to be designed using the provisions of this code.

1. **Shear wall or braced wall offsets out of plane.** Conditions where exterior *shear wall* lines or *braced wall panels* are not in one plane vertically from the foundation to the uppermost story in which they are required.

Exception: For wood *light-frame construction*, floors with cantilevers or setbacks not exceeding four times the nominal depth of the wood floor joists are permitted to support *braced wall panels* that are out of plane with *braced wall panels* below provided that all of the following are satisfied:

1. Floor joists are nominal 2 inches by 10 inches (51 mm by 254 mm) or larger and spaced not more than 16 inches (406 mm) on center.
2. The ratio of the back span to the cantilever is not less than 2 to 1.
3. Floor joists at ends of *braced wall panels* are doubled.

BUILDING PLANNING

4. For wood-frame construction, a continuous rim joist is connected to ends of cantilever joists. Where spliced, the rim joists shall be spliced using a galvanized metal tie not less than 0.058 inch (1.5 mm) (16 gage) and $1\frac{1}{2}$ inches (38 mm) wide fastened with six 16d nails on each side of the splice; or a block of the same size as the rim joist and of sufficient length to fit securely between the joist space at which the splice occurs, fastened with eight 16d nails on each side of the splice.
5. Gravity loads carried at the end of cantilevered joists are limited to uniform wall and roof loads and the reactions from headers having a span of 8 feet (2438 mm) or less.
2. **Lateral support of roofs and floors.** Conditions where a section of floor or roof is not laterally supported by *shear walls* or *braced wall lines* on all edges.

Exception: Portions of floors that do not support *shear walls*, *braced wall panels* above, or roofs shall be permitted to extend not more than 6 feet (1829 mm) beyond a *shear wall* or *braced wall line*.

3. **Shear wall or braced wall offsets in plane.** Conditions where the end of a *braced wall panel* occurs over an opening in the wall below and extends more than 1 foot (305 mm) horizontally past the edge of the opening. This provision is applicable to *shear walls* and *braced wall panels* offset in plane and to *braced wall panels* offset out of plane in accordance with the exception to Item 1.

Exception: For wood light-frame wall construction, one end of a *braced wall panel* shall be permitted to extend more than 1 foot (305 mm) over an opening not more than 8 feet (2438 mm) in width in the wall below provided that the opening includes a header in accordance with all of the following:

1. The building width, loading condition and framing member species limitations of Table R602.7(1) shall apply.
2. The header is composed of:
 - 2.1. Not less than one 2 × 12 or two 2 × 10 for an opening not more than 4 feet (1219 mm) wide.
 - 2.2. Not less than two 2 × 12 or three 2 × 10 for an opening not more than 6 feet (1829 mm) in width.

- 2.3. Not less than three 2 × 12 or four 2 × 10 for an opening not more than 8 feet (2438 mm) in width.
3. The entire length of the *braced wall panel* does not occur over an opening in the wall below.
4. **Floor and roof opening.** Conditions where an opening in a floor or roof exceeds the lesser of 12 feet (3658 mm) or 50 percent of the least floor or roof dimension.
5. **Floor level offset.** Conditions where portions of a floor level are vertically offset.

Exceptions:

1. Framing supported directly by continuous foundations at the perimeter of the building.
2. For wood *light-frame construction*, floors shall be permitted to be vertically offset where the floor framing is lapped or tied together as required by Section R502.6.1.
6. **Perpendicular shear wall and wall bracing.** Conditions where *shear walls* and *braced wall lines* do not occur in two perpendicular directions.
7. **Wall bracing in stories containing masonry or concrete construction.** Conditions where stories above *grade plane* are partially or completely braced by wood wall framing in accordance with Section R602 or cold-formed steel wall framing in accordance with Section R603 include masonry or concrete construction. Where this irregularity applies, the entire story shall be designed in accordance with accepted engineering practice.

- Exceptions:** Fireplaces, chimneys and masonry veneer in accordance with this code.
8. **Hillside light-frame construction.** Conditions in which all of the following apply:
 - 8.1. The grade slope exceeds 1 unit vertical in 5 units horizontal where averaged across the full length of any side of the dwelling.
 - 8.2. The tallest cripple wall clear height exceeds 7 feet (2134 mm), or where a post and beam system occurs at the dwelling perimeter, the post and beam system tallest post clear height exceeds 7 feet (2134 mm).
 - 8.3. Of the total plan area below the lowest framed floor, whether open or enclosed, less than 50 percent is living space having interior wall finishes conforming to Section R702.

Where Item 8 is applicable, design in accordance with accepted engineering practice shall be provided for the floor immediately above the cripple walls or post and beam system and all structural elements and connections from this diaphragm down to and including connections to the foundation and design of the foundation to transfer lateral loads from the framing above.

Exception: *Light-frame construction* in which the lowest framed floor is supported directly on concrete or masonry walls over the full length of all sides except the downhill side of the dwelling need not be considered an irregular dwelling under Item 8.

R301.2.2.7 Height limitations. Wood-framed buildings shall be limited to three *stories* above *grade plane* or the limits given in Table R602.10.3(3). Wood-framed buildings in Seismic Design Category D₂ exceeding two *stories* shall be designed for wind and seismic loads in accordance with accepted engineering practice. Cold-formed steel-framed buildings shall be limited to less than or equal to three *stories* above *grade plane* in accordance with AISI S230. *Mezzanines* as defined in Section R202 that comply with Section R325 shall not be considered as *stories*. *Structural insulated panel* buildings shall be limited to two *stories* above *grade plane*.

R301.2.2.8 Cold-formed steel framing in Seismic Design Categories D₀, D₁ and D₂. In *Seismic Design Categories* D₀, D₁ and D₂ in addition to the requirements of this code, cold-formed steel framing shall comply with the requirements of AISI S230.

R301.2.2.9 Masonry chimneys. In *Seismic Design Categories* D₀, D₁ and D₂, masonry chimneys shall be reinforced and anchored to the building in accordance with Sections R1003.3 and R1003.4.

R301.2.2.10 Anchorage of water heaters. In *Seismic Design Categories* D₀, D₁ and D₂, and in *townhouses* in Seismic Design Category C, water heaters and thermal storage units shall be anchored against movement and overturning in accordance with Section M1307.2 or P2801.8.

R301.2.3 Snow loads. Wood-framed construction, cold-formed, steel-framed construction and masonry and concrete construction, and *structural insulated panel* construction in regions with ground snow loads 70 pounds per square foot (3.35 kPa) or less, shall be in accordance with Chapters 5, 6 and 8. Buildings in regions with ground snow loads greater than 70 pounds per square foot (3.35 kPa) shall be designed in accordance with accepted engineering practice.

R301.2.4 Floodplain construction. Buildings and structures constructed in whole or in part in flood hazard areas (including A or V Zones) as established in Table R301.2, and substantial improvement and *repair* of substantial damage of buildings and structures in flood hazard areas, shall be designed and constructed in accordance with Section R322. Buildings and structures that are located in more than one flood hazard area shall comply with the

provisions associated with the most restrictive flood hazard area. Buildings and structures located in whole or in part in identified floodways shall be designed and constructed in accordance with ASCE 24.

R301.2.4.1 Alternative provisions. As an alternative to the requirements in Section R322, ASCE 24 is permitted subject to the limitations of this code and the limitations therein.

R301.3 Story height. The wind and seismic provisions of this code shall apply to buildings with *story heights* not exceeding the following:

- For wood wall framing, the *story height* shall not exceed 11 feet 7 inches (3531 mm) and the laterally unsupported bearing wall stud height permitted by Table R602.3(5).

Exception: A *story height* not exceeding 13 feet 7 inches (4140 mm) is permitted provided that the maximum wall stud clear height does not exceed 12 feet (3658 mm), the wall studs are in accordance with Exception 2 or 3 of Section R602.3.1 or an engineered design is provided for the wall framing members, and wall bracing for the building is in accordance with Section R602.10. Studs shall be laterally supported at the top and bottom plate in accordance with Section R602.3.

- For cold-formed steel wall framing, the *story height* shall be not more than 11 feet 7 inches (3531 mm) and the unsupported bearing wall stud height shall be not more than 10 feet (3048 mm).
- For masonry walls, the *story height* shall be not more than 13 feet 7 inches (4140 mm) and the bearing wall clear height shall be not more than 12 feet (3658 mm).

Exception: An additional 8 feet (2438 mm) of bearing wall clear height is permitted for gable end walls.

- For insulating concrete form walls, the maximum *story height* shall not exceed 11 feet 7 inches (3531 mm) and the maximum unsupported wall height per *story* as permitted by Section R608 tables shall not exceed 10 feet (3048 mm).
- For structural insulated panel (SIP) walls, the *story height* shall be not more than 11 feet 7 inches (3531 mm) and the bearing wall height per *story* as permitted by Section R610 tables shall not exceed 10 feet (3048 mm).

For walls other than wood-framed walls, individual walls or wall studs shall be permitted to exceed these limits as permitted by Chapter 6, provided that the *story heights* of this section are not exceeded. An engineered design shall be provided for the wall or wall framing members where the limits of Chapter 6 are exceeded. Where the *story height* limits of this section are exceeded, the design of the building, or the noncompliant portions thereof, to resist wind and seismic loads shall be in accordance with the *International Building Code*.

BUILDING PLANNING

R301.4 Dead load. The actual weights of materials and construction shall be used for determining dead load with consideration for the dead load of fixed service equipment.

R301.5 Live load. The minimum uniformly distributed *live load* shall be as provided in Table R301.5.

R301.6 Roof load. The roof shall be designed for the *live load* indicated in Table R301.6 or the ground snow load indicated in Table R301.2, whichever is greater.

R301.7 Deflection. The allowable deflection of any structural member under the *live load* listed in Sections R301.5 and R301.6 or wind loads determined by Section R301.2.1 shall not exceed the values in Table R301.7.

R301.8 Nominal sizes. For the purposes of this code, dimensions of lumber specified shall be deemed to be nominal dimensions unless specifically designated as actual dimensions.

**TABLE R301.5
MINIMUM UNIFORMLY DISTRIBUTED LIVE LOADS (in pounds per square foot)**

USE	UNIFORM LOAD (psf)	CONCENTRATED LOAD (lb)
Uninhabitable attics without storage ^b	10	—
Uninhabitable attics with limited storage ^{b,g}	20	—
Habitable attics and attics served with fixed stairs	30	—
Balconies (exterior) and decks ^e	40	—
Fire escapes	40	—
Guards	—	200 ^{h,i}
Guard in-fill components ^f	—	50 ^h
Handrail ^d	200 ^h	—
Passenger vehicle garages ^a	50 ^a	2,000 ^h
Areas other than sleeping areas	40	—
Sleeping areas	30	—
Stairs	40 ^c	300 ^c

For SI: 1 inch = 25.4 mm, 1 pound per square foot = 0.0479 kPa, 1 square inch = 645 mm², 1 pound = 4.45 N.

- a. Elevated garage floors shall be capable of supporting the uniformly distributed live load or a 2,000-pound concentrated load applied on an area of 4^{1/2} inches by 4^{1/2} inches, whichever produces the greater stresses.
- b. Uninhabitable attics without storage are those where the clear height between joists and rafters is not more than 42 inches, or where there are not two or more adjacent trusses with web configurations capable of accommodating an assumed rectangle 42 inches in height by 24 inches in width, or greater, within the plane of the trusses. This live load need not be assumed to act concurrently with any other live load requirements.
- c. Individual stair treads shall be capable of supporting the uniformly distributed live load or a 300-pound concentrated load applied on an area of 2 inches by 2 inches, whichever produces the greater stresses.
- d. A single concentrated load applied in any direction at any point along the top. For a guard not required to serve as a handrail, the load need not be applied to the top element of the guard in a direction parallel to such element.
- e. See Section R507.1 for decks attached to exterior walls.
- f. Guard in-fill components (all those except the handrail), balusters and panel fillers shall be designed to withstand a horizontally applied normal load of 50 pounds on an area equal to 1 square foot. This load need not be assumed to act concurrently with any other live load requirement.
- g. Uninhabitable attics with limited storage are those where the clear height between joists and rafters is 42 inches or greater, or where there are two or more adjacent trusses with web configurations capable of accommodating an assumed rectangle 42 inches in height by 24 inches in width, or greater, within the plane of the trusses.

The live load need only be applied to those portions of the joists or truss bottom chords where all of the following conditions are met:

1. The attic area is accessed from an opening not less than 20 inches in width by 30 inches in length that is located where the clear height in the attic is not less than 30 inches.
2. The slopes of the joists or truss bottom chords are not greater than 2 units vertical in 12 units horizontal.
3. Required insulation depth is less than the joist or truss bottom chord member depth.

The remaining portions of the joists or truss bottom chords shall be designed for a uniformly distributed concurrent live load of not less than 10 pounds per square foot.

- h. Glazing used in handrail assemblies and guards shall be designed with a load adjustment factor of 4. The load adjustment factor shall be applied to each of the concentrated loads applied to the top of the rail, and to the load on the in-fill components. These loads shall be determined independent of one another, and loads are assumed not to occur with any other live load.
- i. Where the top of a guard system is not required to serve as a handrail, the single concentrated load shall be applied at any point along the top, in the vertical downward direction and in the horizontal direction away from the walking surface. Where the top of a guard is also serving as the handrail, a single concentrated load shall be applied in any direction at any point along the top. Concentrated loads shall not be applied concurrently.

**TABLE R301.6
MINIMUM ROOF LIVE LOADS IN POUNDS-FORCE PER SQUARE FOOT OF HORIZONTAL PROJECTION**

ROOF SLOPE	TRIBUTARY LOADED AREA IN SQUARE FEET FOR ANY STRUCTURAL MEMBER		
	0 to 200	201 to 600	Over 600
Flat or rise less than 4 inches per foot (1:3)	20	16	12
Rise 4 inches per foot (1:3) to less than 12 inches per foot (1:1)	16	14	12
Rise 12 inches per foot (1:1) and greater	12	12	12

For SI: 1 square foot = 0.0929 m², 1 pound per square foot = 0.0479 kPa, 1 inch per foot = 83.3 mm/m.

**TABLE R301.7
ALLOWABLE DEFLECTION OF STRUCTURAL MEMBERS^{b,c}**

STRUCTURAL MEMBER	ALLOWABLE DEFLECTION
Rafters having slopes greater than 3:12 with finished ceiling not attached to rafters	L/180
Interior walls and partitions	H/180
Floors	L/360
Ceilings with brittle finishes (including plaster and stucco)	L/360
Ceilings with flexible finishes (including gypsum board)	L/240
All other structural members	L/240
Exterior walls—wind loads ^a with plaster or stucco finish	H/360
Exterior walls—wind loads ^a with other brittle finishes	H/240
Exterior walls—wind loads ^a with flexible finishes	H/120 ^d
Lintels supporting masonry veneer walls ^e	L/600

Note: L = span length, H = span height.

- a. For the purpose of determining deflection limits herein, the wind load shall be permitted to be taken as 0.7 times the component and cladding (ASD) loads obtained from Table R301.2.1(1).
- b. For cantilever members, L shall be taken as twice the length of the cantilever.
- c. For aluminum structural members or panels used in roofs or walls of sunroom additions or patio covers, not supporting edge of glass or sandwich panels, the total load deflection shall not exceed L/60. For continuous aluminum structural members supporting edge of glass, the total load deflection shall not exceed L/175 for each glass lite or L/60 for the entire length of the member, whichever is more stringent. For sandwich panels used in roofs or walls of sunroom additions or patio covers, the total load deflection shall not exceed L/120.
- d. Deflection for exterior walls with interior gypsum board finish shall be limited to an allowable deflection of H/180.
- e. Refer to Section R703.8.2. The dead load of supported materials shall be included when calculating the deflection of these members.

SECTION R302 FIRE-RESISTANT CONSTRUCTION

R302.1 Exterior walls. Construction, projections, openings and penetrations of exterior walls of *dwellings* and accessory buildings shall comply with Table R302.1(1); or *dwellings* equipped throughout with an *automatic sprinkler system* installed in accordance with Section P2904 shall comply with Table R302.1(2).

Exceptions:

1. Walls, projections, openings or penetrations in walls perpendicular to the line used to determine the *fire separation distance*.
2. Walls of *individual dwelling units* and their *accessory structures* located on the same *lot*.
3. Detached tool sheds and storage sheds, playhouses and similar structures exempted from *permits* are not required to provide wall protection based on location on the *lot*. Projections beyond the exterior wall shall not extend over the *lot line*.
4. Detached garages accessory to a *dwelling* located within 2 feet (610 mm) of a *lot line* are permitted.

to have roof eave projections not exceeding 4 inches (102 mm).

5. Foundation vents installed in compliance with this code are permitted.

R302.2 Townhouses. Walls separating *townhouse units* shall be constructed in accordance with Section R302.2.1 or R302.2.2 and shall comply with Sections 302.2.3 through 302.2.5.

R302.2.1 Double walls. Each *townhouse unit* shall be separated from other *townhouse units* by two 1-hour fire-resistance-rated wall assemblies tested in accordance with ASTM E119, UL 263 or Section 703.2.2 of the *International Building Code*.

R302.2.2 Common walls. Common walls separating *townhouse units* shall be assigned a fire-resistance rating in accordance with Item 1 or 2 and shall be rated for fire exposure from both sides. Common walls shall extend to and be tight against the exterior sheathing of the exterior walls, or the inside face of exterior walls without stud cavities, and the underside of the roof sheathing. The common wall shared by two *townhouse units* shall be constructed without plumbing or mechanical equipment, ducts or vents, other than water-filled fire sprinkler piping

BUILDING PLANNING

in the cavity of the common wall. Electrical installations shall be in accordance with Chapters 34 through 43. Penetrations of the membrane of common walls for electrical outlet boxes shall be in accordance with Section R302.4.

- Where an automatic sprinkler system in accordance with Section P2904 is provided, the common wall shall be not less than a 1-hour fire-resistance-rated wall assembly tested in accordance with ASTM E119, UL 263 or Section 703.2.2 of the *International Building Code*.

- Where an automatic sprinkler system in accordance with Section P2904 is not provided, the common wall shall be not less than a 2-hour fire-resistance-rated wall assembly tested in accordance with ASTM E119, UL 263 or Section 703.2.2 of the *International Building Code*.

Exception: Common walls are permitted to extend to and be tight against the inside of the exterior walls if the cavity between the end of the common wall and the

TABLE R302.1(1)
EXTERIOR WALLS

EXTERIOR WALL ELEMENT		MINIMUM FIRE-RESISTANCE RATING	MINIMUM FIRE SEPARATION DISTANCE
Walls	Fire-resistance rated	1 hour—tested in accordance with ASTM E119, UL 263 or Section 703.3 of the <i>International Building Code</i> with exposure from both sides	0 feet
	Not fire-resistance rated	0 hours	≥ 5 feet
Projections	Not allowed	NA	< 2 feet
	Fire-resistance rated	1 hour on the underside, or heavy timber, or fire-retardant-treated wood ^{a, b}	≥ 2 feet to < 5 feet
	Not fire-resistance rated	0 hours	≥ 5 feet
Openings in walls	Not allowed	NA	< 3 feet
	25% maximum of wall area	0 hours	3 feet
	Unlimited	0 hours	5 feet
Penetrations	All	Comply with Section R302.4	< 3 feet
		None required	3 feet

For SI: 1 foot = 304.8 mm.

NA = Not Applicable.

- The fire-resistance rating shall be permitted to be reduced to 0 hours on the underside of the eave overhang if fireblocking is provided from the wall top plate to the underside of the roof sheathing.
- The fire-resistance rating shall be permitted to be reduced to 0 hours on the underside of the rake overhang where gable vent openings are not installed.

TABLE R302.1(2)
EXTERIOR WALLS—DWELLINGS WITH FIRE SPRINKLERS

EXTERIOR WALL ELEMENT		MINIMUM FIRE-RESISTANCE RATING	MINIMUM FIRE SEPARATION DISTANCE
Walls	Fire-resistance rated	1 hour—tested in accordance with ASTM E119, UL 263 or Section 703.2.2 of the <i>International Building Code</i> with exposure from the outside	0 feet
	Not fire-resistance rated	0 hours	3 feet ^a
Projections	Not allowed	NA	< 2 feet
	Fire-resistance rated	1 hour on the underside, or heavy timber, or fire-retardant-treated wood ^{b, c}	2 feet ^a
	Not fire-resistance rated	0 hours	3 feet
Openings in walls	Not allowed	NA	< 3 feet
	Unlimited	0 hours	3 feet ^a
Penetrations	All	Comply with Section R302.4	< 3 feet
		None required	3 feet ^a

For SI: 1 foot = 304.8 mm.

NA = Not Applicable.

- For residential subdivisions where all dwellings are equipped throughout with an automatic sprinkler system installed in accordance with Section P2904, the fire separation distance for exterior walls not fire-resistance rated and for fire-resistance-rated projections shall be permitted to be reduced to 0 feet, and unlimited unprotected openings and penetrations shall be permitted, where the adjoining lot provides an open setback yard that is 6 feet or more in width on the opposite side of the property line.
- The fire-resistance rating shall be permitted to be reduced to 0 hours on the underside of the eave overhang if fireblocking is provided from the wall top plate to the underside of the roof sheathing.
- The fire-resistance rating shall be permitted to be reduced to 0 hours on the underside of the rake overhang where gable vent openings are not installed.

exterior sheathing is filled with a minimum of two 2-inch nominal thickness wood studs.

R302.2.3 Continuity. The fire-resistance-rated wall or assembly separating *townhouse units* shall be continuous from the foundation to the underside of the roof sheathing, deck or slab. The fire-resistance rating shall extend the full length of the wall or assembly, including wall extensions through and separating attached enclosed *accessory structures*.

R302.2.4 Parapets for townhouses. Parapets constructed in accordance with Section R302.2.5 shall be constructed for *townhouses* as an extension of exterior walls or common walls separating *townhouse units* in accordance with the following:

1. Where roof surfaces adjacent to the wall or walls are at the same elevation, the parapet shall extend not less than 30 inches (762 mm) above the roof surfaces.
2. Where roof surfaces adjacent to the wall or walls are at different elevations and the higher roof is not more than 30 inches (762 mm) above the lower roof, the parapet shall extend not less than 30 inches (762 mm) above the lower roof surface.

Exception: A parapet is not required in the preceding two cases where the roof covering complies with a minimum Class C rating as tested in accordance with ASTM E108 or UL 790 and the roof decking or sheathing is of *noncombustible materials* or fire-retardant-treated wood for a distance of 4 feet (1219 mm) on each side of the wall or walls, or one layer of $\frac{5}{8}$ -inch (15.9 mm) Type X gypsum board is installed directly beneath the roof decking or sheathing, supported by not less than nominal 2-inch (51 mm) ledgers attached to the sides of the roof framing members, for a distance of not less than 4 feet (1219 mm) on each side of the wall or walls and any openings or penetrations in the roof are not within 4 feet (1219 mm) of the common walls. Fire-retardant-treated wood shall meet the requirements of Sections R802.1.5 and R803.2.1.2.

3. A parapet is not required where roof surfaces adjacent to the wall or walls are at different elevations and the higher roof is more than 30 inches (762 mm) above the lower roof. The common wall construction from the lower roof to the underside of the higher *roof deck* shall have not less than a 1-hour fire-resistance rating. The wall shall be rated for exposure from both sides.

R302.2.5 Parapet construction. Parapets shall have the same fire-resistance rating as that required for the supporting wall or walls. On any side adjacent to a roof surface, the parapet shall have noncombustible faces for the uppermost 18 inches (457 mm), to include counter-flashing and coping materials. Where the roof slopes

toward a parapet at slopes greater than 2 units vertical in 12 units horizontal (16.7-percent slope), the parapet shall extend to the same height as any portion of the roof within a distance of 3 feet (914 mm), and the height shall be not less than 30 inches (762 mm).

R302.2.6 Structural independence. Each *townhouse unit* shall be structurally independent.

Exceptions:

1. Foundations supporting exterior walls or common walls.
2. Structural roof and wall sheathing from each unit fastened to the common wall framing.
3. Nonstructural wall and roof coverings.
4. Flashing at termination of roof covering over common wall.
5. *Townhouse units* separated by a common wall as provided in Section R302.2.2, Item 1 or 2.
6. *Townhouse units* protected by a fire sprinkler system complying with Section P2904 or NFPA 13D.

R302.3 Two-family dwellings. *Dwelling units* in two-family dwellings shall be separated from each other by wall and floor assemblies having not less than a 1-hour fire-resistance rating where tested in accordance with ASTM E119, UL 263 or Section 703.2.2 of the *International Building Code*. Such separation shall be provided regardless of whether a *lot line* exists between the two *dwelling units* or not. Fire-resistance-rated floor/ceiling and wall assemblies shall extend to and be tight against the exterior wall, and wall assemblies shall extend from the foundation to the underside of the roof sheathing.

Exceptions:

1. A fire-resistance rating of $\frac{1}{2}$ hour shall be permitted in buildings equipped throughout with an automatic sprinkler system installed in accordance with Section P2904.
2. Wall assemblies need not extend through attic spaces where the ceiling is protected by not less than $\frac{5}{8}$ -inch (15.9 mm) Type X gypsum board, an attic draft stop constructed as specified in Section R302.12.1 is provided above and along the wall assembly separating the *dwellings* and the structural framing supporting the ceiling is protected by not less than $\frac{1}{2}$ -inch (12.7 mm) gypsum board or equivalent.

R302.3.1 Supporting construction. Where floor assemblies are required to be fire-resistance rated by Section R302.3, the supporting construction of such assemblies shall have an equal or greater fire-resistance rating.

R302.4 Dwelling unit rated penetrations. Penetrations of wall or floor-ceiling assemblies required to be fire-resistance rated in accordance with Section R302.2 or R302.3 shall be protected in accordance with this section.

BUILDING PLANNING

R302.4.1 Through penetrations. Through penetrations of fire-resistance-rated wall or floor assemblies shall comply with Section R302.4.1.1 or R302.4.1.2.

Exceptions:

1. Where the penetrating items are steel, ferrous or copper pipes, tubes or conduits, the annular space shall be protected as follows:
 - 1.1. In concrete or masonry wall or floor assemblies, concrete, grout or mortar shall be permitted where installed to the full thickness of the wall or floor assembly or the thickness required to maintain the fire-resistance rating, provided that both of the following are complied with:
 - 1.1.1. The nominal diameter of the penetrating item is not more than 6 inches (152 mm).
 - 1.1.2. The area of the opening through the wall does not exceed 144 square inches (92 900 mm²).
 - 1.2. The material used to fill the annular space shall prevent the passage of flame and hot gases sufficient to ignite cotton waste where subjected to ASTM E119 or UL 263 time temperature fire conditions under a positive pressure differential of not less than 0.01 inch of water (3 Pa) at the location of the penetration for the time period equivalent to the fire-resistance rating of the construction penetrated.
2. The annular space created by the penetration of water-filled fire sprinkler piping, provided that the annular space is filled using a material complying with Item 1.2 of Exception 1.

R302.4.1.1 Fire-resistance-rated assembly. Penetrations shall be installed as tested in the *approved* fire-resistance-rated assembly.

R302.4.1.2 Penetration firestop system. Penetrations shall be protected by an *approved* penetration firestop system installed as tested in accordance with ASTM E814 or UL 1479, with a positive pressure differential of not less than 0.01 inch of water (3 Pa) and shall have an F rating of not less than the required fire-resistance rating of the wall or floor-ceiling assembly penetrated.

R302.4.2 Membrane penetrations. Membrane penetrations shall comply with Section R302.4.1. Where walls are required to have a fire-resistance rating, recessed fixtures shall be installed so that the required fire-resistance rating will not be reduced.

Exceptions:

1. Membrane penetrations of not more than 2-hour fire-resistance-rated walls and partitions

by steel electrical boxes that do not exceed 16 square inches (0.0103 m²) in area provided that the aggregate area of the openings through the membrane does not exceed 100 square inches (0.0645 m²) in any 100 square feet (9.29 m²) of wall area. The annular space between the wall membrane and the box shall not exceed $\frac{1}{8}$ inch (3.1 mm). Such boxes on opposite sides of the wall shall be separated by one of the following:

- 1.1. By a horizontal distance of not less than 24 inches (610 mm) where the wall or partition is constructed with individual noncommunicating stud cavities.
- 1.2. By a horizontal distance of not less than the depth of the wall cavity where the wall cavity is filled with cellulose loose-fill, rockwool or slag mineral wool insulation.
- 1.3. By solid fireblocking in accordance with Section R302.11.
- 1.4. By protecting both boxes with *listed* putty pads.
- 1.5. By other *listed* materials and methods.
2. Membrane penetrations by *listed* electrical boxes of any materials provided that the boxes have been tested for use in fire-resistance-rated assemblies and are installed in accordance with the instructions included in the *listing*. The annular space between the wall membrane and the box shall not exceed $\frac{1}{8}$ inch (3.1 mm) unless *listed* otherwise. Such boxes on opposite sides of the wall shall be separated by one of the following:
 - 2.1. By the horizontal distance specified in the *listing* of the electrical boxes.
 - 2.2. By solid fireblocking in accordance with Section R302.11.
 - 2.3. By protecting both boxes with *listed* putty pads.
 - 2.4. By other *listed* materials and methods.
3. The annular space created by the penetration of a fire sprinkler or water-filled fire sprinkler piping, provided that the annular space is covered by a metal escutcheon plate.
4. Ceiling membrane penetrations by *listed* luminaires or by luminaires protected with *listed* materials that have been tested for use in fire-resistance-rated assemblies and are installed in accordance with the instructions included in the *listing*.

R302.5 Dwelling-garage opening and penetration protection. Openings and penetrations through the walls or ceilings separating the dwelling from the garage shall be in accordance with Sections R302.5.1 through R302.5.3.

R302.5.1 Opening protection. Openings from a private garage directly into a room used for sleeping purposes shall not be permitted. Other openings between the garage and residence shall be equipped with solid wood doors not less than $1\frac{3}{8}$ inches (35 mm) in thickness, solid or honeycomb-core steel doors not less than $1\frac{3}{8}$ inches (35 mm) thick, or 20-minute fire-rated doors. Doors shall be self-latching and equipped with a self-closing or automatic-closing device.

R302.5.2 Duct penetration. Ducts in the garage and ducts penetrating the walls or ceilings separating the dwelling from the garage shall be constructed of a minimum No. 26 gage (0.48 mm) sheet steel or other approved material and shall not have openings into the garage.

R302.5.3 Other penetrations. Penetrations through the separation required in Section R302.6 shall be protected as required by Section R302.11, Item 4.

R302.6 Dwelling-garage fire separation. The garage shall be separated as required by Table R302.6. Openings in garage walls shall comply with Section R302.5. Attachment of gypsum board shall comply with Table R702.3.5. The wall separation provisions of Table R302.6 shall not apply to garage walls that are perpendicular to the adjacent dwelling unit wall.

R302.7 Under-stair protection. Enclosed space under stairs that is accessed by a door or access panel shall have walls, under-stair surface and any soffits protected on the enclosed side with $\frac{1}{2}$ -inch (12.7 mm) gypsum board.

R302.8 Foam plastics. For requirements for foam plastics, see Section R316.

R302.8.1 Interior finish. Foam plastics used as interior finishes shall comply with Section R316.5.10.

R302.9 Flame spread index and smoke-developed index for wall and ceiling finishes. Flame spread and smoke-developed indices for wall and ceiling finishes shall be in accordance with Sections R302.9.1 through R302.9.4.

R302.9.1 Flame spread index. Wall and ceiling finishes shall have a flame spread index of not greater than 200.

Exception: Flame spread index requirements for finishes shall not apply to trim defined as picture molds, chair rails, baseboards and handrails; to doors and windows or their frames; or to materials that are less than $\frac{1}{28}$ inch (0.91 mm) in thickness cemented to

the surface of walls or ceilings if these materials exhibit flame spread index values not greater than those of paper of this thickness cemented to a noncombustible backing.

R302.9.2 Smoke-developed index. Wall and ceiling finishes shall have a *smoke-developed index* of not greater than 450.

R302.9.3 Testing. Tests shall be made in accordance with ASTM E84 or UL 723.

R302.9.4 Alternative test method. As an alternative to having a flame spread index of not greater than 200 and a *smoke-developed index* of not greater than 450 where tested in accordance with ASTM E84 or UL 723, wall and ceiling finishes shall be permitted to be tested in accordance with NFPA 286. Materials tested in accordance with NFPA 286 shall meet the following criteria:

The interior finish shall comply with the following:

1. During the 40 kW exposure, flames shall not spread to the ceiling.
2. The flame shall not spread to the outer extremity of the sample on any wall or ceiling.
3. Flashover, as defined in NFPA 286, shall not occur.
4. The peak heat release rate throughout the test shall not exceed 800 kW.
5. The total smoke released throughout the test shall not exceed 1,000 m².

R302.9.5 High-density polyethylene (HDPE) and polypropylene (PP). Where high-density polyethylene or polypropylene is used as an interior finish material, it shall be tested in accordance with NFPA 286 and comply with the criteria in Section R302.9.4.

R302.10 Flame spread index and smoke-developed index for insulation. Flame spread and *smoke-developed index* for insulation shall be in accordance with Sections R302.10.1 through R302.10.5.

R302.10.1 Insulation. Insulating materials installed within floor-ceiling assemblies, roof-ceiling assemblies, wall assemblies, crawl spaces and attics shall comply with the requirements of this section. They shall exhibit a flame spread index not to exceed 25 and a *smoke-developed index* not to exceed 450 where tested in accordance with ASTM E84 or UL 723. Insulating materials, where

TABLE R302.6
DWELLING-GARAGE SEPARATION

SEPARATION	MATERIAL
From the residence and attics	Not less than $\frac{1}{2}$ -inch gypsum board or equivalent applied to the garage side
From habitable rooms above the garage	Not less than $\frac{5}{8}$ -inch Type X gypsum board or equivalent
Structure(s) supporting floor/ceiling assemblies used for separation required by this section	Not less than $\frac{1}{2}$ -inch gypsum board or equivalent
Garages located less than 3 feet from a dwelling unit on the same lot	Not less than $\frac{1}{2}$ -inch gypsum board or equivalent applied to the interior side of exterior walls that are within this area

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm.

BUILDING PLANNING

tested in accordance with the requirements of this section, shall include facings, where used, such as vapor retarders, *vapor permeable* membranes and similar coverings.

Exceptions:

1. Where such materials are installed in concealed spaces, the flame spread index and *smoke-developed index* limitations do not apply to the facings, provided that the facing is installed in substantial contact with the unexposed surface of the ceiling, floor or wall finish.
2. Cellulose fiber loose-fill insulation that is not spray applied and that complies with the requirements of Section R302.10.3 shall not be required to meet the flame spread index requirements but shall be required to meet a *smoke-developed index* of not more than 450 where tested in accordance with CAN/ULC S102.2.
3. Foam plastic insulation shall comply with Section R316.

R302.10.2 Loose-fill insulation. Loose-fill insulation materials that cannot be mounted in the ASTM E84 or UL 723 apparatus without a screen or artificial supports shall comply with the flame spread and smoke-developed limits of Section R302.10.1 where tested in accordance with CAN/ULC S102.2.

Exception: Cellulosic fiber loose-fill insulation shall not be required to be tested in accordance with CAN/ULC S102.2, provided that such insulation complies with the requirements of Sections R302.10.1 and R302.10.3.

R302.10.3 Cellulosic fiber loose-fill insulation. Cellulosic fiber loose-fill insulation shall comply with CPSC 16 CFR, Parts 1209 and 1404. Each package of such insulating material shall be clearly *labeled* in accordance with CPSC 16 CFR, Parts 1209 and 1404.

R302.10.4 Exposed attic insulation. Exposed insulation materials installed on attic floors shall have a critical radiant flux of not less than 0.12 watt per square centimeter.

R302.10.5 Testing. Tests for critical radiant flux shall be made in accordance with ASTM E970.

R302.11 Fireblocking. In combustible construction, fireblocking shall be provided to cut off both vertical and horizontal concealed draft openings and to form an effective fire barrier between stories, and between a top story and the roof space.

Fireblocking shall be provided in wood-framed construction in the following locations:

1. In concealed spaces of stud walls and partitions, including furred spaces and parallel rows of studs or staggered studs, as follows:
 - 1.1. Vertically at the ceiling and floor levels.
 - 1.2. Horizontally at intervals not exceeding 10 feet (3048 mm).

2. At interconnections between concealed vertical and horizontal spaces such as occur at soffits, drop ceilings and cove ceilings.
3. In concealed spaces between stair stringers at the top and bottom of the run. Enclosed spaces under stairs shall comply with Section R302.7.
4. At openings around vents, pipes, ducts, cables and wires at ceiling and floor level, with an *approved* material to resist the free passage of flame and products of combustion. The material filling this annular space shall not be required to meet the ASTM E136 requirements.
5. For the fireblocking of chimneys and fireplaces, see Section R1003.19.
6. Fireblocking of cornices of a two-family *dwelling* is required at the line of *dwelling unit* separation.

R302.11.1 Fireblocking materials. Except as provided in Section R302.11, Item 4, fireblocking shall consist of the following materials.

1. Two-inch (51 mm) nominal lumber.
2. Two thicknesses of 1-inch (25.4 mm) nominal lumber with broken lap joints.
3. One thickness of $\frac{23}{32}$ -inch (18.3 mm) *wood structural panels* with joints backed by $\frac{23}{32}$ -inch (18.3 mm) *wood structural panels*.
4. One thickness of $\frac{3}{4}$ -inch (19.1 mm) particleboard with joints backed by $\frac{3}{4}$ -inch (19.1 mm) particleboard.
5. One-half-inch (12.7 mm) gypsum board.
6. One-quarter-inch (6.4 mm) cement-based millboard.
7. Batts or blankets of mineral wool or glass fiber or other *approved* materials installed in such a manner as to be securely retained in place.
8. Cellulose insulation installed as tested in accordance with ASTM E119 or UL 263, for the specific application.

R302.11.1.1 Batts or blankets of mineral or glass fiber. Batts or blankets of mineral or glass fiber or other *approved* nonrigid materials shall be permitted for compliance with the 10-foot (3048 mm) horizontal fireblocking in walls constructed using parallel rows of studs or staggered studs.

R302.11.1.2 Unfaced fiberglass. Unfaced fiberglass batt insulation used as fireblocking shall fill the entire cross section of the wall cavity to a height of not less than 16 inches (406 mm) measured vertically. Where piping, conduit or similar obstructions are encountered, the insulation shall be packed tightly around the obstruction.

R302.11.1.3 Loose-fill insulation material. Loose-fill insulation material shall not be used as a fireblock unless specifically tested in the form and manner

intended for use to demonstrate its ability to remain in place and to retard the spread of fire and hot gases.

R302.11.2 Fireblocking integrity. The integrity of fire-blocks shall be maintained.

R302.12 Draftstopping. In combustible construction where there is usable space both above and below the concealed space of a floor-ceiling assembly, draftstops shall be installed so that the area of the concealed space does not exceed 1,000 square feet (92.9 m^2). Draftstopping shall divide the concealed space into approximately equal areas. Where the assembly is enclosed by a floor membrane above and a ceiling membrane below, draftstopping shall be provided in floor-ceiling assemblies under the following circumstances:

1. Ceiling is suspended under the floor framing.
2. Floor framing is constructed of truss-type open-web or perforated members.

R302.12.1 Materials. Draftstopping materials shall be not less than $\frac{1}{2}$ -inch (12.7 mm) gypsum board, $\frac{3}{8}$ -inch (9.5 mm) wood structural panels or other *approved* materials adequately supported. Draftstopping shall be installed parallel to the floor framing members unless otherwise *approved* by the *building official*. The integrity of the draftstops shall be maintained.

R302.13 Fire protection of floors. Floor assemblies that are not required elsewhere in this code to be fire-resistance rated, shall be provided with a $\frac{1}{2}$ -inch (12.7 mm) gypsum wallboard membrane, $\frac{5}{8}$ -inch (16 mm) wood structural panel membrane, or equivalent on the underside of the floor framing member. Penetrations or openings for ducts, vents, electrical outlets, lighting, devices, luminaires, wires, speakers, drainage, piping and similar openings or penetrations shall be permitted.

Exceptions:

1. Floor assemblies located directly over a space protected by an automatic sprinkler system in accordance with Section P2904, NFPA 13D, or other *approved* equivalent sprinkler system.
2. Floor assemblies located directly over a *crawl space* not intended for storage or for the installation of fuel-fired or electric-powered heating *appliances*.
3. Portions of floor assemblies shall be permitted to be unprotected where complying with the following:
 - 3.1. The aggregate area of the unprotected portions does not exceed 80 square feet (7.4 m^2) per story.
 - 3.2. Fireblocking in accordance with Section R302.11.1 is installed along the perimeter of the unprotected portion to separate the unprotected portion from the remainder of the floor assembly.
4. Wood floor assemblies using dimension lumber or *structural composite lumber* equal to or greater

than 2-inch by 10-inch (50.8 mm by 254 mm) nominal dimension, or other *approved* floor assemblies demonstrating equivalent fire performance.

R302.14 Combustible insulation clearance. Combustible insulation shall be separated not less than 3 inches (76 mm) from recessed luminaires, fan motors and other heat-producing devices.

Exception: Where heat-producing devices are *listed* for lesser clearances, combustible insulation complying with the listing requirements shall be separated in accordance with the conditions stipulated in the listing.

Recessed luminaires installed in the *building thermal envelope* shall meet the requirements of Section N1102.4.5 of this code.

SECTION R303 LIGHT, VENTILATION AND HEATING

R303.1 Habitable rooms. Habitable rooms shall have an aggregate glazing area of not less than 8 percent of the floor area of such rooms. Natural *ventilation* shall be through windows, skylights, doors, louvers or other *approved* openings to the outdoor air. Such openings shall be provided with ready access or shall otherwise be readily controllable by the building occupants. The openable area to the outdoors shall be not less than 4 percent of the floor area being ventilated.

Exceptions:

1. For habitable rooms other than kitchens, the glazed areas need not be openable where the opening is not required by Section R310 and a whole-house mechanical *ventilation* system or a mechanical ventilation system capable of producing 0.35 air changes per hour in the habitable rooms is installed in accordance with Section M1505.
2. For kitchens, the glazed areas need not be openable where the opening is not required by Section R310 and a local exhaust system is installed in accordance with Section M1505.
3. The glazed areas need not be installed in rooms where Exception 1 is satisfied and artificial light is provided that is capable of producing an average illumination of 6 footcandles (65 lux) over the area of the room at a height of 30 inches (762 mm) above the floor level.
4. Use of *sunroom* and patio covers, as defined in Section R202, shall be permitted for natural *ventilation* if in excess of 40 percent of the exterior *sunroom* walls are open, or are enclosed only by insect screening.

R303.2 Adjoining rooms. For the purpose of determining light and *ventilation* requirements, rooms shall be considered to be a portion of an adjoining room where not less than one-half of the area of the common wall is open and unobstructed and provides an opening of not less than one-tenth of the

BUILDING PLANNING

floor area of the interior room and not less than 25 square feet (2.3 m^2).

Exception: Openings required for light or *ventilation* shall be permitted to open into a *sunroom* with thermal isolation or a patio cover, provided that there is an openable area between the adjoining room and the *sunroom* or patio cover of not less than one-tenth of the floor area of the interior room and not less than 20 square feet (2 m^2). The minimum openable area to the outdoors shall be based on the total floor area being ventilated.

R303.3 Bathrooms. Bathrooms, water closet compartments and other similar rooms shall be provided with aggregate glazing area in windows of not less than 3 square feet (0.3 m^2), one-half of which shall be openable.

Exception: The glazed areas shall not be required where artificial light and a local exhaust system are provided. The minimum local exhaust rates shall be determined in accordance with Section M1505. Exhaust air from the space shall be exhausted directly to the outdoors.

R303.4 Mechanical ventilation. Buildings and *dwelling units* complying with Section N1102.4.1 shall be provided with mechanical ventilation in accordance with Section M1505, or with other *approved* means of ventilation.

R303.5 Opening location. Outdoor intake and exhaust openings shall be located in accordance with Sections R303.5.1 and R303.5.2.

R303.5.1 Intake openings. Mechanical and gravity outdoor air intake openings shall be located not less than 10 feet (3048 mm) from any hazardous or noxious contaminant, such as vents, chimneys, plumbing vents, streets, alleys, parking lots and loading docks.

For the purpose of this section, the exhaust from *dwelling unit* toilet rooms, bathrooms and *kitchens* shall not be considered as hazardous or noxious.

Exceptions:

1. The 10-foot (3048 mm) separation is not required where the intake opening is located 3 feet (914 mm) or greater below the contaminant source.
2. Vents and chimneys serving fuel-burning *appliances* shall be terminated in accordance with the applicable provisions of Chapters 18 and 24.
3. Clothes dryer exhaust ducts shall be terminated in accordance with Section M1502.3.

R303.5.2 Exhaust openings. Exhaust air shall not be directed onto walkways.

R303.6 Outside opening protection. Air exhaust and intake openings that terminate outdoors shall be protected with corrosion-resistant screens, louvers or grilles having an opening size of not less than $\frac{1}{4}$ inch (6 mm) and a maximum opening size of $\frac{1}{2}$ inch (13 mm), in any dimension. Openings shall be protected against local weather conditions. Outdoor air exhaust and intake openings shall meet the provisions for exterior wall opening protectives in accordance with this code.

R303.7 Interior stairway illumination. Interior *stairways* shall be provided with an artificial light source to illuminate the landings and treads. The light source shall be capable of illuminating treads and landings to levels of not less than 1 footcandle (11 lux) as measured at the center of treads and landings. There shall be a wall switch at each floor level to control the light source where the *stairway* has six or more risers.

Exception: A switch is not required where remote, central or automatic control of lighting is provided.

R303.8 Exterior stairway illumination. Exterior *stairways* shall be provided with an artificial light source located at the top landing of the *stairway*. Exterior *stairways* providing access to a *basement* from the outdoor *grade* level shall be provided with an artificial light source located at the bottom landing of the *stairway*.

R303.9 Required glazed openings. Required glazed openings shall open directly onto a street or public alley, or a *yard* or court located on the same *lot* as the building.

Exceptions:

1. Required glazed openings that face into a roofed porch where the porch abuts a street, *yard* or court and the longer side of the porch is not less than 65 percent unobstructed and the ceiling height is not less than 7 feet (2134 mm).
2. Eave projections shall not be considered as obstructing the clear open space of a *yard* or court.
3. Required glazed openings that face into the area under a deck, balcony, bay or floor cantilever where a clear vertical space not less than 36 inches (914 mm) in height is provided.

R303.9.1 Sunroom additions. Required glazed openings shall be permitted to open into *sunroom additions* or patio covers that abut a street, *yard* or court if in excess of 40 percent of the exterior *sunroom* walls are open, or are enclosed only by insect screening, and the ceiling height of the *sunroom* is not less than 7 feet (2134 mm).

R303.10 Required heating. Where the winter design temperature in Table R301.2 is below 60°F (16°C), every *dwelling unit* shall be provided with heating facilities capable of maintaining a room temperature of not less than 68°F (20°C) at a point 3 feet (914 mm) above the floor and 2 feet (610 mm) from exterior walls in habitable rooms at the design temperature. The installation of one or more portable space heaters shall not be used to achieve compliance with this section.

SECTION R304 MINIMUM ROOM AREAS

R304.1 Minimum area. Habitable rooms shall have a floor area of not less than 70 square feet (6.5 m^2).

Exception: Kitchens.

R304.2 Minimum dimensions. Habitable rooms shall be not less than 7 feet (2134 mm) in any horizontal dimension.

Exception: Kitchens.

R304.3 Height effect on room area. Portions of a room with a sloping ceiling measuring less than 5 feet (1524 mm) or a furred ceiling measuring less than 7 feet (2134 mm) from the finished floor to the finished ceiling shall not be considered as contributing to the minimum required habitable area for that room.

SECTION R305 CEILING HEIGHT

R305.1 Minimum height. *Habitable space*, hallways and portions of *basements* containing these spaces shall have a ceiling height of not less than 7 feet (2134 mm). Bathrooms, toilet rooms and laundry rooms shall have a ceiling height of not less than 6 feet 8 inches (2032 mm).

Exceptions:

1. For rooms with sloped ceilings, the required floor area of the room shall have a ceiling height of not less than 5 feet (1524 mm) and not less than 50 percent of the required floor area shall have a ceiling height of not less than 7 feet (2134 mm).
2. The ceiling height above bathroom and toilet room fixtures shall be such that the fixture is capable of being used for its intended purpose. A shower or tub equipped with a showerhead shall have a ceiling height of not less than 6 feet 8 inches (2032 mm) above an area of not less than 30 inches (762 mm) by 30 inches (762 mm) at the showerhead.
3. Beams, girders, ducts or other obstructions in *basements* containing *habitable space* shall be permitted to project to within 6 feet 4 inches (1931 mm) of the finished floor.
4. Beams and girders spaced apart not less than 36 inches (914 mm) in clear finished width shall project not more than 78 inches (1981 mm) from the finished floor.

R305.1.1 Basements. Portions of *basements* that do not contain *habitable space* or hallways shall have a ceiling height of not less than 6 feet 8 inches (2032 mm).

Exception: At beams, girders, ducts or other obstructions, the ceiling height shall be not less than 6 feet 4 inches (1931 mm) from the finished floor.

SECTION R306 SANITATION

R306.1 Toilet facilities. Every *dwelling unit* shall be provided with a water closet, lavatory, and a bathtub or shower.

R306.2 Kitchen. Each *dwelling unit* shall be provided with a kitchen area and every kitchen area shall be provided with a sink.

R306.3 Sewage disposal. Plumbing fixtures shall be connected to a sanitary sewer or to an *approved* private sewage disposal system.

R306.4 Water supply to fixtures. Plumbing fixtures shall be connected to an *approved* water supply. Kitchen sinks, lavatories, bathtubs, showers, bidets, laundry tubs and washing machine outlets shall be provided with hot and cold water.

SECTION R307 TOILET, BATH AND SHOWER SPACES

R307.1 Space required. Fixtures shall be spaced in accordance with Figure R307.1, and in accordance with the requirements of Section P2705.1.

R307.2 Bathtub and shower spaces. Bathtub and shower floors and walls above bathtubs with installed shower heads and in shower compartments shall be finished with a nonabsorbent surface. Such wall surfaces shall extend to a height of not less than 6 feet (1829 mm) above the floor.

SECTION R308 GLAZING

R308.1 Identification. Except as indicated in Section R308.1.1 each pane of glazing installed in hazardous locations as defined in Section R308.4 shall be provided with a manufacturer's designation specifying who applied the designation, the type of glass and the safety glazing standard with which it complies, and that is visible in the final installation. The designation shall be acid etched, sandblasted, ceramic-fired, laser etched, embossed, or be of a type that once applied cannot be removed without being destroyed. A *label* shall be permitted in lieu of the manufacturer's designation.

Exceptions:


1. For other than tempered glass, manufacturer's designations are not required provided that the *building official* approves the use of a certificate, affidavit or other evidence confirming compliance with this code.
2. Tempered spandrel glass is permitted to be identified by the manufacturer with a removable paper designation.

R308.1.1 Identification of multiple assemblies. Multi-pane assemblies having individual panes not exceeding 1 square foot (0.09 m^2) in exposed area shall have not less than one pane in the assembly identified in accordance with Section R308.1. Other panes in the assembly shall be labeled "CPSC 16 CFR 1201" or "ANSI Z97.1" as appropriate.

R308.2 Louvered windows or jalousies. Regular, float, wired or patterned glass in jalousies and louvered windows shall be not less than nominal $\frac{3}{16}$ inch (5 mm) thick and not more than 48 inches (1219 mm) in length. Exposed glass edges shall be smooth.

R308.2.1 Wired glass prohibited. Wired glass with wire exposed on longitudinal edges shall not be used in jalousies or louvered windows.

BUILDING PLANNING

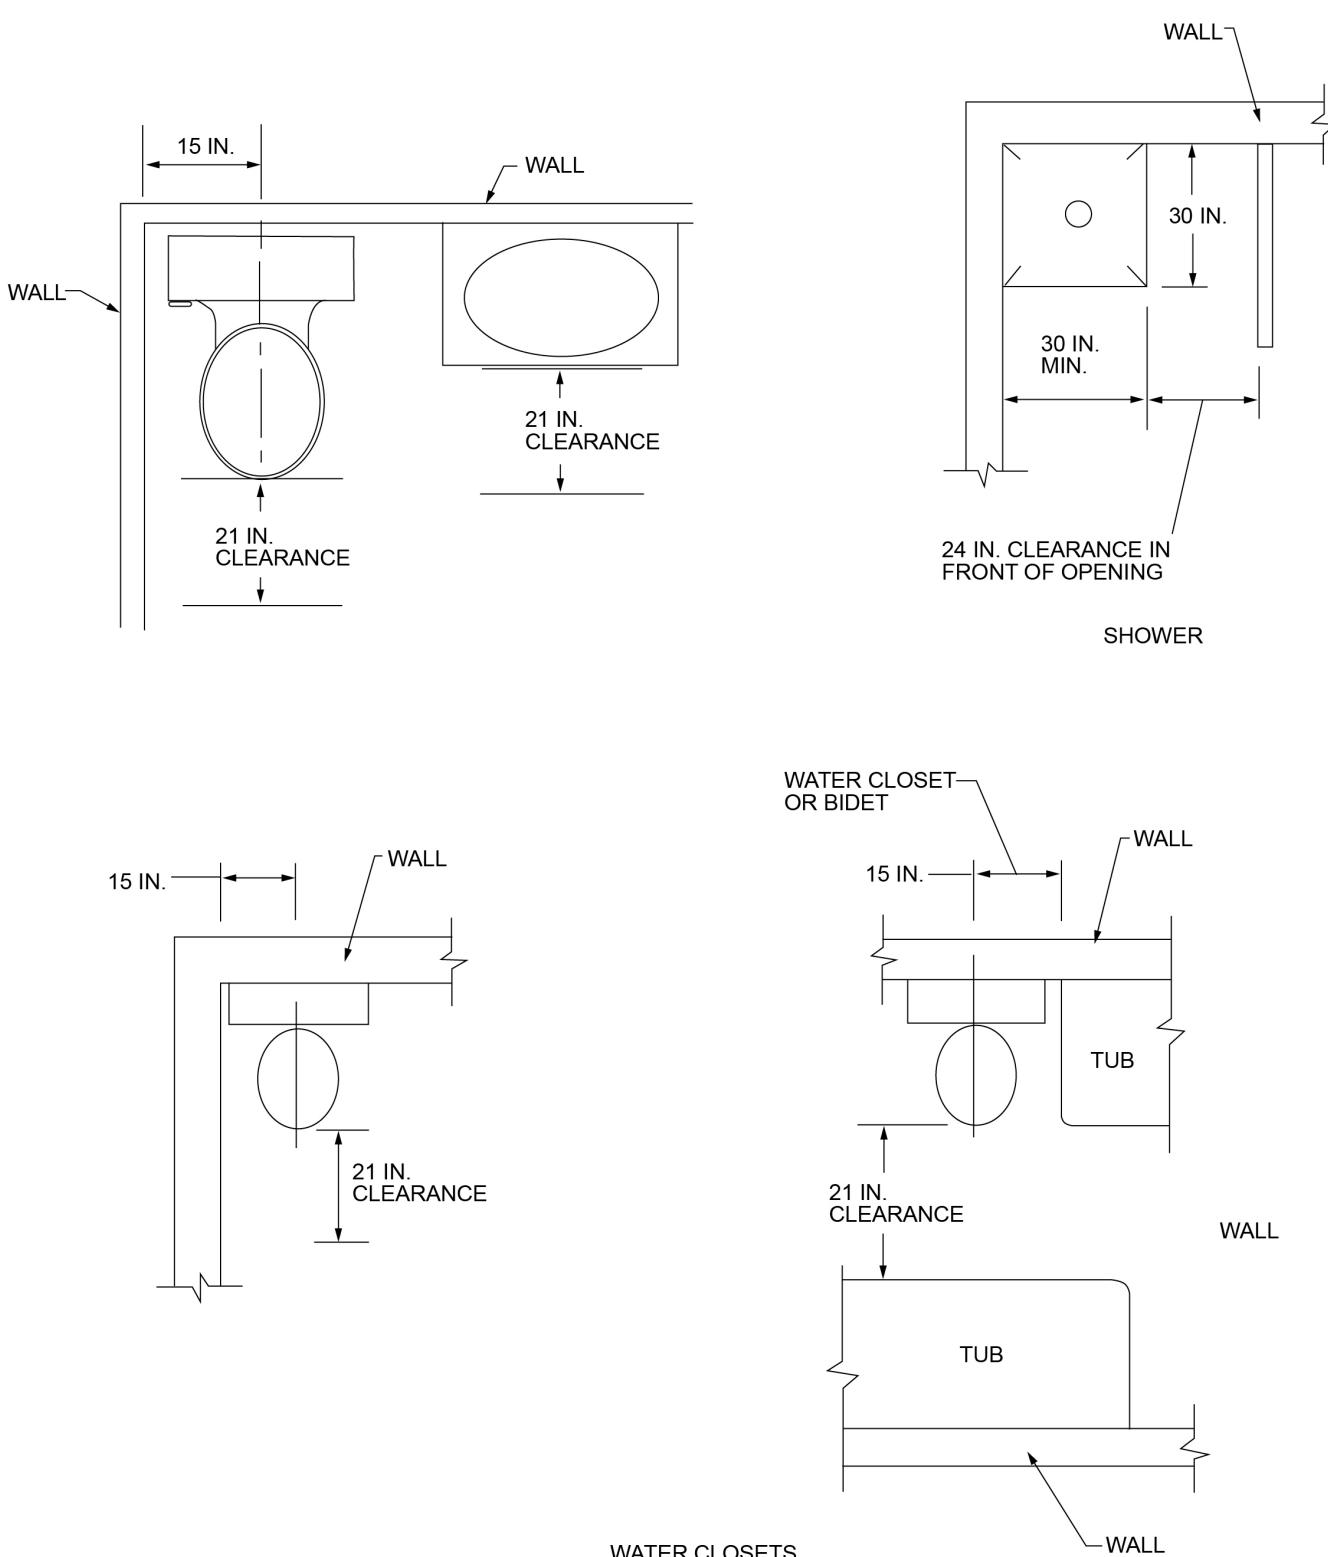

For SI: 1 inch = 25.4 mm.

**FIGURE R307.1
MINIMUM FIXTURE CLEARANCES**

R308.3 Human impact loads. Individual glazed areas, including glass mirrors in hazardous locations such as those indicated as defined in Section R308.4, shall pass the test requirements of Section R308.3.1.

Exceptions:

1. Louvered windows and jalousies shall comply with Section R308.2.
2. Mirrors and other glass panels mounted or hung on a surface that provides a continuous backing support.
3. Glass unit masonry complying with Section R607.

R308.3.1 Impact test. Where required by other sections of the code, glazing shall be tested in accordance with CPSC 16 CFR 1201. Glazing shall comply with the test criteria for Category II unless otherwise indicated in Table R308.3.1(1).

Exception: Glazing not in doors or enclosures for hot tubs, whirlpools, saunas, steam rooms, bathtubs and showers shall be permitted to be tested in accordance with ANSI Z97.1. Glazing shall comply with the test criteria for Class A unless otherwise indicated in Table R308.3.1(2).

R308.4 Hazardous locations. The locations specified in Sections R308.4.1 through R308.4.7 shall be considered to be specific hazardous locations for the purposes of glazing.

R308.4.1 Glazing in doors. Glazing in fixed and operable panels of swinging, sliding and bifold doors shall be considered to be a hazardous location.

Exceptions:

1. Glazed openings of a size through which a 3-inch-diameter (76 mm) sphere is unable to pass.
2. Decorative glazing.

R308.4.2 Glazing adjacent to doors. Glazing in an individual fixed or operable panel adjacent to a door shall be considered to be a hazardous location where the bottom exposed edge of the glazing is less than 60 inches (1524 mm) above the floor or walking surface and it meets either of the following conditions:

1. Where the glazing is within 24 inches (610 mm) of either side of the door in the plane of the door in a closed position.
2. Where the glazing is on a wall less than 180 degrees (3.14 rad) from the plane of the door in a closed position and within 24 inches (610 mm) of the hinge side of an in-swinging door.

Exceptions:

1. Decorative glazing.
2. Where there is an intervening wall or other permanent barrier between the door and the glazing.
3. Where access through the door is to a closet or storage area 3 feet (914 mm) or less in depth. Glazing in this application shall comply with Section R308.4.3.
4. Glazing that is adjacent to the fixed panel of patio doors.

R308.4.3 Glazing in windows. Glazing in an individual fixed or operable panel that meets all of the following conditions shall be considered to be a hazardous location:

1. The exposed area of an individual pane is larger than 9 square feet (0.836 m²).
2. The bottom edge of the glazing is less than 18 inches (457 mm) above the floor.
3. The top edge of the glazing is more than 36 inches (914 mm) above the floor.

TABLE R308.3.1(1)
MINIMUM CATEGORY CLASSIFICATION OF GLAZING USING CPSC 16 CFR 1201

EXPOSED SURFACE AREA OF ONE SIDE OF ONE LITE	GLAZING IN STORM OR COMBINATION DOORS (Category Class)	GLAZING INDOORS (Category Class)	GLAZED PANELS REGULATED BY SECTION R308.4.3 (Category Class)	GLAZED PANELS REGULATED BY SECTION R308.4.2 (Category Class)	GLAZING INDOORS AND ENCLOSURES REGULATED BY SECTION 308.4.5 (Category Class)	SLIDING GLASS DOORS PATIO TYPE (Category Class)
9 square feet or less	I	I	NR	I	II	II
More than 9 square feet	II	II	II	II	II	II

For SI: 1 square foot = 0.0929 m².

NR = No Requirement.

TABLE R308.3.1(2)
MINIMUM CATEGORY CLASSIFICATION OF GLAZING USING ANSI Z97.1

EXPOSED SURFACE AREA OF ONE SIDE OF ONE LITE	GLAZED PANELS REGULATED BY SECTION R308.4.3 (Category Class)	GLAZED PANELS REGULATED BY SECTION R308.4.2 (Category Class)	DOORS AND ENCLOSURES REGULATED BY SECTION R308.4.5 ^a (Category Class)
9 square feet or less	No requirement	B	A
More than 9 square feet	A	A	A

For SI: 1 square foot = 0.0929 m².

a. Use is permitted only by the exception to Section R308.3.1.

BUILDING PLANNING

4. One or more walking surfaces are within 36 inches (914 mm), measured horizontally and in a straight line, of the glazing.

Exceptions:

1. Decorative glazing.
2. Where glazing is adjacent to a walking surface and a horizontal rail is installed 34 to 38 inches (864 to 965 mm) above the walking surface. The rail shall be capable of withstanding a horizontal load of 50 pounds per linear foot (730 N/m) without contacting the glass and have a cross-sectional height of not less than 1½ inches (38 mm).
3. Outboard panes in insulating glass units and other multiple glazed panels where the bottom edge of the glass is 25 feet (7620 mm) or more above *grade*, a roof, walking surfaces or other horizontal [within 45 degrees (0.79 rad) of horizontal] surface adjacent to the glass exterior.

R308.4.4 Glazing in guards and railings. Glazing in *guards* and railings, including structural baluster panels and nonstructural in-fill panels, regardless of area or height above a walking surface shall be considered to be a hazardous location.

R308.4.4.1 Structural glass baluster panels. *Guards* with structural glass baluster panels shall be installed with an attached top rail or *handrail*. The top rail or *handrail* shall be supported by not less than three glass baluster panels, or shall be otherwise supported to remain in place should one glass baluster panel fail.

Exception: An attached top rail or *handrail* is not required where the glass baluster panels are laminated glass with two or more glass plies of equal thickness and of the same glass type.

R308.4.5 Glazing and wet surfaces. Glazing in walls, enclosures or fences containing or adjacent to hot tubs, spas, whirlpools, saunas, steam rooms, bathtubs, showers and indoor or outdoor swimming pools where the bottom exposed edge of the glazing is less than 60 inches (1524 mm) measured vertically above any standing or walking surface shall be considered to be a hazardous location. This shall apply to single glazing and each pane in multiple glazing.

Exception: Glazing that is more than 60 inches (1524 mm), measured horizontally, from the water's edge of a bathtub, hot tub, spa, whirlpool or swimming pool or from the edge of a shower, sauna or steam room.

R308.4.6 Glazing adjacent to stairs and ramps. Glazing where the bottom exposed edge of the glazing is less than 36 inches (914 mm) above the plane of the adjacent walking surface of *stairways*, landings between flights of stairs and *ramps* shall be considered to be a hazardous location.

Exceptions:

1. Where glazing is adjacent to a walking surface and a horizontal rail is installed at 34 to 38

inches (864 to 965 mm) above the walking surface. The rail shall be capable of withstanding a horizontal load of 50 pounds per linear foot (730 N/m) without contacting the glass and have a cross-sectional height of not less than 1½ inches (38 mm).

2. Glazing 36 inches (914 mm) or more measured horizontally from the walking surface.

R308.4.7 Glazing adjacent to the bottom stair landing.

Glazing adjacent to the landing at the bottom of a *stairway* where the glazing is less than 36 inches (914 mm) above the landing and within a 60-inch (1524 mm) horizontal arc less than 180 degrees (3.14 rad) from the bottom tread *nosing* shall be considered to be a hazardous location. (See Figure R308.4.7.)

Exception: Where the glazing is protected by a *guard* complying with Section R312 and the plane of the glass is more than 18 inches (457 mm) from the *guard*.

R308.5 Site-built windows. Site-built windows shall comply with Section 2404 of the *International Building Code*.

R308.6 Skylights and sloped glazing. *Skylights and sloped glazing* shall comply with the following sections.

R308.6.1 Definitions. The following terms are defined in Chapter 2:

SKYLIGHT, UNIT.

SKYLIGHTS AND SLOPED GLAZING.


TUBULAR DAYLIGHTING DEVICE (TDD).

R308.6.2 Materials. Glazing materials shall be limited to the following:

1. Laminated glass with not less than a 0.015-inch (0.38 mm) polyvinyl butyral interlayer for glass panes 16 square feet (1.5 m²) or less in area located such that the highest point of the glass is not more than 12 feet (3658 mm) above a walking surface; for higher or larger sizes, the interlayer thickness shall be not less than 0.030 inch (0.76 mm).
2. Fully tempered glass.
3. Heat-strengthened glass.
4. Wired glass.
5. *Approved* rigid plastics.

R308.6.3 Screens, general. For fully tempered or heat-strengthened glass, a broken glass retention screen meeting the requirements of Section R308.6.7 shall be installed below the full area of the glass, except for fully tempered glass that meets Condition 1 or 2 listed in Section R308.6.5.

R308.6.4 Screens with multiple glazing. Where the inboard pane is fully tempered, heat-strengthened or wired glass, a broken glass retention screen meeting the requirements of Section R308.6.7 shall be installed below the full area of the glass, except for Condition 1 or 2 listed in Section R308.6.5. Other panes in the multiple glazing shall be of any type listed in Section R308.6.2.

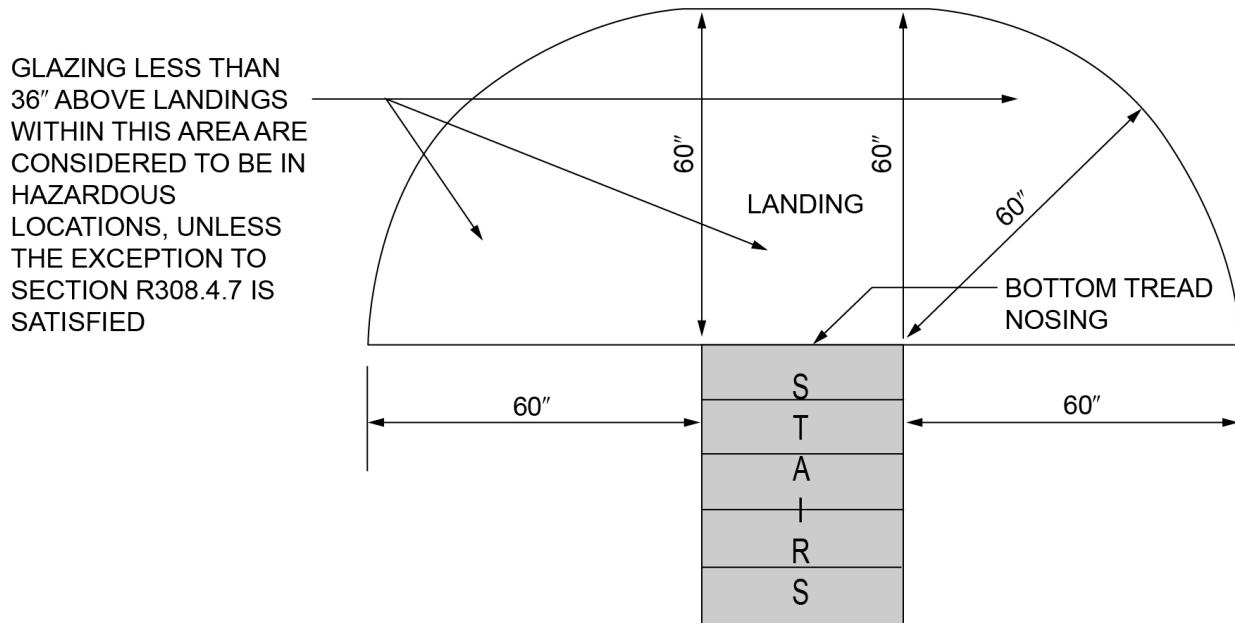

For SI: 1 inch = 25.4 mm.

**FIGURE R308.4.7
HAZARDOUS GLAZING LOCATIONS AT BOTTOM STAIR LANDINGS**

R308.6.5 Screens not required. Screens shall not be required where laminated glass complying with Item 1 of Section R308.6.2 is used as single glazing or the inboard pane in multiple glazing. Screens shall not be required where fully tempered glass is used as single glazing or the inboard pane in multiple glazing and either of the following conditions is met:

1. The glass area is 16 square feet (1.49 m^2) or less; the highest point of glass is not more than 12 feet (3658 mm) above a walking surface; the nominal glass thickness is not more than $\frac{3}{16}$ inch (4.8 mm); and for multiple glazing only the other pane or panes are fully tempered, laminated or wired glass.
2. The glass area is greater than 16 square feet (1.49 m^2); the glass is sloped 30 degrees (0.52 rad) or less from vertical; and the highest point of glass is not more than 10 feet (3048 mm) above a walking surface.

R308.6.6 Glass in greenhouses. Any glazing material is permitted to be installed without screening in the sloped areas of greenhouses, provided that the greenhouse height at the ridge does not exceed 20 feet (6096 mm) above grade.

R308.6.7 Screen characteristics. The screen and its fastenings shall: be capable of supporting twice the weight of the glazing; be firmly and substantially fastened to the framing members; be installed within 4 inches (102 mm) of the glass; and have a mesh opening of not greater than 1 inch by 1 inch (25 mm by 25 mm).

R308.6.8 Curbs for skylights. Unit skylights installed in a roof with a pitch of less than three units vertical in 12 units horizontal (25-percent slope) shall be mounted on a curb extending not less than 4 inches (102 mm) above the plane of the roof, unless otherwise specified in the manufacturer's installation instructions.

R308.6.9 Testing and labeling. Unit skylights and tubular daylighting devices shall be tested by an approved independent laboratory, and bear a label identifying manufacturer, performance grade rating and approved inspection agency to indicate compliance with the requirements of AAMA/WDMA/CSA 101/I.S.2/A440.

R308.6.9.1 Comparative analysis for glass-glazed unit skylights. Structural wind load design pressures for glass-glazed unit skylights different than the size tested in accordance with Section R308.6.9 shall be permitted to be different than the design value of the tested unit where determined in accordance with one of the following comparative analysis methods:

1. Structural wind load design pressures for glass-glazed unit skylights smaller than the size tested in accordance with Section R308.6.9 shall be permitted to be higher than the design value of the tested unit provided that such higher pressures are determined by accepted engineering analysis. Components of the smaller unit shall be the same as those of the tested unit. Such calculated design pressures shall be validated by an additional test of the glass-glazed unit skylight having the highest allowable design pressure.
2. In accordance with WDMA I.S.11.

BUILDING PLANNING

SECTION R309 GARAGES AND CARPORTS

R309.1 Floor surface. Garage floor surfaces shall be of *approved noncombustible material*.

The area of floor used for parking of automobiles or other vehicles shall be sloped to facilitate the movement of liquids to a drain or toward the main vehicle entry doorway.

R309.2 Carports. Carports shall be open on not less than two sides. Carport floor surfaces shall be of *approved noncombustible material*. Carports not open on two or more sides shall be considered to be a garage and shall comply with the provisions of this section for garages.

The area of floor used for parking of automobiles or other vehicles shall be sloped to facilitate the movement of liquids to a drain or toward the main vehicle entry doorway.

Exception: Asphalt surfaces shall be permitted at ground level in carports.

R309.3 Flood hazard areas. Garages and carports located in flood hazard areas as established by Table R301.2 shall be constructed in accordance with Section R322.

R309.4 Automatic garage door openers. Automatic garage door openers, if provided, shall be *listed* and *labeled* in accordance with UL 325.

R309.5 Fire sprinklers. Private garages shall be protected by fire sprinklers where the garage wall has been designed based on Table R302.1(2), Note a. Sprinklers in garages shall be connected to an automatic sprinkler system that complies with Section P2904. Garage sprinklers shall be residential sprinklers or quick-response sprinklers, designed to provide a density of 0.05 gpm/ft². Garage doors shall not be considered obstructions with respect to sprinkler placement.

SECTION R310

EMERGENCY ESCAPE AND RESCUE OPENINGS

R310.1 Emergency escape and rescue opening required. Basements, habitable attics and every sleeping room shall have not less than one operable *emergency escape and rescue opening*. Where basements contain one or more sleeping rooms, an *emergency escape and rescue opening* shall be required in each sleeping room. *Emergency escape and rescue openings* shall open directly into a *public way*, or to a *yard* or court having a minimum width of 36 inches (914 mm) that opens to a *public way*.

Exceptions:

1. *Storm shelters* and *basements* used only to house mechanical *equipment* not exceeding a total floor area of 200 square feet (18.58 m²).
2. Where the *dwelling unit* or *townhouse unit* is equipped with an automatic sprinkler system installed in accordance with Section P2904, sleeping rooms in *basements* shall not be required to have *emergency escape and rescue openings*

provided that the *basement* has one of the following:

- 2.1. One means of egress complying with Section R311 and one *emergency escape and rescue opening*.
- 2.2. Two means of egress complying with Section R311.
3. A *yard* shall not be required to open directly into a *public way* where the *yard* opens to an unobstructed path from the *yard* to the *public way*. Such path shall have a width of not less than 36 inches (914 mm).

R310.1.1 Operational constraints and opening control devices.

Emergency escape and rescue openings shall be operational from the inside of the room without the use of keys, tools or special knowledge. Window opening control devices and fall prevention devices complying with ASTM F2090 shall be permitted for use on windows serving as a required *emergency escape and rescue opening* and shall be not more than 70 inches (178 cm) above the finished floor.

R310.2 Emergency escape and rescue openings. *Emergency escape and rescue openings* shall have minimum dimensions in accordance with Sections R310.2.1 through R310.2.4.

R310.2.1 Minimum size. *Emergency escape and rescue openings* shall have a net clear opening of not less than 5.7 square feet (0.530 m²).

Exception: The minimum net clear opening for *grade-floor emergency escape and rescue openings* shall be 5 square feet (0.465 m²).

R310.2.2 Minimum dimensions. The minimum net clear opening height dimension shall be 24 inches (610 mm). The minimum net clear opening width dimension shall be 20 inches (508 mm). The net clear opening dimensions shall be the result of normal operation of the opening.

R310.2.3 Maximum height from floor. Emergency escape and rescue openings shall have the bottom of the clear opening not greater than 44 inches (1118 mm) above the floor.

R310.2.4 Emergency escape and rescue openings under decks, porches and cantilevers. *Emergency escape and rescue openings* installed under decks, porches and cantilevers shall be fully openable and provide a path not less than 36 inches (914 mm) in height and 36 inches (914 mm) in width to a *yard* or court.

R310.3 Emergency escape and rescue doors. Where a door is provided as the required *emergency escape and rescue opening*, it shall be a side-hinged door or a sliding door.

R310.4 Area wells. An *emergency escape and rescue opening* where the bottom of the clear opening is below the adjacent grade shall be provided with an area well in accordance with Sections R310.4.1 through R310.4.4.

R310.4.1 Minimum size. The horizontal area of the area well shall be not less than 9 square feet (0.9 m²), with a

horizontal projection and width of not less than 36 inches (914 mm). The size of the area well shall allow the *emergency escape and rescue opening* to be fully opened.

Exception: The ladder or steps required by Section R310.4.2 shall be permitted to encroach not more than 6 inches (152 mm) into the required dimensions of the area well.

R310.4.2 Ladder and steps. Area wells with a vertical depth greater than 44 inches (1118 mm) shall be equipped with an *approved*, permanently affixed ladder or steps. The ladder or steps shall not be obstructed by the *emergency escape and rescue opening* where the window or door is in the open position. Ladders or steps required by this section shall not be required to comply with Section R311.7.

R310.4.2.1 Ladders. Ladders and rungs shall have an inside width of not less than 12 inches (305 mm), shall project not less than 3 inches (76 mm) from the wall and shall be spaced not more than 18 inches (457 mm) on center vertically for the full height of the area well.

R310.4.2.2 Steps. Steps shall have an inside width of not less than 12 inches (305 mm), a minimum tread depth of 5 inches (127 mm) and a maximum *riser* height of 18 inches (457 mm) for the full height of the area well.

R310.4.3 Drainage. Area wells shall be designed for proper drainage by connecting to the building's foundation drainage system required by Section R405.1.

Exception: A drainage system for area wells is not required where the foundation is on well-drained soil or sand-gravel mixture soils in accordance with the United Soil Classification System, Group I Soils, as detailed in Table R405.1.

R310.4.4 Bars, grilles, covers and screens. Where bars, grilles, covers, screens or similar devices are placed over *emergency escape and rescue openings*, bulkhead enclosures or area wells that serve such openings, the minimum net clear opening size shall comply with Sections R310.2 through R310.2.2 and R310.4.1. Such devices shall be releasable or removable from the inside without the use of a key or tool or force greater than that required for the normal operation of the escape and rescue opening.

R310.5 Replacement windows for emergency escape and rescue openings. Replacement windows installed in buildings meeting the scope of this code shall be exempt from Sections R310.2 and R310.4.4, provided that the replacement window meets the following conditions:

1. The replacement window is the manufacturer's largest standard size window that will fit within the existing frame or existing rough opening. The replacement window is of the same operating style as the existing window or a style that provides for an equal or greater window opening area than the existing window.
2. The replacement window is not part of a change of occupancy.

R310.6 Dwelling additions. Where *dwelling additions* contain sleeping rooms, an *emergency escape and rescue opening* shall be provided in each new sleeping room. Where *dwelling additions* have *basements*, an *emergency escape and rescue opening* shall be provided in the new *basement*.

Exceptions:

1. An *emergency escape and rescue opening* is not required in a new *basement* that contains a sleeping room with an *emergency escape and rescue opening*.
2. An *emergency escape and rescue opening* is not required in a new *basement* where there is an *emergency escape and rescue opening* in an existing *basement* that is accessed from the new *basement*.
3. An operable window complying with Section 310.7.1 shall be acceptable as an *emergency escape and rescue opening*.

R310.7 Alterations or repairs of existing basements. New sleeping rooms created in an existing *basement* shall be provided with *emergency escape and rescue openings* in accordance with Section R310.1. Other than new sleeping rooms, where existing basements undergo alterations or repairs, an *emergency escape and rescue opening* is not required.

Exception: An operable window complying with Section 310.7.1 shall be acceptable as an *emergency escape and rescue opening*.

R310.7.1 Existing emergency escape and rescue openings. Where a *change of occupancy* would require an *emergency escape and rescue opening* in accordance with Section 310.1, operable windows serving as the *emergency escape and rescue opening* shall comply with the following:

1. An existing operable window shall provide a minimum net clear opening of 4 square feet (0.38 m^2) with a minimum net clear opening height of 22 inches (559 mm) and a minimum net clear opening width of 20 inches (508 mm).
2. A replacement window where such window complies with both of the following:
 - 2.1. The replacement window meets the size requirements in Item 1.
 - 2.2. The replacement window is the manufacturer's largest standard-size window that will fit within the existing frame or existing rough opening. The replacement window shall be permitted to be of the same operating style as the existing window or a style that provides for an equal or greater window opening area than the existing window.

BUILDING PLANNING

SECTION R311 MEANS OF EGRESS

R311.1 Means of egress. *Dwellings* shall be provided with a means of egress in accordance with this section. The means of egress shall provide a continuous and unobstructed path of vertical and horizontal egress travel from all portions of the *dwelling* to the required egress door without requiring travel through a garage. The required egress door shall open directly into a *public way* or to a *yard* or court that opens to a *public way*.

R311.2 Egress door. Not less than one egress door shall be provided for each *dwelling unit*. The egress door shall be side-hinged, and shall provide a clear width of not less than 32 inches (813 mm) where measured between the face of the door and the stop, with the door open 90 degrees (1.57 rad). The clear height of the door opening shall be not less than 78 inches (1981 mm) in height measured from the top of the threshold to the bottom of the stop. Other doors shall not be required to comply with these minimum dimensions. Egress doors shall be readily openable from inside the *dwelling* without the use of a key or special knowledge or effort.

R311.3 Floors and landings at exterior doors. There shall be a landing or floor on each side of each exterior door. The width of each landing shall be not less than the door served. Landings shall have a dimension of not less than 36 inches (914 mm) measured in the direction of travel. The slope at exterior landings shall not exceed $\frac{1}{4}$ unit vertical in 12 units horizontal (2 percent).

Exception: Exterior balconies less than 60 square feet (5.6 m^2) and only *accessed* from a door are permitted to have a landing that is less than 36 inches (914 mm) measured in the direction of travel.

R311.3.1 Floor elevations at the required egress doors. Landings or finished floors at the required egress door shall be not more than $1\frac{1}{2}$ inches (38 mm) lower than the top of the threshold.

Exception: The landing or floor on the exterior side shall be not more than $7\frac{3}{4}$ inches (196 mm) below the top of the threshold provided that the door does not swing over the landing or floor.

Where exterior landings or floors serving the required egress door are not at *grade*, they shall be provided with access to *grade* by means of a *ramp* in accordance with Section R311.8 or a *stairway* in accordance with Section R311.7.

R311.3.2 Floor elevations at other exterior doors. Doors other than the required egress door shall be provided with landings or floors not more than $7\frac{3}{4}$ inches (196 mm) below the top of the threshold.

Exception: A top landing is not required where a *stairway* of not more than two *risers* is located on the exterior side of the door, provided that the door does not swing over the *stairway*.

R311.3.3 Storm and screen doors. Storm and screen doors shall be permitted to swing over exterior stairs and landings.

R311.4 Vertical egress. Egress from habitable levels including habitable attics and *basements* that are not provided with an egress door in accordance with Section R311.2 shall be by a *ramp* in accordance with Section R311.8 or a *stairway* in accordance with Section R311.7.

R311.5 Landing, deck, balcony and stair construction and attachment. Exterior landings, decks, balconies, stairs and similar facilities shall be positively anchored to the primary structure to resist both vertical and lateral forces or shall be designed to be self-supporting. Attachment shall not be accomplished by use of toenails or nails subject to withdrawal.

R311.6 Hallways. The width of a hallway shall be not less than 3 feet (914 mm).

R311.7 Stairways. Where required by this code or provided, *stairways* shall comply with this section.

Exceptions:

1. Stairways not within or serving a building, porch or deck.
2. Stairways leading to nonhabitable attics.
3. Stairways leading to *crawl spaces*.

R311.7.1 Width. *Stairways* shall be not less than 36 inches (914 mm) in clear width at all points above the permitted *handrail* height and below the required headroom height. The clear width of *stairways* at and below the *handrail* height, including treads and landings, shall be not less than $31\frac{1}{2}$ inches (787 mm) where a *handrail* is installed on one side and 27 inches (698 mm) where *handrails* are installed on both sides.

Exception: The width of *spiral stairways* shall be in accordance with Section R311.7.10.1.

R311.7.2 Headroom. The headroom in *stairways* shall be not less than 6 feet 8 inches (2032 mm) measured vertically from the sloped line adjoining the tread *nosing* or from the floor surface of the landing or platform on that portion of the *stairway*.

Exceptions:

1. Where the *nosings* of treads at the side of a flight extend under the edge of a floor opening through which the *stair* passes, the floor opening shall not project horizontally into the required headroom more than $4\frac{3}{4}$ inches (121 mm).
2. The headroom for spiral *stairways* shall be in accordance with Section R311.7.10.1.

R311.7.3 Vertical rise. A flight of stairs shall not have a vertical rise greater than 12 feet 7 inches (3835 mm) between floor levels or landings.

R311.7.4 Walkline. The walkline across *winder* treads and landings shall be concentric to the turn and parallel to the direction of travel entering and exiting the turn. The walkline shall be located 12 inches (305 mm) from the inside of the turn. The 12-inch (305 mm) dimension shall be measured from the widest point of the clear stair width

at the walking surface. Where *winders* are adjacent within a flight, the point of the widest clear stair width of the adjacent *winders* shall be used.

R311.7.5 Stair treads and risers. *Stair* treads and *risers* shall meet the requirements of this section. For the purposes of this section, dimensions and dimensioned surfaces shall be exclusive of carpets, rugs or runners.

R311.7.5.1 Risers. The *riser* height shall be not more than $7\frac{3}{4}$ inches (196 mm). The *riser* height shall be measured vertically between leading edges of the adjacent treads. The greatest *riser* height within any flight of stairs shall not exceed the smallest by more than $\frac{3}{8}$ inch (9.5 mm). *Risers* shall be vertical or sloped from the underside of the *nosing* of the tread above at an angle not more than 30 degrees (0.51 rad) from the vertical. At open *risers*, openings located more than 30 inches (762 mm), as measured vertically, to the floor or *grade* below shall not permit the passage of a 4-inch-diameter (102 mm) sphere.

Exceptions:

1. The opening between adjacent treads is not limited on *spiral stairways*.
2. The *riser* height of *spiral stairways* shall be in accordance with Section R311.7.10.1.

R311.7.5.2 Treads. The tread depth shall be not less than 10 inches (254 mm). The tread depth shall be measured horizontally between the vertical planes of the foremost projection of adjacent treads and at a right angle to the tread's leading edge. The greatest tread depth within any flight of stairs shall not exceed the smallest by more than $\frac{3}{8}$ inch (9.5 mm).

R311.7.5.2.1 Winder treads. *Winder* treads shall have a tread depth of not less than 10 inches (254 mm) measured between the vertical planes of the foremost projection of adjacent treads at the intersections with the walkline. *Winder* treads shall have a tread depth of not less than 6 inches (152 mm) at any point within the clear width of the *stair*. Within any flight of stairs, the largest *winder* tread depth at the walkline shall not exceed the smallest *winder* tread by more than $\frac{3}{8}$ inch (9.5 mm). Consistently shaped *winders* at the walkline shall be allowed within the same flight of stairs as rectangular treads and shall not be required to be within $\frac{3}{8}$ inch (9.5 mm) of the rectangular tread depth.

Exception: The tread depth at *spiral stairways* shall be in accordance with Section R311.7.10.1.

R311.7.5.3 Nosings. *Nosings* at treads, landings and floors of *stairways* shall have a radius of curvature at the *nosing* not greater than $\frac{9}{16}$ inch (14 mm) or a bevel not greater than $\frac{1}{2}$ inch (12.7 mm). A *nosing* projection not less than $\frac{3}{4}$ inch (19 mm) and not more

than $1\frac{1}{4}$ inches (32 mm) shall be provided on *stairways*. The greatest *nosing* projection shall not exceed the smallest *nosing* projection by more than $\frac{3}{8}$ inch (9.5 mm) within a *stairway*.

Exception: A *nosing* projection is not required where the tread depth is not less than 11 inches (279 mm).

R311.7.5.4 Exterior plastic composite stair treads. *Plastic composite* exterior stair treads shall comply with the provisions of this section and Section R507.2.2.

R311.7.6 Landings for stairways. There shall be a floor or landing at the top and bottom of each *stairway*. The width perpendicular to the direction of travel shall be not less than the width of the flight served. For landings of shapes other than square or rectangular, the depth at the walk line and the total area shall be not less than that of a quarter circle with a radius equal to the required landing width. Where the *stairway* has a straight run, the depth in the direction of travel shall be not less than 36 inches (914 mm).

Exception: A floor or landing is not required at the top of an interior flight of stairs, including stairs in an enclosed garage, provided that a door does not swing over the stairs.

R311.7.7 Stairway walking surface. The walking surface of treads and landings of *stairways* shall be sloped not steeper than 1 unit vertical in 48 units horizontal (2-percent slope).

Exception: Where the surface of a landing is required elsewhere in the code to drain surface water, the walking surface of the landing shall be sloped not steeper than 1 unit vertical in 20 units horizontal (5-percent slope) in the direction of travel.

R311.7.8 Handrails. *Handrails* shall be provided on not less than one side of each flight of stairs with four or more *risers*.

R311.7.8.1 Height. *Handrail* height, measured vertically from the sloped plane adjoining the tread *nosing*, or finish surface of ramp slope, shall be not less than 34 inches (864 mm) and not more than 38 inches (965 mm).

Exceptions:

1. The use of a volute, turnout or starting easing shall be allowed over the lowest tread.
2. Where *handrail* fittings or bendings are used to provide continuous transition between flights, transitions at *winder* treads, the transition from *handrail* to *guard*, or used at the start of a flight, the *handrail* height at the fittings or bendings shall be permitted to exceed 38 inches (965 mm).

BUILDING PLANNING

R311.7.8.2 Handrail projection. *Handrails* shall not project more than $4\frac{1}{2}$ inches (114 mm) on either side of the *stairway*.

Exception: Where *nosings* of landings, floors or passing flights project into the *stairway* reducing the clearance at passing *handrails*, *handrails* shall project not more than $6\frac{1}{2}$ inches (165 mm) into the *stairway*, provided that the stair width and *handrail* clearance are not reduced to less than that required.

R311.7.8.3 Handrail clearance. *Handrails* adjacent to a wall shall have a space of not less than $1\frac{1}{2}$ inches (38 mm) between the wall and the *handrails*.

R311.7.8.4 Continuity. *Handrails* shall be continuous for the full length of the flight, from a point directly above the top riser of the flight to a point directly above the lowest riser of the flight. *Handrail* ends shall be returned toward a wall, guard walking surface continuous to itself, or terminate to a post.

Exceptions:

1. *Handrail* continuity shall be permitted to be interrupted by a newel post at a turn in a flight with winders, at a landing, or over the lowest tread.
2. A volute, turnout or starting easing shall be allowed to terminate over the lowest tread and over the top landing.

R311.7.8.5 Grip size. Required *handrails* shall be of one of the following types or provide equivalent graspability.

1. Type I. *Handrails* with a circular cross section shall have an outside diameter of not less than $1\frac{1}{4}$ inches (32 mm) and not greater than 2 inches (51 mm). If the *handrail* is not circular, it shall have a perimeter of not less than 4 inches (102 mm) and not greater than $6\frac{1}{4}$ inches (160 mm) and a cross section of not more than $2\frac{1}{4}$ inches (57 mm). Edges shall have a radius of not less than 0.01 inch (0.25 mm).
2. Type II. *Handrails* with a perimeter greater than $6\frac{1}{4}$ inches (160 mm) shall have a graspable finger recess area on both sides of the profile. The finger recess shall begin within $\frac{3}{4}$ inch (19 mm) measured vertically from the tallest portion of the profile and have a depth of not less than $\frac{5}{16}$ inch (8 mm) within $\frac{7}{8}$ inch (22 mm) below the widest portion of the profile. This required depth shall continue for not less than $\frac{3}{8}$ inch (10 mm) to a level that is not less than $1\frac{3}{4}$ inches (45 mm) below the tallest portion of the profile. The width of the *handrail* above the recess shall be not less than $1\frac{1}{4}$ inches (32 mm) and not more than $2\frac{3}{4}$ inches (70 mm). Edges shall have a radius of not less than 0.01 inch (0.25 mm).

R311.7.8.6 Exterior plastic composite handrails. *Plastic composite exterior handrails* shall comply with the requirements of Section R507.2.2.

R311.7.9 Illumination. *Stairways* shall be provided with illumination in accordance with Sections R303.7 and R303.8.

R311.7.10 Special stairways. *Spiral stairways* and bulkhead enclosure *stairways* shall comply with the requirements of Section R311.7 except as specified in Sections R311.7.10.1 and R311.7.10.2.

R311.7.10.1 Spiral stairways. The clear width at and below the *handrails* at *spiral stairways* shall be not less than 26 inches (660 mm) and the walkline radius shall be not greater than $24\frac{1}{2}$ inches (622 mm). Each tread shall have a depth of not less than $6\frac{3}{4}$ inches (171 mm) at the walkline. Treads shall be identical, and the rise shall be not more than $9\frac{1}{2}$ inches (241 mm). Headroom shall be not less than 6 feet 6 inches (1982 mm).

R311.7.10.2 Bulkhead enclosure stairways. *Stairways* serving bulkhead enclosures, not part of the required building egress, providing access from the outside *grade* level to the *basement* shall be exempt from the requirements of Sections R311.3 and R311.7 where the height from the *basement* finished floor level to *grade* adjacent to the *stairway* is not more than 8 feet (2438 mm) and the *grade* level opening to the *stairway* is covered by a bulkhead enclosure with hinged doors or other *approved* means.

R311.7.11 Alternating tread devices. Alternating tread devices shall not be used as an element of a means of egress. Alternating tread devices shall be permitted provided that a required means of egress *stairway* or *ramp* serves the same space at each adjoining level or where a means of egress is not required. The clear width at and below the *handrails* shall be not less than 20 inches (508 mm).

Exception: Alternating tread devices are allowed to be used as an element of a means of egress for lofts, *mezzanines* and similar areas of 200 gross square feet (18.6 m²) or less where such devices do not provide exclusive access to a kitchen or bathroom.

R311.7.11.1 Treads of alternating tread devices. Alternating tread devices shall have a tread depth of not less than 5 inches (127 mm), a projected tread depth of not less than $8\frac{1}{2}$ inches (216 mm), a tread width of not less than 7 inches (178 mm) and a *riser* height of not more than $9\frac{1}{2}$ inches (241 mm). The tread depth shall be measured horizontally between the vertical planes of the foremost projections of adjacent treads. The *riser* height shall be measured vertically between the leading edges of adjacent treads. The *riser* height and tread depth provided shall result in an angle of ascent from the horizontal of between 50 and 70 degrees (0.87 and 1.22 rad). The initial tread of the device shall begin at the same elevation as the platform, landing or floor surface.

R311.7.11.2 Handrails of alternating tread devices. *Handrails* shall be provided on both sides of alternating tread devices and shall comply with Sections R311.7.8.2 through R311.7.8.6. *Handrail* height shall be uniform, not less than 30 inches (762 mm) and not more than 34 inches (864 mm).

R311.7.12 Ship's ladders. Ship's ladders shall not be used as an element of a means of egress. Ship's ladders shall be permitted provided that a required means of egress *stairway* or *ramp* serves the same space at each adjoining level or where a means of egress is not required. The clear width at and below the *handrails* shall be not less than 20 inches (508 mm).

Exception: Ship's ladders are allowed to be used as an element of a means of egress for lofts, *mezzanines* and similar areas of 200 gross square feet (18.6 m^2) or less that do not provide exclusive access to a kitchen or bathroom.

R311.7.12.1 Treads of ship's ladders. Treads shall have a depth of not less than 5 inches (127 mm). The tread shall be projected such that the total of the tread depth plus the *nosing* projection is not less than $8\frac{1}{2}$ inches (216 mm). The *riser* height shall be not more than $9\frac{1}{2}$ inches (241 mm).

R311.7.12.2 Handrails of ship's ladders. *Handrails* shall be provided on both sides of ship's ladders and shall comply with Sections R311.7.8.2 through R311.7.8.6. *Handrail* height shall be uniform, not less than 30 inches (762 mm) and not more than 34 inches (864 mm).

R311.8 Ramps. Where required by this code or provided, *ramps* shall comply with this section.

Exception: Ramps not within or serving a building, porch or deck.

R311.8.1 Maximum slope. *Ramps* serving the egress door required by Section R311.2 shall have a slope of not more than 1 unit vertical in 12 units horizontal (8.3-percent slope).

Other *ramps* shall have a maximum slope of 1 unit vertical in 8 units horizontal (12.5 percent).

Exception: Where it is technically infeasible to comply because of site constraints, *ramps* shall have a slope of not more than 1 unit vertical in 8 units horizontal (12.5 percent).

R311.8.2 Landings required. There shall be a floor or landing at the top and bottom of each *ramp*, where doors open onto *ramps*, and where *ramps* change directions. The width of the landing perpendicular to the *ramp* slope shall be not less than the width of the *ramp*. The depth of the landing in the direction of the ramp slope shall be not less than 36 inches (914 mm).

R311.8.3 Handrails required. *Handrails* shall be provided on not less than one side of *ramps* exceeding a slope of 1 unit vertical in 12 units horizontal (8.33-percent slope).

R311.8.3.1 Height. *Handrail* height, measured above the finished surface of the *ramp* slope, shall be not less than 34 inches (864 mm) and not more than 38 inches (965 mm).

R311.8.3.2 Grip size. *Handrails* on *ramps* shall comply with Section R311.7.8.5.

R311.8.3.3 Continuity. *Handrails* where required on *ramps* shall be continuous for the full length of the *ramp*. *Handrail* ends shall be returned or shall terminate in newel posts or safety terminals. *Handrails* adjacent to a wall shall have a space of not less than $1\frac{1}{2}$ inches (38 mm) between the wall and the *handrails*.

SECTION R312 GUARDS AND WINDOW FALL PROTECTION

R312.1 Guards. *Guards* shall be provided in accordance with Sections R312.1.1 through R312.1.4.

R312.1.1 Where required. *Guards* shall be provided for those portions of open-sided walking surfaces, including floors, stairs, *ramps* and landings that are located more than 30 inches (762 mm) measured vertically to the floor or *grade* below at any point within 36 inches (914 mm) horizontally to the edge of the open side. Insect screening shall not be considered as a *guard*.

R312.1.2 Height. Required *guards* at open-sided walking surfaces, including stairs, porches, balconies or landings, shall be not less than 36 inches (914 mm) in height as measured vertically above the adjacent walking surface or the line connecting the *nosings*.

Exceptions:

1. *Guards* on the open sides of stairs shall have a height of not less than 34 inches (864 mm) measured vertically from a line connecting the *nosings*.
2. Where the top of the *guard* serves as a *handrail* on the open sides of stairs, the top of the *guard* shall be not less than 34 inches (864 mm) and not more than 38 inches (965 mm) as measured vertically from a line connecting the *nosings*.

R312.1.3 Opening limitations. Required *guards* shall not have openings from the walking surface to the required *guard* height that allow passage of a sphere 4 inches (102 mm) in diameter.

Exceptions:

1. The triangular openings at the open side of *stair*, formed by the *riser*, tread and bottom rail of a *guard*, shall not allow passage of a sphere 6 inches (153 mm) in diameter.
2. *Guards* on the open side of stairs shall not have openings that allow passage of a sphere $4\frac{3}{8}$ inches (111 mm) in diameter.

R312.1.4 Exterior plastic composite guards. Plastic composite exterior *guards* shall comply with the requirements of Section R317.4.

BUILDING PLANNING

R312.2 Window fall protection. Window fall protection shall be provided in accordance with Sections R312.2.1 and R312.2.2.

R312.2.1 Window opening height. In *dwelling units*, where the bottom of the clear opening of an operable window opening is located less than 24 inches (610 mm) above the finished floor and greater than 72 inches (1829 mm) above the finished *grade* or other surface below on the exterior of the building, the operable window shall comply with one of the following:

1. Operable window openings will not allow a 4-inch-diameter (102 mm) sphere to pass through where the openings are in their largest opened position.
2. Operable windows are provided with window opening control devices or fall prevention devices that comply with ASTM F2090.

R312.2.2 Emergency escape and rescue openings.

Where an operable window serves as an *emergency escape and rescue opening*, a window opening control device or fall prevention device, after operation to release the control device or fall prevention device allowing the window to fully open, shall not reduce the net clear opening area of the window unit to less than the area required by Sections R310.2.1 and R310.2.2.

SECTION R313 AUTOMATIC FIRE SPRINKLER SYSTEMS

R313.1 Townhouse automatic fire sprinkler systems. An automatic sprinkler system shall be installed in *townhouses*.

Exception: An automatic sprinkler system shall not be required where *additions* or *alterations* are made to existing *townhouses* that do not have an automatic sprinkler system installed.

R313.1.1 Design and installation. Automatic sprinkler systems for *townhouses* shall be designed and installed in accordance with Section P2904 or NFPA 13D.

R313.2 One- and two-family dwellings automatic sprinkler systems. An automatic sprinkler system shall be installed in one- and two-family *dwellings*.

Exception: An automatic sprinkler system shall not be required for *additions* or *alterations* to existing buildings that are not already provided with a sprinkler system.

R313.2.1 Design and installation. Automatic sprinkler systems shall be designed and installed in accordance with Section P2904 or NFPA 13D.

SECTION R314 SMOKE ALARMS

R314.1 General. Smoke alarms shall comply with NFPA 72 and Section R314.

R314.1.1 Listings. Smoke alarms shall be *listed* in accordance with UL 217. Combination smoke and carbon

monoxide alarms shall be *listed* in accordance with UL 217 and UL 2034.

R314.2 Where required. Smoke alarms shall be provided in accordance with this section.

R314.2.1 New construction. Smoke alarms shall be provided in *dwelling units*.

R314.2.2 Alterations, repairs and additions. Where *alterations*, *repairs* or *additions* requiring a *permit* occur, the individual *dwelling unit* shall be equipped with smoke alarms located as required for new *dwellings*.

Exceptions:

1. Work involving the exterior surfaces of *dwellings*, such as the replacement of roofing or siding, the addition or replacement of windows or doors, or the addition of a porch or deck.
2. Installation, *alteration* or repairs of plumbing or mechanical systems.

R314.3 Location. Smoke alarms shall be installed in the following locations:

1. In each sleeping room.
2. Outside each separate sleeping area in the immediate vicinity of the bedrooms.
3. On each additional story of the *dwelling*, including *basements* and *habitable attics* and not including crawl spaces and uninhabitable attics. In *dwellings* or *dwelling units* with split levels and without an intervening door between the adjacent levels, a smoke alarm installed on the upper level shall suffice for the adjacent lower level provided that the lower level is less than one full *story* below the upper level.
4. Not less than 3 feet (914 mm) horizontally from the door or opening of a bathroom that contains a bathtub or shower unless this would prevent placement of a smoke alarm required by this section.
5. In the hallway and in the room open to the hallway in *dwelling units* where the ceiling height of a room open to a hallway serving bedrooms exceeds that of the hallway by 24 inches (610 mm) or more.

R314.3.1 Installation near cooking appliances. Smoke alarms shall not be installed in the following locations unless this would prevent placement of a smoke alarm in a location required by Section R314.3.

1. Ionization smoke alarms shall not be installed less than 20 feet (6096 mm) horizontally from a permanently installed cooking *appliance*.
2. Ionization smoke alarms with an alarm-silencing switch shall not be installed less than 10 feet (3048 mm) horizontally from a permanently installed cooking *appliance*.
3. Photoelectric smoke alarms shall not be installed less than 6 feet (1828 mm) horizontally from a permanently installed cooking *appliance*.
4. Smoke alarms *listed* and marked “helps reduce cooking nuisance alarms” shall not be installed

less than 6 feet (1828 mm) horizontally from a permanently installed cooking *appliance*.

R314.4 Interconnection. Where more than one smoke alarm is required to be installed within an individual *dwelling unit* in accordance with Section R314.3, the alarm devices shall be interconnected in such a manner that the actuation of one alarm will activate all of the alarms in the individual *dwelling unit*. Physical interconnection of smoke alarms shall not be required where *listed* wireless alarms are installed and all alarms sound upon activation of one alarm.

R314.5 Combination alarms. Combination smoke and carbon monoxide alarms shall be permitted to be used in lieu of smoke alarms.

R314.6 Power source. Smoke alarms shall receive their primary power from the building wiring where such wiring is served from a commercial source and, where primary power is interrupted, shall receive power from a battery. Wiring shall be permanent and without a disconnecting switch other than those required for overcurrent protection.

Exceptions:

1. Smoke alarms shall be permitted to be battery operated where installed in buildings without commercial power.
2. Smoke alarms installed in accordance with Section R314.2.2 shall be permitted to be battery powered.

R314.7 Fire alarm systems. Fire alarm systems shall be permitted to be used in lieu of smoke alarms and shall comply with Sections R314.7.1 through R314.7.4.

R314.7.1 General. Fire alarm systems shall comply with the provisions of this code and the household fire warning equipment provisions of NFPA 72. Smoke detectors shall be *listed* in accordance with UL 268.

R314.7.2 Location. Smoke detectors shall be installed in the locations specified in Section R314.3.

R314.7.3 Permanent fixture. Where a household fire alarm system is installed, it shall become a permanent fixture of the occupancy, owned by the homeowner.

R314.7.4 Combination detectors. Combination smoke and carbon monoxide detectors shall be permitted to be installed in fire alarm systems in lieu of smoke detectors, provided that they are *listed* in accordance with UL 268 and UL 2075.

SECTION R315 CARBON MONOXIDE ALARMS

R315.1 General. Carbon monoxide alarms shall comply with Section R315.

R315.1.1 Listings. Carbon monoxide alarms shall be *listed* in accordance with UL 2034. Combination carbon monoxide and smoke alarms shall be *listed* in accordance with UL 217 and UL 2034.

R315.2 Where required. Carbon monoxide alarms shall be provided in accordance with Sections R315.2.1 and R315.2.2.

R315.2.1 New construction. For new construction, carbon monoxide alarms shall be provided in *dwelling units* where either or both of the following conditions exist.

1. The *dwelling unit* contains a fuel-fired *appliance*.
2. The *dwelling unit* has an attached garage with an opening that communicates with the *dwelling unit*.

R315.2.2 Alterations, repairs and additions. Where *alterations*, *repairs* or *additions* requiring a *permit* occur, the individual *dwelling unit* shall be equipped with carbon monoxide alarms located as required for new *dwellings*.

Exceptions:

1. Work involving the exterior surfaces of *dwellings*, such as the replacement of roofing or siding, or the addition or replacement of windows or doors, or the addition of a porch or deck.
2. Installation, *alteration* or repairs of plumbing systems.
3. Installation, alteration or repairs of mechanical systems that are not fuel fired.

R315.3 Location. Carbon monoxide alarms in *dwelling units* shall be installed outside of each separate sleeping area in the immediate vicinity of the bedrooms. Where a fuel-burning *appliance* is located within a bedroom or its attached bathroom, a carbon monoxide alarm shall be installed within the bedroom.

R315.4 Combination alarms. Combination carbon monoxide and smoke alarms shall be permitted to be used in lieu of carbon monoxide alarms.

R315.5 Interconnectivity. Where more than one carbon monoxide alarm is required to be installed within an individual *dwelling unit* in accordance with Section R315.3, the alarm devices shall be interconnected in such a manner that the actuation of one alarm will activate all of the alarms in the individual *dwelling unit*. Physical interconnection of carbon monoxide alarms shall not be required where *listed* wireless alarms are installed and all alarms sound upon activation of one alarm.

Exception: Interconnection of carbon monoxide alarms in existing areas shall not be required where *alterations* or *repairs* do not result in removal of interior wall or ceiling finishes exposing the structure, unless there is an attic, *crawl space* or *basement* available that could provide access for interconnection without the removal of interior finishes.

R315.6 Power source. Carbon monoxide alarms shall receive their primary power from the building wiring where such wiring is served from a commercial source and, where primary power is interrupted, shall receive power from a

BUILDING PLANNING

battery. Wiring shall be permanent and without a disconnecting switch other than those required for overcurrent protection.

Exceptions:

1. Carbon monoxide alarms shall be permitted to be battery operated where installed in buildings without commercial power.
2. Carbon monoxide alarms installed in accordance with Section R315.2.2 shall be permitted to be battery powered.

R315.7 Carbon monoxide detection systems. Carbon monoxide detection systems shall be permitted to be used in lieu of carbon monoxide alarms and shall comply with Sections R315.7.1 through R315.7.4.

R315.7.1 General. Household carbon monoxide detection systems shall comply with NFPA 720. Carbon monoxide detectors shall be *listed* in accordance with UL 2075.

R315.7.2 Location. Carbon monoxide detectors shall be installed in the locations specified in Section R315.3. These locations supersede the locations specified in NFPA 720.

R315.7.3 Permanent fixture. Where a household carbon monoxide detection system is installed, it shall become a permanent fixture of the occupancy and owned by the homeowner.

R315.7.4 Combination detectors. Combination carbon monoxide and smoke detectors installed in carbon monoxide detection systems in lieu of carbon monoxide detectors shall be *listed* in accordance with UL 268 and UL 2075.

SECTION R316 FOAM PLASTIC

R316.1 General. The provisions of this section shall govern the materials, design, application, construction and installation of foam plastic materials.

R316.2 Labeling and identification. Packages and containers of foam plastic insulation and foam plastic insulation components delivered to the job site shall bear the *label* of an *approved agency* showing the manufacturer's name, the product listing, product identification and information sufficient to determine that the end use will comply with the requirements.

R316.3 Surface burning characteristics. Unless otherwise allowed in Section R316.5, foam plastic, or foam plastic cores used as a component in manufactured assemblies, used in building construction shall comply with Section R316.3.1 or R316.3.2. Loose-fill-type foam plastic insulation shall be tested as board stock for the flame spread index and *smoke-developed index*.

Exception: Spray foam plastic insulation more than 4 inches (102 mm) in thickness shall have a flame spread index of not more than 25 and a *smoke-developed index* of not more than 450 where tested at a thickness of 4

inches (102 mm) and at the density intended for use. Such spray foam plastic shall be separated from the interior of a building by $\frac{1}{2}$ -inch (12.7 mm) gypsum wallboard or by a material that has been tested in accordance with NFPA 275, and shall meet the acceptance criteria of both the Temperature Transmission Fire Test and the Integrity Fire Test.

R316.3.1 Foam plastic insulation 4 inches thick or less. Foam plastic insulation installed at 4 inches (102 mm) in thickness or less shall have a flame spread index of not more than 75 and a *smoke-developed index* of not more than 450 where tested in the maximum thickness and density intended for use in accordance with ASTM E84 or UL 723.

R316.3.2 Foam plastic insulation more than 4 inches thick. Foam plastic insulation installed at more than 4 inches (102 mm) in thickness shall have a flame spread index of not more than 75 and a *smoke-developed index* of not more than 450 where tested at a thickness of 4 inches (102 mm) in accordance with ASTM E84 or UL 723, provided that the end use is *approved* in accordance with Section R316.6 using the thickness and density intended for use.

R316.4 Thermal barrier. Unless otherwise allowed in Section R316.5, foam plastic shall be separated from the interior of a building by an *approved* thermal barrier of not less than $\frac{1}{2}$ -inch (12.7 mm) gypsum wallboard, $\frac{23}{32}$ -inch (18.2 mm) *wood structural panel* or a material that is tested in accordance with and meets the acceptance criteria of both the Temperature Transmission Fire Test and the Integrity Fire Test of NFPA 275.

R316.5 Specific requirements. The following requirements shall apply to these uses of foam plastic unless specifically *approved* in accordance with Section R316.6 or by other sections of the code or the requirements of Sections R316.2 through R316.4 have been met.

R316.5.1 Masonry or concrete construction. The thermal barrier specified in Section R316.4 is not required in a masonry or concrete wall, floor or roof where the foam plastic insulation is separated from the interior of the building by not less than a 1-inch (25 mm) thickness of masonry or concrete.

R316.5.2 Roofing. The thermal barrier specified in Section R316.4 is not required where the foam plastic in a *roof assembly* or under a roof covering is installed in accordance with the code and the manufacturer's instructions and is separated from the interior of the building by tongue-and-groove wood planks or *wood structural panel* sheathing, in accordance with Section R803, that is not less than $\frac{15}{32}$ inch (11.9 mm) thick bonded with exterior glue, identified as Exposure 1 and with edges supported by blocking or tongue-and-groove joints or an equivalent material. The *smoke-developed index* for roof applications shall not be limited.

R316.5.3 Attics. The thermal barrier specified in Section R316.4 is not required where all of the following apply:

1. Attic access is required by Section R807.1.

BUILDING PLANNING

2. The space is entered only for purposes of repairs or maintenance.
3. The foam plastic insulation has been tested in accordance with Section R316.6 or the foam plastic insulation is protected against ignition using one of the following ignition barrier materials:
 - 3.1. $1\frac{1}{2}$ -inch-thick (38 mm) mineral fiber insulation.
 - 3.2. $\frac{1}{4}$ -inch-thick (6.4 mm) wood structural panels.
 - 3.3. $\frac{3}{8}$ -inch (9.5 mm) particleboard.
 - 3.4. $\frac{1}{4}$ -inch (6.4 mm) hardboard.
 - 3.5. $\frac{3}{8}$ -inch (9.5 mm) gypsum board.
 - 3.6. Corrosion-resistant steel having a base metal thickness of 0.016 inch (0.406 mm).
 - 3.7. $1\frac{1}{2}$ -inch-thick (38 mm) cellulose insulation.
 - 3.8. $\frac{1}{4}$ -inch (6.4 mm) fiber-cement panel, soffit or backer board.

The ignition barrier is not required where the foam plastic insulation has been tested in accordance with Section R316.6.

R316.5.4 Crawl spaces. The thermal barrier specified in Section R316.4 is not required where all of the following apply:

1. *Crawl space* access is required by Section R408.4.
2. Entry is made only for purposes of repairs or maintenance.
3. The foam plastic insulation has been tested in accordance with Section R316.6 or the foam plastic insulation is protected against ignition using one of the following ignition barrier materials:
 - 3.1. $1\frac{1}{2}$ -inch-thick (38 mm) mineral fiber insulation.
 - 3.2. $\frac{1}{4}$ -inch-thick (6.4 mm) wood structural panels.
 - 3.3. $\frac{3}{8}$ -inch (9.5 mm) particleboard.
 - 3.4. $\frac{1}{4}$ -inch (6.4 mm) hardboard.
 - 3.5. $\frac{3}{8}$ -inch (9.5 mm) gypsum board.
 - 3.6. Corrosion-resistant steel having a base metal thickness of 0.016 inch (0.406 mm).
 - 3.7. $\frac{1}{4}$ -inch (6.4 mm) fiber-cement panel, soffit or backer board.

R316.5.5 Foam-filled exterior doors. Foam-filled exterior doors are exempt from the requirements of Sections R316.3 and R316.4.

R316.5.6 Foam-filled garage doors. Foam-filled garage doors in attached or detached garages are exempt from the requirements of Sections R316.3 and R316.4.

R316.5.7 Foam backer board. The thermal barrier specified in Section R316.4 is not required where siding backer board foam plastic insulation has a thickness of not more than 0.5 inch (12.7 mm) and a potential heat of

not more than 2000 Btu per square foot ($22\ 720\ kJ/m^2$) when tested in accordance with NFPA 259 and it complies with one or more of the following:

1. The foam plastic insulation is separated from the interior of the building by not less than 2 inches (51 mm) of mineral fiber insulation.
2. The foam plastic insulation is installed over existing exterior wall finish in conjunction with re-siding.
3. The foam plastic insulation has been tested in accordance with Section R316.6.

R316.5.8 Re-siding. The thermal barrier specified in Section R316.4 is not required where the foam plastic insulation is installed over existing exterior wall finish in conjunction with re-siding provided that the foam plastic has a thickness of not more than 0.5 inch (12.7 mm) and a potential heat of not more than 2000 Btu per square foot ($22\ 720\ kJ/m^2$) when tested in accordance with NFPA 259.

R316.5.9 Interior trim. The thermal barrier specified in Section R316.4 is not required for exposed foam plastic interior *trim*, provided that all of the following are met:

1. The density is not less than 20 pounds per cubic foot ($320\ kg/m^3$).
2. The thickness of the *trim* is not more than 0.5 inch (12.7 mm) and the width is not more than 8 inches (204 mm).
3. The interior *trim* shall not constitute more than 10 percent of the aggregate wall and ceiling area of any room or space.
4. The flame spread index does not exceed 75 when tested in accordance with ASTM E84 or UL 723. The *smoke-developed index* is not limited.

R316.5.10 Interior finish. Foam plastics used as interior finishes shall comply with Section R316.6 and shall meet the flame spread index and *smoke-developed index* requirements of Sections R302.9.1 and R302.9.2.

R316.5.11 Sill plates and headers. Foam plastic spray applied to sill plates and headers or installed in the perimeter joist space without the thermal barrier specified in Section R316.4 shall comply with all of the following:

1. The thickness of the foam plastic shall be not more than $3\frac{1}{4}$ inches (83 mm).
2. The density of the foam plastic shall be in the range of 0.5 to 2.0 pounds per cubic foot (8 to $32\ kg/m^3$).
3. The foam plastic shall have a flame spread index of 25 or less and an accompanying *smoke-developed index* of 450 or less when tested in accordance with ASTM E84 or UL 723.

R316.5.12 Sheathing. Foam plastic insulation used as sheathing shall comply with Section R316.3 and Section R316.4. Where the foam plastic sheathing is exposed to the *attic* space at a gable or kneewall, the provisions of Section R316.5.3 shall apply. Where foam plastic insula-

BUILDING PLANNING

tion is used as exterior wall sheathing on framed wall assemblies, it shall comply with Section R316.8.

R316.5.13 Floors. The thermal barrier specified in Section R316.4 is not required to be installed on the walking surface of a structural floor system that contains foam plastic insulation where the foam plastic is covered by not less than a nominal $\frac{1}{2}$ -inch-thick (12.7 mm) *wood structural panel* or equivalent. The thermal barrier specified in Section R316.4 is required on the underside of the structural floor system that contains foam plastic insulation where the underside of the structural floor system is exposed to the interior of the building.

R316.6 Specific approval. Foam plastic not meeting the requirements of Sections R316.3 through R316.5 shall be specifically *approved* on the basis of one of the following *approved* tests: NFPA 286 with the acceptance criteria of Section R302.9.4, FM 4880, UL 1040 or UL 1715, or fire tests related to actual end-use configurations. Approval shall be based on the actual end-use configuration and shall be performed on the finished foam plastic assembly in the maximum thickness intended for use. Assemblies tested shall include seams, joints and other typical details used in the installation of the assembly and shall be tested in the manner intended for use.

R316.7 Termite damage. The use of foam plastics in areas of “very heavy” termite infestation probability shall be in accordance with Section R318.4.

R316.8 Wind resistance. Foam plastic insulation complying with ASTM C578 and ASTM C1289 and used as exterior wall sheathing on framed wall assemblies shall comply with SBCA FS 100 for wind pressure resistance unless installed directly over a sheathing material that is separately capable of resisting the wind load or otherwise exempted from the scope of SBCA FS 100.

SECTION R317 PROTECTION OF WOOD AND WOOD-BASED PRODUCTS AGAINST DECAY

R317.1 Location required. Protection of wood and wood-based products from decay shall be provided in the following locations by the use of *naturally durable wood* or wood that is preservative-treated in accordance with AWPA U1.

1. In crawl spaces or unexcavated areas located within the periphery of the building foundation, wood joists or the bottom of a wood structural floor where closer than 18 inches (457 mm) to exposed ground, wood girders where closer than 12 inches (305 mm) to exposed ground, and wood columns where closer than 8 inches (204 mm) to exposed ground.
2. Wood framing members, including columns, that rest directly on concrete or masonry exterior foundation walls and are less than 8 inches (203 mm) from the exposed ground.
3. Sills and sleepers on a concrete or masonry slab that is in direct contact with the ground unless separated from such slab by an impervious moisture barrier.

4. The ends of wood girders entering exterior masonry or concrete walls having clearances of less than $\frac{1}{2}$ inch (12.7 mm) on tops, sides and ends.
5. Wood siding, sheathing and wall framing on the exterior of a building having a clearance of less than 6 inches (152 mm) from the ground or less than 2 inches (51 mm) measured vertically from concrete steps, porch slabs, patio slabs and similar horizontal surfaces exposed to the weather.
6. Wood structural members supporting moisture-permeable floors or roofs that are exposed to the weather, such as concrete or masonry slabs, unless separated from such floors or roofs by an impervious moisture barrier.
7. Wood furring strips or other wood framing members attached directly to the interior of exterior masonry walls or concrete walls below *grade* except where an *approved* vapor retarder is applied between the wall and the furring strips or framing members.
8. Portions of wood structural members that form the structural supports of buildings, balconies, porches or similar permanent building appurtenances where those members are exposed to the weather without adequate protection from a roof, eave, overhang or other covering that would prevent moisture or water accumulation on the surface or at joints between members.

Exception: Sawn lumber used in buildings located in a geographical region where experience has demonstrated that climatic conditions preclude the need to use naturally durable or preservative-treated wood where the structure is exposed to the weather.

9. Wood columns in contact with *basement* floor slabs unless supported by concrete piers or metal pedestals projecting not less than 1 inch (25 mm) above the concrete floor and separated from the concrete pier by an impervious moisture barrier.

R317.1.1 Field treatment. Field-cut ends, notches and drilled holes of preservative-treated wood shall be treated in the field in accordance with AWPA M4.

R317.1.2 Ground contact. All wood in contact with the ground, embedded in concrete in direct contact with the ground or embedded in concrete exposed to the weather that supports permanent structures intended for human occupancy shall be *approved* pressure-preservative-treated wood suitable for ground contact use, except that untreated wood used entirely below groundwater level or continuously submerged in fresh water shall not be required to be pressure-preservative treated.

R317.2 Quality mark. Lumber and plywood required to be pressure-preservative treated in accordance with Section R318.1 shall bear the quality *mark* of an *approved* inspection agency that maintains continuing supervision, testing and inspection over the quality of the product and that has been *approved* by an accreditation body that complies with the

requirements of the American Lumber Standard Committee treated wood program.

R317.2.1 Required information. The required quality *mark* on each piece of pressure-preservative-treated lumber or plywood shall contain the following information:

1. Identification of the treating plant.
2. Type of preservative.
3. The minimum preservative retention.
4. End use for which the product was treated.
5. Standard to which the product was treated.
6. Identity of the *approved* inspection agency.
7. The designation "Dry," if applicable.

Exception: Quality *marks* on lumber less than 1 inch (25 mm) nominal thickness, or lumber less than nominal 1 inch by 5 inches (25 mm by 127 mm) or 2 inches by 4 inches (51 mm by 102 mm) or lumber 36 inches (914 mm) or less in length shall be applied by stamping the faces of exterior pieces or by end labeling not less than 25 percent of the pieces of a bundled unit.

R317.3 Fasteners and connectors in contact with preservative-treated and fire-retardant-treated wood.

Fasteners, including nuts and washers, and connectors in contact with preservative-treated wood and fire-retardant-treated wood shall be in accordance with this section. The coating weights for zinc-coated fasteners shall be in accordance with ASTM A153. Stainless steel driven fasteners shall be in accordance with the material requirements of ASTM F1667.

R317.3.1 Fasteners for preservative-treated wood.

Fasteners, including nuts and washers, for preservative-treated wood shall be of hot-dipped, zinc-coated galvanized steel, stainless steel, silicon bronze or copper. Staples shall be of stainless steel. Coating types and weights for connectors in contact with preservative-treated wood shall be in accordance with the connector manufacturer's recommendations. In the absence of manufacturer's recommendations, not less than ASTM A653 type G185 zinc-coated galvanized steel, or equivalent, shall be used.

Exceptions:

1. $\frac{1}{2}$ -inch-diameter (12.7 mm) or greater steel bolts.
2. Fasteners other than nails, staples and timber rivets shall be permitted to be of mechanically deposited zinc-coated steel with coating weights in accordance with ASTM B695, Class 55 minimum.
3. Plain carbon steel fasteners in SBX/DOT and zinc borate preservative-treated wood in an interior, dry environment shall be permitted.

R317.3.2 Fastenings for wood foundations. Fastenings, including nuts and washers, for wood foundations shall be as required in AWC PWF.

R317.3.3 Fasteners for fire-retardant-treated wood used in exterior applications or wet or damp locations.

Fasteners, including nuts and washers, for fire-retardant-treated wood used in exterior applications or wet or damp locations shall be of hot-dipped, zinc-coated galvanized steel, stainless steel, silicon bronze or copper. Fasteners other than nails, staples and timber rivets shall be permitted to be of mechanically deposited zinc-coated steel with coating weights in accordance with ASTM B695, Class 55 minimum.

R317.3.4 Fasteners for fire-retardant-treated wood used in interior applications. Fasteners, including nuts and washers, for fire-retardant-treated wood used in interior locations shall be in accordance with the manufacturer's recommendations. In the absence of the manufacturer's recommendations, Section R317.3.3 shall apply.

R317.4 Plastic composites. *Plastic composite* exterior deck boards, stair treads, *guards* and *handrails* containing wood, cellulosic or other biodegradable materials shall comply with the requirements of Section R507.2.2.

SECTION R318 PROTECTION AGAINST SUBTERRANEAN TERMITES

R318.1 Subterranean termite control methods. In areas subject to damage from termites as indicated by Table R301.2, protection shall be by one, or a combination, of the following methods:

1. Chemical termiticide treatment in accordance with Section R318.2.
2. Termite-baiting system installed and maintained in accordance with the *label*.
3. Pressure-preservative-treated wood in accordance with the provisions of Section R317.1.
4. Naturally durable termite-resistant wood.
5. Physical barriers in accordance with Section R318.3 and used in locations as specified in Section R317.1.
6. Cold-formed steel framing in accordance with Sections R505.2.1 and R603.2.1.

R318.1.1 Quality mark. Lumber and plywood required to be pressure-preservative treated in accordance with Section R318.1 shall bear the quality *mark* of an *approved* inspection agency that maintains continuing supervision, testing and inspection over the quality of the product and that has been *approved* by an accreditation body that complies with the requirements of the American Lumber Standard Committee treated wood program.

R318.1.2 Field treatment. Field-cut ends, notches and drilled holes of pressure-preservative-treated wood shall be retreated in the field in accordance with AWPA M4.

R318.2 Chemical termiticide treatment. Chemical termiticide treatment shall include soil treatment or field-applied wood treatment. The concentration, rate of application and method of treatment of the chemical termiticide shall be in strict accordance with the termiticide *label*.

BUILDING PLANNING

R318.3 Barriers. Approved physical barriers, such as metal or plastic sheeting or collars specifically designed for termite prevention, shall be installed in a manner to prevent termites from entering the structure. Shields placed on top of an exterior foundation wall shall be used only if in combination with another method of protection.

R318.4 Foam plastic protection. In areas where the probability of termite infestation is “very heavy” as indicated in Figure R318.4, extruded and expanded polystyrene, polyisocyanurate and other foam plastics shall not be installed on the exterior face or under interior or exterior foundation walls or slab foundations located below *grade*. The clearance between foam plastics installed above *grade* and exposed earth shall be not less than 6 inches (152 mm).

Exceptions:

1. Buildings where the structural members of walls, floors, ceilings and roofs are entirely of *noncombustible materials* or pressure-preserved-treated wood.
2. Where in addition to the requirements of Section R318.1, an *approved* method of protecting the foam plastic and structure from subterranean termite damage is used.
3. On the interior side of basement *walls*.

SECTION R319 SITE ADDRESS

R319.1 Address identification. Buildings shall be provided with *approved* address identification. The address identification shall be legible and placed in a position that is visible from the street or road fronting the property. Address identification characters shall contrast with their background. Address numbers shall be Arabic numbers or alphabetical letters. Numbers shall not be spelled out. Each character shall be not less than 4 inches (102 mm) in height with a stroke width of not less than 0.5 inch (12.7 mm). Where required by the fire code official, address identification shall be provided in additional *approved* locations to facilitate emergency response. Where access is by means of a private road and the building address cannot be viewed from the *public way*, a monument, pole or other sign or means shall be used to identify the structure. Address identification shall be maintained.

SECTION R320 ACCESSIBILITY

R320.1 Scope. Where there are four or more *dwelling units* or *sleeping units* in a single structure, the provisions of Chapter 11 of the *International Building Code* for Group R-3 shall apply.

Exception: Owner-occupied *lodging houses* with five or fewer guestrooms are not required to be accessible.

R320.2 Live/work units. In *live/work units*, the nonresidential portion shall be accessible in accordance with Sections 508.5.9 and 508.5.11 of the *International Building Code*. In

a structure where there are four or more *live/work units*, the dwelling portion of the *live/work unit* shall comply with Section 1108.6.2.1 of the *International Building Code*.

SECTION R321 ELEVATORS AND PLATFORM LIFTS

R321.1 Elevators. Where provided, passenger elevators, limited-use and limited-application elevators or private residence elevators shall comply with ASME A17.1/CSA B44.

R321.2 Platform lifts. Where provided, platform lifts shall comply with ASME A18.1.

R321.3 Accessibility. Elevators or platform lifts that are part of an accessible route required by Chapter 11 of the *International Building Code*, shall comply with ICC A117.1.

SECTION R322 FLOOD-RESISTANT CONSTRUCTION

R322.1 General. Buildings and structures constructed in whole or in part in flood hazard areas, including A or V Zones and Coastal A Zones, as established in Table R301.2, and substantial improvement and *repair* of substantial damage of buildings and structures in flood hazard areas, shall be designed and constructed in accordance with the provisions contained in this section. Buildings and structures that are located in more than one flood hazard area shall comply with the provisions associated with the most restrictive flood hazard area. Buildings and structures located in whole or in part in identified floodways shall be designed and constructed in accordance with ASCE 24.


R322.1.1 Alternative provisions. As an alternative to the requirements in Section R322, ASCE 24 is permitted subject to the limitations of this code and the limitations therein.

R322.1.2 Structural systems. Structural systems of buildings and structures shall be designed, connected and anchored to resist flotation, collapse or permanent lateral movement due to structural loads and stresses from flooding equal to the design flood elevation.

R322.1.3 Flood-resistant construction. Buildings and structures erected in areas prone to flooding shall be constructed by methods and practices that minimize flood damage.

R322.1.4 Establishing the design flood elevation. The design flood elevation shall be used to define flood hazard areas. At a minimum, the design flood elevation shall be the higher of the following:

1. The base flood elevation at the depth of peak elevation of flooding, including wave height, that has a 1-percent (100-year flood) or greater chance of being equaled or exceeded in any given year.
2. The elevation of the design flood associated with the area designated on a flood hazard map adopted by the community, or otherwise legally designated.

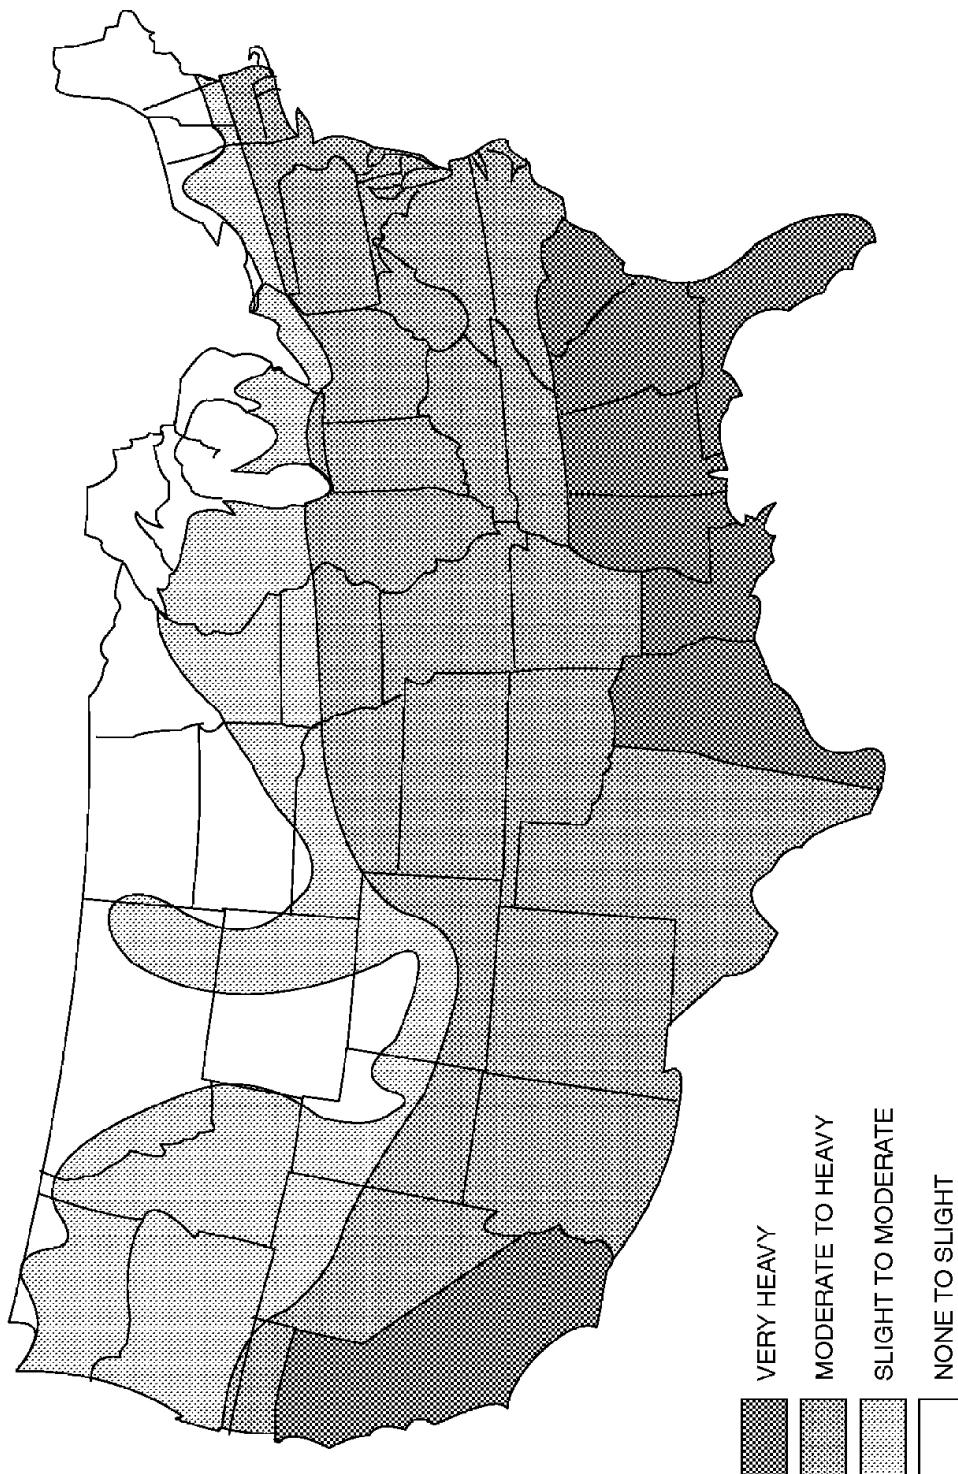

Note: Lines defining areas are approximate only. Local conditions may be more or less severe than indicated by the region classification.

**FIGURE R318.4
TERMITE INFESTATION PROBABILITY MAP**

BUILDING PLANNING

R322.1.4.1 Determination of design flood elevations. If design flood elevations are not specified, the *building official* is authorized to require the applicant to comply with either of the following:

1. Obtain and reasonably use data available from a federal, state or other source.
2. Determine the design flood elevation in accordance with accepted hydrologic and hydraulic engineering practices used to define special flood hazard areas. Determinations shall be undertaken by a *registered design professional* who shall document that the technical methods used reflect currently accepted engineering practice. Studies, analyses and computations shall be submitted in sufficient detail to allow thorough review and *approval*.

R322.1.4.2 Determination of impacts. In riverine flood hazard areas where design flood elevations are specified but floodways have not been designated, the applicant shall demonstrate that the effect of the proposed buildings and structures on design flood elevations, including fill, when combined with other existing and anticipated flood hazard area encroachments, will not increase the design flood elevation more than 1 foot (305 mm) at any point within the *jurisdiction*.

R322.1.5 Lowest floor. The lowest floor shall be the lowest floor of the lowest enclosed area, including *basement*, and excluding any unfinished flood-resistant enclosure that is useable solely for vehicle parking, building access or limited storage provided that such enclosure is not built so as to render the building or structure in violation of this section.

R322.1.6 Protection of mechanical, plumbing and electrical systems. Electrical systems, *equipment* and components; heating, ventilating, air-conditioning; plumbing *appliances* and plumbing fixtures; *duct systems*; and other service *equipment* shall be located at or above the elevation required in Section R322.2 or R322.3. If replaced as part of a substantial improvement, electrical systems, *equipment* and components; heating, ventilating, air-conditioning and plumbing *appliances* and plumbing fixtures; *duct systems*; and other service *equipment* shall meet the requirements of this section. Systems, fixtures, and *equipment* and components shall not be mounted on or penetrate through walls intended to break away under flood loads.

Exception: Locating electrical systems, *equipment* and components; heating, ventilating, air-conditioning; plumbing *appliances* and plumbing fixtures; *duct systems*; and other service *equipment* is permitted below the elevation required in Section R322.2 or R322.3 provided that they are designed and installed to prevent water from entering or accumulating within the components and to resist hydrostatic and hydrodynamic loads and stresses, including the effects of buoyancy, during the occurrence of flooding to the required elevation in accordance with ASCE 24. Elec-

trical wiring systems are permitted to be located below the required elevation provided that they conform to the provisions of the electrical part of this code for wet locations.

R322.1.7 Protection of water supply and sanitary sewage systems. New and replacement water supply systems shall be designed to minimize or eliminate infiltration of flood waters into the systems in accordance with the plumbing provisions of this code. New and replacement sanitary sewage systems shall be designed to minimize or eliminate infiltration of floodwaters into systems and discharges from systems into floodwaters in accordance with the plumbing provisions of this code and Chapter 3 of the *International Private Sewage Disposal Code*.

R322.1.8 Flood-resistant materials. Building materials and installation methods used for flooring and interior and exterior walls and wall coverings below the elevation required in Section R322.2 or R322.3 shall be flood damage-resistant materials that conform to the provisions of FEMA TB-2.

R322.1.9 Manufactured homes. The bottom of the frame of new and replacement *manufactured homes* on foundations that conform to the requirements of Section R322.2 or R322.3, as applicable, shall be elevated to or above the elevations specified in Section R322.2 (flood hazard areas including A Zones) or R322.3 in coastal high-hazard areas (V Zones and Coastal A Zones). The anchor and tie-down requirements of the applicable state or federal requirements shall apply. The foundation and anchorage of *manufactured homes* to be located in identified floodways shall be designed and constructed in accordance with ASCE 24.

R322.1.10 As-built elevation documentation. A *registered design professional* shall prepare and seal documentation of the elevations specified in Section R322.2 or R322.3.

R322.2 Flood hazard areas (including A Zones). Areas that have been determined to be prone to flooding and that are not subject to high-velocity wave action shall be designated as flood hazard areas. Flood hazard areas that have been delineated as subject to wave heights between $1\frac{1}{2}$ feet (457 mm) and 3 feet (914 mm) or otherwise designated by the *jurisdiction* shall be designated as Coastal A Zones and are subject to the requirements of Section R322.3. Buildings and structures constructed in whole or in part in flood hazard areas shall be designed and constructed in accordance with Sections R322.2.1 through R322.2.4.

R322.2.1 Elevation requirements.

1. Buildings and structures in flood hazard areas, not including flood hazard areas designated as Coastal A Zones, shall have the lowest floors elevated to or above the base flood elevation plus 1 foot (305 mm), or the design flood elevation, whichever is higher.
2. In areas of shallow flooding (AO Zones), buildings and structures shall have the lowest floor

(including *basement*) elevated to a height above the highest adjacent *grade* of not less than the depth number specified in feet (mm) on the FIRM plus 1 foot (305 mm), or not less than 3 feet (915 mm) if a depth number is not specified.

3. *Basement* floors that are below *grade* on all sides shall be elevated to or above base flood elevation plus 1 foot (305 mm), or the design flood elevation, whichever is higher.
4. Garage and carport floors shall comply with one of the following:
 - 4.1. They shall be elevated to or above the elevations required in Item 1 or Item 2, as applicable.
 - 4.2. They shall be at or above *grade* on not less than one side. Where a garage or carport is enclosed by walls, the garage or carport shall be used solely for parking, building access or storage.

Exception: Enclosed areas below the elevation required in this section, including *basements* with floors that are not below *grade* on all sides, shall meet the requirements of Section R322.2.2.

R322.2 Enclosed area below required elevation.

Enclosed areas, including *crawl spaces*, that are below the elevation required in Section R322.2.1 shall:

1. Be used solely for parking of vehicles, building access or storage.
2. Be provided with flood openings that meet the following criteria and are installed in accordance with Section R322.2.2.1:
 - 2.1. The total net area of nonengineered openings shall be not less than 1 square inch (645 mm^2) for each square foot (0.093 m^2) of enclosed area where the enclosed area is measured on the exterior of the enclosure walls, or the openings shall be designed as engineered openings and the *construction documents* shall include a statement by a *registered design professional* that the design of the openings will provide for equalization of hydrostatic flood forces on exterior walls by allowing for the automatic entry and exit of floodwaters as specified in Section 2.7.2.2 of ASCE 24.
 - 2.2. Openings shall be not less than 3 inches (76 mm) in any direction in the plane of the wall.
 - 2.3. The presence of louvers, blades, screens and faceplates or other covers and devices shall allow the automatic flow of floodwater into and out of the enclosed areas and shall be accounted for in the determination of the net open area.

R322.2.2.1 Installation of openings. The walls of enclosed areas shall have openings installed such that:

1. There shall be not less than two openings on different sides of each enclosed area; if a building has more than one enclosed area, each area shall have openings.
2. The bottom of each opening shall be not more than 1 foot (305 mm) above the higher of the final interior grade or floor and the finished exterior grade immediately under each opening.
3. Openings shall be permitted to be installed in doors and windows; doors and windows without installed openings do not meet the requirements of this section.

R322.2.3 Foundation design and construction.

Foundation walls for buildings and structures erected in flood hazard areas shall meet the requirements of Chapter 4.

Exception: Unless designed in accordance with Section R404:

1. The unsupported height of 6-inch (152 mm) plain masonry walls shall be not more than 3 feet (914 mm).
2. The unsupported height of 8-inch (203 mm) plain masonry walls shall be not more than 4 feet (1219 mm).
3. The unsupported height of 8-inch (203 mm) reinforced masonry walls shall be not more than 8 feet (2438 mm).

For the purpose of this exception, unsupported height is the distance from the finished *grade* of the under-floor space to the top of the wall.

R322.2.4 Tanks. Underground tanks shall be anchored to prevent flotation, collapse and lateral movement under conditions of the base flood. Above-ground tanks shall be installed at or above the elevation required in Section R322.2.1 or shall be anchored to prevent flotation, collapse and lateral movement under conditions of the base flood.

R322.3 Coastal high-hazard areas (including V Zones and Coastal A Zones, where designated). Areas that have been determined to be subject to wave heights in excess of 3 feet (914 mm) or subject to high-velocity wave action or wave-induced erosion shall be designated as coastal high-hazard areas. Flood hazard areas that have been designated as subject to wave heights between $1\frac{1}{2}$ feet (457 mm) and 3 feet (914 mm) or otherwise designated by the *jurisdiction* shall be designated as Coastal A Zones. Buildings and structures constructed in whole or in part in coastal high-hazard areas and Coastal A Zones, where designated, shall be designed and constructed in accordance with Sections R322.3.1 through R322.3.10.

R322.3.1 Location and site preparation.

1. New buildings and buildings that are determined to be substantially improved pursuant to Section

BUILDING PLANNING

- R105.3.1.1 shall be located landward of the reach of mean high tide.
2. For any alteration of sand dunes and mangrove stands, the *building official* shall require submission of an engineering analysis that demonstrates that the proposed alteration will not increase the potential for flood damage.

R322.3.2 Elevation requirements.

1. Buildings and structures erected within coastal high-hazard areas and Coastal A Zones, shall be elevated so that the bottom of the lowest horizontal structural members supporting the lowest floor, with the exception of piling, pile caps, columns, grade beams and bracing, is elevated to or above the base flood elevation plus 1 foot (305 mm) or the design flood elevation, whichever is higher.
2. *Basement* floors that are below *grade* on all sides are prohibited.
3. Garages used solely for parking, building access or storage, and carports shall comply with Item 1 or shall be at or above *grade* on not less than one side and, if enclosed with walls, such walls shall comply with Item 6.
4. The use of fill for structural support is prohibited.
5. Minor grading, and the placement of minor quantities of fill, shall be permitted for landscaping and for drainage purposes under and around buildings and for support of parking slabs, pool decks, patios and walkways.
6. Walls and partitions enclosing areas below the elevation required in this section shall meet the requirements of Sections R322.3.5 and R322.3.6.

R322.3.3 Foundations. Buildings and structures erected in coastal high-hazard areas and Coastal A Zones shall be supported on pilings or columns and shall be adequately anchored to such pilings or columns and shall comply with the following:

1. The space below the elevated building shall be either free of obstruction or, if enclosed with walls, the walls shall meet the requirements of Section R322.3.5.
2. Pilings shall have adequate soil penetrations to resist the combined wave and wind loads (lateral and uplift) and pile embedment shall include consideration of decreased resistance capacity caused by scour of soil strata surrounding the piling.
3. Columns and their supporting foundations shall be designed to resist combined wave and wind loads, lateral and uplift, and shall include consideration of decreased resistance capacity caused by scour of soil strata surrounding the columns. Spread footing, mat, raft or other foundations that support columns shall not be permitted where soil investigations that are required in accordance with Section R401.4 indicate that soil material under

the spread footing, mat, raft or other foundation is subject to scour or erosion from wave-velocity flow conditions. If permitted, spread footing, mat, raft or other foundations that support columns shall be designed in accordance with ASCE 24.

4. Flood and wave loads shall be those associated with the design flood. Wind loads shall be those required by this code.
5. Foundation designs and *construction documents* shall be prepared and sealed in accordance with Section R322.3.9.

Exception: In Coastal A Zones, stem wall foundations supporting a floor system above and backfilled with soil or gravel to the underside of the floor system shall be permitted provided that the foundations are designed to account for wave action, debris impact, erosion and local scour. Where soils are susceptible to erosion and local scour, stem wall foundations shall have deep footings to account for the loss of soil.

R322.3.4 Concrete slabs. Concrete slabs used for parking, floors of enclosures, landings, decks, walkways, patios and similar uses that are located beneath structures, or slabs that are located such that if undermined or displaced during base flood conditions could cause structural damage to the building foundation, shall be designed and constructed in accordance with one of the following:

1. To be structurally independent of the foundation system of the structure, to not transfer flood loads to the main structure, and to be frangible and break away under flood conditions prior to base flood conditions. Slabs shall be a maximum of 4 inches (102 mm) thick, shall not have turned-down edges, shall not contain reinforcing, shall have isolation joints at pilings and columns, and shall have control or construction joints in both directions spaced not more than 4 feet (1219 mm) apart.
2. To be self-supporting, structural slabs capable of remaining intact and functional under base flood conditions, including erosion and local scour, and the main structure shall be capable of resisting any added flood loads and effects of local scour caused by the presence of the slabs.

R322.3.5 Walls below required elevation. Walls and partitions are permitted below the elevation required in Section R322.3.2, provided that such walls and partitions are not part of the structural support of the building or structure and:

1. Electrical, mechanical and plumbing system components are not to be mounted on or penetrate through walls that are designed to break away under flood loads; and
2. Are constructed with insect screening or open lattice; or
3. Are designed to break away or collapse without causing collapse, displacement or other structural damage to the elevated portion of the building or

supporting foundation system. Such walls, framing and connections shall have a resistance of not less than 10 (479 Pa) and not more than 20 pounds per square foot (958 Pa) as determined using allowable stress design; or

4. Where wind loading values of this code exceed 20 pounds per square foot (958 Pa), as determined using allowable stress design, the *construction documents* shall include documentation prepared and sealed by a *registered design professional* that:
 - 4.1. The walls and partitions below the required elevation have been designed to collapse from a water load less than that which would occur during the base flood.
 - 4.2. The elevated portion of the building and supporting foundation system have been designed to withstand the effects of wind and flood loads acting simultaneously on structural and nonstructural building components. Water-loading values used shall be those associated with the design flood. Wind-loading values shall be those required by this code.
5. Walls intended to break away under flood loads as specified in Item 3 or 4 have flood openings that meet the criteria in Section R322.2.2, Item 2.

R322.3.6 Enclosed areas below required elevation. Enclosed areas below the elevation required in Section R322.3.2 shall be used solely for parking of vehicles, building access or storage.

R322.3.6.1 Protection of building envelope. An exterior door that meets the requirements of Section R609 shall be installed at the top of stairs that provide access to the building and that are enclosed with walls designed to break away in accordance with Section R322.3.5.

R322.3.7 Stairways and ramps. *Stairways and ramps* that are located below the lowest floor elevations specified in Section R322.3.2 shall comply with one or more of the following:

1. Be designed and constructed with open or partially open *risers* and *guards*.
2. *Stairways and ramps* not part of the required means of egress shall be designed and constructed to break away during design flood conditions without causing damage to the building or structure, including foundation.
3. Be retractable, or able to be raised to or above the lowest floor elevation, provided that the ability to be retracted or raised prior to the onset of flooding is not contrary to the means of egress requirements of the code.
4. Be designed and constructed to resist flood loads and minimize transfer of flood loads to the building or structure, including foundation.

Areas below *stairways* and *ramps* shall not be enclosed with walls below the required in Section R322.3.2 elevation unless such walls are constructed in accordance with Section R322.3.5.

R322.3.8 Decks and porches. Attached decks and porches shall meet the elevation requirements of Section R322.3.2 and shall either meet the foundation requirements of this section or shall be cantilevered from or knee braced to the building or structure. Self-supporting decks and porches that are below the elevation required in Section R322.3.2 shall not be enclosed by solid, rigid walls, including walls designed to break away. Self-supporting decks and porches shall be designed and constructed to remain in place during base flood conditions or shall be frangible and break away under base flood conditions.

R322.3.9 Construction documents. The *construction documents* shall include documentation that is prepared and sealed by a *registered design professional* that the design and methods of construction to be used meet the applicable criteria of this section.

R322.3.10 Tanks. Underground tanks shall be anchored to prevent flotation, collapse and lateral movement under conditions of the base flood. Above-ground tanks shall be installed at or above the elevation required in Section R322.3.2. Where elevated on platforms, the platforms shall be cantilevered from or knee braced to the building or shall be supported on foundations that conform to the requirements of Section R322.3.

SECTION R323 STORM SHELTERS

R323.1 General. This section applies to *storm shelters* where constructed as separate detached buildings or where constructed as safe rooms within buildings for the purpose of providing refuge from storms that produce high winds, such as tornados and hurricanes. In addition to other applicable requirements in this code, storm shelters shall be constructed in accordance with ICC 500.

R323.1.1 Sealed documentation. The *construction documents* for all structural components and *impact protective systems* of the *storm shelter* shall be prepared and sealed by a *registered design professional* indicating that the design meets the criteria of ICC 500.

Exception: *Storm shelters*, structural components and impact-protective systems that are *listed* and *labeled* to indicate compliance with ICC 500.

SECTION R324 SOLAR ENERGY SYSTEMS

R324.1 General. Solar energy systems shall comply with the provisions of this section.

R324.2 Solar thermal systems. Solar thermal systems shall be designed and installed in accordance with Chapter 23.

BUILDING PLANNING

R324.3 Photovoltaic systems. Photovoltaic (PV) systems shall be designed and installed in accordance with Sections R324.3.1 through R324.7.1 and the manufacturer's installation instructions. The electrical portion of solar PV systems shall be designed and installed in accordance with NFPA 70.

R324.3.1 Equipment listings. *Photovoltaic panels* and modules shall be *listed* and *labeled* in accordance with UL 1703 or with both UL 61730-1 and UL 61730-2. Inverters shall be *listed* and *labeled* in accordance with UL 1741. Systems connected to the utility grid shall use inverters *listed* for utility interaction. Mounting systems *listed* and *labeled* in accordance with UL 2703 shall be installed in accordance with the manufacturer's installation instructions and their listings.

R324.4 Rooftop-mounted photovoltaic systems. Rooftop-mounted *photovoltaic panel systems* installed on or above the roof covering shall be designed and installed in accordance with this section.

R324.4.1 Structural requirements. Rooftop-mounted *photovoltaic panel systems* shall be designed to structurally support the system and withstand applicable gravity loads in accordance with Chapter 3. The roof on which these systems are installed shall be designed and constructed to support the loads imposed by such systems in accordance with Chapter 8.

R324.4.1.1 Roof load. Portions of roof structures not covered with *photovoltaic panel systems* shall be designed for dead loads and roof loads in accordance with Sections R301.4 and R301.6. Portions of roof structures covered with *photovoltaic panel systems* shall be designed for the following load cases:

1. Dead load (including *photovoltaic panel* weight) plus snow load in accordance with Table R301.2.
2. Dead load (excluding *photovoltaic panel* weight) plus roof *live load* or snow load, whichever is greater, in accordance with Section R301.6.

R324.4.1.2 Wind load. Rooftop-mounted *photovoltaic panel* or *module* systems and their supports shall be designed and installed to resist the component and cladding loads specified in Table R301.2.1(1), adjusted for height and exposure in accordance with Table R301.2.1(2).

R324.4.2 Fire classification. Rooftop-mounted *photovoltaic panel systems* shall have the same fire classification as the *roof assembly* required in Section R902.

R324.4.3 Roof penetrations. Roof penetrations shall be flashed and sealed in accordance with Chapter 9.

R324.5 Building-integrated photovoltaic systems. Building-integrated photovoltaic (BIPV) systems that serve as roof coverings shall be designed and installed in accordance with Section R905.

R324.5.1 Photovoltaic shingles. Photovoltaic shingles shall comply with Section R905.16.

R324.5.2 Fire classification. *Building-integrated photovoltaic systems* shall have a fire classification in accordance with Section R902.3.

R324.5.3 BIPV roof panels. BIPV roof panels shall comply with Section R905.17.

R324.6 Roof access and pathways. Roof access, pathways and setback requirements shall be provided in accordance with Sections R324.6.1 through R324.6.2.1. Access and minimum spacing shall be required to provide emergency access to the roof, to provide pathways to specific areas of the roof, provide for smoke ventilation opportunity areas, and to provide emergency egress from the roof.

Exceptions:

1. Detached, nonhabitable structures, including but not limited to detached garages, parking shade structures, carports, solar trellises and similar structures, shall not be required to provide roof access.
2. Roof access, pathways and setbacks need not be provided where the code official has determined that rooftop operations will not be employed.
3. These requirements shall not apply to roofs with slopes of 2 units vertical in 12 units horizontal (17-percent slope) or less.
4. BIPV systems *listed* in accordance with Section 690.12(B)(2) of NFPA 70, where the removal or cutting away of portions of the BIPV system during fire-fighting operations has been determined to not expose a fire fighter to electrical shock hazards.

R324.6.1 Pathways. Not fewer than two pathways, on separate roof planes from lowest roof edge to ridge and not less than 36 inches (914 mm) wide, shall be provided on all buildings. Not fewer than one pathway shall be provided on the street or driveway side of the roof. For each roof plane with a photovoltaic array, a pathway not less than 36 inches wide (914 mm) shall be provided from the lowest roof edge to ridge on the same roof plane as the photovoltaic array, on an adjacent roof plane, or straddling the same and adjacent roof planes. Pathways shall be over areas capable of supporting fire fighters accessing the roof. Pathways shall be located in areas with minimal obstructions such as vent pipes, conduit, or mechanical equipment.

R324.6.2 Setback at ridge. For photovoltaic arrays occupying not more than 33 percent of the plan view total roof area, not less than an 18-inch (457 mm) clear setback is required on both sides of a horizontal ridge. For photovoltaic arrays occupying more than 33 percent of the plan view total roof area, not less than a 36-inch (914 mm) clear setback is required on both sides of a horizontal ridge.

R324.6.2.1 Alternative setback at ridge. Where an automatic sprinkler system is installed within the dwelling in accordance with NFPA 13D or Section P2904, setbacks at ridges shall comply with one of the following:

1. For photovoltaic arrays occupying not more than 66 percent of the plan view total roof area, not less than an 18-inch (457 mm) clear setback is required on both sides of a horizontal ridge.
2. For photovoltaic arrays occupying more than 66 percent of the plan view total roof area, not less than a 36-inch (914 mm) clear setback is required on both sides of a horizontal ridge.

R324.6.3 Emergency escape and rescue openings. Panels and modules installed on dwellings shall not be placed on the portion of a roof that is below an *emergency escape and rescue opening*. A pathway not less than 36 inches (914 mm) wide shall be provided to the emergency escape and rescue opening.

Exception: BIPV systems *listed* in accordance with Section 690.12(B)(2) of NFPA 70, where the removal or cutting away of portions of the BIPV system during fire-fighting operations has been determined to not expose a fire fighter to electrical shock hazards.

R324.7 Ground-mounted photovoltaic systems. Ground-mounted photovoltaic systems shall be designed and installed in accordance with Section R301.

R324.7.1 Fire separation distances. Ground-mounted photovoltaic systems shall be subject to the *fire separation distance* requirements determined by the local jurisdiction.

SECTION R325 MEZZANINES

R325.1 General. *Mezzanines* shall comply with Sections R325 through R325.5.

R325.2 Mezzanines. The clear height above and below *mezzanine* floor construction shall be not less than 7 feet (2134 mm).

R325.3 Area limitation. The aggregate area of a *mezzanine* or *mezzanines* shall be not greater than one-third of the floor area of the room or space in which they are located. The enclosed portion of a room shall not be included in a determination of the floor area of the room in which the *mezzanine* is located.

Exception: The aggregate area of a *mezzanine* located within a *dwelling unit* equipped with an automatic sprinkler system in accordance with Section P2904 shall not be greater than one-half of the floor area of the room, provided that the *mezzanine* meets all of the following requirements:

1. Except for enclosed closets and bathrooms, the *mezzanine* is open to the room in which such *mezzanine* is located.

2. The opening to the room is unobstructed except for walls not more than 42 inches (1067 mm) in height, columns and posts.

3. The exceptions to Section R325.5 are not applied.

R325.4 Means of egress. The means of egress for *mezzanines* shall comply with the applicable provisions of Section R311.

R325.5 Openness. *Mezzanines* shall be open and unobstructed to the room in which they are located except for walls not more than 36 inches (914 mm) in height, columns and posts.

Exceptions:

1. *Mezzanines* or portions thereof are not required to be open to the room in which they are located, provided that the aggregate floor area of the enclosed space is not greater than 10 percent of the *mezzanine* area.
2. In buildings that are not more than two stories above *grade plane* and equipped throughout with an automatic sprinkler system in accordance with Section R313, a *mezzanine* shall not be required to be open to the room in which the *mezzanine* is located.

SECTION R326 HABITABLE ATTICS

R326.1 General. Habitable attics shall comply with Sections R326.2 and R326.3.

R326.2 Minimum dimensions. A habitable attic shall have a floor area in accordance with Section R304 and a ceiling height in accordance with Section R305.

R326.3 Story above grade plane. A habitable attic shall be considered a story above *grade plane*.

Exceptions: A habitable attic shall not be considered to be a story above *grade plane* provided that the habitable attic meets all the following:

1. The aggregate area of the habitable attic is either of the following:
 - 1.1. Not greater than one-third of the floor area of the story below.
 - 1.2. Not greater than one-half of the floor area of the story below where the habitable attic is located within a dwelling unit equipped with a fire sprinkler system in accordance with Section P2904.
2. The occupiable space is enclosed by the roof assembly above, knee walls, if applicable, on the sides and the floor-ceiling assembly below.
3. The floor of the habitable attic does not extend beyond the exterior walls of the story below.
4. Where a habitable attic is located above a third story, the dwelling unit or townhouse unit shall be equipped with a fire sprinkler system in accordance with Section P2904.

BUILDING PLANNING

R326.4 Means of egress. The means of egress for habitable attics shall comply with the applicable provisions of Section R311.

SECTION R327 SWIMMING POOLS, SPAS AND HOT TUBS

R327.1 General. The design and construction of pools and spas shall comply with the *International Swimming Pool and Spa Code*.

SECTION R328 ENERGY STORAGE SYSTEMS

R328.1 General. Energy storage systems (ESS) shall comply with the provisions of this section.

Exceptions:

1. ESS listed and labeled in accordance with UL 9540 and marked "For use in residential dwelling units" where installed in accordance with the manufacturer's instructions and NFPA 70.
2. ESS less than 1 kWh (3.6 megajoules).

R328.2 Equipment listings. Energy storage systems (ESS) shall be listed and labeled in accordance with UL 9540.

Exception: Where approved, repurposed unlisted battery systems from electric vehicles are allowed to be installed outdoors or in detached sheds located not less than 5 feet (1524 mm) from exterior walls, property lines and public ways.

R328.3 Installation. ESS shall be installed in accordance with the manufacturer's instructions and their listing.

R328.3.1 Spacing. Individual units shall be separated from each other by not less than 3 feet (914 mm) except where smaller separation distances are documented to be adequate based on large-scale fire testing complying with Section 1207.1.5 of the *International Fire Code*.

R328.4 Locations. ESS shall be installed only in the following locations:

1. Detached garages and detached accessory structures.
2. Attached garages separated from the *dwelling unit* living space in accordance with Section R302.6.
3. Outdoors or on the exterior side of exterior walls located not less than 3 feet (914 mm) from doors and windows directly entering the *dwelling unit*.
4. Enclosed utility closets, basements, storage or utility spaces within *dwelling units* with finished or noncombustible walls and ceilings. Walls and ceilings of unfinished wood-framed construction shall be provided with not less than $\frac{5}{8}$ -inch (15.9 mm) Type X gypsum wallboard.

ESS shall not be installed in sleeping rooms, or closets or spaces opening directly into sleeping rooms.

R328.5 Energy ratings. Individual ESS units shall have a maximum rating of 20 kWh. The aggregate rating of the ESS shall not exceed:

1. 40 kWh within utility closets, basements and storage or utility spaces.
2. 80 kWh in attached or detached garages and detached accessory structures.
3. 80 kWh on exterior walls.
4. 80 kWh outdoors on the ground.

ESS installations exceeding the permitted individual or aggregate ratings shall be installed in accordance with Section 1207 of the *International Fire Code*.

R328.6 Electrical installation. ESS shall be installed in accordance with NFPA 70. Inverters shall be listed and labeled in accordance with UL 1741 or provided as part of the UL 9540 listing. Systems connected to the utility grid shall use inverters listed for utility interaction.

R328.7 Fire detection. Rooms and areas within *dwelling units*, basements and attached garages in which ESS are installed shall be protected by smoke alarms in accordance with Section R314. A heat detector, listed and interconnected to the smoke alarms, shall be installed in locations within *dwelling units* and attached garages where smoke alarms cannot be installed based on their listing.

R328.8 Protection from impact. ESS installed in a location subject to vehicle damage shall be protected by approved barriers.

R328.9 Ventilation. Indoor installations of ESS that produce hydrogen or other flammable gases during charging shall be provided with mechanical ventilation in accordance with Section M1307.4.

R328.10 Electric vehicle use. The temporary use of an owner or occupant's electric-powered vehicle to power a *dwelling unit* while parked in an attached or detached garage or outdoors shall comply with the vehicle manufacturer's instructions and NFPA 70.

R328.11 Documentation and labeling. The following information shall be provided:

1. A copy of the manufacturer's installation, operation, maintenance and decommissioning instructions shall be provided to the owner or placed in a conspicuous location near the ESS equipment.
2. A label on the installed system containing the contact information for the qualified maintenance and service providers.

SECTION R329 STATIONARY ENGINE GENERATORS

R329.1 General. Stationary engine generators shall be listed and labeled in accordance with UL 2200 and shall comply with this section. The connection of stationary engine generators to the premise wiring system shall be by means of a listed transfer switch.

R329.2 Installation. The installation of stationary engine generators shall be in an *approved* location and in accordance with the listing, the manufacturer's installation instructions and Chapters 34 through 43.

SECTION R330 STATIONARY FUEL CELL POWER SYSTEMS

R330.1 General. *Stationary fuel cell power systems* in new and existing buildings and structures shall comply with Section 1206 of the *International Fire Code*.

