


Adjusted BIC

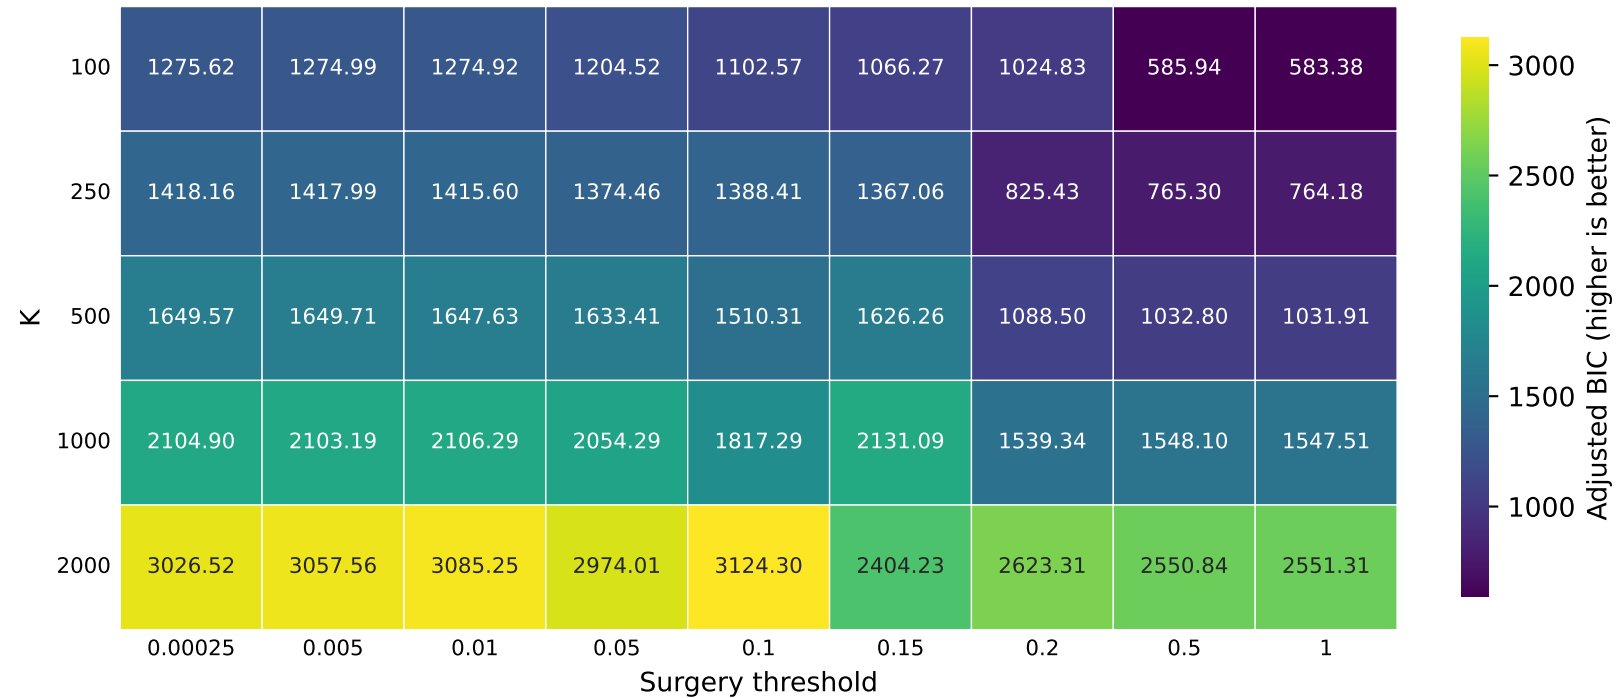

hddc across K and surgery threshold | noise ratio=noiseless, rank capacity=32