

RED-POWER ELECTRICAL ENGINEERING PTE LTD
BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197
TEL : 6 289 2298 FAX : 6 287 9635

TOWN COUNCIL	<u>NEE SOON TOWN COUNCIL</u>
LOCATION	<u>NEE SOON EAST DIVISION</u>
DATE OF SERVICING	5 /09/2025

WEEKLY FIRE ALARM CHECKLIST REPORT

1. SIMULATED TEST

- 1.1 Carry out a stimulated fire alarm call
 - 1.2 Operate any Alarm Zone
 - 1.3 Transmit a Fire Alarm Signal to the monitoring station and reset the system

2. MONITORING STATION

- 2.1 Contact the monitoring system prior to the transmitting of the fire alarm signal
 - 2.2 To warn them of the simulated fire condition to be tested
 - 2.3 Check with them after completion of test to ensure the fire alarm signal was received
 - 2.4 Advise the monitoring station that the system has been reset

3 BATTERY CONDITION

- ### 3.1 Check the battery voltage

4 SWITCHES

- 4.1 Ensure that all switches are in the correct operating condition after completion of tests
 - 4.2 Take immediate steps to rectify the fault(s) should they exist

5. DEFECTS

 - 5.1 Record in the log any fault(s) identified and that the above test has been carried out

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

1 SL

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

TOWN COUNCIL	<u>NEE SOON TOWN COUNCIL</u>
LOCATION	<u>NEE SOON EAST DIVISION</u>
DATE OF SERVICING	<u>5 /09/2025</u>

WEEKLY FIRE ALARM CHECKLIST REPORT

1. SIMULATED TEST

- 1.1 Carry out a stimulated fire alarm call
 - 1.2 Operate any Alarm Zone
 - 1.3 Transmit a Fire Alarm Signal to the monitoring station and reset the system

2. MONITORING STATION

- 2.1 Contact the monitoring system prior to the transmitting of the fire alarm signal
 - 2.2 To warn them of the simulated fire condition to be tested
 - 2.3 Check with them after completion of test to ensure the fire alarm signal was received
 - 2.4 Advise the monitoring station that the system has been reset

3. BATTERY CONDITION

- 3.1 Check the battery voltage
 - 3.2 Check the battery conditions

4 SWITCHES

- 4.1 Ensure that all switches are in the correct operating condition after completion of tests
 - 4.2 Take immediate steps to rectify the fault(s) should they exist

5. DEFECTS

5.1 Record in the logbook. Fault(s) identified and their cause(s) must be recorded.

卷之三

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

$$1 \frac{1}{\sqrt{2}}$$

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD
BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197
TEL : 6 289 2298 FAX : 6 287 9635

TOWN COUNCIL	<u>NEE SOON TOWN COUNCIL</u>
LOCATION	<u>NEE SOON EAST DIVISION</u>
DATE OF SERVICING	<u>16/09/2025</u>

WEEKLY FIRE ALARM CHECKLIST REPORT

1. SIMULATED TEST

- 1.1 Carry out a stimulated fire alarm call
 - 1.2 Operate any Alarm Zone
 - 1.3 Transmit a Fire Alarm Signal to the monitoring station and reset the system

2. MONITORING STATION

- 2.1 Contact the monitoring system prior to the transiting of the fire alarm signal
 - 2.2 To warn them of the simulated fire condition to be tested
 - 2.3 Check with them after completion of test to ensure the fire alarm signal was received
 - 2.4 Advise the monitoring station that the systm has been reset

3. BATTERY CONDITION

- 3.1 Check the battery voltage
 - 3.2 Check the battery conditions

4 SWITCHES

- 4.1 Ensure that all switches are in the correct operating condition after completion of tests
 - 4.2 Take immediate steps to rectify the fault(s) should they exist

5. DEFECTS

- 5.1 Record in the log any fault(s) identified and that the above test has been carried out

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

1 Df.

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

TOWN COUNCIL	<u>NEE SOON TOWN COUNCIL</u>
LOCATION	<u>NEE SOON EAST DIVISION</u>
DATE OF SERVICING	<u>6 /09/2025</u>

WEEKLY FIRE ALARM CHECKLIST REPORT

1. SIMULATED TEST

- 1.1 Carry out a stimulated fire alarm call
 - 1.2 Operate any Alarm Zone
 - 1.3 Transmit a Fire Alarm Signal to the monitoring station and reset the system

2. MONITORING STATION

- 2.1 Contact the monitoring system prior to the transmitting of the fire alarm signal
 - 2.2 To warn them of the simulated fire condition to be tested
 - 2.3 Check with them after completion of test to ensure the fire alarm signal was received
 - 2.4 Advise the monitoring station that the system has been reset

3. BATTERY CONDITION

- 3.1 Check the battery voltage
 - 3.2 Check the battery condition

4 SWITCHES

- 4.1 Ensure that all switches are in the correct operating condition after completion of tests
 - 4.2 Take immediate steps to rectify the fault(s) should they exist

5. DEFECTS

- 5.1 Record in the log any fault(s) identified and that the above test has been carried out

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

1 Df

(Name & signature)

2 _____

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10, #01 - 364, SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

TOWN COUNCIL	<u>NEE SOON TOWN COUNCIL</u>
LOCATION	<u>NEE SOON EAST DIVISION</u>
DATE OF SERVICING	<u>6 /09/2025</u>

WEEKLY FIRE ALARM CHECKLIST REPORT

1. SIMULATED TEST

- 1.1 Carry out a stimulated fire alarm call
 - 1.2 Operate any Alarm Zone
 - 1.3 Transmit a Fire Alarm Signal to the monitoring station and reset the system

2. MONITORING STATION

- 2.1 Contact the monitoring system prior to the transmitting of the fire alarm signal
 - 2.2 To warn them of the simulated fire condition to be tested
 - 2.3 Check with them after completion of test to ensure the fire alarm signal was received
 - 2.4 Advise the monitoring station that the system has been reset

3 BATTERY CONDITION

- 3.1 Check the battery voltage
 - 3.2 Check the battery condition

4 SWITCHES

- 4.1 Ensure that all switches are in the correct operating condition after completion of tests
 - 4.2 Take immediate steps to rectify the fault(s) should they exist

5. DEFECTS

 - 5.1 Record in the log any fault(s) identified and that the above test has been carried out

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

1 RX.

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD
BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197
TEL : 6 289 2298 FAX : 6 287 9635

TOWN COUNCIL	<u>NEE SOON TOWN COUNCIL</u>
LOCATION	<u>NEE SOON EAST DIVISION</u>
DATE OF SERVICING	<u>11 /09/2025</u>

WEEKLY FIRE ALARM CHECKLIST REPORT

1. SIMULATED TEST

- 1.1 Carry out a stimulated fire alarm call
 - 1.2 Operate any Alarm Zone
 - 1.3 Transmit a Fire Alarm Signal to the monitoring station and reset the system

2. MONITORING STATION

- 2.1 Contact the monitoring system prior to the transitioning of the fire alarm signal
 - 2.2 To warn them of the simulated fire condition to be tested
 - 2.3 Check with them after completion of test to ensure the fire alarm signal was received
 - 2.4 Advise the monitoring station that the system has been reset

3 BATTERY CONDITION

- 3.1 Check the battery voltage
 - 3.2 Check the battery condition

4 SWITCHES

- 4.1 Ensure that all switches are in the correct operating condition after completion of tests
 - 4.2 Take immediate steps to rectify the fault(s) should they exist

5. DEFECTS

5.1 Record in the log any fault(s) identified and that the above test has been carried out.

3.1 Record

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

1 Rf

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

TOWN COUNCIL	<u>NEE SOON TOWN COUNCIL</u>
LOCATION	<u>NEE SOON EAST DIVISION</u>
DATE OF SERVICING	<u>11 /09/2025</u>

WEEKLY FIRE ALARM CHECKLIST REPORT

1. SIMULATED TEST

- 1.1 Carry out a stimulated fire alarm call
 - 1.2 Operate any Alarm Zone
 - 1.3 Transmit a Fire Alarm Signal to the monitoring station and reset the system

2. MONITORING STATION

- 2.1 Contact the monitoring system prior to the transitting of the fire alarm signal
 - 2.2 To warn them of the simulated fire condition to be tested
 - 2.3 Check with them after completion of test to ensure the fire alarm signal was received
 - 2.4 Advise the monitoring station that the systm has been reset

3. BATTERY CONDITION

- 3.1 Check the battery voltage
 - 3.2 Check the battery conditions

4 SWITCHES

- 4.1 Ensure that all switches are in the correct operating condition after completion of tests
 - 4.2 Take immediate steps to rectify the fault(s) should they exist

5. DEFECTS

- 5.1 Record in the log any fault(s) identified and that the above test has been carried out

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

1 24

(Name & signature)

2 _____

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

TOWN COUNCIL NEE SOON TOWN COUNCIL

LOCATION NEE SOON EAST DIVISION

DATE OF SERVICING 12 ~~09~~ /09/2025

WEEKLY FIRE ALARM CHECKLIST REPORT

1. SIMULATED TEST

- 1.1 Carry out a stimulated fire alarm call
 - 1.2 Operate any Alarm Zone
 - 1.3 Transmit a Fire Alarm Signal to the monitoring station and reset the system

2. MONITORING STATION

- 2.1 Contact the monitoring system prior to the transmitting of the fire alarm signal
 - 2.2 To warn them of the simulated fire condition to be tested
 - 2.3 Check with them after completion of test to ensure the fire alarm signal was received
 - 2.4 Advise the monitoring station that the system has been reset

3. BATTERY CONDITION

- 3.1 Check the battery voltage
 - 3.2 Check the battery conditions

4. SWITCHES

- 4.1 Ensure that all switches are in the correct operating condition after completion of tests
 - 4.2 Take immediate steps to rectify the fault(s) should they exist

5. DEFECTS

- 5.1 Record in the log any fault(s) identified and that the above test has been carried out

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

1 Th.

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

NEE SOON TOWN COUNCIL

LOCATION NEE SOON EAST DIVISION

DATE OF SERVICING 12 /09/2025

[View Details](#) | [Edit](#) | [Delete](#)

WEEKLY FIRE ALARM CHECKLIST REPORT

1. SIMULATED TEST

- 1.1 Carry out a stimulated fire alarm call
 - 1.2 Operate any Alarm Zone
 - 1.3 Transmit a Fire Alarm Signal to the monitoring station and reset the system

2. MONITORING STATION

- 2.1 Contact the monitoring system prior to the transmitting of the fire alarm signal
 - 2.2 To warn them of the simulated fire condition to be tested
 - 2.3 Check with them after completion of test to ensure the fire alarm signal was received
 - 2.4 Advise the monitoring station that the system has been reset

3 BATTERY CONDITION

- ### 3.1 Check the battery voltage

5.2 CHECK THE

- 4. SWITCHES
 - 4.1 Ensure that all switches are in the correct operating condition after completion of tests
 - 4.2 Take immediate steps to rectify the fault(s) should they exist
 - 5. DEFECTS
 - 5.1 Record in the log any fault(s) identified and that the above test has been carried out

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

1

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD
BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197
TEL : 6 289 2298 FAX : 6 287 9635

TOWN COUNCIL	<u>NEE SOON TOWN COUNCIL</u>
LOCATION	<u>NEE SOON EAST DIVISION</u>
DATE OF SERVICING	<u>12 /09/2025</u>

WEEKLY FIRE ALARM CHECKLIST REPORT

1. SIMULATED TEST

- 1.1 Carry out a stimulated fire alarm call
 - 1.2 Operate any Alarm Zone
 - 1.3 Transmit a Fire Alarm Signal to the monitoring station and reset the system
 2. MONITORING STATION
 - 2.1 Contact the monitoring system prior to the transitting of the fire alarm signal
 - 2.2 To warn them of the simulated fire condition to be tested
 - 2.3 Check with them after completion of test to ensure the fire alarm signal was received
 - 2.4 Advise the monitoring station that the systm has been reset
 3. BATTERY CONDITION
 - 3.1 Check the battery voltage
 - 3.2 Check the battery conditions
 4. SWITCHES
 - 4.1 Ensure that all switches are in the correct operating condition after completion of test
 - 4.2 Take immediate steps to rectify the fault(s) should they exist
 5. DEFECTS
 - 5.1 Record in the log any fault(s) identified and that the above test has been carried out

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

1 Pf.

(Name & signature)

2 _____

RED-POWER ELECTRICAL ENGINEERING PTE LTD
BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197
TEL : 6 289 2298 FAX : 6 287 9635

TOWN COUNCIL	<u>NEE SOON TOWN COUNCIL</u>
LOCATION	<u>NEE SOON EAST DIVISION</u>
DATE OF SERVICING	<u>15/09/2025</u>

WEEKLY FIRE ALARM CHECKLIST REPORT

1. SIMULATED TEST

- 1.1 Carry out a stimulated fire alarm call
 - 1.2 Operate any Alarm Zone
 - 1.3 Transmit a Fire Alarm Signal to the monitoring station and reset the system

2. MONITORING STATION

- 2.1 Contact the monitoring system prior to the transmitting of the fire alarm signal
 - 2.2 To warn them of the simulated fire condition to be tested
 - 2.3 Check with them after completion of test to ensure the fire alarm signal was received
 - 2.4 Advise the monitoring station that the system has been reset

3. BATTERY CONDITION

- 3.1 Check the battery voltage
3.2 Check the battery condition

4 SWITCHES

- 4.1 Ensure that all switches are in the correct operating condition after completion of tests
 - 4.2 Take immediate steps to rectify the fault(s) should they exist

5. DEFECTS

 - 5.1 Record in the log any fault(s) identified and that the above test has been carried out

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

1 dkf.

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

TOWN COUNCIL	<u>NEE SOON TOWN COUNCIL</u>
LOCATION	<u>NEE SOON EAST DIVISION</u>
DATE OF SERVICING	<u>15 /09/2025</u>

WEEKLY FIRE ALARM CHECKLIST REPORT

1. SIMULATED TEST

- 1.1 Carry out a stimulated fire alarm call
 - 1.2 Operate any Alarm Zone
 - 1.3 Transmit a Fire Alarm Signal to the monitoring station and reset the system

2. MONITORING STATION

- 2.1 Contact the monitoring system prior to the transmitting of the fire alarm signal
 - 2.2 To warn them of the simulated fire condition to be tested
 - 2.3 Check with them after completion of test to ensure the fire alarm signal was received

2.4 Advise the monitor

- ### 3. BATTERY CONDITION

3.1 Check the battery voltage

3.2 Check the

4. SWITCHES

4.1 Ensure that all switches are in the correct operating condition after completion of tests

4.2 Take immediate steps to rectify the fault(s) should they exist

5. DEFECTS

5.1 Record in the log any fault(s) identified and that the above test has been completed.

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

1 

(Name & signature)

2 _____

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

TOWN COUNCIL	<u>NEE SOON TOWN COUNCIL</u>
LOCATION	<u>NEE SOON EAST DIVISION</u>
DATE OF SERVICING	<u>16 /09/2025</u>

WEEKLY FIRE ALARM CHECKLIST REPORT

1. SIMULATED TEST

- 1.1 Carry out a stimulated fire alarm call
 - 1.2 Operate any Alarm Zone
 - 1.3 Transmit a Fire Alarm Signal to the monitoring station and reset the system

2. MONITORING STATION

- 2.1 Contact the monitoring system prior to the transmitting of the fire alarm signal
 - 2.2 To warn them of the simulated fire condition to be tested
 - 2.3 Check with them after completion of test to ensure the fire alarm signal was received
 - 2.4 Advise the monitoring station that the system has been reset

3 BATTERY CONDITION

- 3.1 Check the battery voltage
 - 3.2 Check the battery condition

4 SWITCHES

- 4.1 Ensure that all switches are in the correct operating condition after completion of tests
 - 4.2 Take immediate steps to rectify the fault(s) should they exist

5 DEFECTS

- 5.1 Record in the log any fault(s) identified and that the above test has been carried out

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

1 Rlf

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

TOWN COUNCIL	<u>NEE SOON TOWN COUNCIL</u>
LOCATION	<u>NEE SOON EAST DIVISION</u>
DATE OF SERVICING	<u>16</u> /09/2025

WEEKLY FIRE ALARM CHECKLIST REPORT

1. SIMULATED TEST

- 1.1 Carry out a stimulated fire alarm call
 - 1.2 Operate any Alarm Zone
 - 1.3 Transmit a Fire Alarm Signal to the monitoring station and reset the system

2. MONITORING STATION

- 2.1 Contact the monitoring system prior to the transmitting of the fire alarm signal
 - 2.2 To warn them of the simulated fire condition to be tested
 - 2.3 Check with them after completion of test to ensure the fire alarm signal was received

2.4 Advise the monitor

- ### 3. BATTERY CONDITION

3.1 Check the battery voltage

3.2 Check the

4. SWITCHES
4.1 Ensure that all switches are in the correct operating condition after completion of tests

4.2 Take in

- 5.1.2. *Defects* *Defects* are errors or failures in the system.

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

1

(Name & signature)

2 _____

RED-POWER ELECTRICAL ENGINEERING PTE LTD
BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197
TEL : 6 289 2298 FAX : 6 287 9635

TOWN COUNCIL	<u>NEE SOON TOWN COUNCIL</u>
LOCATION	<u>NEE SOON EAST DIVISION</u>
DATE OF SERVICING	<u>16 /09/2025</u>

WEEKLY FIRE ALARM CHECKLIST REPORT

1. SIMULATED TEST

- 1.1 Carry out a stimulated fire alarm call
 - 1.2 Operate any Alarm Zone
 - 1.3 Transmit a Fire Alarm Signal to the monitoring station and reset the system

2. MONITORING STATION

- 2.1 Contact the monitoring system prior to the transmitting of the fire alarm signal
 - 2.2 To warn them of the simulated fire condition to be tested
 - 2.3 Check with them after completion of test to ensure the fire alarm signal was received
 - 2.4 Advise the monitoring station that the system has been reset

3 BATTERY CONDITION

- ### 3.1 Check the battery voltage

3.2 Check the

4. SWITCHES
 - 4.1 Ensure that all switches are in the correct operating condition after completion of tests
 - 4.2 Take immediate steps to rectify the fault(s) should they exist
 5. DEFECTS
 - 5.1 Record in the log any fault(s) identified and that the above test has been carried out

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

1 DH

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

TOWN COUNCIL	<u>NEE SOON TOWN COUNCIL</u>
LOCATION	<u>NEE SOON EAST DIVISION</u>
DATE OF SERVICING	<u>22/09/2025</u>

WEEKLY FIRE ALARM CHECKLIST REPORT

1. SIMULATED TEST

- 1.1 Carry out a stimulated fire alarm call
 - 1.2 Operate any Alarm Zone
 - 1.3 Transmit a Fire Alarm Signal to the monitoring station and reset the system

2. MONITORING STATION

- 2.1 Contact the monitoring system prior to the transmitting of the fire alarm signal
 - 2.2 To warn them of the simulated fire condition to be tested
 - 2.3 Check with them after completion of test to ensure the fire alarm signal was received
 - 2.4 Advise the monitoring station that the system has been reset

3. BATTERY CONDITION

- 3.1 Check the battery voltage
 - 3.2 Check the battery conditions

4 SWITCHES

- 4.1 Ensure that all switches are in the correct operating condition after completion of tests
 - 4.2 Take immediate steps to rectify the fault(s) should they exist

5. DEFECTS

 - 5.1 Record in the log any fault(s) identified and that the above test has been carried out

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

1 Rf

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD
BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197
TEL : 6 289 2298 FAX : 6 287 9635

TOWN COUNCIL	<u>NEE SOON TOWN COUNCIL</u>
LOCATION	<u>NEE SOON EAST DIVISION</u>
DATE OF SERVICING	<u>22/09/2025</u>

WEEKLY FIRE ALARM CHECKLIST REPORT

1. SIMULATED TEST

- 1.1 Carry out a stimulated fire alarm call
 - 1.2 Operate any Alarm Zone
 - 1.3 Transmit a Fire Alarm Signal to the monitoring station and reset the system

2. MONITORING STATION

- 2.1 Contact the monitoring system prior to the transmitting of the fire alarm signal
 - 2.2 To warn them of the simulated fire condition to be tested
 - 2.3 Check with them after completion of test to ensure the fire alarm signal was received
 - 2.4 Advise the monitoring station that the system has been reset.

3 BATTERY CONDITION

- ### 3.1 Check the battery voltage

3.2 CHECK THE

- 4.1 Ensure that all switches are in the correct operating condition after completion of tests
 - 4.2 Take immediate steps to rectify the fault(s) should they exist

5. DEFECTS

 - 5.1 Record in the log any fault(s) identified and that the above test has been carried out

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

1 

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

TOWN COUNCIL	<u>NEE SOON TOWN COUNCIL</u>
LOCATION	<u>NEE SOON EAST DIVISION</u>
DATE OF SERVICING	<u>23 /09/2025</u>

WEEKLY FIRE ALARM CHECKLIST REPORT

1. SIMULATED TEST

- 1.1 Carry out a stimulated fire alarm call
 - 1.2 Operate any Alarm Zone
 - 1.3 Transmit a Fire Alarm Signal to the monitoring station and reset the system

2. MONITORING STATION

- 2.1 Contact the monitoring system prior to the transmitting of the fire alarm signal
 - 2.2 To warn them of the simulated fire condition to be tested
 - 2.3 Check with them after completion of test to ensure the fire alarm signal was received
 - 2.4 Advise the monitoring station that the system has been reset

3. BATTERY CONDITION

- 3.1 Check the battery voltage
 - 3.2 Check the battery conditions

4 SWITCHES

- 4.1 Ensure that all switches are in the correct operating condition after completion of tests
 - 4.2 Take immediate steps to rectify the fault(s) should they exist

5. DEFECTS

5.1 Record

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

PL

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

TOWN COUNCIL	<u>NEE SOON TOWN COUNCIL</u>
LOCATION	<u>NEE SOON EAST DIVISION</u>
DATE OF SERVICING	<u>23/09/2025</u>

WEEKLY FIRE ALARM CHECKLIST REPORT

1. SIMULATED TEST

- 1.1 Carry out a stimulated fire alarm call
 - 1.2 Operate any Alarm Zone
 - 1.3 Transmit a Fire Alarm Signal to the monitoring station and reset the system

2. MONITORING STATION

- 2.1 Contact the monitoring system prior to the transmitting of the fire alarm signal
 - 2.2 To warn them of the simulated fire condition to be tested .
 - 2.3 Check with them after completion of test to ensure the fire alarm signal was received

3. BATTERY CONDITION

- 3.1 Check the battery voltage
 - 3.2 Check the battery conditions

4 SWITCHES

- 4.1 Ensure that all switches are in the correct operating condition after completion of tests
 - 4.2 Take immediate steps to rectify the fault(s) should they exist.

5 DEFECTS

- 5.1 Record in the log any fault(s) identified and that the above test has been carried out.

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

1

(Name & signature)

2 _____

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

TOWN COUNCIL **NEE SOON TOWN COUNCIL**

LOCATION NEE SOON EAST DIVISION

DATE OF SERVICING 23/09/2025

WEEKLY FIRE ALARM CHECKLIST REPORT

1. SIMULATED TEST

- 1.1 Carry out a stimulated fire alarm call
 - 1.2 Operate any Alarm Zone
 - 1.3 Transmit a Fire Alarm Signal to the monitoring station and reset the system

2. MONITORING STATION

- 2.1 Contact the monitoring system prior to the transmitting of the fire alarm signal
 - 2.2 To warn them of the simulated fire condition to be tested
 - 2.3 Check with them after completion of test to ensure the fire alarm signal was received
 - 2.4 Advise the monitoring station that the system has been reset

3 BATTERY CONDITION

- ### 3.1 Check the battery voltage

4. OUTCOMES

- 4.1 Ensure that all switches are in the correct operating condition after completion of tests

4.2 Take time

- ### 5. DEFECTS

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

1 PF 1

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298

FAX : 6 287 9635

TOWN COUNCIL	<u>NEE SOON TOWN COUNCIL</u>
LOCATION	<u>NEE SOON EAST DIVISION</u>
DATE OF SERVICING	<u>3/09/2025</u>

WEEKLY PRESSURE TANK CHECKLIST REPORT

1. Test run of pumps
 2. Check pump and motor running condition
 3. Check coupling set, baseplate and spring isolator
 4. Check mechanical seal / gland-packing and bearings
 5. Check all pipe work, check valve, gate valve, expansion joint, strainer
 6. Check correct function of pump system in auto and manual mode
 7. Check control panel and electrical isolator
 8. Check electrical components in control panel
 9. Check all indicator lamps
 10. Check conduit and wiring
 11. Check electrode holder and sensor
 12. Check ball float valve / pilot valve and motorised valve
 13. Check pump running ampere
 14. Check pressure switch setting and pressure gauge

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

¹ P. Mani Bhij

(Name & signature)

2 _____

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

TOWN COUNCIL	<u>NEE SOON TOWN COUNCIL</u>
LOCATION	<u>NEE SOON EAST DIVISION</u>
DATE OF SERVICING	<u>3 /09/2025</u>

WEEKLY PRESSURE TANK CHECKLIST REPORT

1. Test run of pumps
 2. Check pump and motor running condition
 3. Check coupling set, baseplate and spring isolator
 4. Check mechanical seal / gland-packing and bearings
 5. Check all pipe work, check valve, gate valve, expansion joint, strainer
 6. Check correct function of pump system in auto and manual mode
 7. Check control panel and electrical isolator
 8. Check electrical components in control panel
 9. Check all indicator lamps
 10. Check conduit and wiring
 11. Check electrode holder and sensor
 12. Check ball float valve / pilot valve and motorised valve
 13. Check pump running ampere
 14. Check pressure switch setting and pressure gauge

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

¹ Mani Shri

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

NEE SOON TOWN COUNCIL

LOCATION

NEE SOON EAST DIVISION

DATE OF SERVICING

3 /09/2025

WEEKLY PRESSURE TANK CHECKLIST REPORT

1. Test run of pumps
 2. Check pump and motor running condition
 3. Check coupling set, baseplate and spring isolator
 4. Check mechanical seal / gland-packing and bearings
 5. Check all pipe work, check valve, gate valve, expansion joint, strainer
 6. Check correct function of pump system in auto and manual mode
 7. Check control panel and electrical isolator
 8. Check electrical components in control panel
 9. Check all indicator lamps
 10. Check conduit and wiring
 11. Check electrode holder and sensor
 12. Check ball float valve / pilot valve and motorised valve
 13. Check pump running ampere
 14. Check pressure switch setting and pressure gauge

Block No :

Manus

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

FAX : 6 287 9635

TOWN COUNCIL

NEE SOON TOWN COUNCIL

LOCATION

NEE SOON EAST DIVISION

DATE OF SERVICING

 /09/2025

WEEKLY PRESSURE TANK CHECKLIST REPORT

1. Test run of pumps
 2. Check pump and motor running condition
 3. Check coupling set, baseplate and spring isolator
 4. Check mechanical seal / gland-packing and bearings
 5. Check all pipe work, check valve, gate valve, expansion joint, strainer
 6. Check correct function of pump system in auto and manual mode
 7. Check control panel and electrical isolator
 8. Check electrical components in control panel
 9. Check all indicator lamps
 10. Check conduit and wiring
 11. Check electrode holder and sensor
 12. Check ball float valve / pilot valve and motorised valve
 13. Check pump running ampere
 14. Check pressure switch setting and pressure gauge

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

1 Mani Thij

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

www.elsevier.com

TOWN COUNCIL	<u>NEE SOON TOWN COUNCIL</u>
LOCATION	<u>NEE SOON EAST DIVISION</u>
DATE OF SERVICING	<u>21/09/2025</u>

WEEKLY PRESSURE TANK CHECKLIST REPORT

1. Test run of pumps
 2. Check pump and motor running condition
 3. Check coupling set, baseplate and spring isolator
 4. Check mechanical seal / gland-packing and bearings
 5. Check all pipe work, check valve, gate valve, expansion joint, strainer
 6. Check correct function of pump system in auto and manual mode
 7. Check control panel and electrical isolator
 8. Check electrical components in control panel
 9. Check all indicator lamps
 10. Check conduit and wiring
 11. Check electrode holder and sensor
 12. Check ball float valve / pilot valve and motorised valve
 13. Check pump running ampere
 14. Check pressure switch setting and pressure gauge

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

¹ P. Mori Ohio

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

TOWN COUNCIL	<u>NEE SOON TOWN COUNCIL</u>
LOCATION	<u>NEE SOON EAST DIVISION</u>
DATE OF SERVICING	<u>2 /09/2025</u>

WEEKLY PRESSURE TANK CHECKLIST REPORT

1. Test run of pumps
 2. Check pump and motor running condition
 3. Check coupling set, baseplate and spring isolator
 4. Check mechanical seal / gland-packing and bearings
 5. Check all pipe work, check valve, gate valve, expansion joint, strainer
 6. Check correct function of pump system in auto and manual mode
 7. Check control panel and electrical isolator
 8. Check electrical components in control panel
 9. Check all indicator lamps
 10. Check conduit and wiring
 11. Check electrode holder and sensor
 12. Check ball float valve / pilot valve and motorised valve
 13. Check pump running ampere
 14. Check pressure switch setting and pressure gauge

Block No :

REMARKS

~~REMARKS~~
~~BLR-269A - PT1 + PT2 SPO⁰ 296A - PT1 + PT2 - SPO⁰~~

Name & signature of Technician(s)

Verified By :

1 Mami Alij

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298

FAX : 6 287 9635

TOWN COUNCIL

NEE SOON TOWN COUNCIL

LOCATION

NEE SOON EAST DIVISION

3 /09/2025

WEEKLY PRESSURE TANK CHECKLIST REPORT

1. Test run of pumps
 2. Check pump and motor running condition
 3. Check coupling set, baseplate and spring isolator
 4. Check mechanical seal / gland-packing and bearings
 5. Check all pipe work, check valve, gate valve, expansion joint, strainer
 6. Check correct function of pump system in auto and manual mode
 7. Check control panel and electrical isolator
 8. Check electrical components in control panel
 9. Check all indicator lamps
 10. Check conduit and wiring
 11. Check electrode holder and sensor
 12. Check ball float valve / pilot valve and motorised valve
 13. Check pump running ampere
 14. Check pressure switch setting and pressure gauge

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

1 Miami Ohio

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

FAX : 6 287 9635

TOWN COUNCIL

NEE SOON TOWN COUNCIL

LOCATION

NEE SOON EAST DIVISION

DATE OF SERVICING

9 /09/2025

WEEKLY PRESSURE TANK CHECKLIST REPORT

1. Test run of pumps
 2. Check pump and motor running condition
 3. Check coupling set, baseplate and spring isolator
 4. Check mechanical seal / gland-packing and bearings
 5. Check all pipe work, check valve, gate valve, expansion joint, strainer
 6. Check correct function of pump system in auto and manual mode
 7. Check control panel and electrical isolator
 8. Check electrical components in control panel
 9. Check all indicator lamps
 10. Check conduit and wiring
 11. Check electrode holder and sensor
 12. Check ball float valve / pilot valve and motorised valve
 13. Check pump running ampere
 14. Check pressure switch setting and pressure gauge

Block No :

REMARKS

RKS BUK - 269A, PT1 & PT2 - 3⁰oil, 296A - PT1 & PT2 3⁰oil

Name & signature of Technician(s)

Verified By :

1 Mani Brij

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

TOWN COUNCIL	<u>NEE SOON TOWN COUNCIL</u>
LOCATION	<u>NEE SOON EAST DIVISION</u>
DATE OF SERVICING	<u>9/09/2025</u>

WEEKLY PRESSURE TANK CHECKLIST REPORT

1. Test run of pumps
 2. Check pump and motor running condition
 3. Check coupling set, baseplate and spring isolator
 4. Check mechanical seal / gland-packing and bearings
 5. Check all pipe work, check valve, gate valve, expansion joint, strainer
 6. Check correct function of pump system in auto and manual mode
 7. Check control panel and electrical isolator
 8. Check electrical components in control panel
 9. Check all indicator lamps
 10. Check conduit and wiring
 11. Check electrode holder and sensor
 12. Check ball float valve / pilot valve and motorised valve
 13. Check pump running ampere
 14. Check pressure switch setting and pressure gauge

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

¹ P. Mani Mri

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

TOWN COUNCIL	<u>NEE SOON TOWN COUNCIL</u>
LOCATION	<u>NEE SOON EAST DIVISION</u>
DATE OF SERVICING	<u>9/09/2025</u>

WEEKLY PRESSURE TANK CHECKLIST REPORT

1. Test run of pumps
 2. Check pump and motor running condition
 3. Check coupling set, baseplate and spring isolator
 4. Check mechanical seal / gland-packing and bearings
 5. Check all pipe work, check valve, gate valve, expansion joint, strainer
 6. Check correct function of pump system in auto and manual mode
 7. Check control panel and electrical isolator
 8. Check electrical components in control panel
 9. Check all indicator lamps
 10. Check conduit and wiring
 11. Check electrode holder and sensor
 12. Check ball float valve / pilot valve and motorised valve
 13. Check pump running ampere
 14. Check pressure switch setting and pressure gauge

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

1 Mani ohni

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

TOWN COUNCIL	<u>NEE SOON TOWN COUNCIL</u>
LOCATION	<u>NEE SOON EAST DIVISION</u>
DATE OF SERVICING	10/09/2025

WEEKLY PRESSURE TANK CHECKLIST REPORT

1. Test run of pumps
 2. Check pump and motor running condition
 3. Check coupling set, baseplate and spring isolator
 4. Check mechanical seal / gland-packing and bearings
 5. Check all pipe work, check valve, gate valve, expansion joint, strainer
 6. Check correct function of pump system in auto and manual mode
 7. Check control panel and electrical isolator
 8. Check electrical components in control panel
 9. Check all indicator lamps
 10. Check conduit and wiring
 11. Check electrode holder and sensor
 12. Check ball float valve / pilot valve and motorised valve
 13. Check pump running ampere
 14. Check pressure switch setting and pressure gauge

Block No :

RED-POWER ELECTRICAL ENGINEERING PTE LTD
BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 53919
TEL : 6 289 2298 FAX : 6 287 9635

TOWN COUNCIL	<u>NEE SOON TOWN COUNCIL</u>
LOCATION	<u>NEE SOON EAST DIVISION</u>
DATE OF SERVICING	<u>NO/09/2025</u>

WEEKLY PRESSURE TANK CHECKLIST REPORT

1. Test run of pumps
 2. Check pump and motor running condition
 3. Check coupling set, baseplate and spring isolator
 4. Check mechanical seal / gland-packing and bearings
 5. Check all pipe work, check valve, gate valve, expansion joint, strainer
 6. Check correct function of pump system in auto and manual mode
 7. Check control panel and electrical isolator
 8. Check electrical components in control panel
 9. Check all indicator lamps
 10. Check conduit and wiring
 11. Check electrode holder and sensor
 12. Check ball float valve / pilot valve and motorised valve
 13. Check pump/running ampere
 14. Check pressure switch setting and pressure gauge

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

1 Mani M.

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD
BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197
TEL : 6 289 2298 FAX : 6 287 9635

TOWN COUNCIL NEE SOON TOWN COUNCIL
LOCATION NEE SOON EAST DIVISION
DATE OF SERVICING  /09/2025

WEEKLY PRESSURE TANK CHECKLIST REPORT

- ~~SECRET REPORT~~

 1. Test run of pumps
 2. Check pump and motor running condition
 3. Check coupling set, baseplate and spring isolator
 4. Check mechanical seal / gland-packing and bearings
 5. Check all pipe work, check valve, gate valve, expansion joint, strainer
 6. Check correct function of pump system in auto and manual mode
 7. Check control panel and electrical isolator
 8. Check electrical components in control panel
 9. Check all indicator lamps
 10. Check conduit and wiring
 11. Check electrode holder and sensor
 12. Check ball float valve / pilot valve and motorised valve
 13. Check pump running ampere
 14. Check pressure switch setting and pressure gauge

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

¹ P. Mani Phij

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

FAX : 6 287 9635

TOWN COUNCIL **NEE SOON TOWN COUNCIL**

LOCATION NEE SOON EAST DIVISION

DATE OF SERVICING 10/09/2025

WEEKLY PRESSURE TANK CHECKLIST REPORT

1. Test run of pumps
 2. Check pump and motor running condition
 3. Check coupling set, baseplate and spring isolator
 4. Check mechanical seal / gland-packing and bearings
 5. Check all pipe work, check valve, gate valve, expansion joint, strainer
 6. Check correct function of pump system in auto and manual mode
 7. Check control panel and electrical isolator
 8. Check electrical components in control panel
 9. Check all indicator lamps
 10. Check conduit and wiring
 11. Check electrode holder and sensor
 12. Check ball float valve / pilot valve and motorised valve
 13. Check pump running ampere
 14. Check pressure switch setting and pressure gauge

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

1 Mani Mai

(Name & signature)

2 _____



RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

FAX : 6 287 9635

TOWN COUNCIL

NEE SOON TOWN COUNCIL

LOCATION

NEE SOON EAST DIVISION

DATE OF SERVICING

16 /09/2025

WEEKLY PRESSURE TANK CHECKLIST REPORT

1. Test run of pumps
 2. Check pump and motor running condition
 3. Check coupling set, baseplate and spring isolator
 4. Check mechanical seal / gland-packing and bearings
 5. Check all pipe work, check valve, gate valve, expansion joint, strainer
 6. Check correct function of pump system in auto and manual mode
 7. Check control panel and electrical isolator
 8. Check electrical components in control panel
 9. Check all indicator lamps
 10. Check conduit and wiring
 11. Check electrode holder and sensor
 12. Check ball float valve / pilot valve and motorised valve
 13. Check pump running ampere
 14. Check pressure switch setting and pressure gauge

Block No :

REMARKS

REMARKS Bk 2bq A- PT1 + PT2 Spoil, 29b A- PT1 + PT2 Spoil.

Name & signature of Technician(s)

Verified By :

¹ Mami Phi

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

TOWN COUNCIL	<u>NEE SOON TOWN COUNCIL</u>
LOCATION	<u>NEE SOON EAST DIVISION</u>
DATE OF SERVICING	<u>16 /09/2025</u>

WEEKLY PRESSURE TANK CHECKLIST REPORT

1. Test run of pumps
 2. Check pump and motor running condition
 3. Check coupling set, baseplate and spring isolator
 4. Check mechanical seal / gland-packing and bearings
 5. Check all pipe work, check valve, gate valve, expansion joint, strainer
 6. Check correct function of pump system in auto and manual mode
 7. Check control panel and electrical isolator
 8. Check electrical components in control panel
 9. Check all indicator lamps
 10. Check conduit and wiring
 11. Check electrode holder and sensor
 12. Check ball float valve / pilot valve and motorised valve
 13. Check pump running ampere
 14. Check pressure switch setting and pressure gauge

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

¹ P. N. omi ohi

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298

FAX : 6 287 9635

TOWN COUNCIL

NEE SOON TOWN COUNCIL

LOCATION

NEE SOON EAST DIVISION

DATE OF SERVICING

16 /09/2025

WEEKLY PRESSURE TANK CHECKLIST REPORT

1. Test run of pumps
 2. Check pump and motor running condition
 3. Check coupling set, baseplate and spring isolator
 4. Check mechanical seal / gland-packing and bearings
 5. Check all pipe work, check valve, gate valve, expansion joint, strainer
 6. Check correct function of pump system in auto and manual mode
 7. Check control panel and electrical isolator
 8. Check electrical components in control panel
 9. Check all indicator lamps
 10. Check conduit and wiring
 11. Check electrode holder and sensor
 12. Check ball float valve / pilot valve and motorised valve
 13. Check pump running ampere
 14. Check pressure switch setting and pressure gauge

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

¹ Miami Mij

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

TOWN COUNCIL	<u>NEE SOON TOWN COUNCIL</u>
LOCATION	<u>NEE SOON EAST DIVISION</u>
DATE OF SERVICING	17/09/2025

WEEKLY PRESSURE TANK CHECKLIST REPORT

1. Test run of pumps
 2. Check pump and motor running condition
 3. Check coupling set, baseplate and spring isolator
 4. Check mechanical seal / gland-packing and bearings
 5. Check all pipe work, check valve, gate valve, expansion joint, strainer
 6. Check correct function of pump system in auto and manual mode
 7. Check control panel and electrical isolator
 8. Check electrical components in control panel
 9. Check all indicator lamps
 10. Check conduit and wiring
 11. Check electrode holder and sensor
 12. Check ball float valve / pilot valve and motorised valve
 13. Check pump running ampere
 14. Check pressure switch setting and pressure gauge

Block No :

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

TOWN COUNCIL	<u>NEE SOON TOWN COUNCIL</u>
LOCATION	<u>NEE SOON EAST DIVISION</u>
DATE OF SERVICING	<u>17/09/2025</u>

WEEKLY PRESSURE TANK CHECKLIST REPORT

1. Test run of pumps
 2. Check pump and motor running condition
 3. Check coupling set, baseplate and spring isolator
 4. Check mechanical seal / gland-packing and bearings
 5. Check all pipe work, check valve, gate valve, expansion joint, strainer
 6. Check correct function of pump system in auto and manual mode
 7. Check control panel and electrical isolator
 8. Check electrical components in control panel
 9. Check all indicator lamps
 10. Check conduit and wiring
 11. Check electrode holder and sensor
 12. Check ball float valve / pilot valve and motorised valve
 13. Check pump running ampere
 14. Check pressure switch setting and pressure gauge

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

¹ Mami Muri

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

TOWN COUNCIL	<u>NEE SOON TOWN COUNCIL</u>
LOCATION	<u>NEE SOON EAST DIVISION</u>
DATE OF SERVICING	<u>17/09/2025</u>

WEEKLY PRESSURE TANK CHECKLIST REPORT

1. Test run of pumps
 2. Check pump and motor running condition
 3. Check coupling set, baseplate and spring isolator
 4. Check mechanical seal / gland-packing and bearings
 5. Check all pipe work, check valve, gate valve, expansion joint, strainer
 6. Check correct function of pump system in auto and manual mode
 7. Check control panel and electrical isolator
 8. Check electrical components in control panel
 9. Check all indicator lamps
 10. Check conduit and wiring
 11. Check electrode holder and sensor
 12. Check ball float valve / pilot valve and motorised valve
 13. Check pump running ampere
 14. Check pressure switch setting and pressure gauge

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

1 P. Nani Mji

(Name & signature)

2 _____

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298

FAX : 6 287 9635

TOWN COUNCIL

NEE SOON TOWN COUNCIL

LOCATION

NEE SOON EAST DIVISION

DATE OF SERVICING

17/09/2025

WEEKLY PRESSURE TANK CHECKLIST REPORT

1. Test run of pumps
2. Check pump and motor running condition
3. Check coupling set, baseplate and spring isolator
4. Check mechanical seal / gland-packing and bearings
5. Check all pipe work, check valve, gate valve, expansion joint, strainer
6. Check correct function of pump system in auto and manual mode
7. Check control panel and electrical isolator
8. Check electrical components in control panel
9. Check all indicator lamps
10. Check conduit and wiring
11. Check electrode holder and sensor
12. Check ball float valve / pilot valve and motorised valve
13. Check pump running ampere
14. Check pressure switch setting and pressure gauge

Block No :

384A	384B	-	-	-	-	-	-	-	-
✓	✓	-	-	-	-	-	-	-	-
✓	✓	-	-	-	-	-	-	-	-
✓	✓	-	-	-	-	-	-	-	-
✓	✓	-	-	-	-	-	-	-	-
✓	✓	-	-	-	-	-	-	-	-
✓	✓	-	-	-	-	-	-	-	-
✓	✓	-	-	-	-	-	-	-	-
✓	✓	-	-	-	-	-	-	-	-
✓	✓	-	-	-	-	-	-	-	-
✓	✓	-	-	-	-	-	-	-	-
✓	✓	-	-	-	-	-	-	-	-
✓	✓	-	-	-	-	-	-	-	-
✓	✓	-	-	-	-	-	-	-	-
✓	✓	-	-	-	-	-	-	-	-
35 40		-	-	-	-	-	-	-	-
✓	✓	-	-	-	-	-	-	-	-

REMARKS

Name & signature of Technician(s)

Verified By :

1 P. Mami Neni

(Name & signature)

2 _____

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

FAX : 6 287 9635

TOWN COUNCIL NEE SOON TOWN COUNCIL

LOCATION NEE SOON EAST DIVISION

DATE OF SERVICING 23 /09/2025

23 /09/2025

WEEKLY PRESSURE TANK CHECKLIST REPORT

1. Test run of pumps
 2. Check pump and motor running condition
 3. Check coupling set, baseplate and spring isolator
 4. Check mechanical seal / gland-packing and bearings
 5. Check all pipe work, check valve, gate valve, expansion joint, strainer
 6. Check correct function of pump system in auto and manual mode
 7. Check control panel and electrical isolator
 8. Check electrical components in control panel
 9. Check all indicator lamps
 10. Check conduit and wiring
 11. Check electrode holder and sensor
 12. Check ball float valve / pilot valve and motorised valve
 13. Check pump running ampere
 14. Check pressure switch setting and pressure gauge

Block No :

REMARKS

REMARKS BUK-269A - PT1 + P₁₀₀ & spoil, 296A - PT1 + PT2 & spoil.

Name & signature of Technician(s)

Verified By :

1 P.Nani ahri

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298

FAX : 6 287 9635

TOWN COUNCIL

NEE SOON TOWN COUNCIL

LOCATION

NEE SOON EAST DIVISION

DATE OF SERVICING

23 /09/2025

WEEKLY PRESSURE TANK CHECKLIST REPORT

1. Test run of pumps
 2. Check pump and motor running condition
 3. Check coupling set, baseplate and spring isolator
 4. Check mechanical seal / gland-packing and bearings
 5. Check all pipe work, check valve, gate valve, expansion joint, strainer
 6. Check correct function of pump system in auto and manual mode
 7. Check control panel and electrical isolator
 8. Check electrical components in control panel
 9. Check all indicator lamps
 10. Check conduit and wiring
 11. Check electrode holder and sensor
 12. Check ball float valve / pilot valve and motorised valve
 13. Check pump running ampere
 14. Check pressure switch setting and pressure gauge

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

1 P. Mani Meij

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

FAX : 6 287 9635

TOWN COUNCIL

NEE SOON TOWN COUNCIL

LOCATION

NEE SOON EAST DIVISION

DATE OF SERVICING

23 /09/2025

WEEKLY PRESSURE TANK CHECKLIST REPORT

1. Test run of pumps
 2. Check pump and motor running condition
 3. Check coupling set, baseplate and spring isolator
 4. Check mechanical seal / gland-packing and bearings
 5. Check all pipe work, check valve, gate valve, expansion joint, strainer
 6. Check correct function of pump system in auto and manual mode
 7. Check control panel and electrical isolator
 8. Check electrical components in control panel
 9. Check all indicator lamps
 10. Check conduit and wiring
 11. Check electrode holder and sensor
 12. Check ball float valve / pilot valve and motorised valve
 13. Check pump running ampere
 14. Check pressure switch setting and pressure gauge

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

¹ P. Nomi Ohri

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

TOWN COUNCIL	<u>NEE SOON TOWN COUNCIL</u>
LOCATION	<u>NEE SOON EAST DIVISION</u>
DATE OF SERVICING	<u>24 /09/2025</u>

WEEKLY PRESSURE TANK CHECKLIST REPORT

1. Test run of pumps
 2. Check pump and motor running condition
 3. Check coupling set, baseplate and spring isolator
 4. Check mechanical seal / gland-packing and bearings
 5. Check all pipe work, check valve, gate valve, expansion joint, strainer
 6. Check correct function of pump system in auto and manual mode
 7. Check control panel and electrical isolator
 8. Check electrical components in control panel
 9. Check all indicator lamps
 10. Check conduit and wiring
 11. Check electrode holder and sensor
 12. Check ball float valve / pilot valve and motorised valve
 13. Check pump running ampere
 14. Check pressure switch setting and pressure gauge

Block No :

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

FAX : 6 287 9635

TOWN COUNCIL

NEE SOON TOWN COUNCIL

LOCATION

NEE SOON EAST DIVISION

DATE OF SERVICING

24 09/2025

WEEKLY PRESSURE TANK CHECKLIST REPORT

1. Test run of pumps
 2. Check pump and motor running condition
 3. Check coupling set, baseplate and spring isolator
 4. Check mechanical seal / gland-packing and bearings
 5. Check all pipe work, check valve, gate valve, expansion joint, strainer
 6. Check correct function of pump system in auto and manual mode
 7. Check control panel and electrical isolator
 8. Check electrical components in control panel
 9. Check all indicator lamps
 10. Check conduit and wiring
 11. Check electrode holder and sensor
 12. Check ball float valve / pilot valve and motorised valve
 13. Check pump running ampere
 14. Check pressure switch setting and pressure gauge

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

¹ P-Nomi dhg

(Name & signature)

2 _____

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298

FAX : 6 287 9635

TOWN COUNCIL

NEE SOON TOWN COUNCIL

LOCATION

NEE SOON EAST DIVISION

DATE OF SERVICING

24 /09/2025

WEEKLY PRESSURE TANK CHECKLIST REPORT

1. Test run of pumps
 2. Check pump and motor running condition
 3. Check coupling set, baseplate and spring isolator
 4. Check mechanical seal / gland-packing and bearings
 5. Check all pipe work, check valve, gate valve, expansion joint, strainer
 6. Check correct function of pump system in auto and manual mode
 7. Check control panel and electrical isolator
 8. Check electrical components in control panel
 9. Check all indicator lamps
 10. Check conduit and wiring
 11. Check electrode holder and sensor
 12. Check ball float valve / pilot valve and motorised valve
 13. Check pump running ampere
 14. Check pressure switch setting and pressure gauge

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

1 P.Mani Nthi

(Name & signature)

2 _____

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

FAX : 6 287 9635

TOWN COUNCIL

NEE SOON TOWN COUNCIL

LOCATION

NEE SOON EAST DIVISION

DATE OF SERVICING

20/09/2025

WEEKLY PRESSURE TANK CHECKLIST REPORT

1. Test run of pumps
 2. Check pump and motor running condition
 3. Check coupling set, baseplate and spring isolator
 4. Check mechanical seal / gland-packing and bearings
 5. Check all pipe work, check valve, gate valve, expansion joint, strainer
 6. Check correct function of pump system in auto and manual mode
 7. Check control panel and electrical isolator
 8. Check electrical components in control panel
 9. Check all indicator lamps
 10. Check conduit and wiring
 11. Check electrode holder and sensor
 12. Check ball float valve / pilot valve and motorised valve
 13. Check pump running ampere
 14. Check pressure switch setting and pressure gauge

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

¹ P.Ntami Ohij

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

FAX : 6 287 9635

TOWN COUNCIL

NEE SOON TOWN COUNCIL

LOCATION

NEE SOON EAST DIVISION

DATE OF SERVICING

29 /09/2025

WEEKLY PRESSURE TANK CHECKLIST REPORT

1. Test run of pumps
 2. Check pump and motor running condition
 3. Check coupling set, baseplate and spring isolator
 4. Check mechanical seal / gland-packing and bearings
 5. Check all pipe work, check valve, gate valve, expansion joint, strainer
 6. Check correct function of pump system in auto and manual mode
 7. Check control panel and electrical isolator
 8. Check electrical components in control panel
 9. Check all indicator lamps
 10. Check conduit and wiring
 11. Check electrode holder and sensor
 12. Check ball float valve / pilot valve and motorised valve
 13. Check pump running ampere
 14. Check pressure switch setting and pressure gauge

Block No :

REMARKS

REMARKS BLK - 269A - PT1 ♀ · PT2 - Spoil, 296A · PT1 ♂ PT2 - Spoil

Name & signature of Technician(s)

Verified By :

¹ P.Ntami Nthi

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298

FAX : 6 287 9635

TOWN COUNCIL

NEE SOON TOWN COUNCIL

LOCATION

NEE SOON EAST DIVISION

DATE OF SERVICING

29 /09/2025

WEEKLY PRESSURE TANK CHECKLIST REPORT

1. Test run of pumps
 2. Check pump and motor running condition
 3. Check coupling set, baseplate and spring isolator
 4. Check mechanical seal / gland-packing and bearings
 5. Check all pipe work, check valve, gate valve, expansion joint, strainer
 6. Check correct function of pump system in auto and manual mode
 7. Check control panel and electrical isolator
 8. Check electrical components in control panel
 9. Check all indicator lamps
 10. Check conduit and wiring
 11. Check electrode holder and sensor
 12. Check ball float valve / pilot valve and motorised valve
 13. Check pump running ampere
 14. Check pressure switch setting and pressure gauge

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

1 P.Nomi Neri

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

TOWN COUNCIL	<u>NEE SOON TOWN COUNCIL</u>
LOCATION	<u>NEE SOON EAST DIVISION</u>
DATE OF SERVICING	<u>29/09/2025</u>

WEEKLY PRESSURE TANK CHECKLIST REPORT

1. Test run of pumps
 2. Check pump and motor running condition
 3. Check coupling set, baseplate and spring isolator
 4. Check mechanical seal / gland-packing and bearings
 5. Check all pipe work, check valve, gate valve, expansion joint, strainer
 6. Check correct function of pump system in auto and manual mode
 7. Check control panel and electrical isolator
 8. Check electrical components in control panel
 9. Check all indicator lamps
 10. Check conduit and wiring
 11. Check electrode holder and sensor
 12. Check ball float valve / pilot valve and motorised valve
 13. Check pump running ampere
 14. Check pressure switch setting and pressure gauge

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

¹ Pantani Bhi

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6

FAX : 6 287 9635

TOWN COUNCIL

NEE SOON TOWN COUNCIL

LOCATION

NEE SOON EAST DIVISION

DATE OF SERVICING

20 /09/2025

WEEKLY PRESSURE TANK CHECKLIST REPORT

1. Test run of pumps
 2. Check pump and motor running condition
 3. Check coupling set, baseplate and spring isolator
 4. Check mechanical seal / gland-packing and bearings
 5. Check all pipe work, check valve, gate valve, expansion joint, strainer
 6. Check correct function of pump system in auto and manual mode
 7. Check control panel and electrical isolator
 8. Check electrical components in control panel
 9. Check all indicator lamps
 10. Check conduit and wiring
 11. Check electrode holder and sensor
 12. Check ball float valve / pilot valve and motorised valve
 13. Check pump running ampere
 14. Check pressure switch setting and pressure gauge

Block No :

RED-POWER ELECTRICAL ENGINEERING PTE LTD
BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539196
TEL : 6 289 2298 FAX : 6 287 9635

TOWN COUNCIL	<u>NEE SOON TOWN COUNCIL</u>
LOCATION	<u>NEE SOON EAST DIVISION</u>
DATE OF SERVICING	<u>20/09/2025</u>

WEEKLY PRESSURE TANK CHECKLIST REPORT

1. Test run of pumps
 2. Check pump and motor running condition
 3. Check coupling set, baseplate and spring isolator
 4. Check mechanical seal / gland-packing and bearings
 5. Check all pipe work, check valve, gate valve, expansion joint, strainer
 6. Check correct function of pump system in auto and manual mode
 7. Check control panel and electrical isolator
 8. Check electrical components in control panel
 9. Check all indicator lamps
 10. Check conduit and wiring
 11. Check electrode holder and sensor
 12. Check ball float valve / pilot valve and motorised valve
 13. Check pump running ampere
 14. Check pressure switch setting and pressure gauge

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

¹ D. Nomi Mhi

(Name & signature)

2 _____

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

TOWN COUNCIL	<u>NEE SOON TOWN COUNCIL</u>
LOCATION	<u>NEE SOON EAST DIVISION</u>
DATE OF SERVICING	<u>20 /09/2025</u>

WEEKLY PRESSURE TANK CHECKLIST REPORT

1. Test run of pumps
 2. Check pump and motor running condition
 3. Check coupling set, baseplate and spring isolator
 4. Check mechanical seal / gland-packing and bearings
 5. Check all pipe work, check valve, gate valve, expansion joint, strainer
 6. Check correct function of pump system in auto and manual mode
 7. Check control panel and electrical isolator
 8. Check electrical components in control panel
 9. Check all indicator lamps
 10. Check conduit and wiring
 11. Check electrode holder and sensor
 12. Check ball float valve / pilot valve and motorised valve
 13. Check pump running ampere
 14. Check pressure switch setting and pressure gauge

Block No :

REMARKS

Name & signature of Technician(s)

Verified By :

¹ P-Nani Rhy

(Name & signature)

2

RED-POWER ELECTRICAL ENGINEERING PTE LTD

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197

TEL : 6 289 2298 FAX : 6 287 9635

FAX : 6 287 9635

TOWN COUNCIL

NEE SOON TOWN COUNCIL

LOCATION

NEE SOON EAST DIVISION

DATE OF SERVICING

20/09/2025

WEEKLY PRESSURE TANK CHECKLIST REPORT

1. Test run of pumps
 2. Check pump and motor running condition
 3. Check coupling set, baseplate and spring isolator
 4. Check mechanical seal / gland-packing and bearings
 5. Check all pipe work, check valve, gate valve, expansion joint, strainer
 6. Check correct function of pump system in auto and manual mode
 7. Check control panel and electrical isolator
 8. Check electrical components in control panel
 9. Check all indicator lamps
 10. Check conduit and wiring
 11. Check electrode holder and sensor
 12. Check ball float valve / pilot valve and motorised valve
 13. Check pump running ampere
 14. Check pressure switch setting and pressure gauge

Block No :

REMARKS

Name & signature of Technician(s)


Verified By :

¹ P.N.Tomi Ohi

(Name & signature)

2

32A DP MCB	20A DP MCB	20A DP MCB	MCB 1	MCB 2	MCB 3	MCB 4	MCB 5
MAIN INCOMING MCB	PUMP No. 1 SUPPLY	PUMP No. 2 SUPPLY	INCOMING INDICATOR SUPPLY	PUMP 1 CONTROL SUPPLY	PUMP 2 CONTROL SUPPLY	ALARM BELL SUPPLY	FLOATLESS RELAY SUPPLY

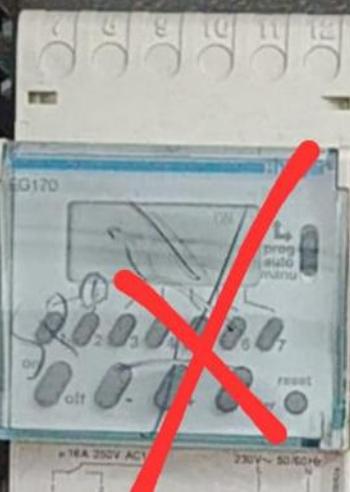

**RED POWER
DURAI**


17:03 Mon
08/09/2025

■ 315 Yishun Avenue 9,
760315

Timemark App

Authentic time, GPS


© NDU91G2R4WY62K Timemark Verified

 **RED POWER**
DURAI

17:29 Mon
08/09/2025

■ 315B Yishun Avenue 9,
762315

Timemark App
Authentic time, GPS

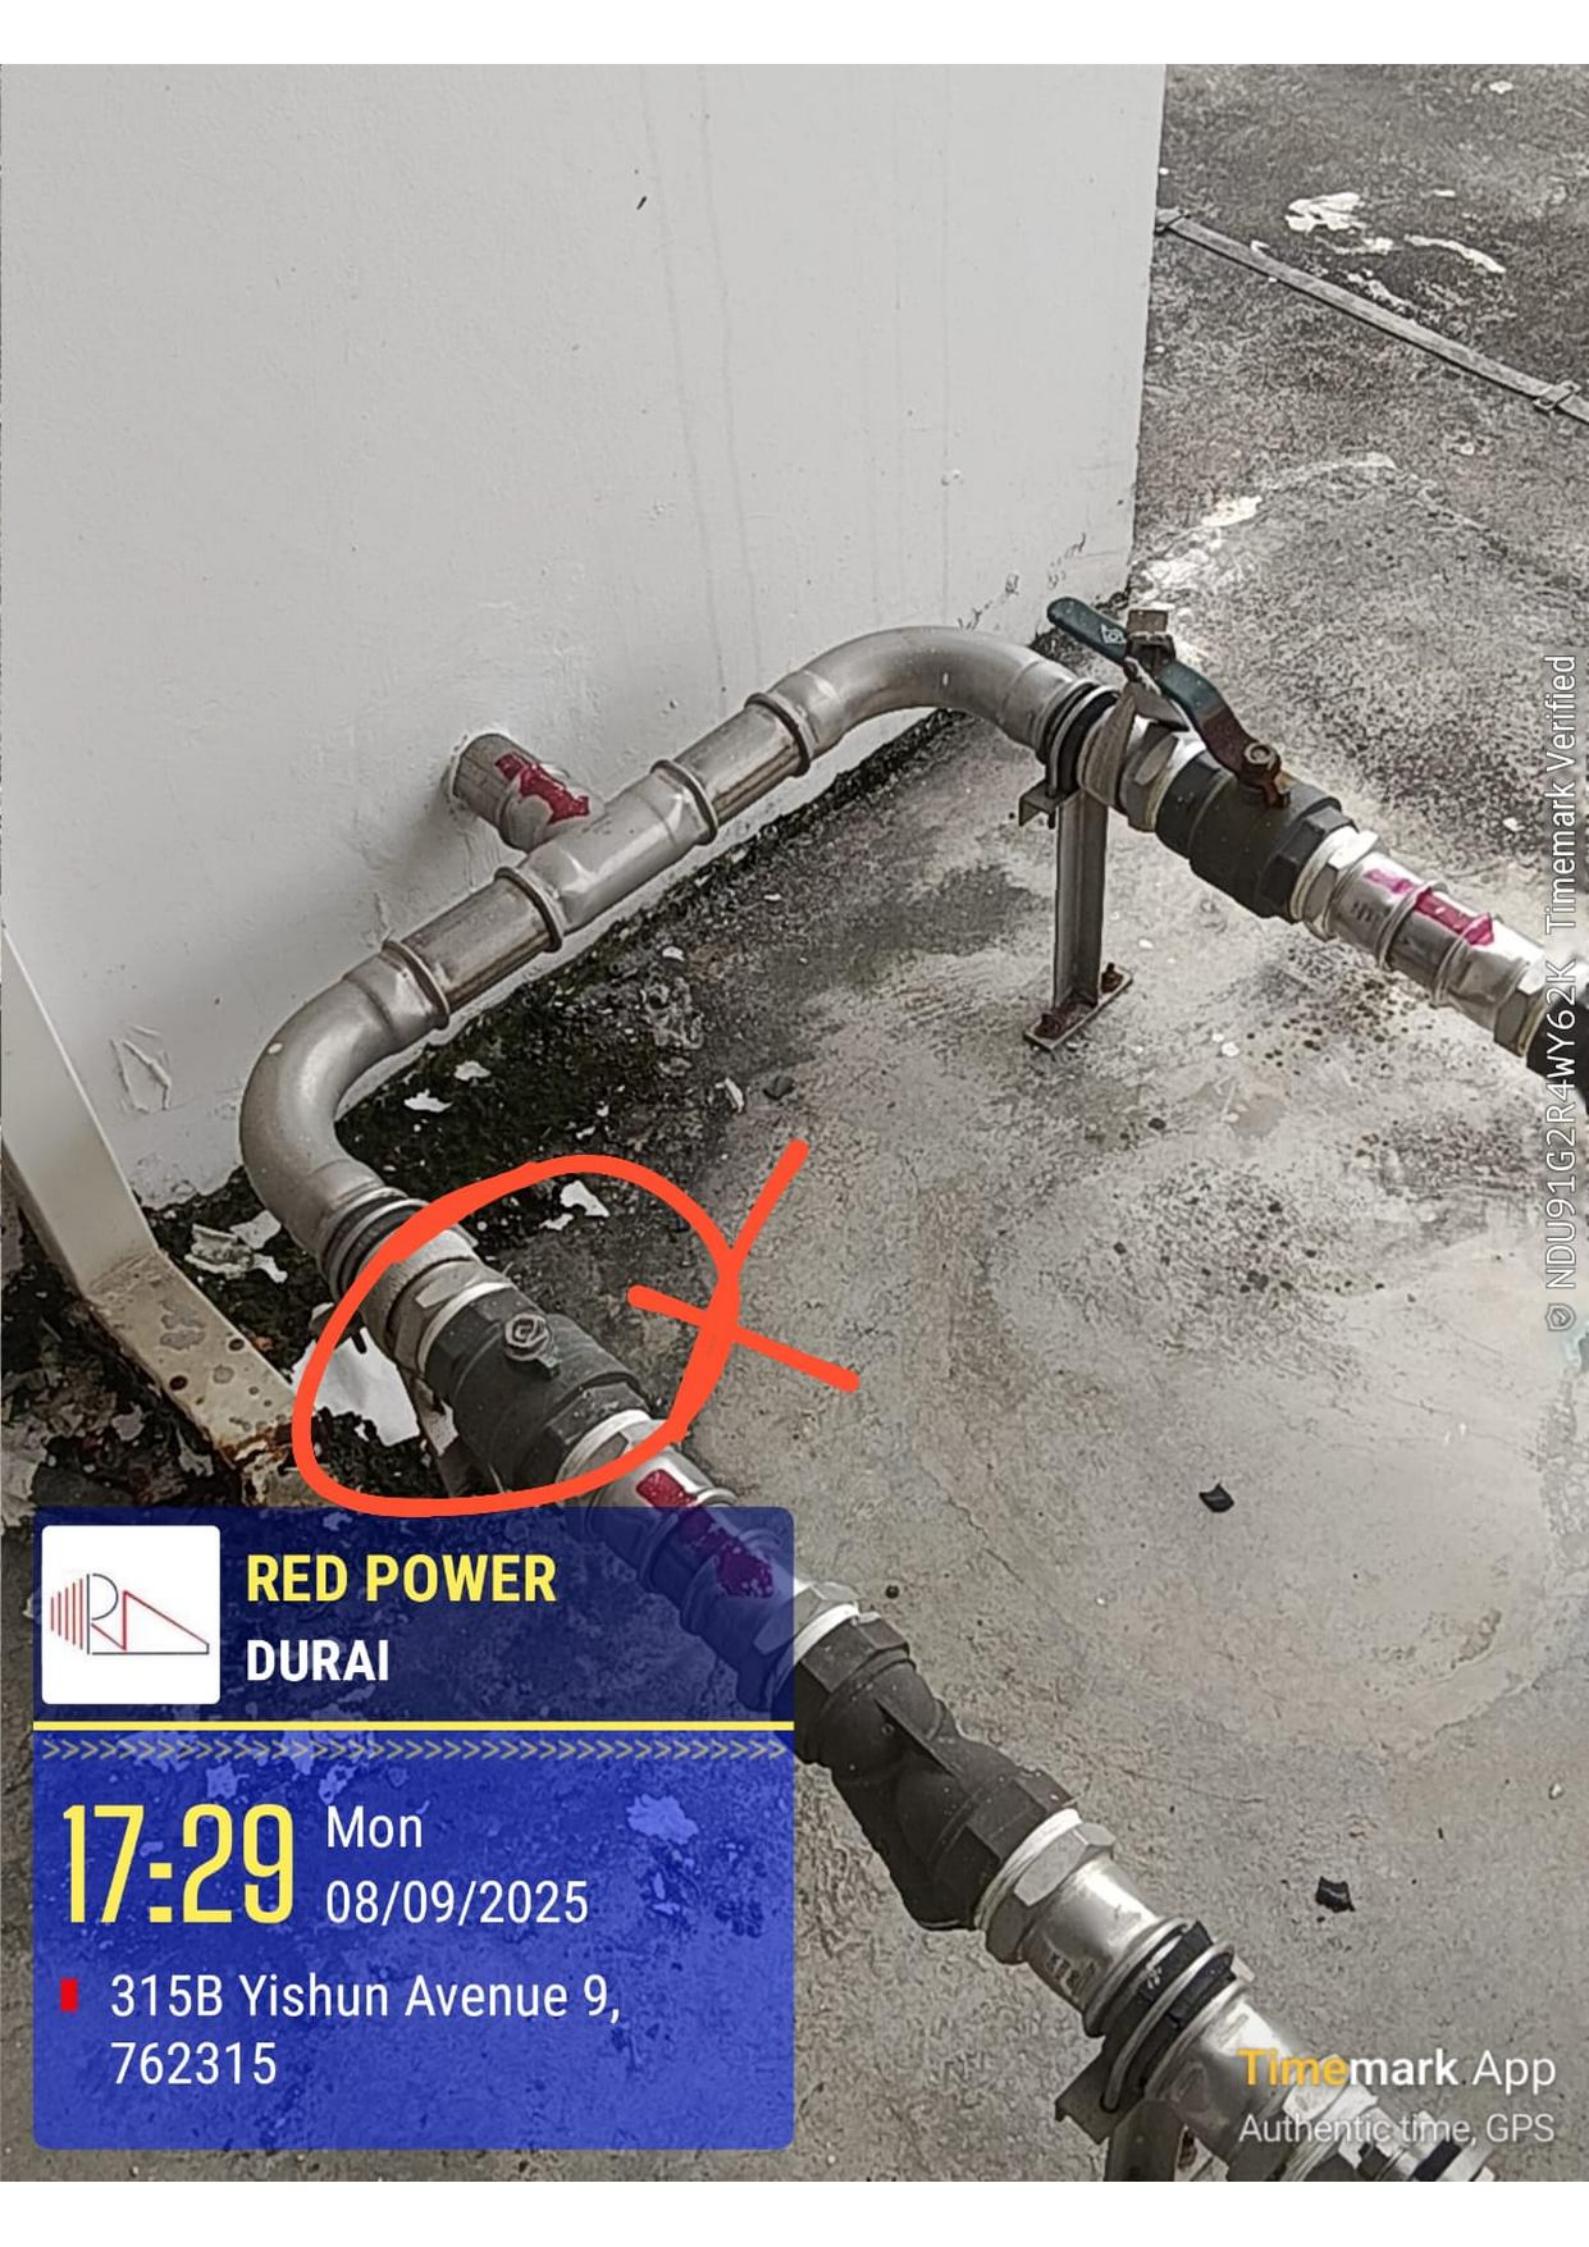

© EX2K6HHWYWW9V Timemark Verified



**RED POWER
DURAI**

17:37 Mon
08/09/2025

315B Yishun Avenue 9,
762315

Timemark App
Authentic time, GPS

© TCI1CN1N42DABP2 Timemark Verified

32A DP MCB	20A DP MCB	20A DP MCB	MCB 1	MCB 2	MCB 3	MCB 4
MAIN INCOMING MCB	PUMP No. 1 SUPPLY	PUMP No. 2 SUPPLY	INCOMING INDICATOR SUPPLY	PUMP 1 CONTROL SUPPLY	PUMP 2 CONTROL SUPPLY	ALARM BELL SUPPLY

Buk3P
Yishun

RED POWER
DURAI

16:58

Mon

08/09/2025

■ Yishun Greenwalk, 317
Yishun Avenue 9, 760317

Timemark App
Authentic time, GPS

KT2D499CHX9BK1 Timemark Verified

 **RED POWER**
DURAI

15:31 Mon
08/09/2025

Yishun Greenwalk, 317B
Yishun Avenue 9, 762317

Timemark App
Authentic time, GPS



Blk 342B alarm bell spoil




NSTC
Hosereel pump

14:43 Mon
22/09/2025

■ 336B Yishun Street 31
■ spoil

Timemark App
Authentic time, GPS

Blk 342B alarm bell spoil



NSTC
Hosereel pump

>>>>>>>>>>>>>>>>>>>>>>>>>>>>

14:43 Mon
22/09/2025

■ 336B Yishun Street 31
■ spoil

Timemark App
Authentic time, GPS

Blk 342B timer spoil



Blk 342B timer spoil



Blk 342C alarm bell SPOIL



NSTC
Hosereel pump

14:53 Mon
22/09/2025

- Yishun Natura, 342C Yishun Ring Road, 763342
- spoil


Timemark
Camera

TD
DELAY
TIMER
AC 230V

TS

Blk 342C timer spoil



 **NSTC**
Hosereel pump

TSR

ALARM RELAY AC 230V TIME SWITCH RELAY AC 230V

14:53 Mon 22/09/2025

Yishun Natura, 342C Yishun
Ring Road, 763342
spoil

Timemark
Camera

Blk 342A timer SPOIL



NSTC
Hosereel pump

15:01 Mon
22/09/2025

- Yishun Natura, 342A Yishun Ring Road, 761342
- spoil

Blk 342C alarm bell SPOIL



NSTC
Hosereel pump

14:53 Mon
22/09/2025

- Yishun Natura, 342C Yishun Ring Road, 763342
- spoil

Timemark
Camera


TD
DELAY
TIMER
AC 230V

TS

Blk 342C timer spoil



Blk 342A timer SPOIL

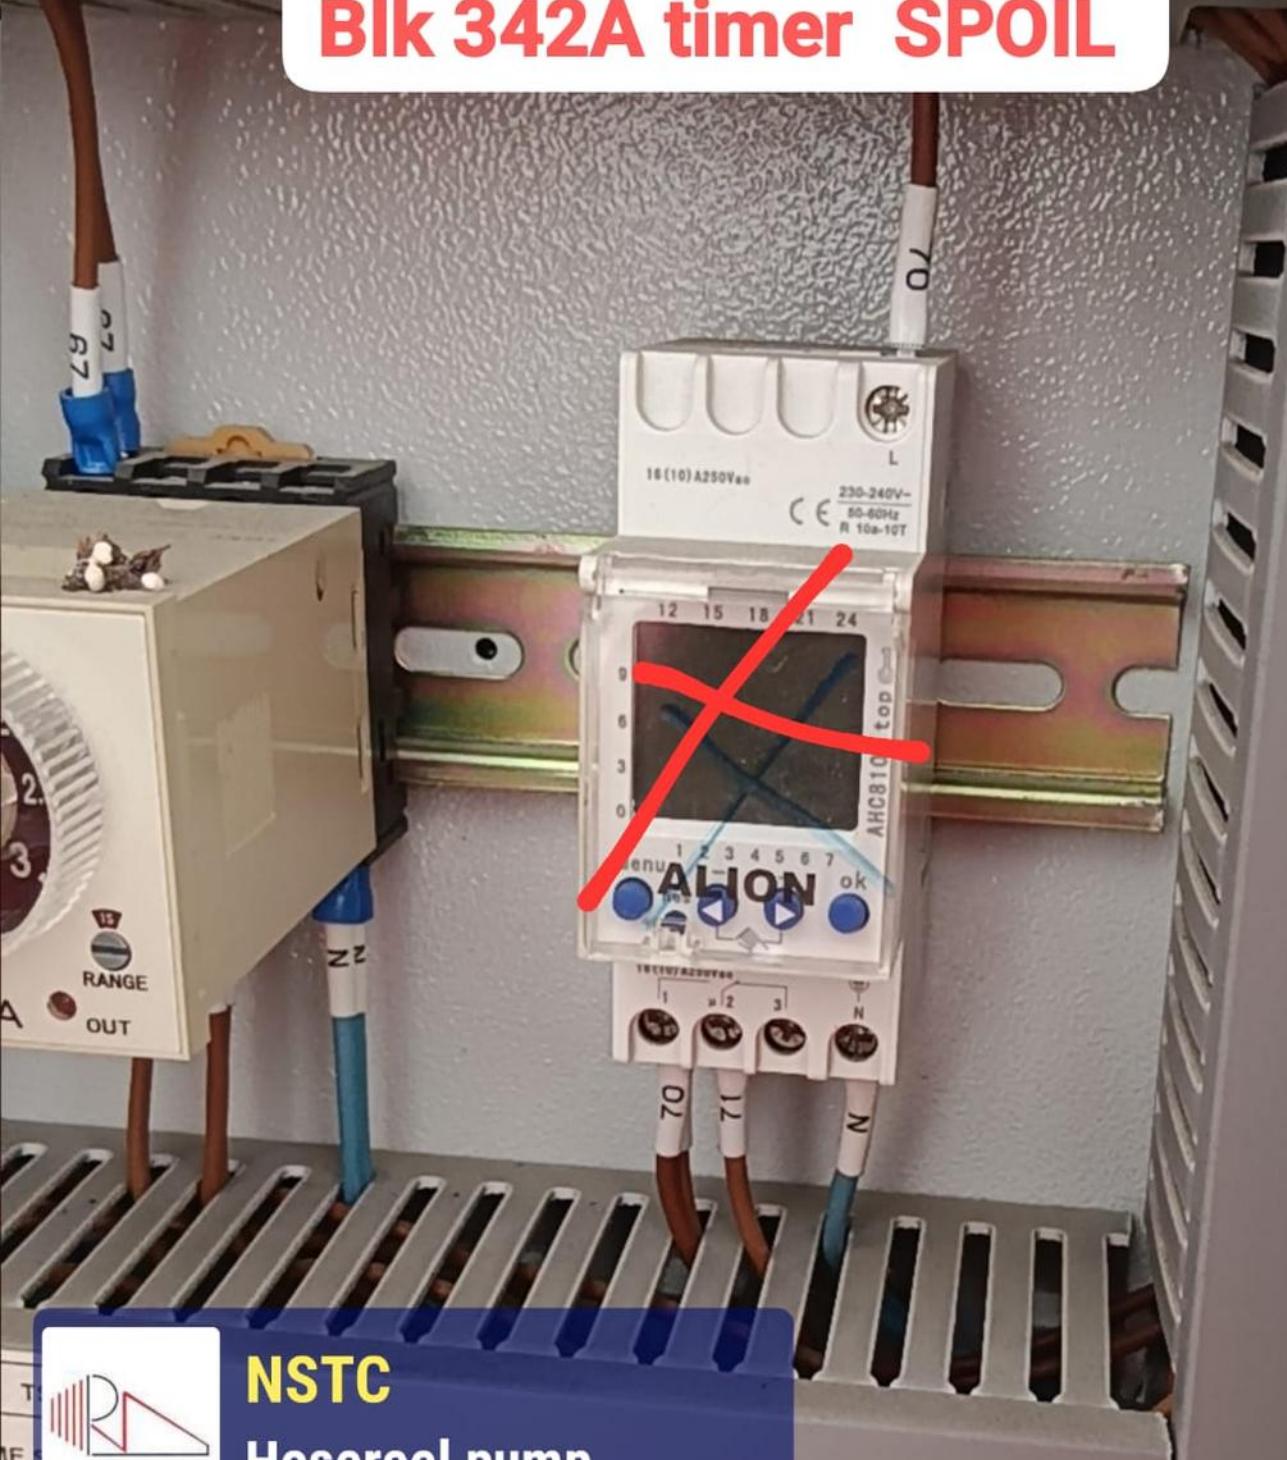

15:01 Mon
22/09/2025

- Yishun Natura, 342A Yishun Ring Road, 761342
- spoil

LTR-1

LTR-2

347 mscp HP timer SPOIL



NSTC

Hosereel pump

12:20

Mon

22/09/2025

- 347B Yishun Ave 11
- spoil

Timemark App
Authentic time, GPS

MRT-2

347 mscp HP alarm

SPOIL



NSTC
Hosereel pump

12:20 Mon
22/09/2025

- 347B Yishun Ave 11
- spoil

Timemark App
Authentic time, GPS

LTR-1

LTR-2

347 mscp HP timer SPOIL



347 mscp HP alarm

SPOIL



NSTC
Hosereel pump

>>>>>>>>>>>>>>>>>>>>>>>>>>


12:20 Mon
22/09/2025

- 347B Yishun Ave 11
- spoil

Timemark App
Authentic time, GPS

Blk 381D HP PT1 PT2

spoil



NSE
Hosereel pump

11:26 Tues
30/09/2025

- Work Content: spoil need to replace
- Yishun Glen, 381D Yishun Ring Road, 764381

Blk 382C HP PT2

Spoil



NSE
Hosereel pump

14:07 Tues
30/09/2025

- Work Content: spoil need to replace
- 382C Yishun Street 31