

	FIRE	FAULT	ISOLATE	LOCATION
5/Z1	☐	☐	☐	HEAT DETECTOR (DECK 6A)
5/Z2	☐	☐	☐	HEAT DETECTOR (DECK 6A)
5/Z3	☐	☐	☐	HEAT DETECTOR (DECK 5B)
5/Z4	☐	☐	☐	HEAT DETECTOR (DECK 5B)

	FIRE	FAULT	ISOLATE	LOCATION
SPARE	☐	☐	☐	
SPARE	☐	☐	☐	
SPARE	☐	☐	☐	
SPARE	☐	☐	☐	

SAP-5

ALARM COUNTER

000

AVT STATE INDICATORS

- AVT BYPASS
- ALARM RETARD
- ALARM CONFIRMATION

PATENT *System 88*

POWER ON

FAULT INDICATORS

- FIRE
- FAULT
- ISOLATED

SYSTEM CONTROL SWITCHES

- Sounder Silence
- Sounder Silence
- Sounder Silence
- SPARE
- Evacuate Alarm
- Indicators Test
- Reset



RED POWER
TAMIL


08:48 Mon
15/09/2025

■ Srisun Prata - Yishun
Greenwalk, 317 Yishun
Avenue 9, 760317

AND

Timemark App
Authentic time, GPS

© U22Y6LAA6BPT4M Timemark Verified

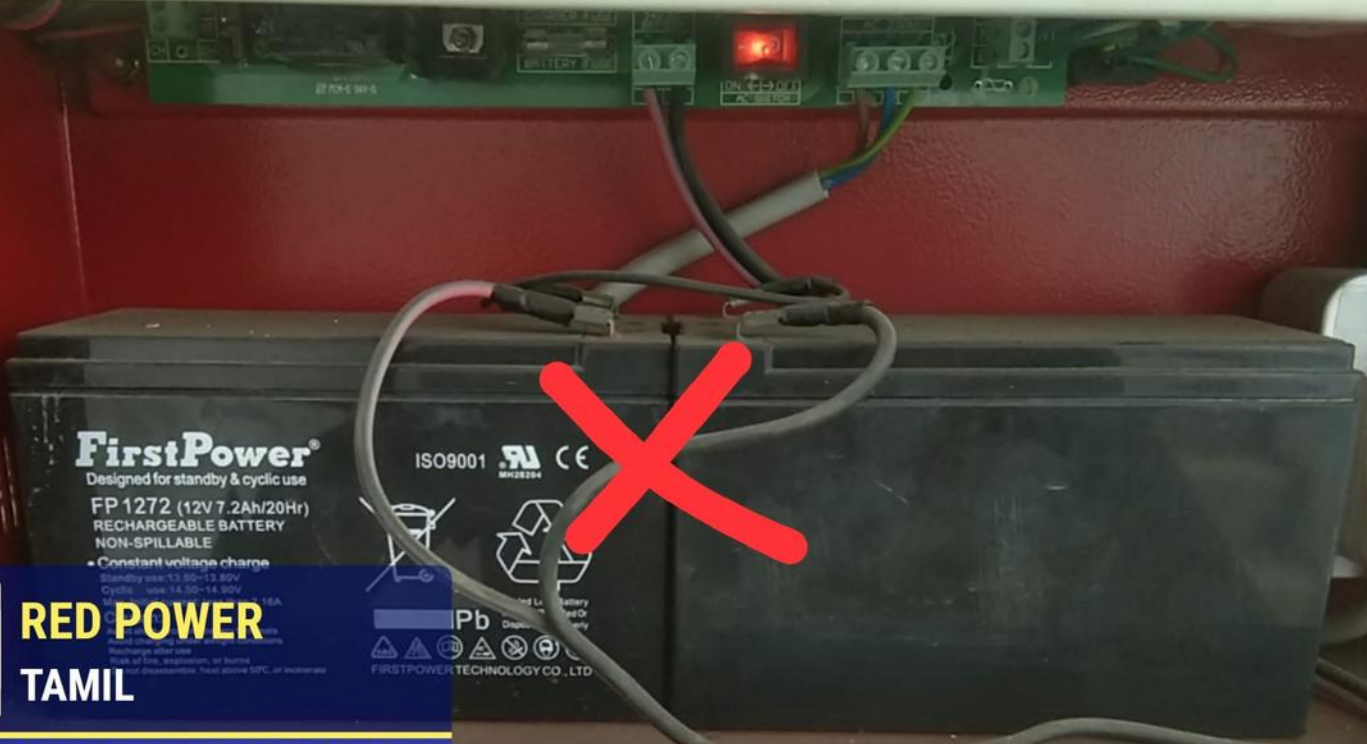

RED POWER
TAMIL

08:49

Mon
15/09/2025

■ Srisun Prata - Yishun
Greenwalk, 317 Yishun
Avenue 9, 760317

HOSE AND

Timemark App
Authentic time, GPS

© B1TLAD9E1WK1EA Timemark Verified



SUB ALARM PANEL -6

MX300 FIRE ALARM SYSTEM

COMPLIES WITH SS CP10: 2005
BS EN54-2:1998
BS EN54-4:1998

FIRE		FAULT	ISOLATED	ZONE
☒	☐	☐	☐	SAP-6 DECK 6A /HD
☐	☐	☐	☐	SAP-6 DECK 6A /HD
☐	☐	☐	☐	SAP-6 DECK 6B /HD
☐	☐	☐	☐	SAP-6 DECK 6B /HD

☐ TROUBLE	☐ SUPERVISORY SIGNAL	☐ ISOLATION	☐ SYSTEM TROUBLE	☐ POWER ON
☐ AC MAINS FAULT	☐ AVF RETARD	☐ SOUNDER LINE FAULT	☐ AVF CONFIRM	☐ EARTH FAULT
☐ CHARGER FAULT	☐ FIRE SIGNAL SENT	☐ BATTERY FAULT	☐ "FIRE SIGNAL" LINE FAULT	☐ "FAULT SIGNAL" LINE FAULT
☐ BATTERY LOW				

☐ ALARM SILENCE	☐ BUZZER SILENCE	☐ SYSTEM RESET
☐ AUXILIARY DISABLE	☐ LAMP TEST	☐ EVACUATE

SPARE

ZONE MODULE

FIRE	FAULT	ISOLATED	ZONE
☐	☐	☐	ZR-1 HR/DR & LIFT LOBBY
☐	☐	☐	ZR-2 E&I
☐	☐	☐	ZR-3 TMS
☐	☐	☐	ZR-4 LIFT SHAFT
☐	☐	☐	ZR-5 HR/DR
☐	☐	☐	SPARE
☐	☐	☐	SPARE
☐	☐	☐	SPARE

DC VOLTS
0 10 20 30 40 50



**RED POWER
TAMIL**

14:16 Tues
16/09/2025

333 Yishun Street 31,
760333

Timemark App
Authentic time, GPS

	ZR-3 TMS
	ZR-4 LIFT SHAFT
	ZR-5 HR/DR
	SPARE
	SPARE
	SPARE

VALVE REGULATED LEAD-ACID BATTERY

6FM7.2

CE

Constant voltage charge
Cycle use: 14.1-14.4V (25°C)
Standby use: 13.5-13.8V (25°C)
Initial current less than: 2.16A

Caution:
Avoid short-circuiting
Avoid charging under air
Recharge after use

31

-2

RED POWER
TAMIL

14:16 Tues
16/09/2025

333 Yishun Street 31,
760333

Timemark App
Authentic time, GPS

LRHN4YNPRGHAA2 Timemark Verified