

BLK 16 DEFU LANE 10. #01 - 364. SINGAPORE 539197
TEL : 6 289 2298 FAX : 6 287 9635

NEE SOON TOWN COUNCIL
NEE SOON LINK DIVISION

29 /09/2025

1. QUALIFIED PERSON
 - 1.1 All servicing and recharging of fire extinguishers shall only be performed by qualified person
 - 1.2 Qualified person must belong to companies approved by Singapore Civil Defence Force
 - 1.3 Carry out maintenance as specified in CP 55: 1991
2. FIRE EXTINGUISHERS
 - 2.1 All fire extinguishers are in their designated & proper places as specified by code of practice
 - 2.1 All fire extinguishers are in their designated & proper places as specified by code of practice
 - 2.2 All fire extinguishers have not been discharged or lost pressure
 - 2.3 Access to and visibility of each extinguishers is not obstructed
 - 2.4 Operating instructions on each extinguishers surface shall be legible and faced outward
 - 2.5 Pressure gauge readings if any shall be in the operable range
 - 2.6 Any seals, safety clip or tamper indicators that are broken or missing shall be replaced
 - 2.7 Any physical damage, corrosion, leakage or clogged nozzle shall be rectified
 - 2.8 Damaged, broken or rusty fire extinguishers shall be repaired or replaced
 - 2.9 Keep inspection records for those extinguishers that are found to require corrective actions
 - 2.10 Submit inspection records to Superintending Officer
 - 2.11 All extinguishers are to be properly hung
 - 2.12 Date of service is shown and has not expired
 - 2.13 The extinguishers shall bear a PSB label

[illegible]

REMARKS BULK 461 B RHE Fire extinguisher ABC Dry Powder no have need to top up.

1 selwa af.

(Name & signature)

Fire extinguisher SPOIL
need to replace

RHE




NSTC
fire extinguisher

14:06 Sun
21/09/2025

■ Blossom Spring @ Yishun,
461A Yishun Avenue 6,
761461

■ spoil

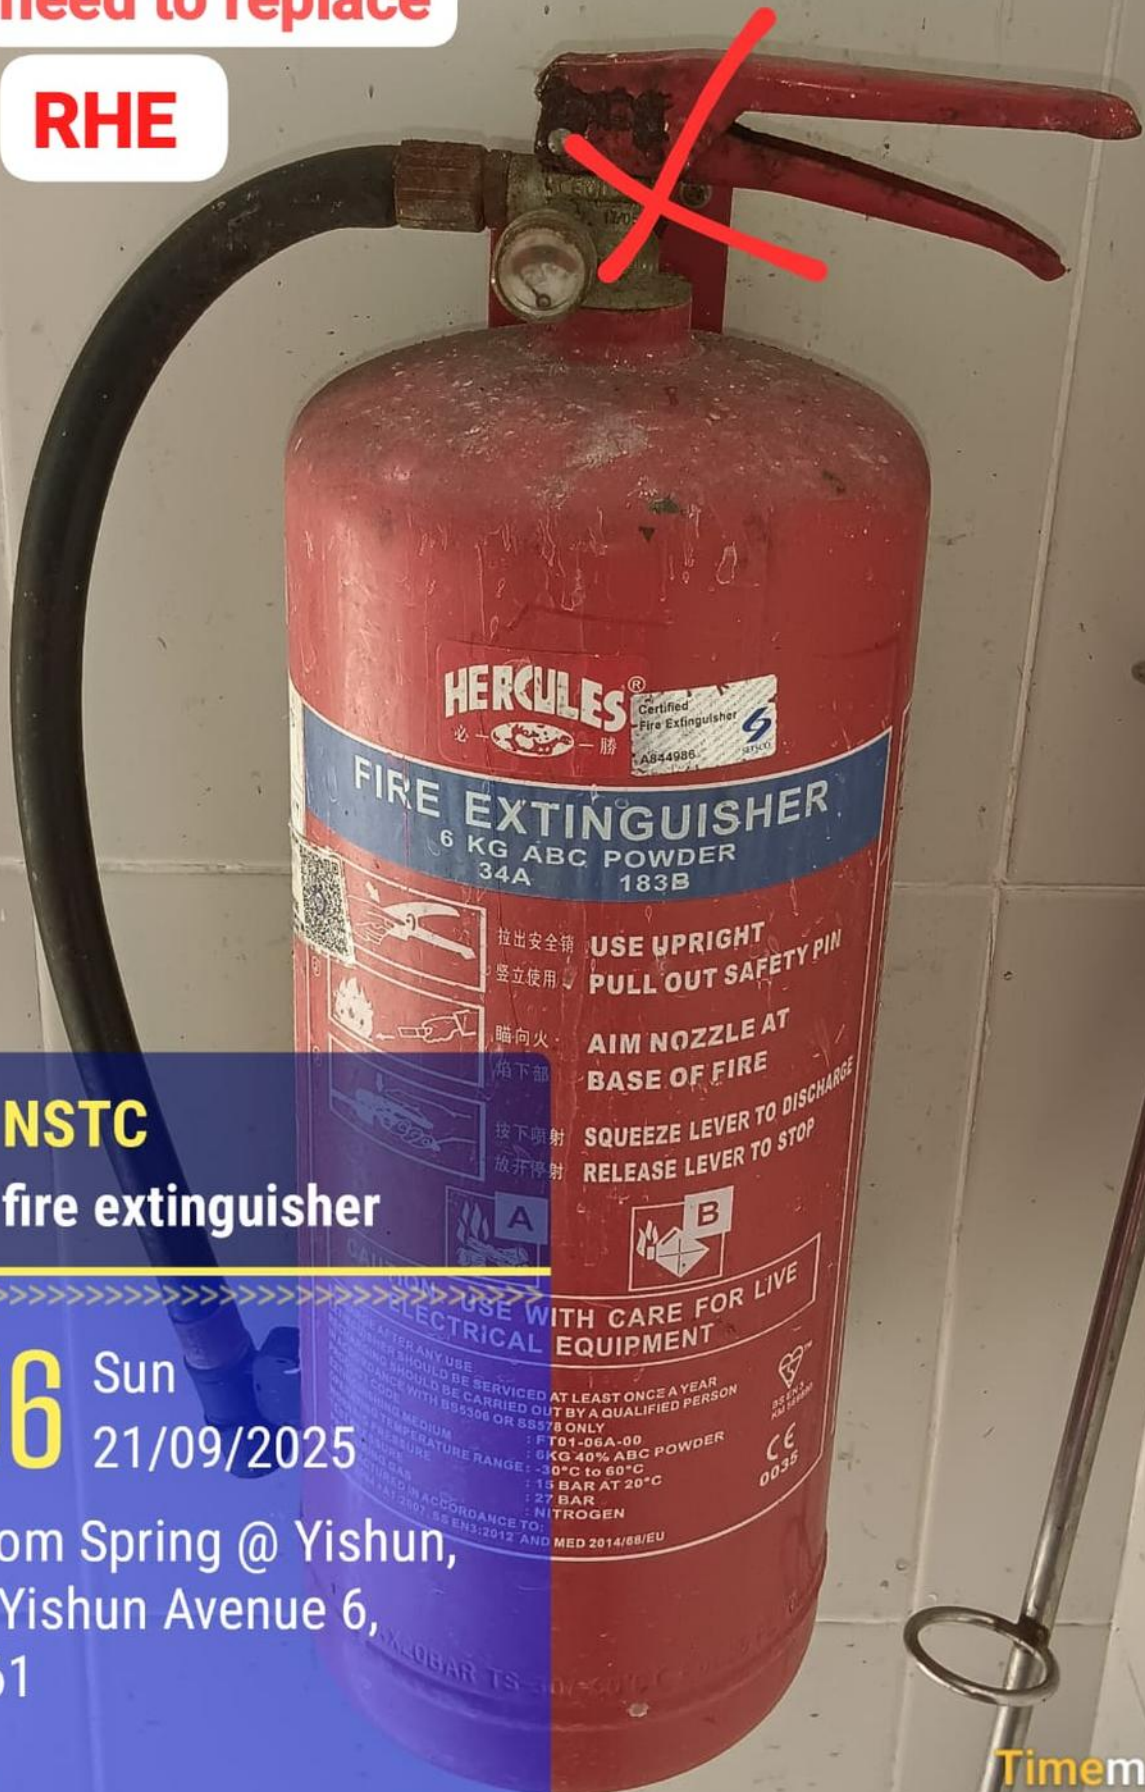

Timemark App
Authentic time, GPS

**Blk 461BRHE fire
extinguisher need to top
up**



NSTC
fire extinguisher

10:59 Sun
28/09/2025

- 461B Yishun Ave 6
- fire extinguisher top up

Timemark App
Authentic time, GPS