
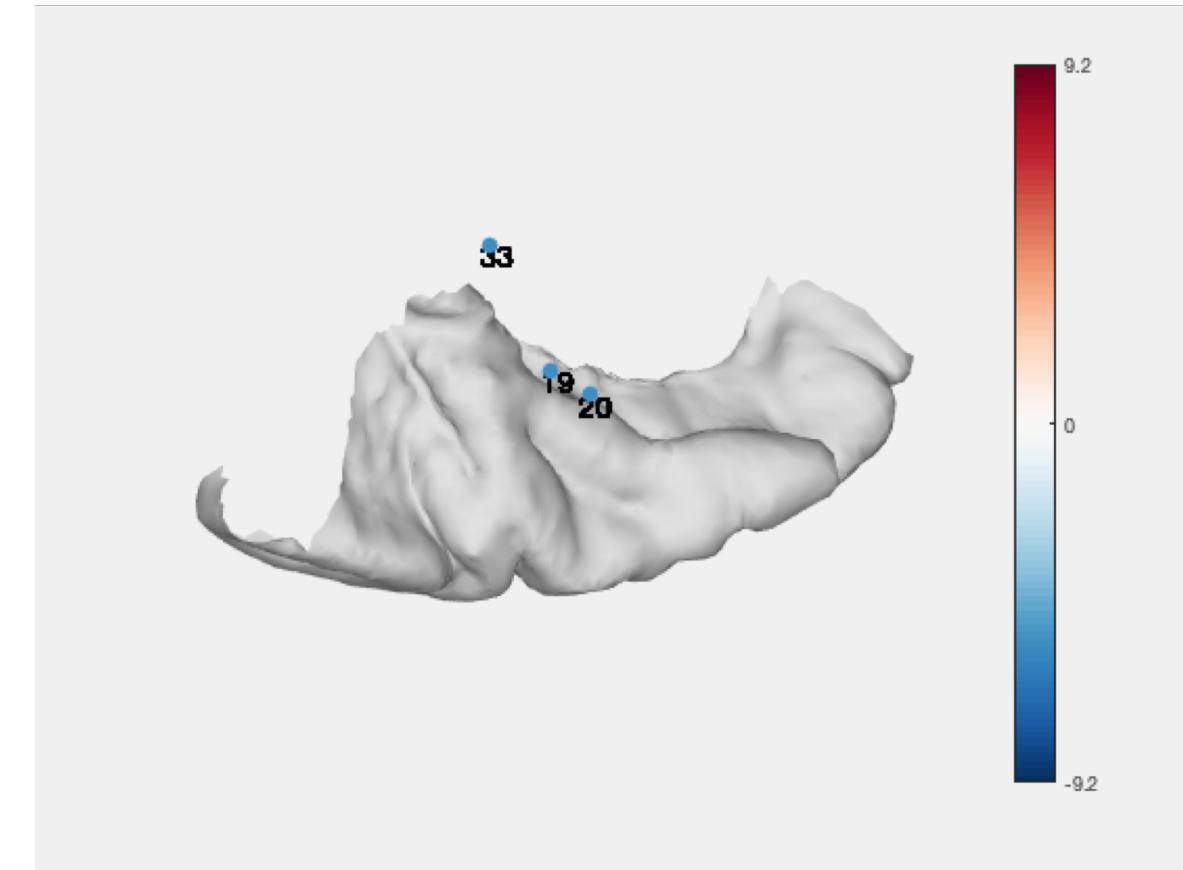




# Ttest Results

- Ran a ttest (post/pre) for all electrodes
  - Pre stim (-200 - 0)
  - Post stim (0 – 200)
- All trials
- Frequency depends on click frequency (25,50,100,125,150,200)
- Only plotted Values that had a pvalue smaller than 0.05



25 Hz

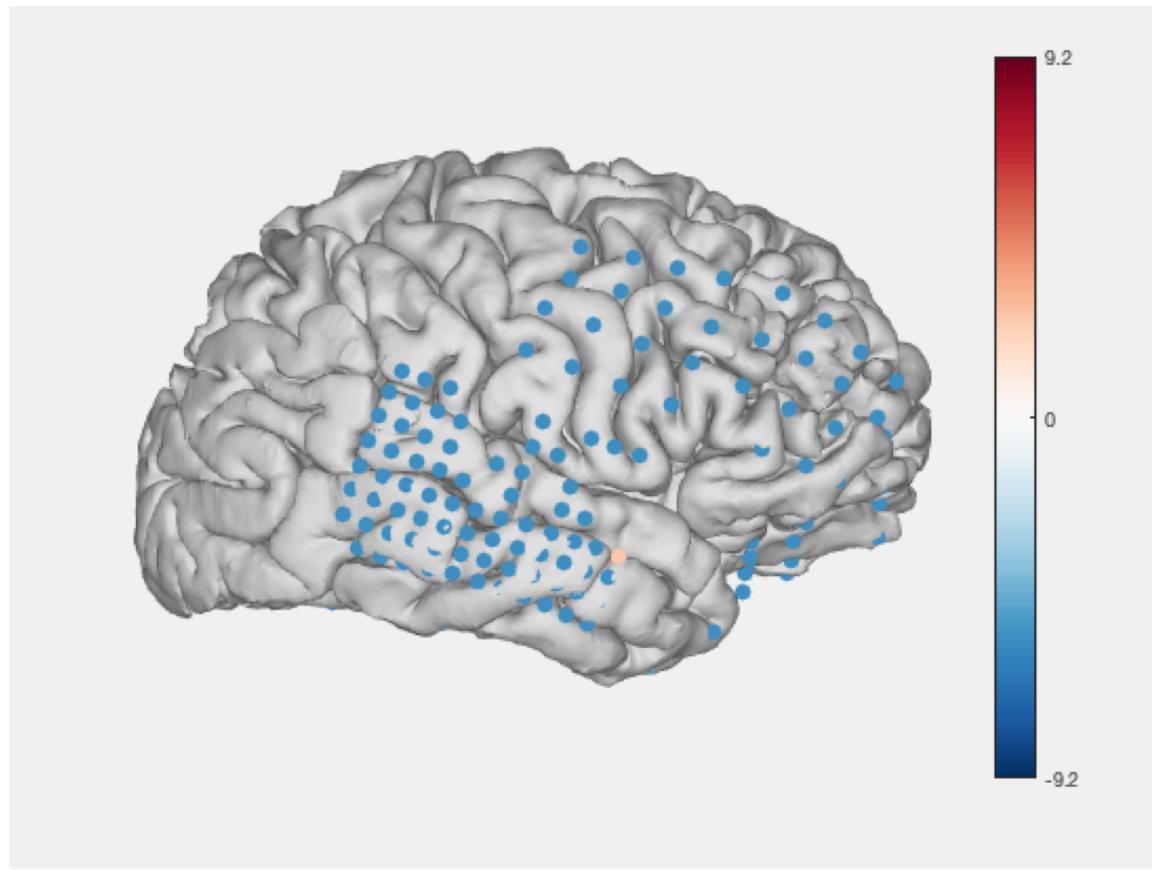



50 Hz

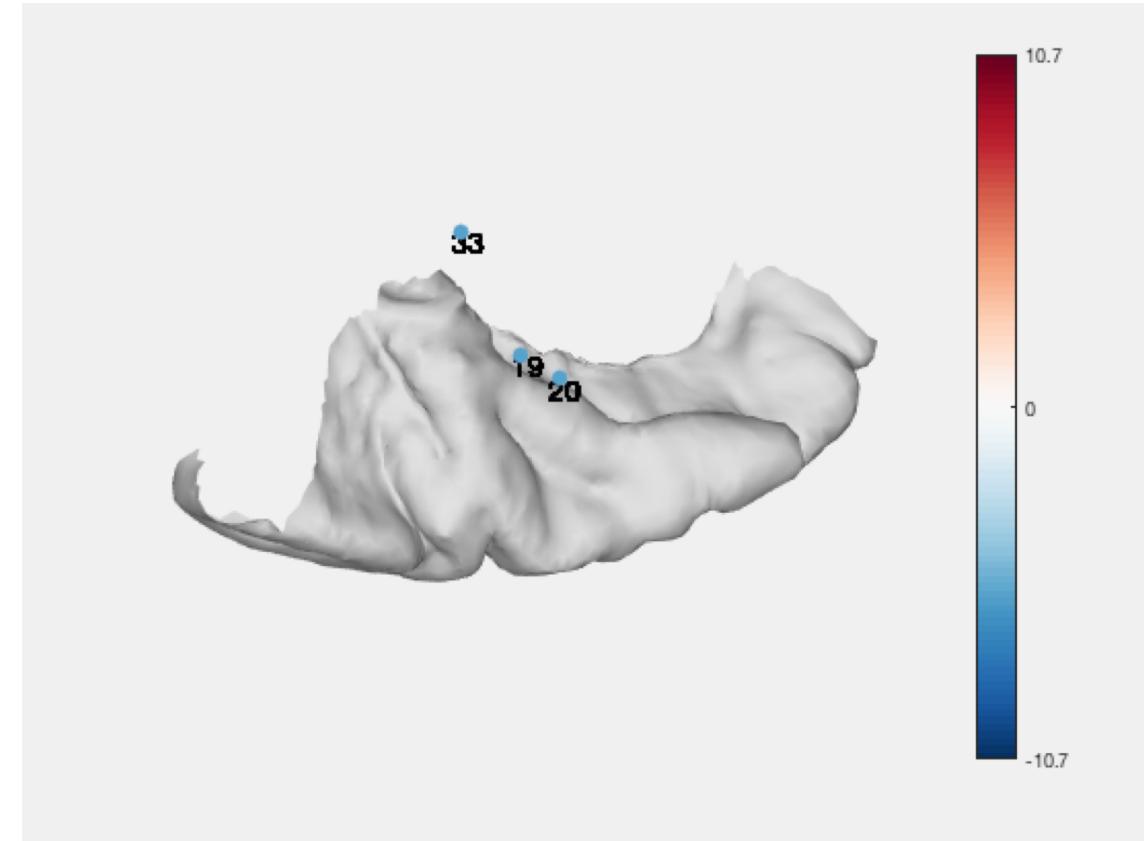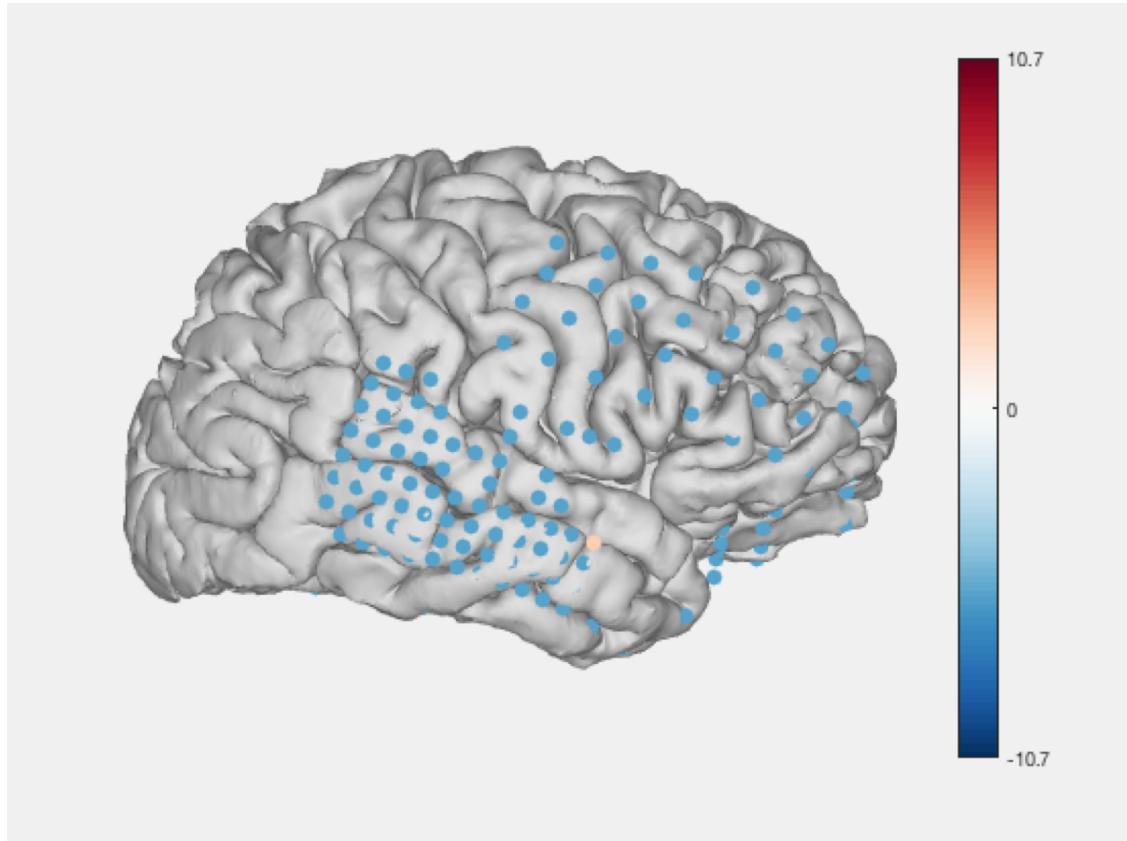



100 Hz

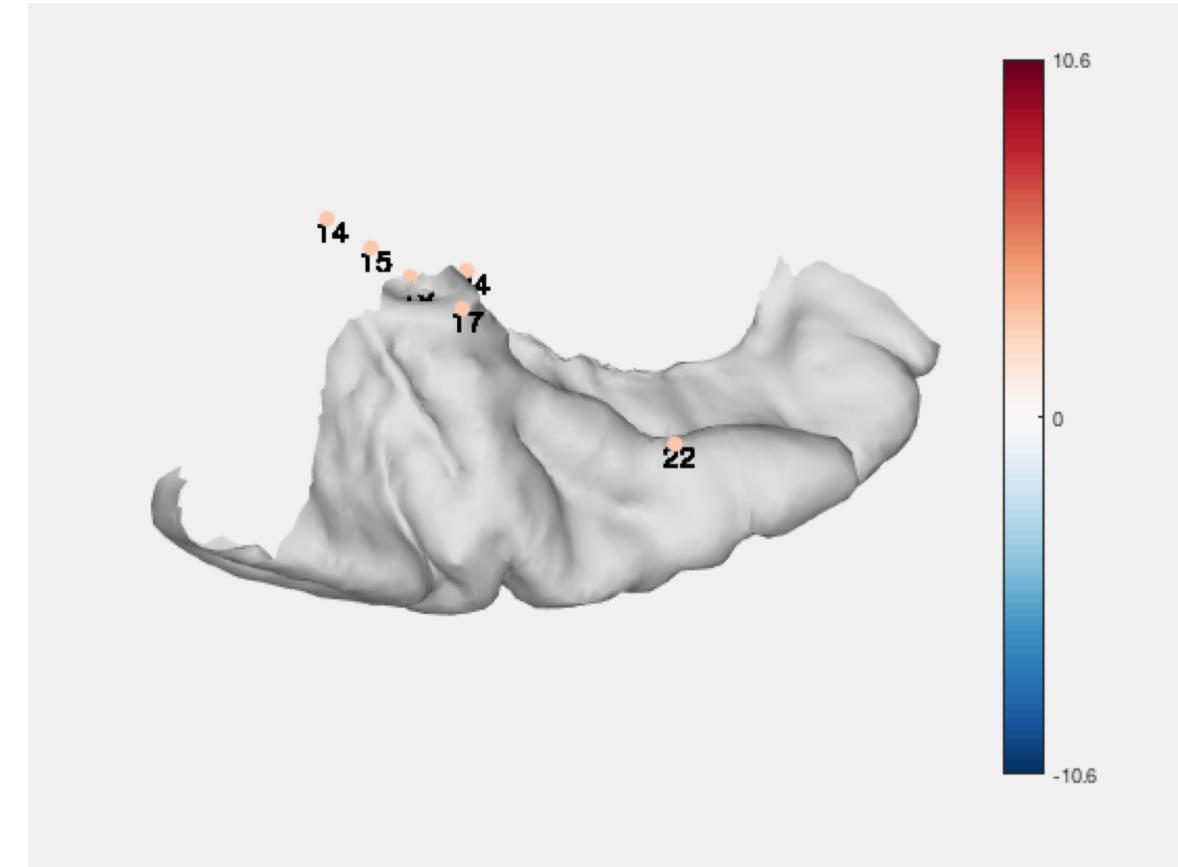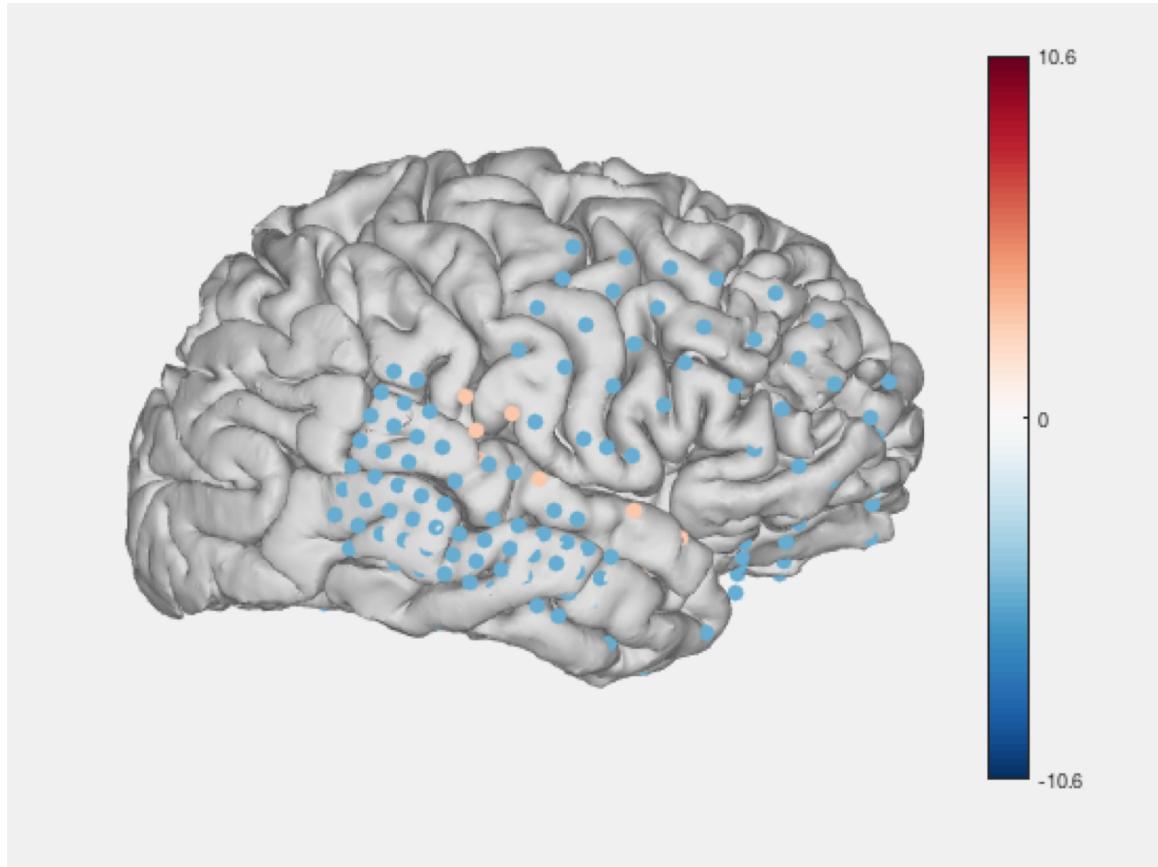

125 Hz

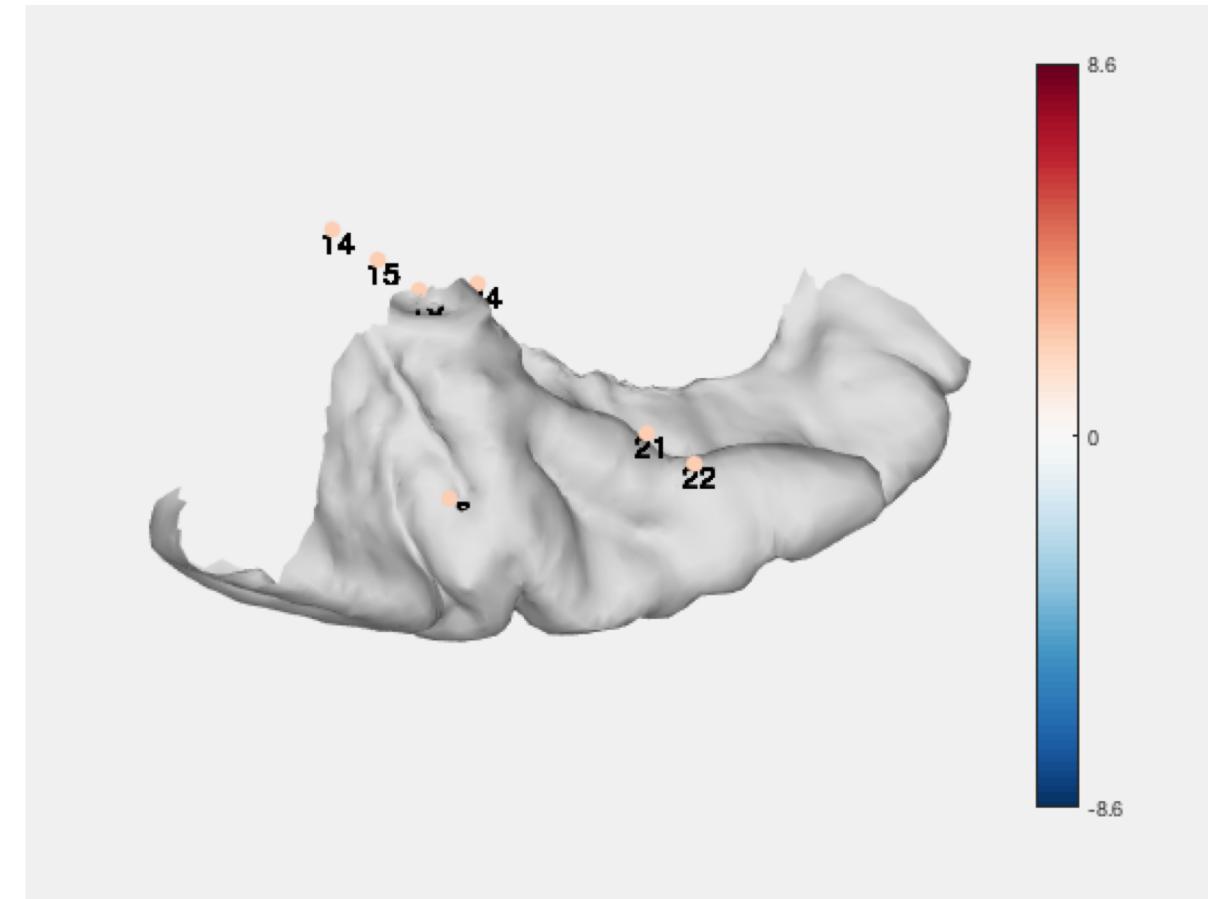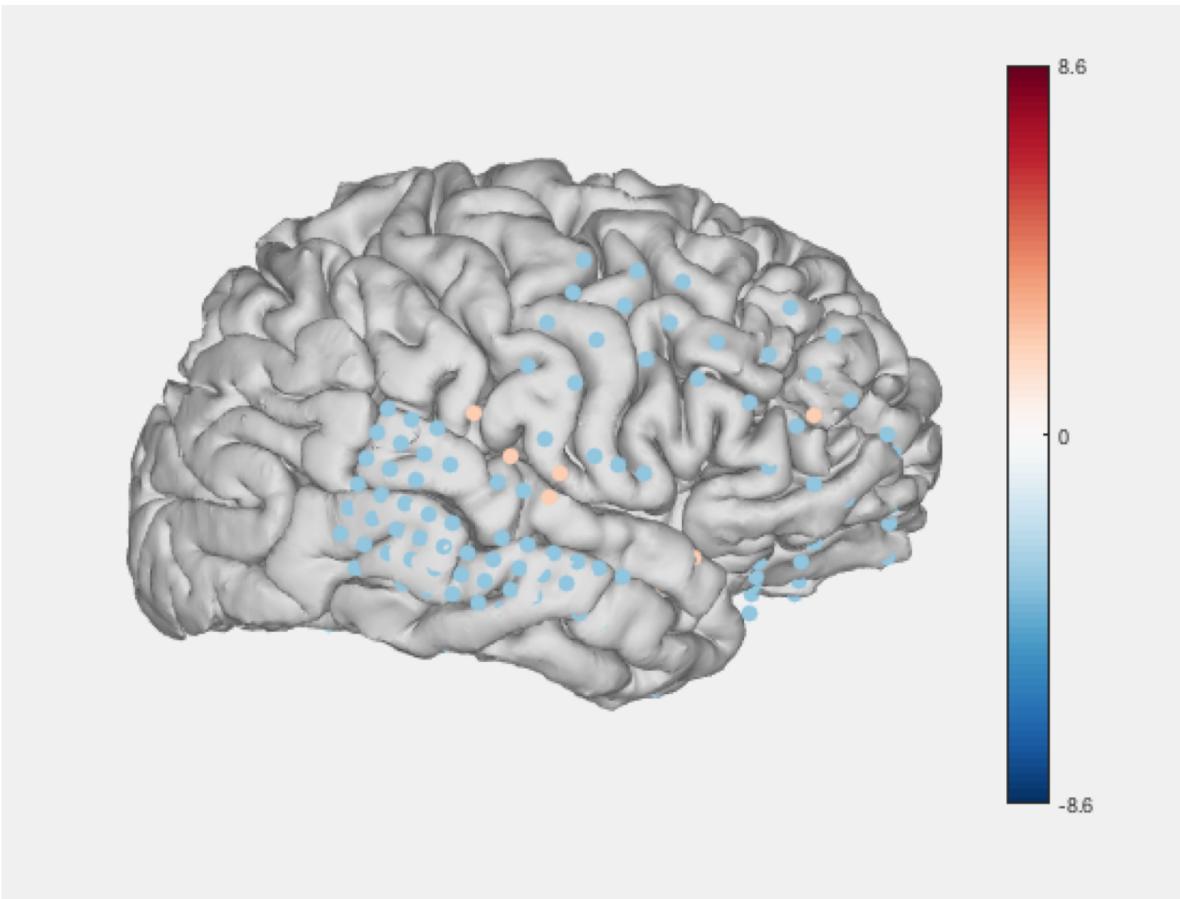

150 Hz

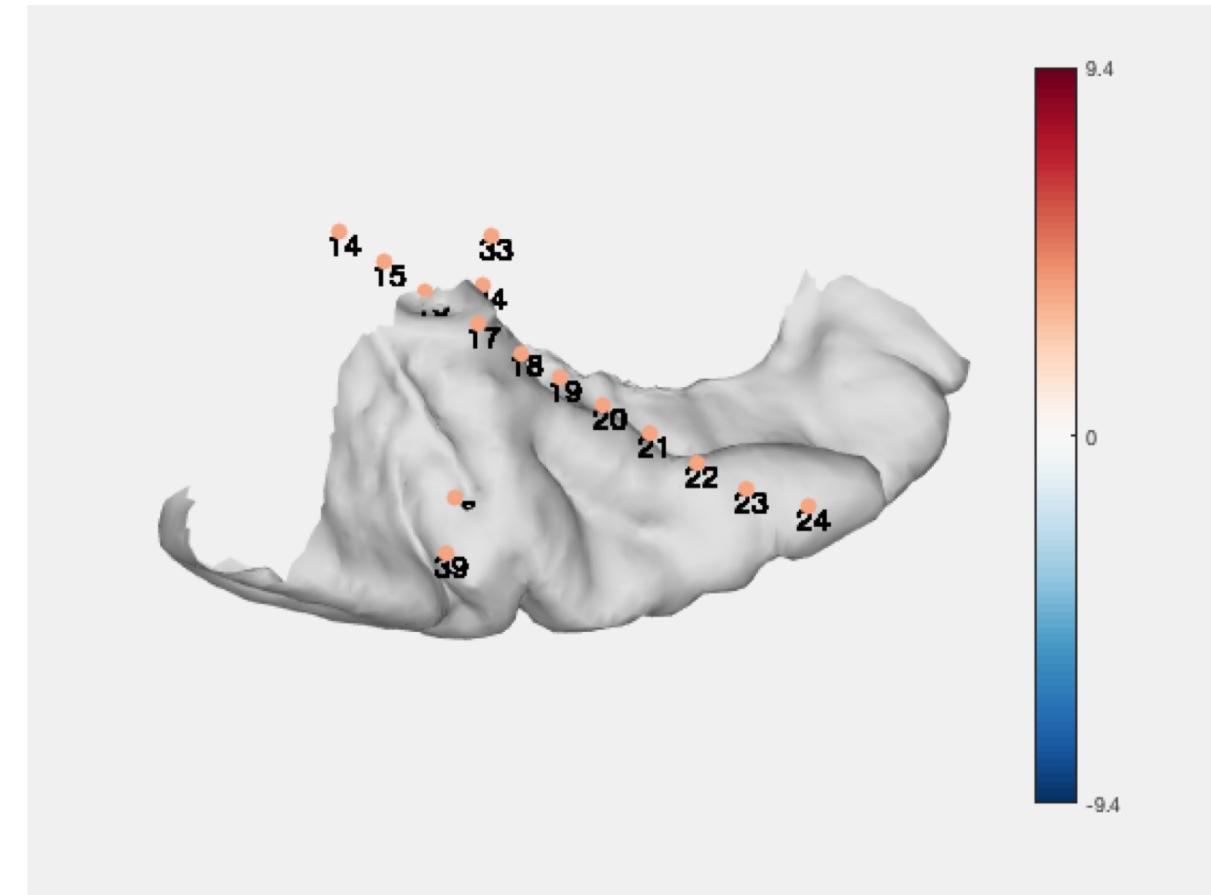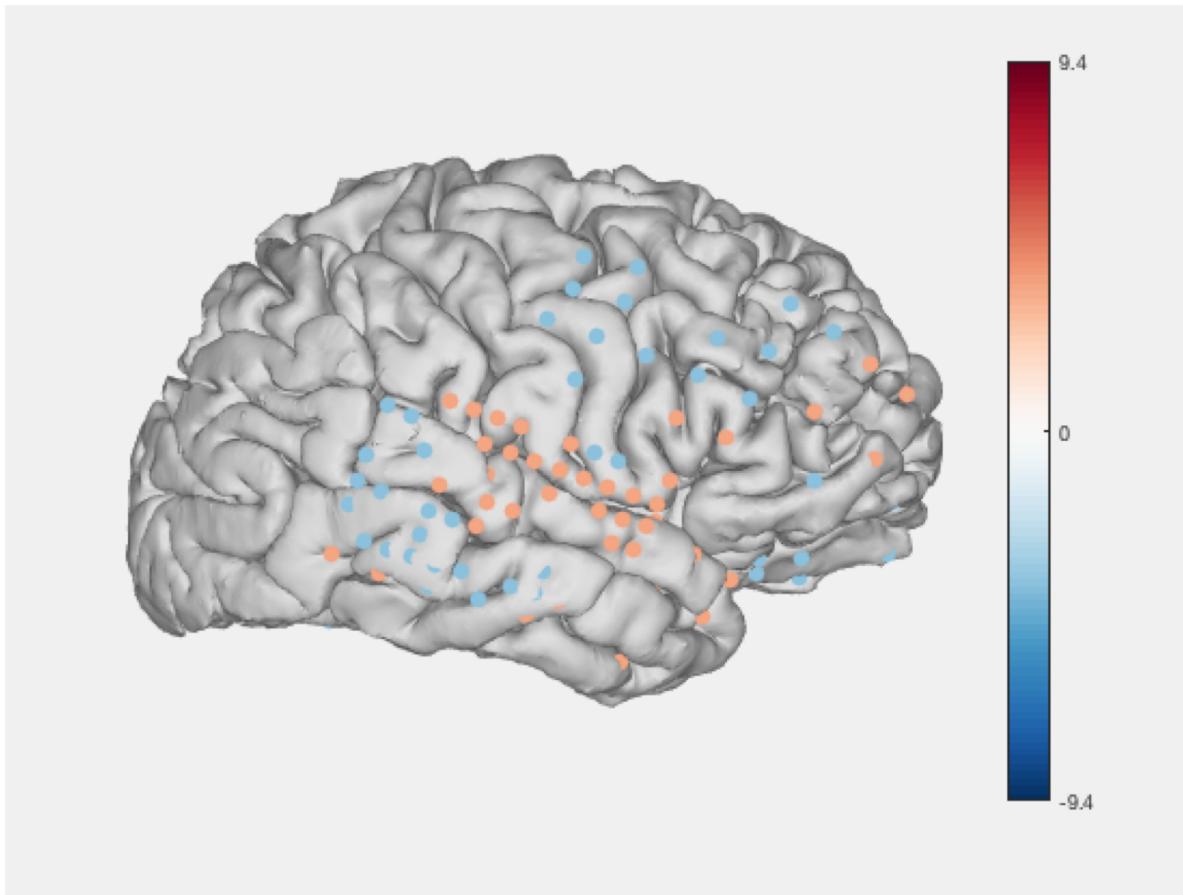

200 Hz

