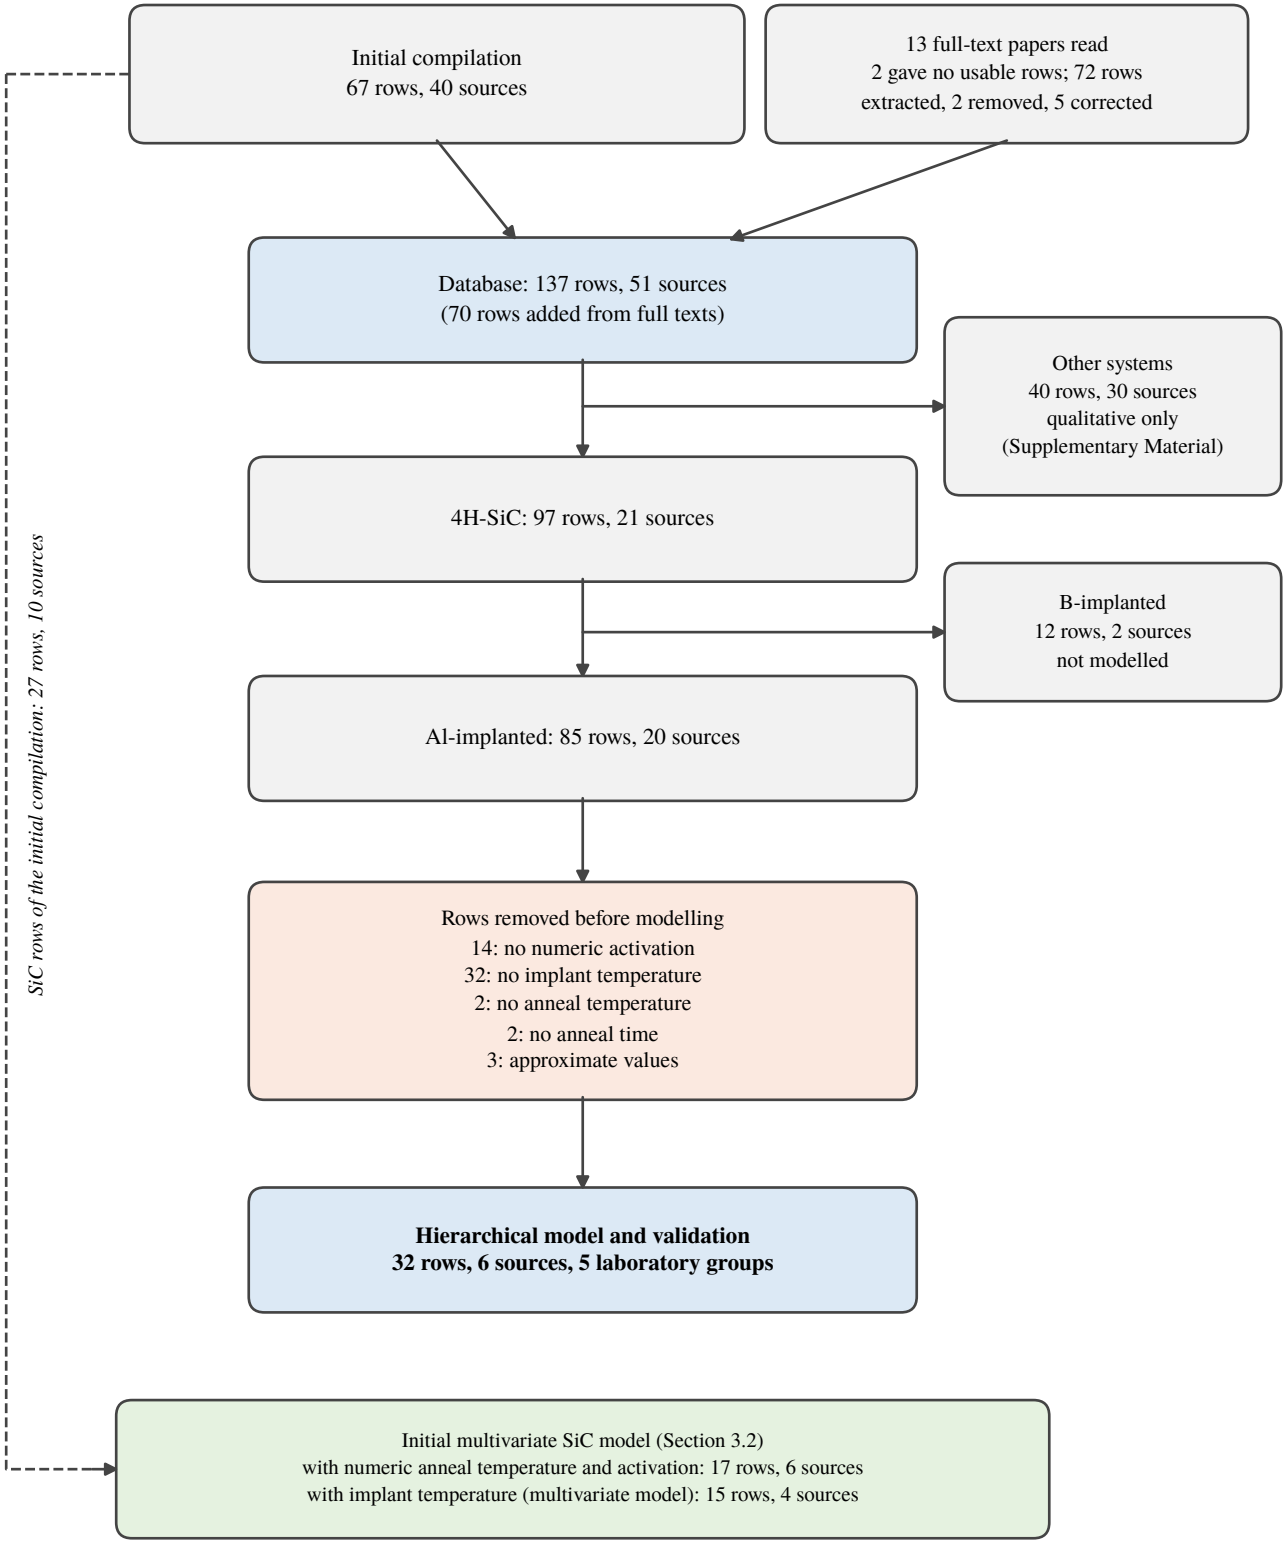
Initial compilation
67 rows, 40 sources
13 full-text papers read
2 gave no usable rows; 72 rows
extracted, 2 removed, 5 corrected
Database: 137 rows, 51 sources
(70 rows added from full texts)
Other systems
40 rows, 30 sources
qualitative only
(Supplementary Material)
4H-SiC: 97 rows, 21 sources
B-implanted
12 rows, 2 sources
not modelled
Al-implanted: 85 rows, 20 sources
Rows removed before modelling
14: no numeric activation
32: no implant temperature
2: no anneal temperature
2: no anneal time
3: approximate values
Hierarchical model and validation
32 rows, 6 sources, 5 laboratory groups
SiC rows of the initial compilation: 27 rows, 10 sources
Initial multivariate SiC model (Section 3.2)
with numeric anneal temperature and activation: 17 rows, 6 sources
with implant temperature (multivariate model): 15 rows, 4 sources