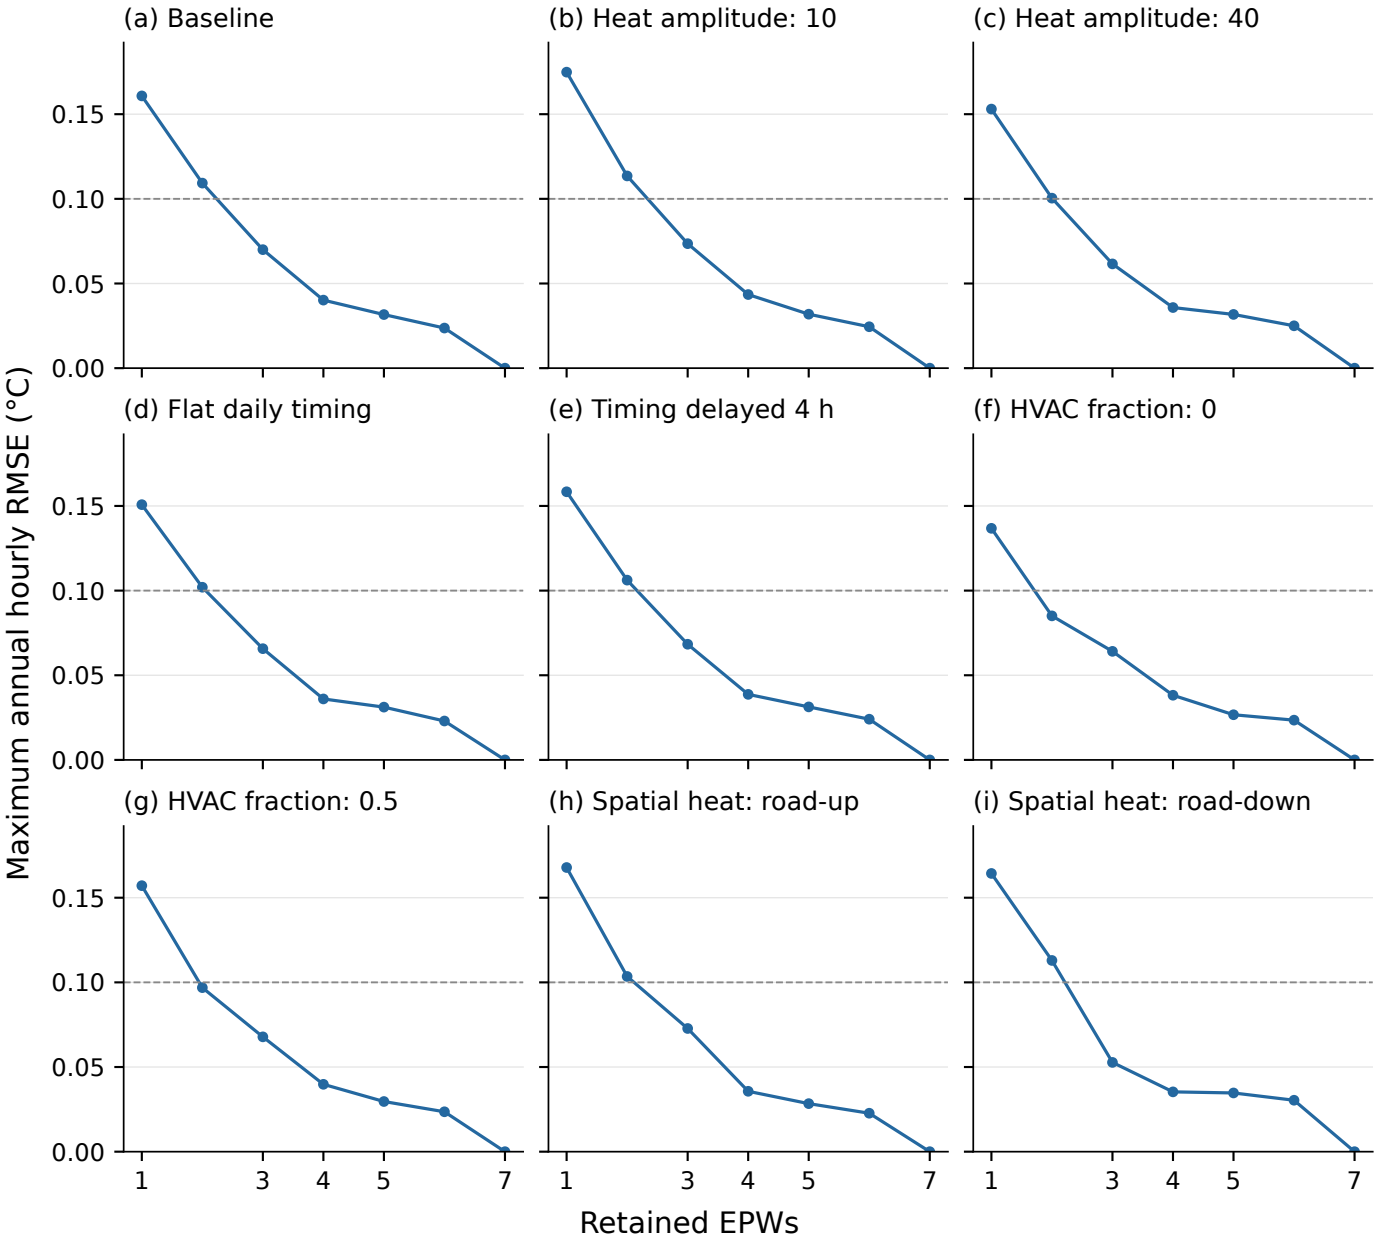
(a) Baseline
(b) Heat amplitude: 10
(c) Heat amplitude: 40
(d) Flat daily timing
(e) Timing delayed 4 h
(f) HVAC fraction: 0
(g) HVAC fraction: 0.5
(h) Spatial heat: road-up
(i) Spatial heat: road-down
Maximum annual hourly RMSE (°C)
0.00
0.05
0.10
0.15
1
3
4
5
7
Retained EPWs