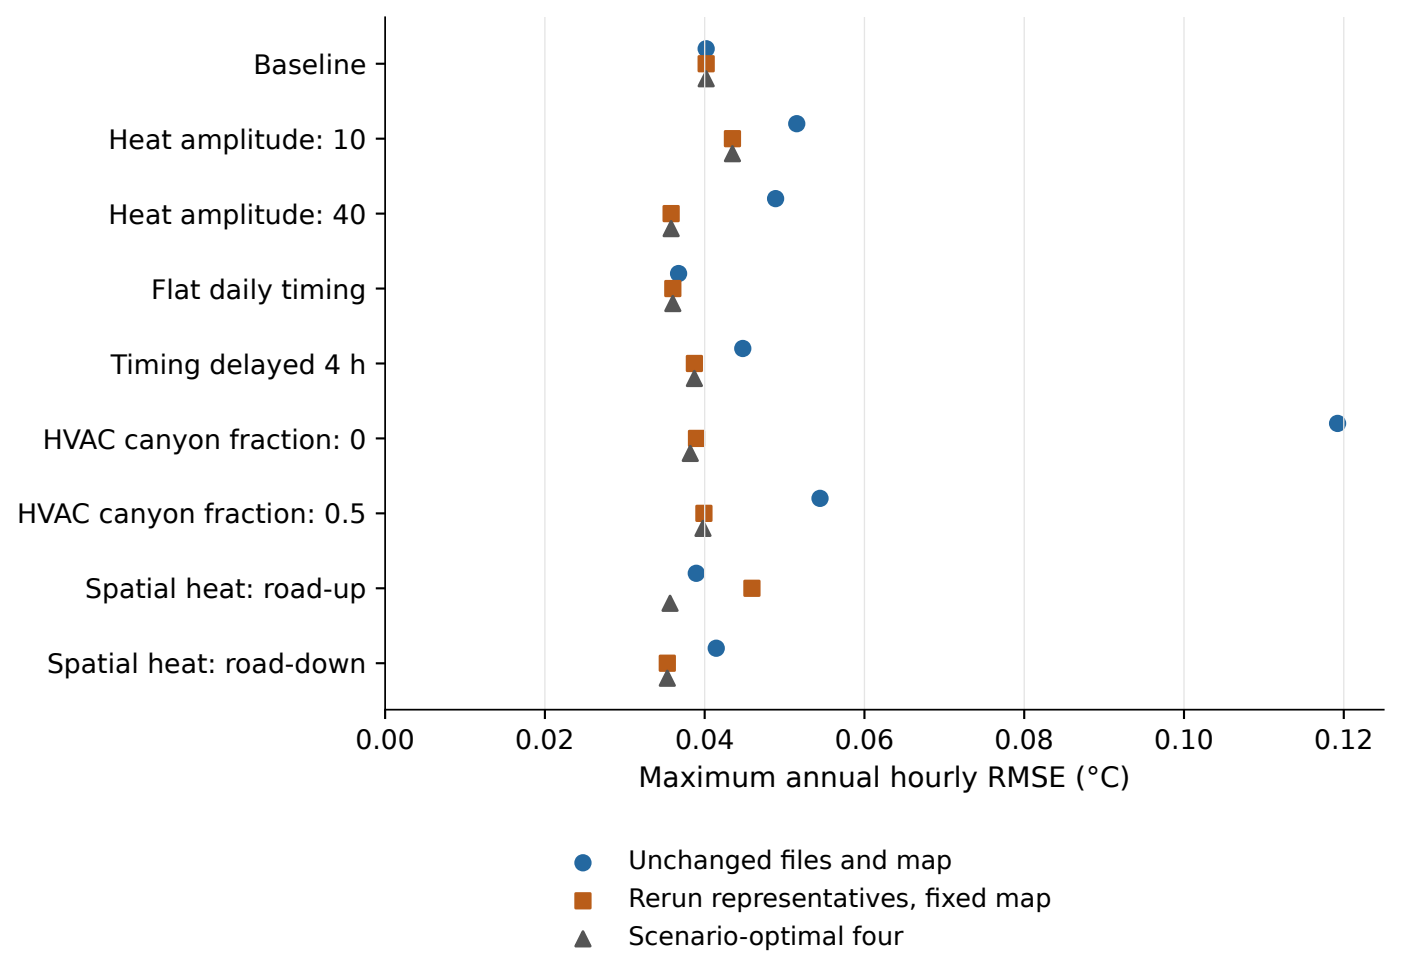
Baseline
Heat amplitude: 10
Heat amplitude: 40
Flat daily timing
Timing delayed 4 h
HVAC canyon fraction: 0
HVAC canyon fraction: 0.5
Spatial heat: road-up
Spatial heat: road-down
0.00
0.02
0.04
0.06
0.08
0.10
0.12
Maximum annual hourly RMSE (°C)
Unchanged files and map
Rerun representatives, fixed map
Scenario-optimal four