


PARTS LIST		
ITEM	QTY	DESCRIPTION
P01	1	1" 316 S.S.
P02	1	1" 316 S.S.

- NOTES:**
- 1. ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE SPECIFIED.
 - 2. ALL PIPES ARE 1" 316L S.S. SCH40 UNLESS OTHERWISE SPECIFIED
 - 3. ALL VALVES ARE PROVIDED BY NAPIER REID
 - 4. FLANGES SHALL BE IN ACCORDANCE WITH ASME B16.5 OR B6.1
 - 5. PIPE DESIGN TO BE IN ACCORDANCE WITH ASME B31.3
 - 6. ALL HALF AND FULL COUPLINGS ARE 3000# STAINLESS STEEL
 - 7. WELDING JOINT SHALL BE FULL PENETRATE AND CONTINUOUS.
 - 8. ALL NPT CONNECTION WILL BE FULL TIGHT.
 - 9. ALL PARTS SHALL BE DEBURRE, SHARP EDGES SHALL BE REMOVED AND GIVE 1-1/16" RADIUS
 - 10. ALL COMPONENTS AND WELDS SHALL BE CLEANED WITH ACID AND PASSIVATED.

03	REVISED FOR FABRICATION	15/06/2023	A.S.	M.O.	M.D.	
02	REVISED FOR FABRICATION	15/06/2023	A.S.	M.O.	M.D.	
01	REVISED FOR FABRICATION	06/06/2023	A.S.	M.O.	M.D.	
00	FOR FABRICATION	02/21/2023	A.S.	M.O.	M.D.	
REV	DESCRIPTION	MM / DD / YYYY	DESIGN	CHECK	APPROVE	NOTES
REVISION HISTORY						
			DESIGN FLOW RATE M³/HR CONVENTIONAL WATER TREATMENT PLANT, PUMP SKID FOR TREATED WATER			
CUSTOMER ALAMOS GOLD INC.		PROJECT ISLAND GOLD MINE SHAFT PROJECT H363409/PM011		SCALE AS SHOWN OR AS NOTED		
CONTRACTOR HATCH		CONSULTING ENGINEER		FILE NO.: 22-3122		SHEET 44 OF 51
				DWG. NO.: SKID-2-DRAWING		VERSION R03
				DESIGN DATE: 04/10/2022		
				PLOT DATE: 07/02/2023		

D

C

B


A


D

C


B

A

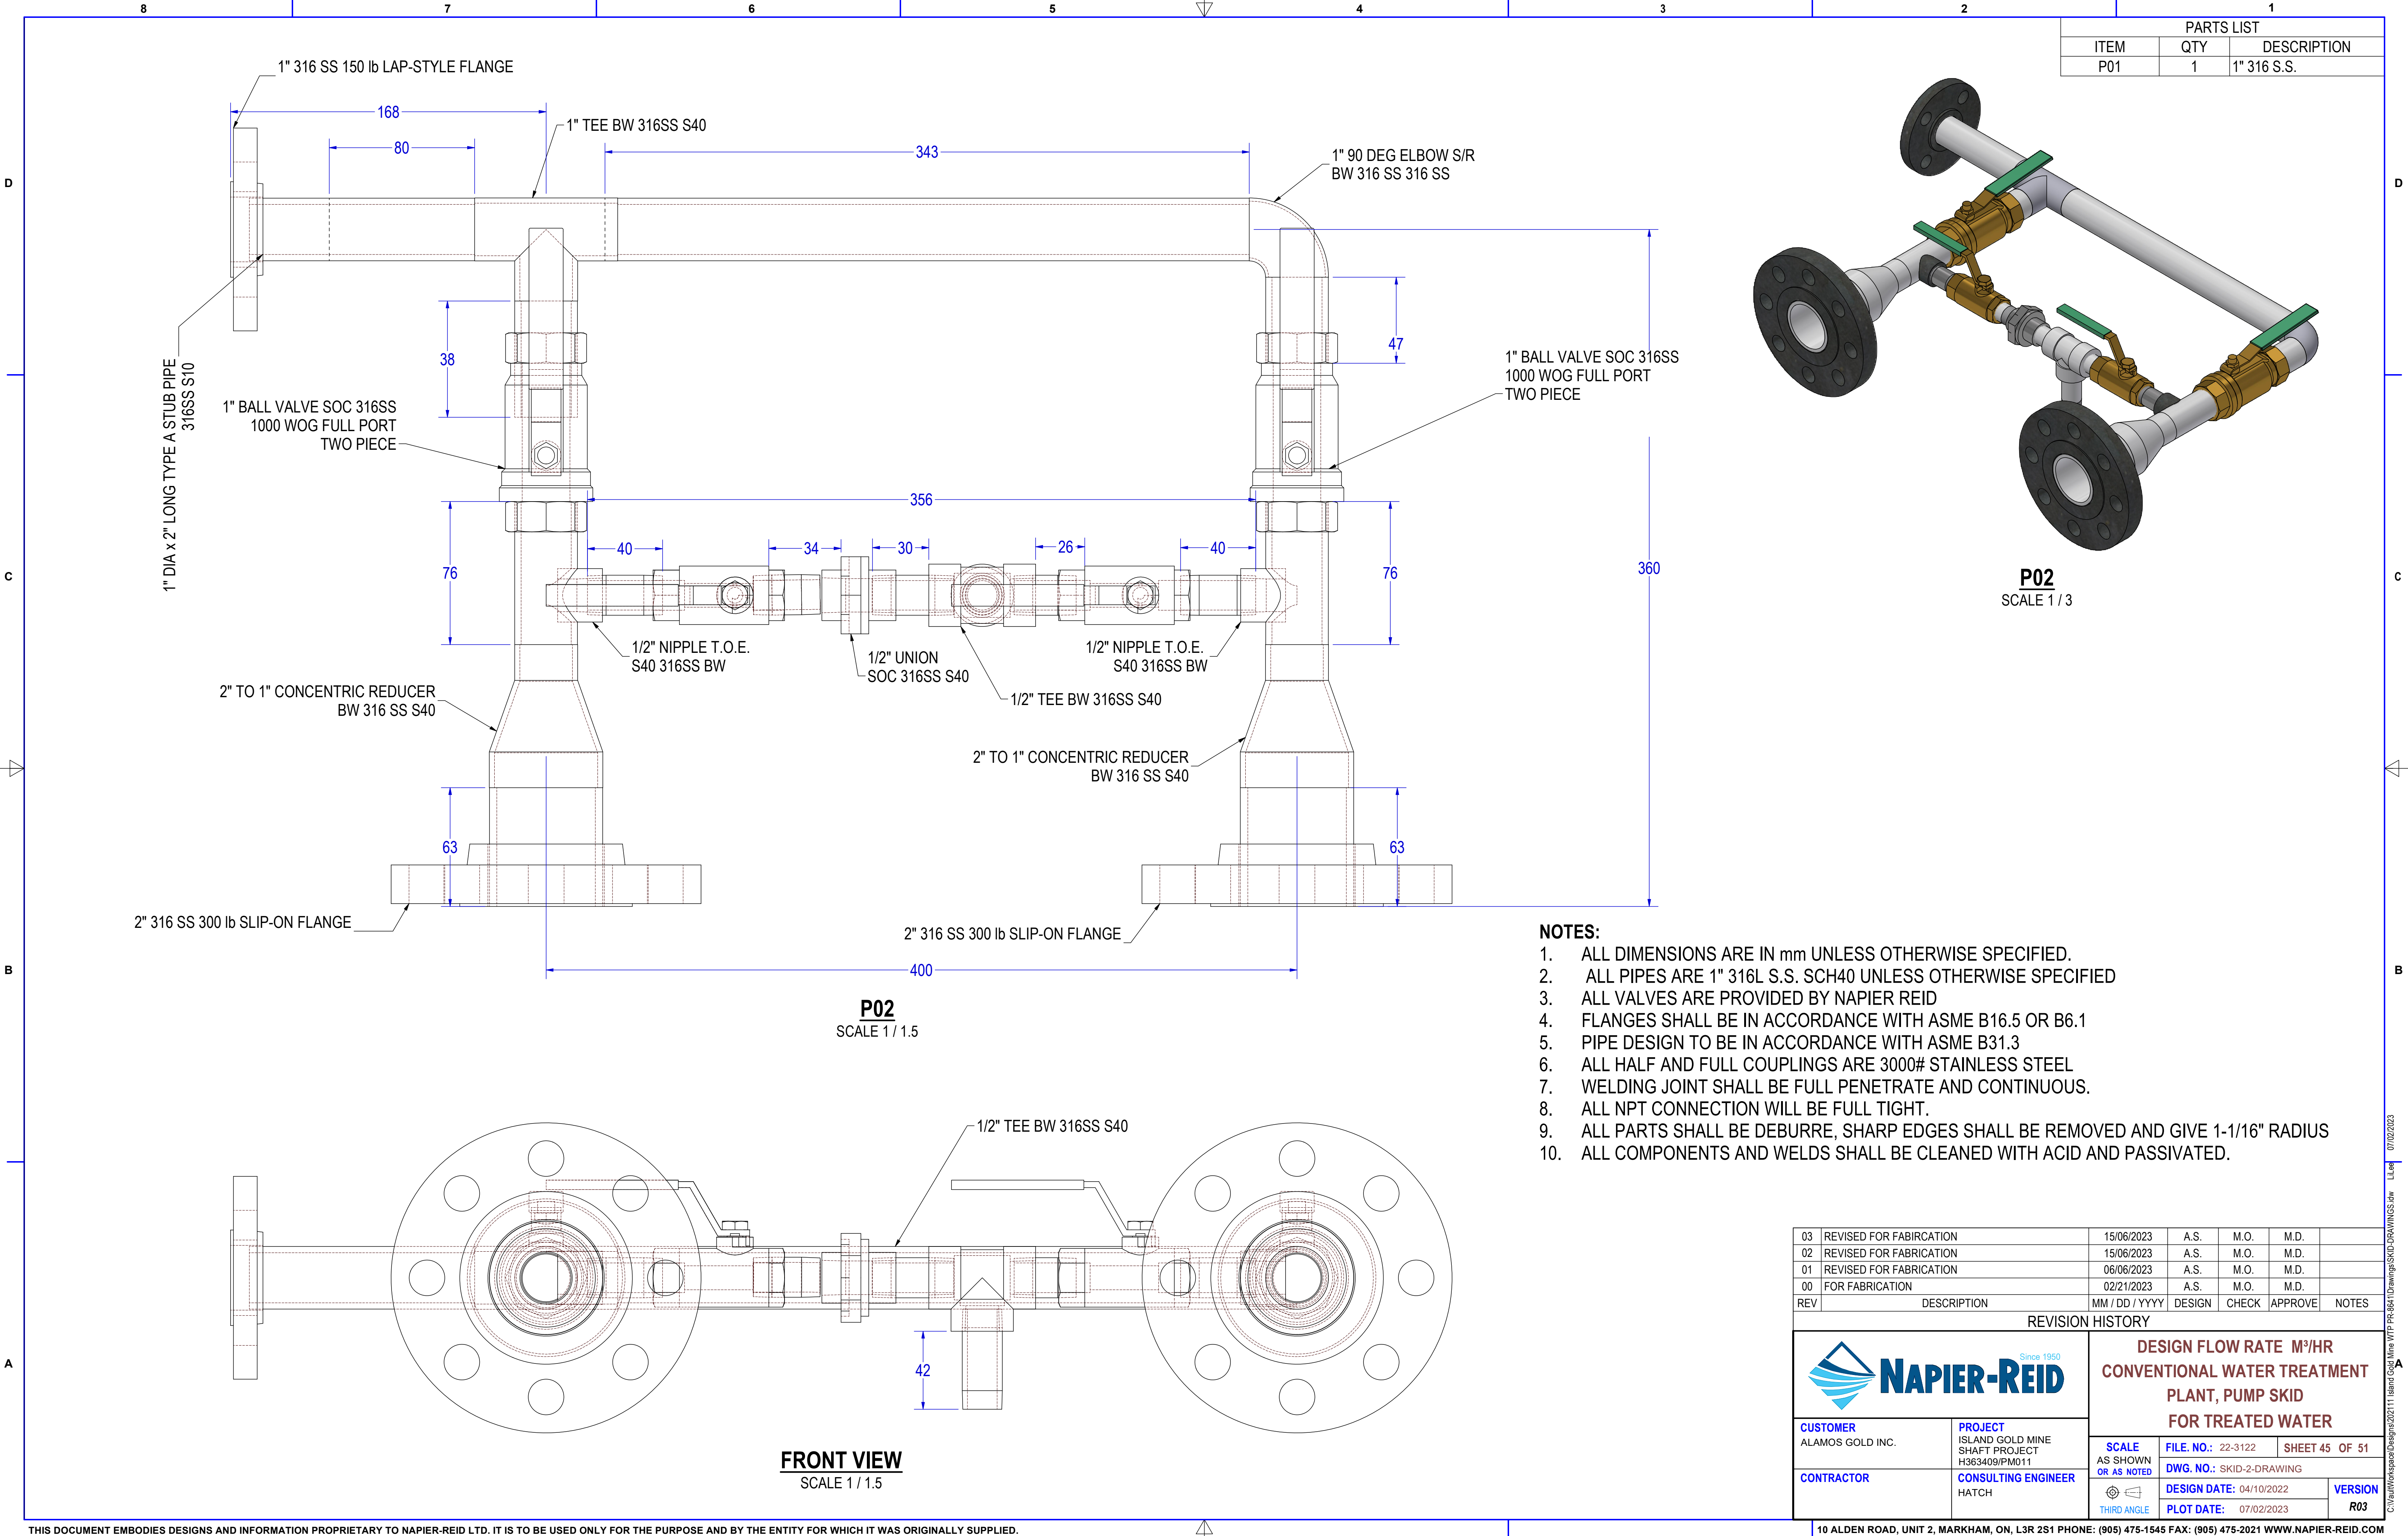

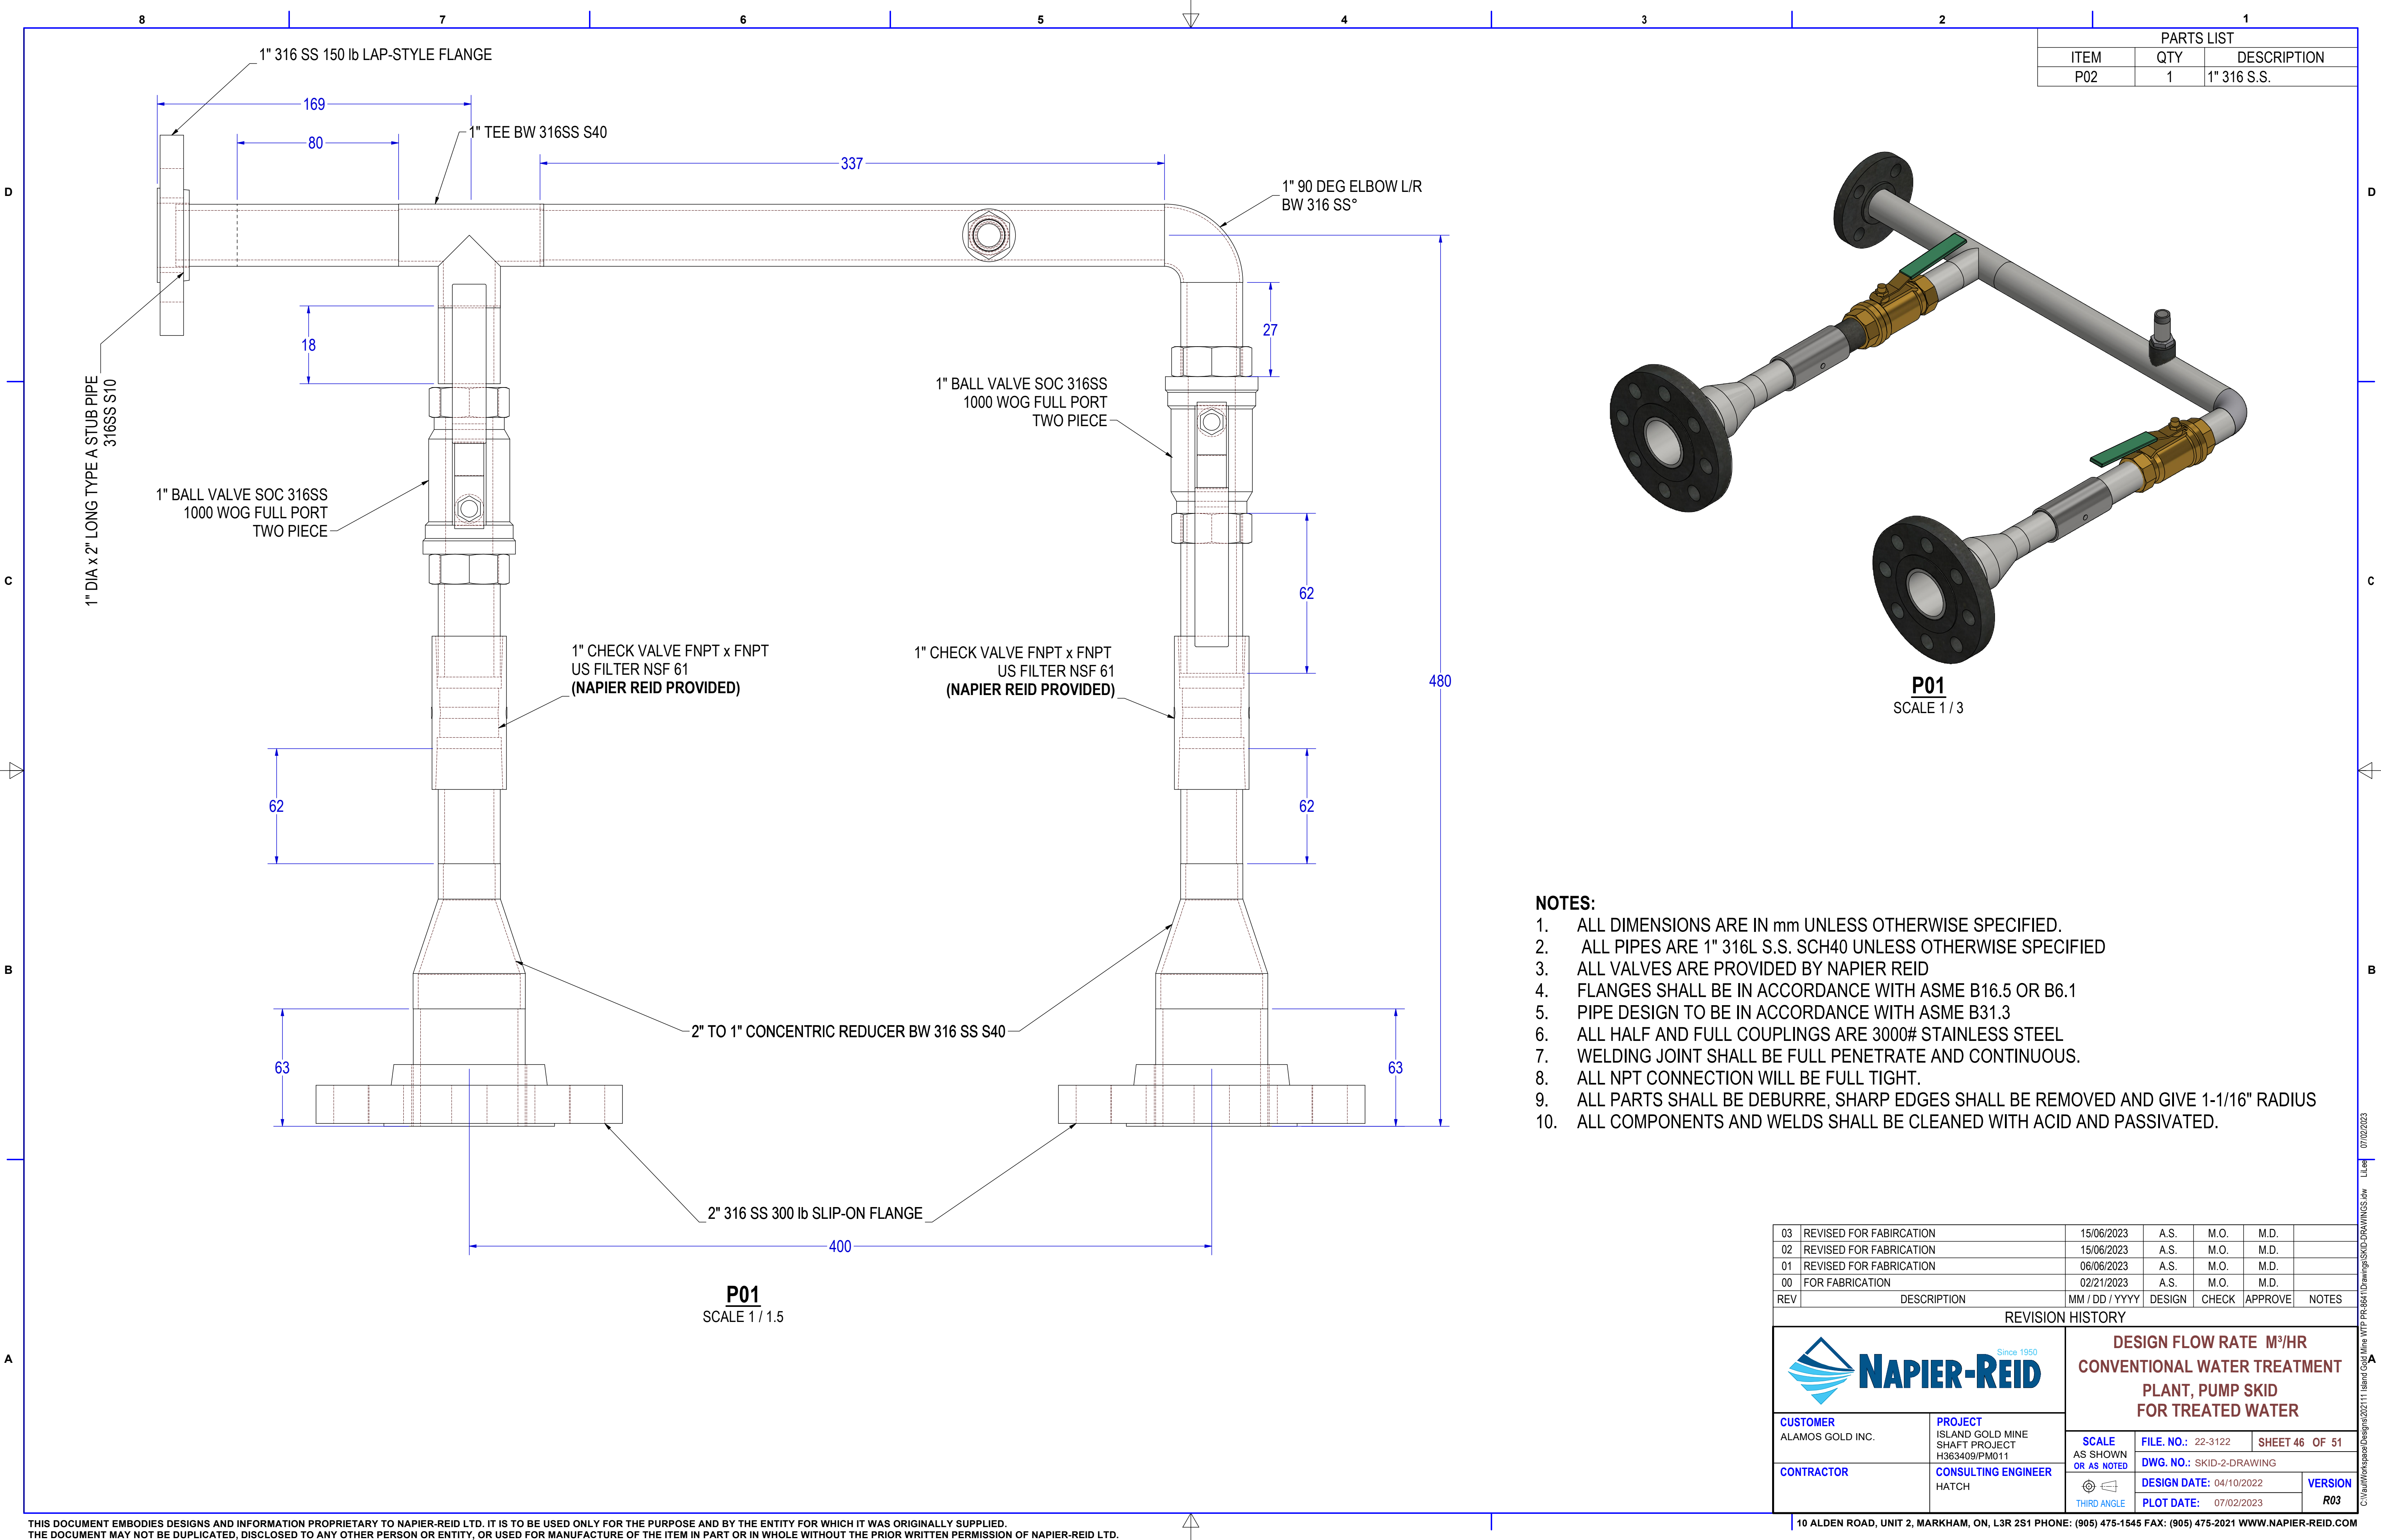

PARTS LIST		
ITEM	QTY	DESCRIPTION
P02	1	1" 316 S.S.

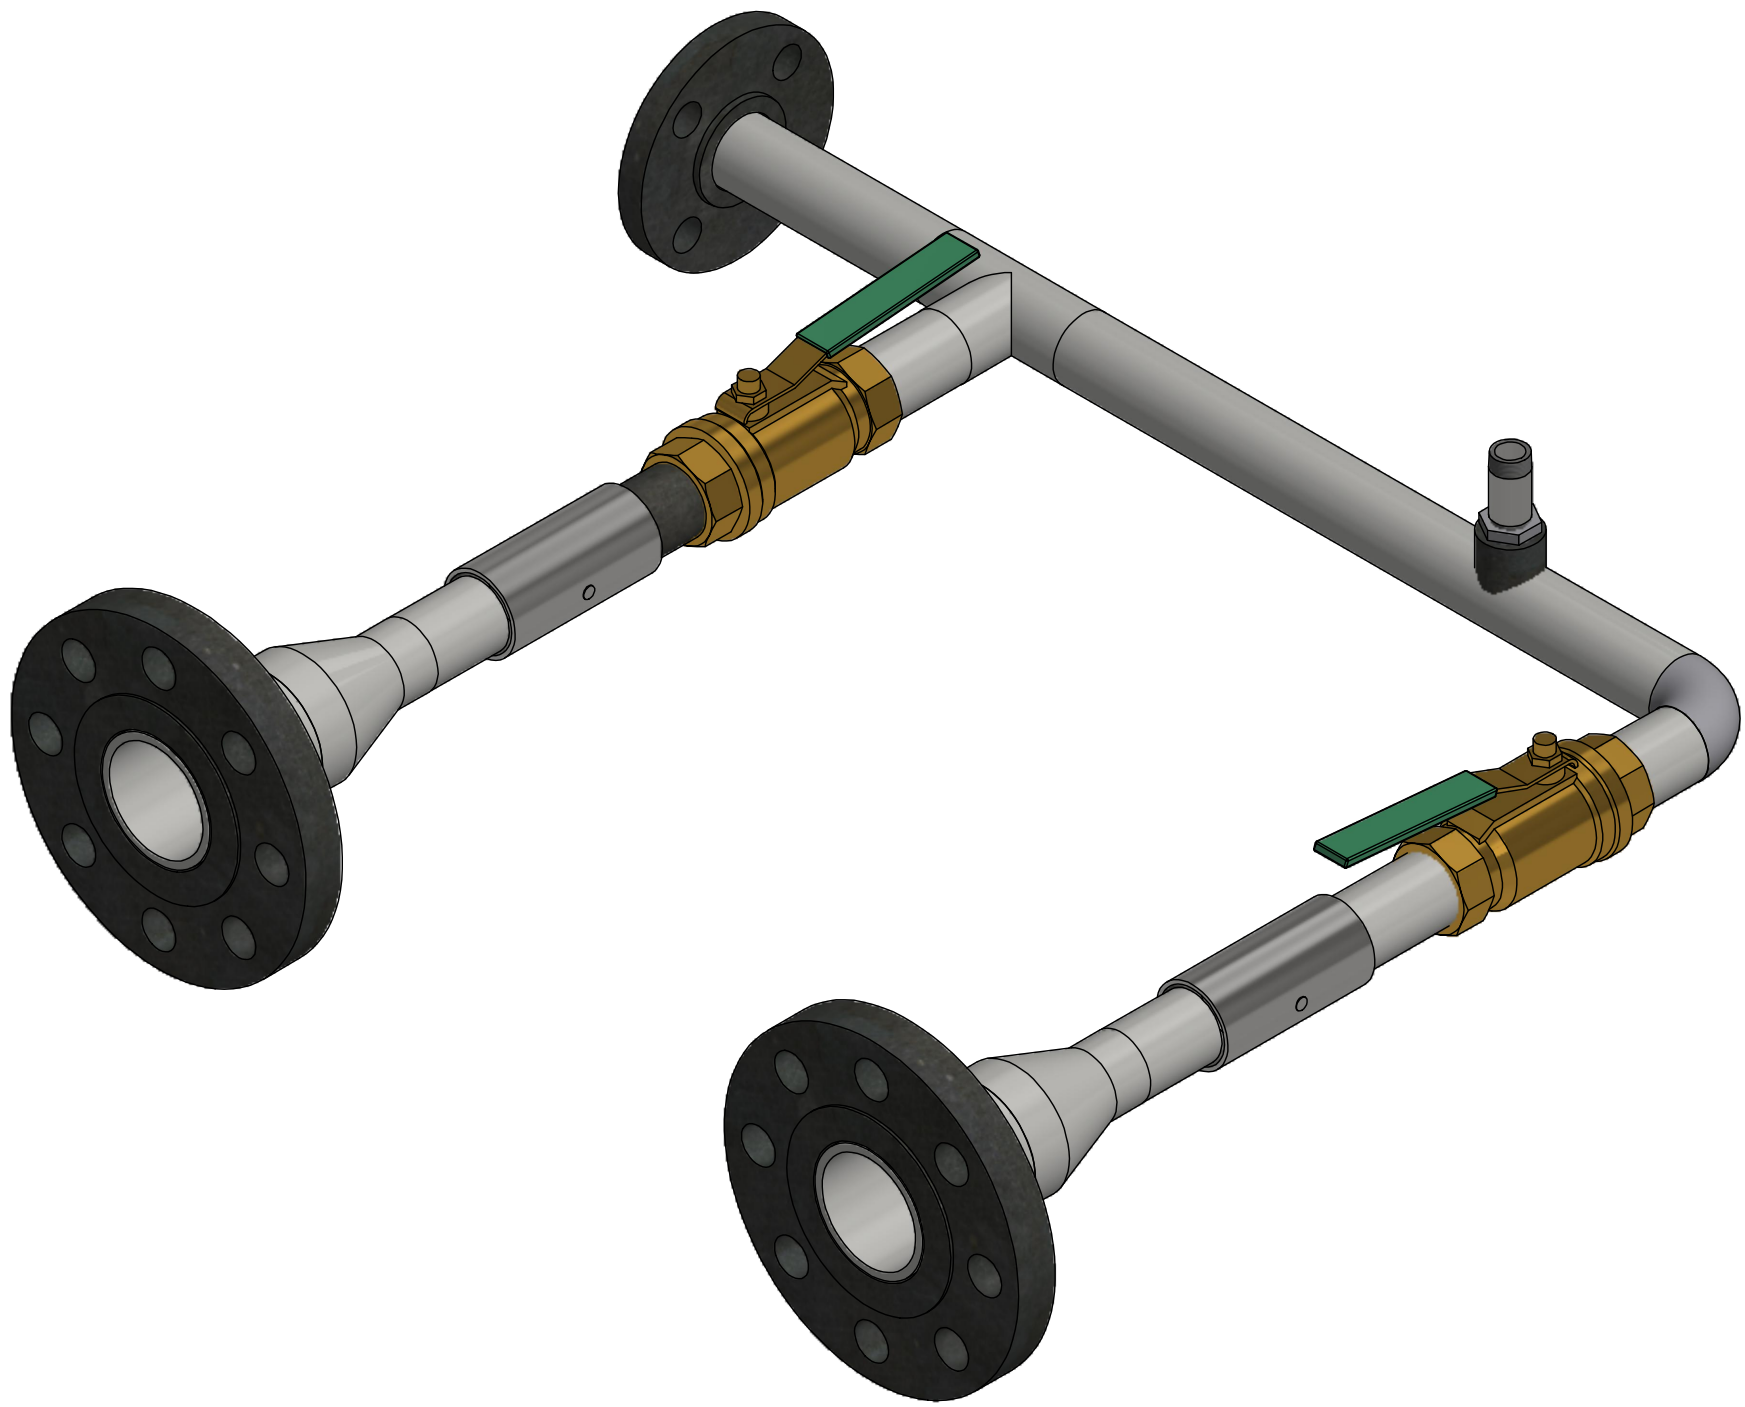



P01
SCALE 1 / 3

- NOTES:
- ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE SPECIFIED.
 - ALL PIPES ARE 1" 316L S.S. SCH40 UNLESS OTHERWISE SPECIFIED
 - ALL VALVES ARE PROVIDED BY NAPIER REID
 - FLANGES SHALL BE IN ACCORDANCE WITH ASME B16.5 OR B6.1
 - PIPE DESIGN TO BE IN ACCORDANCE WITH ASME B31.3
 - ALL HALF AND FULL COUPLINGS ARE 3000# STAINLESS STEEL
 - WELDING JOINT SHALL BE FULL PENETRATE AND CONTINUOUS.
 - ALL NPT CONNECTION WILL BE FULL TIGHT.
 - ALL PARTS SHALL BE DEBURRE, SHARP EDGES SHALL BE REMOVED AND GIVE 1-1/16" RADIUS
 - ALL COMPONENTS AND WELDS SHALL BE CLEANED WITH ACID AND PASSIVATED.

03	REVISED FOR FABRICATION	15/06/2023	A.S.	M.O.	M.D.	
02	REVISED FOR FABRICATION	15/06/2023	A.S.	M.O.	M.D.	
01	REVISED FOR FABRICATION	06/06/2023	A.S.	M.O.	M.D.	
00	FOR FABRICATION	02/21/2023	A.S.	M.O.	M.D.	
REV	DESCRIPTION	MM / DD / YYYY	DESIGN	CHECK	APPROVE	NOTES

REVISION HISTORY

<div> NAPIER-REID Since 1950</div>		<div>DESIGN FLOW RATE M³/HR CONVENTIONAL WATER TREATMENT PLANT, PUMP SKID FOR TREATED WATER</div>			
<div>CUSTOMER ALAMOS GOLD INC.</div>	<div>PROJECT ISLAND GOLD MINE SHAFT PROJECT H363409/PM011</div>	<div>SCALE AS SHOWN OR AS NOTED</div>	<div>FILE. NO.: 22-3122</div>	<div>SHEET 46 OF 51</div>	
<div>CONTRACTOR</div>	<div>CONSULTING ENGINEER HATCH</div>	<div> THIRD ANGLE</div>	<div>DESIGN DATE: 04/10/2022</div>	<div>VERSION R03</div>	
			<div>PLOT DATE: 07/02/2023</div>		