

D

C

B

A



D

C


B


A


PARTS LIST		
ITEM	QTY	DESCRIPTION
P03-02	1	1" 316 S.S.
P03-01	1	1" 316 S.S.
P02	1	1" 316 S.S.
P01	1	1" 316 S.S.

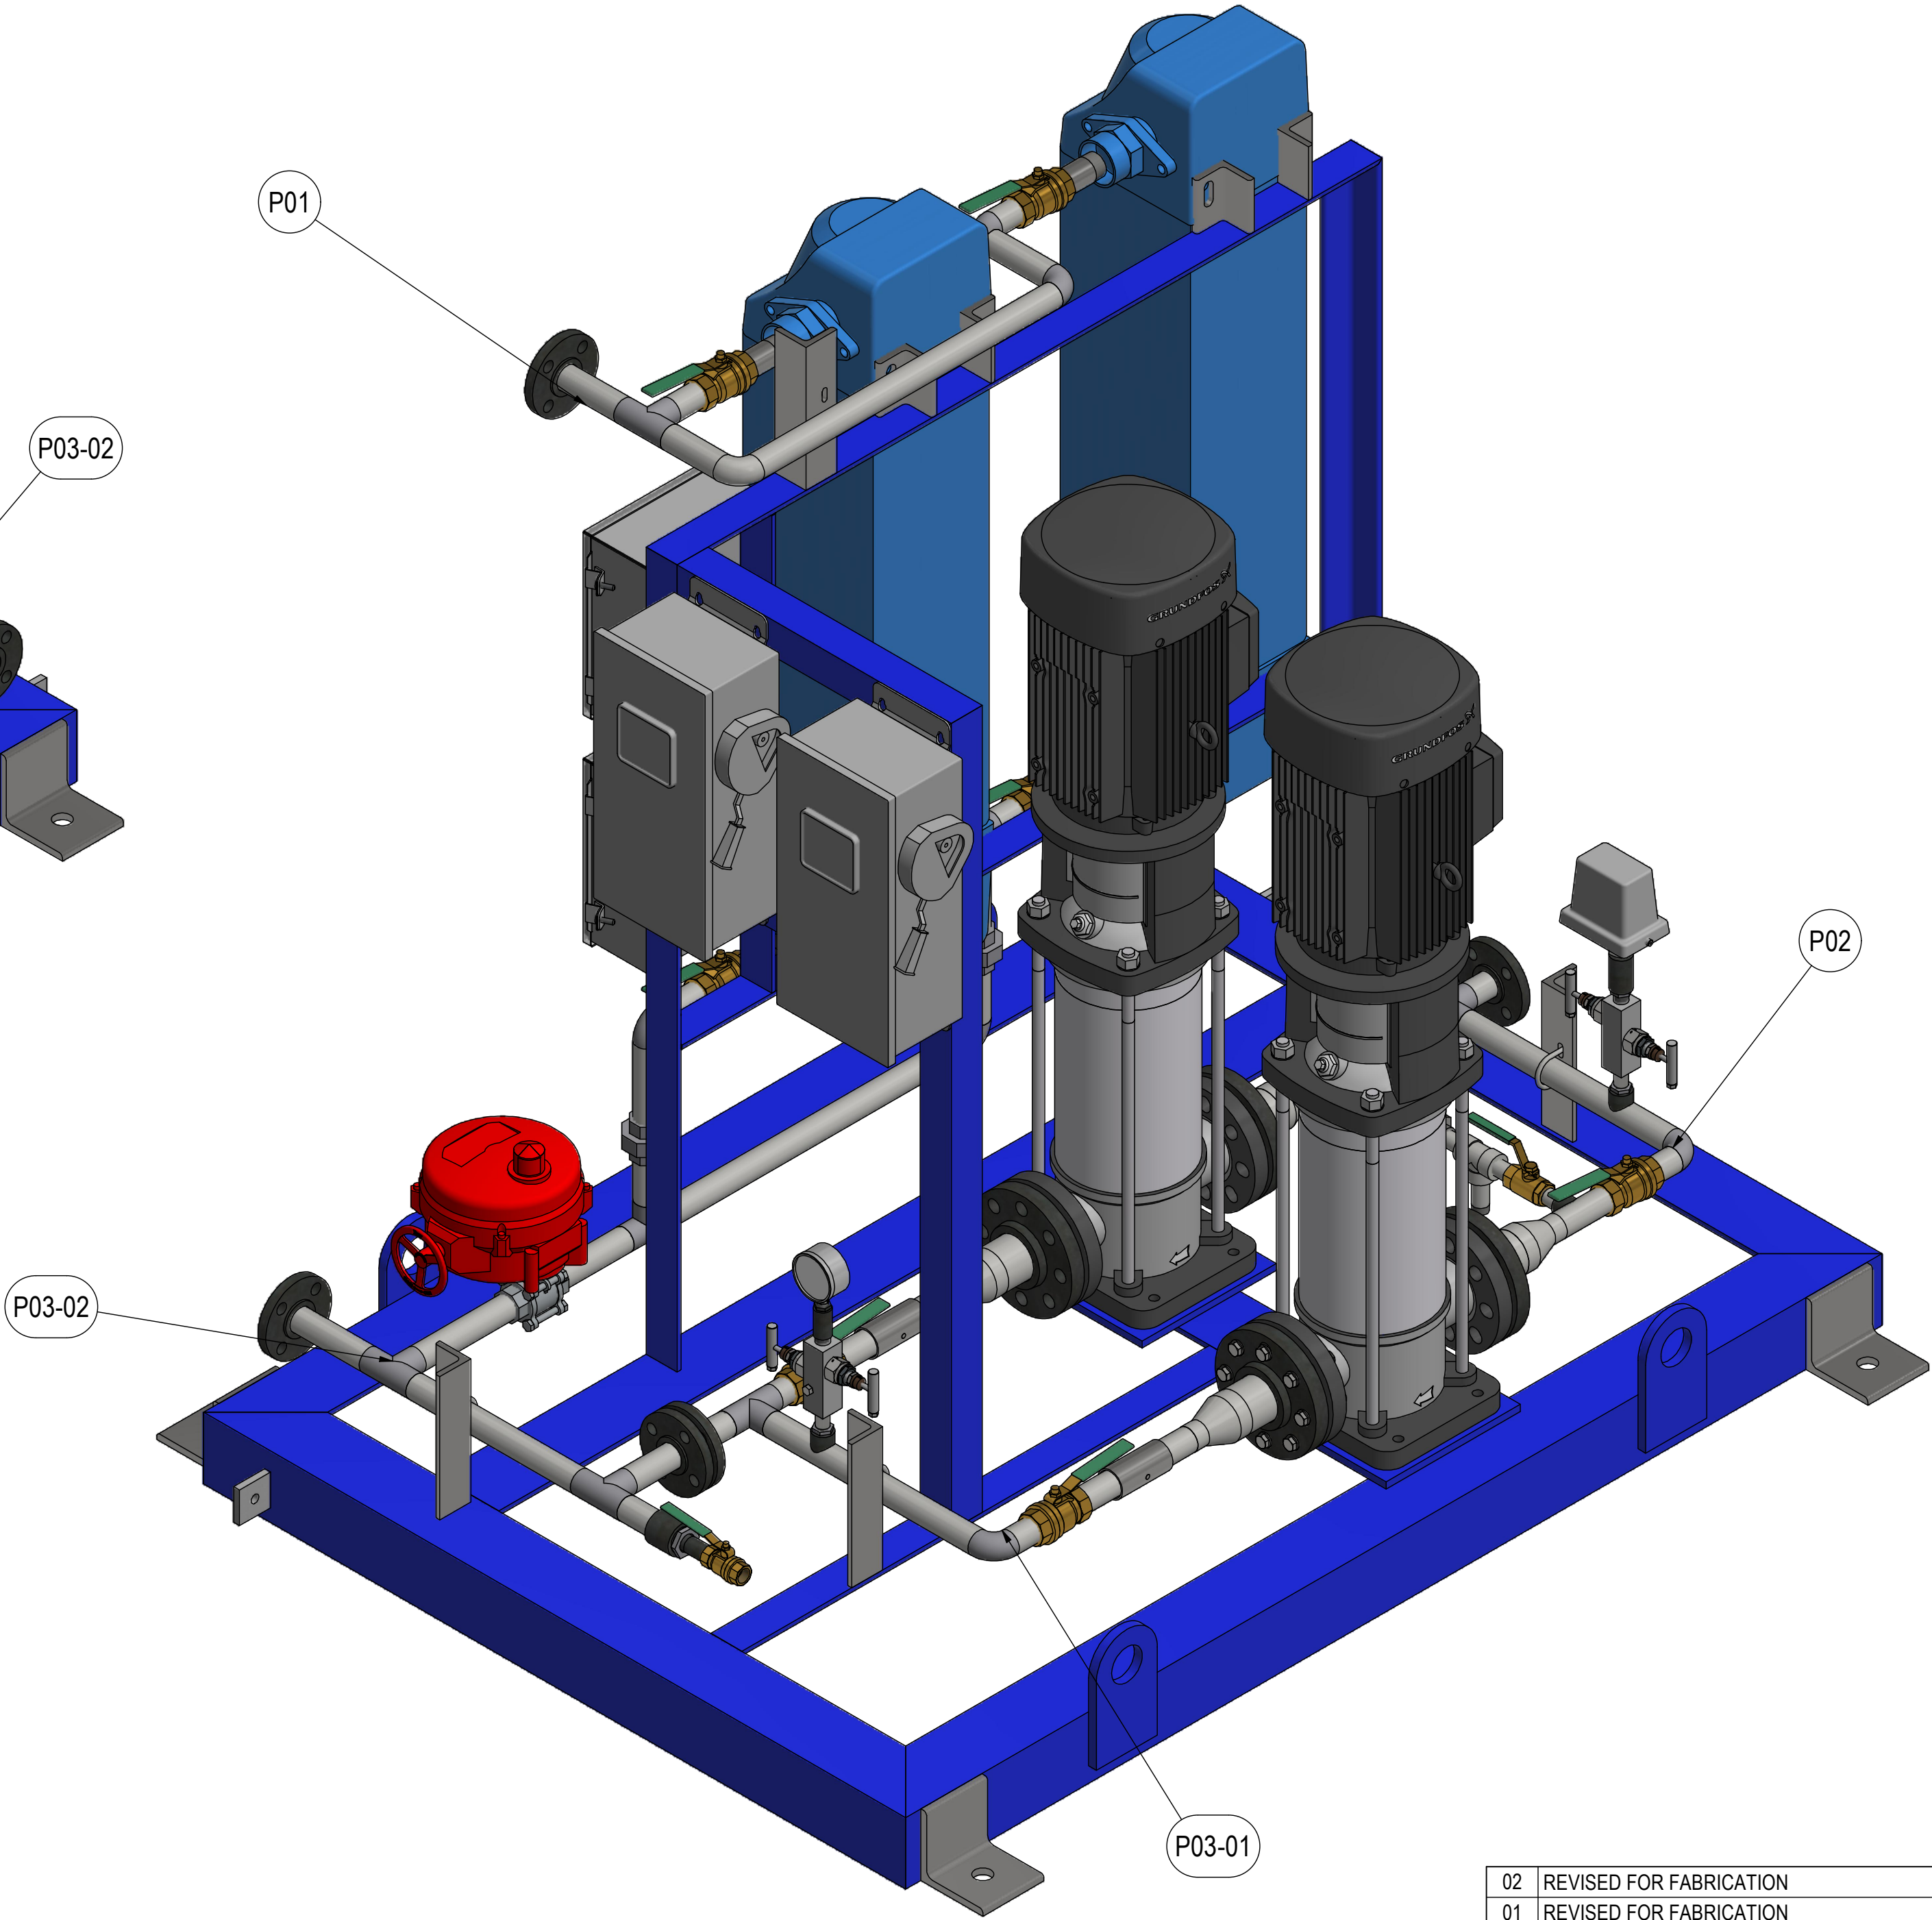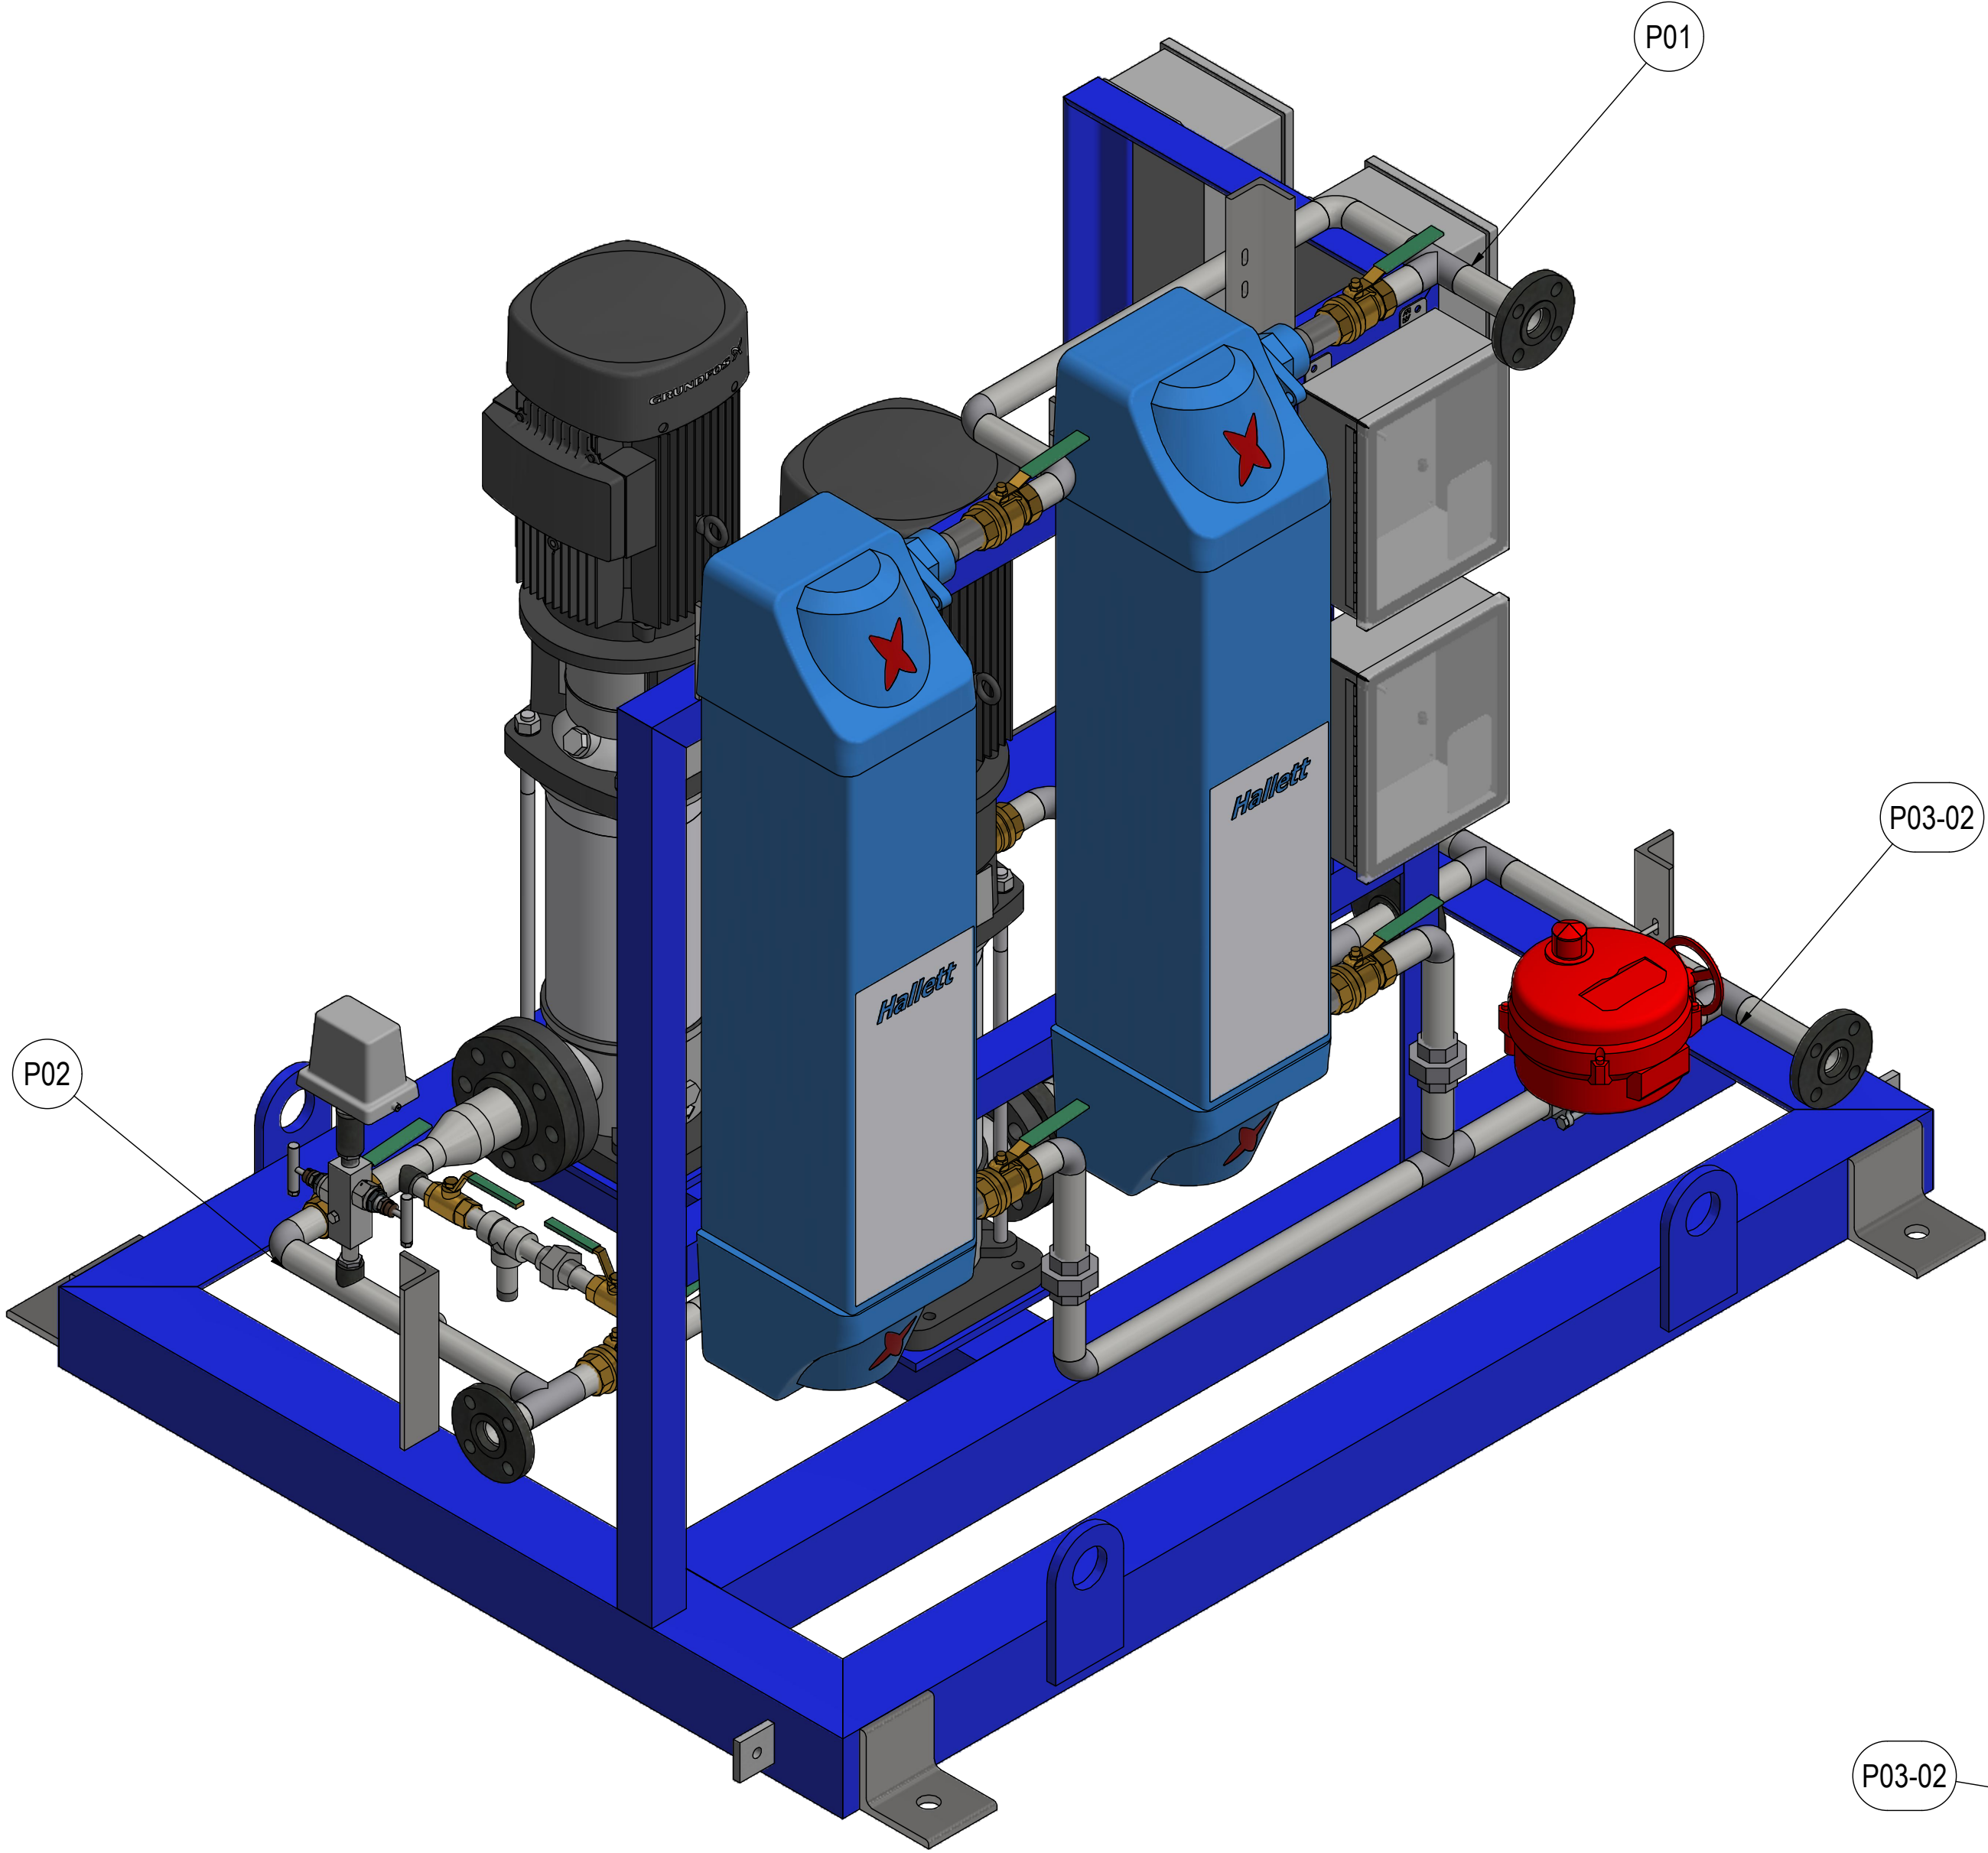


- NOTES:**
- ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE SPECIFIED.
 - ALL PIPES ARE 1" 316L S.S. SCH40
 - ALL VALVES ARE PROVIDED BY NAPIER-REID.
 - FLANGES SHALL BE IN ACCORDANCE WITH ASME B16.5 OR B6.1
 - PIPE DESIGN TO BE IN ACCORDANCE WITH ASME B31.3
 - ALL HALF AND FULL COUPLINGS ARE 3000# STAINLESS STEEL
 - WELDING JOINT SHALL BE FULL PENETRATE AND CONTINUOUS.
 - ALL NPT CONNECTION WILL BE FULL TIGHT.
 - ALL PARTS SHALL BE DEBURRE, SHARP EDGES SHALL BE REMOVED AND GIVE 1-1/16" RADIUS
 - ALL COMPONENTS AND WELDS SHALL BE CLEANED WITH ACID AND PASSIVATED.

02	REVISED FOR FABRICATION	15/06/2023	A.S.	M.O.	M.D.	
01	REVISED FOR FABRICATION	06/06/2023	A.S.	M.O.	M.D.	
00	FOR FABRICATION	02/21/2023	A.S.	M.O.	M.D.	
REV	DESCRIPTION	MM / DD / YYYY	DESIGN	CHECK	APPROVE	NOTES
REVISION HISTORY						
			DESIGN FLOW RATE M³/HR CONVENTIONAL WATER TREATMENT PLANT, PUMP SKID			
CUSTOMER ALAMOS GOLD INC.		PROJECT ISLAND GOLD MINE SHAFT PROJECT H363409/PM011		SCALE AS SHOWN OR AS NOTED		
CONTRACTOR HATCH		CONSULTING ENGINEER		FILE. NO.: 22-3122		SHEET 39 OF 51
				DWG. NO.: SKID-2-DRAWING		VERSION R02
				DESIGN DATE: 04/10/2022		
				PLOT DATE: 07/02/2023		

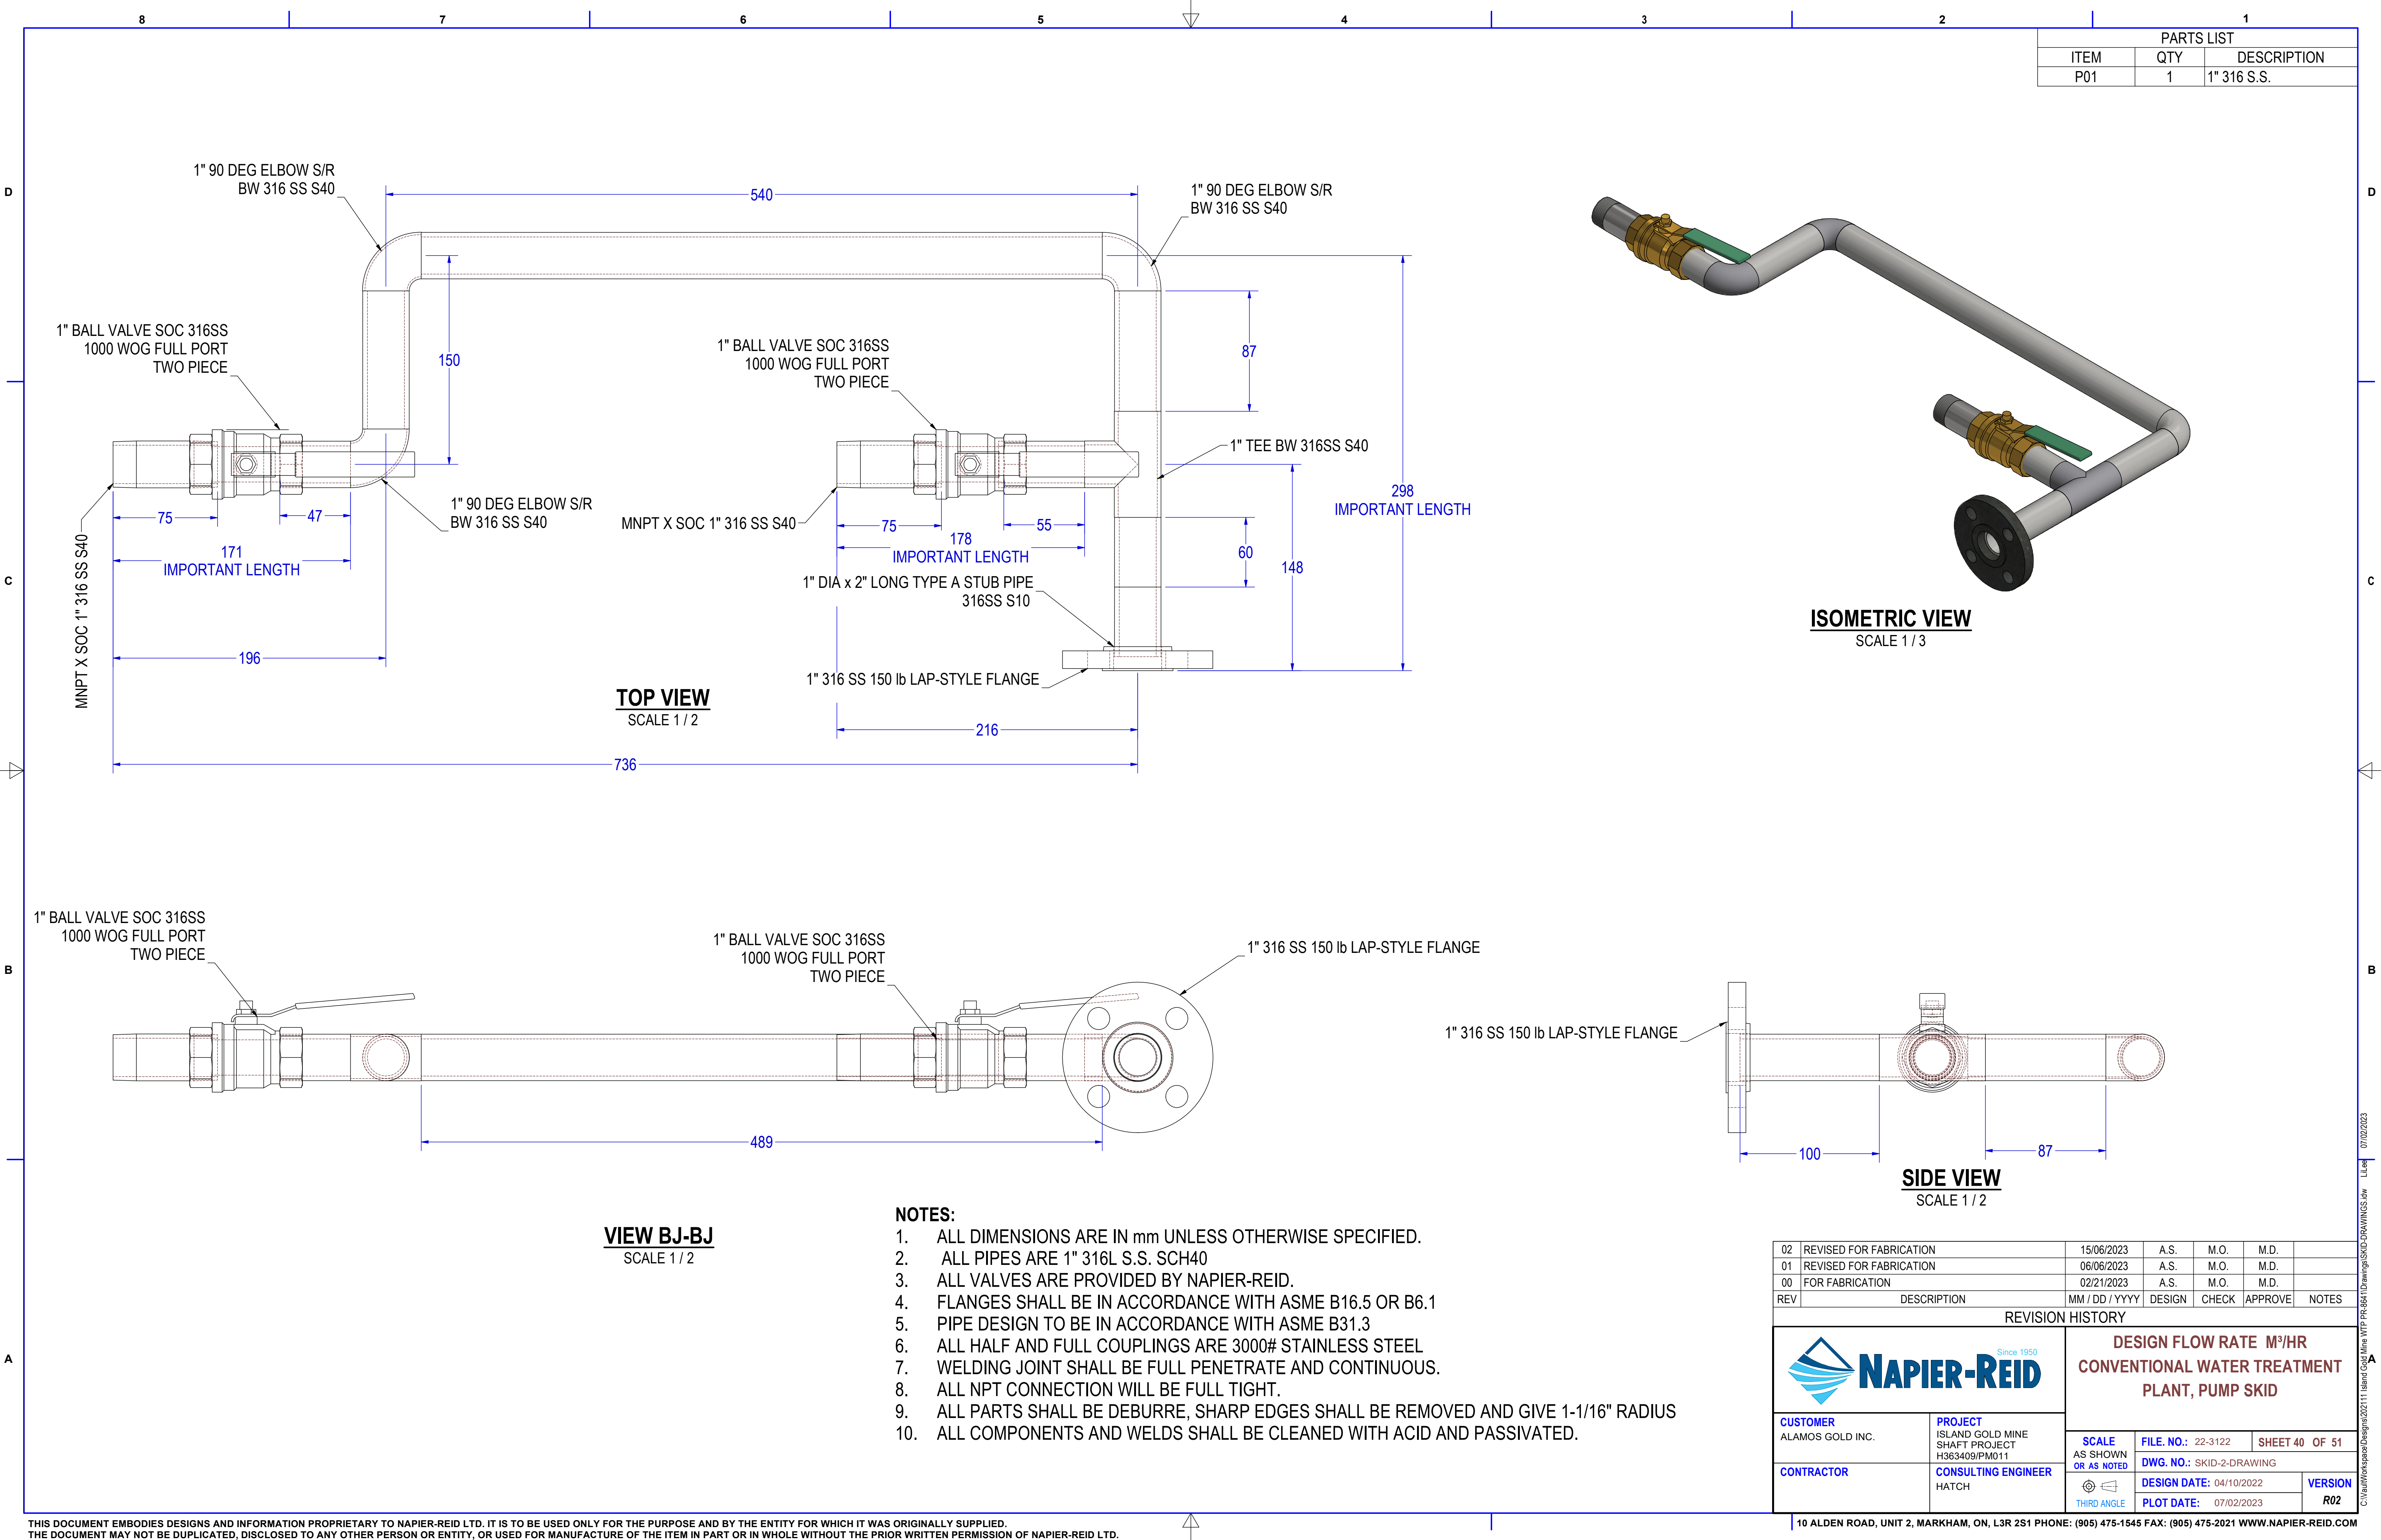

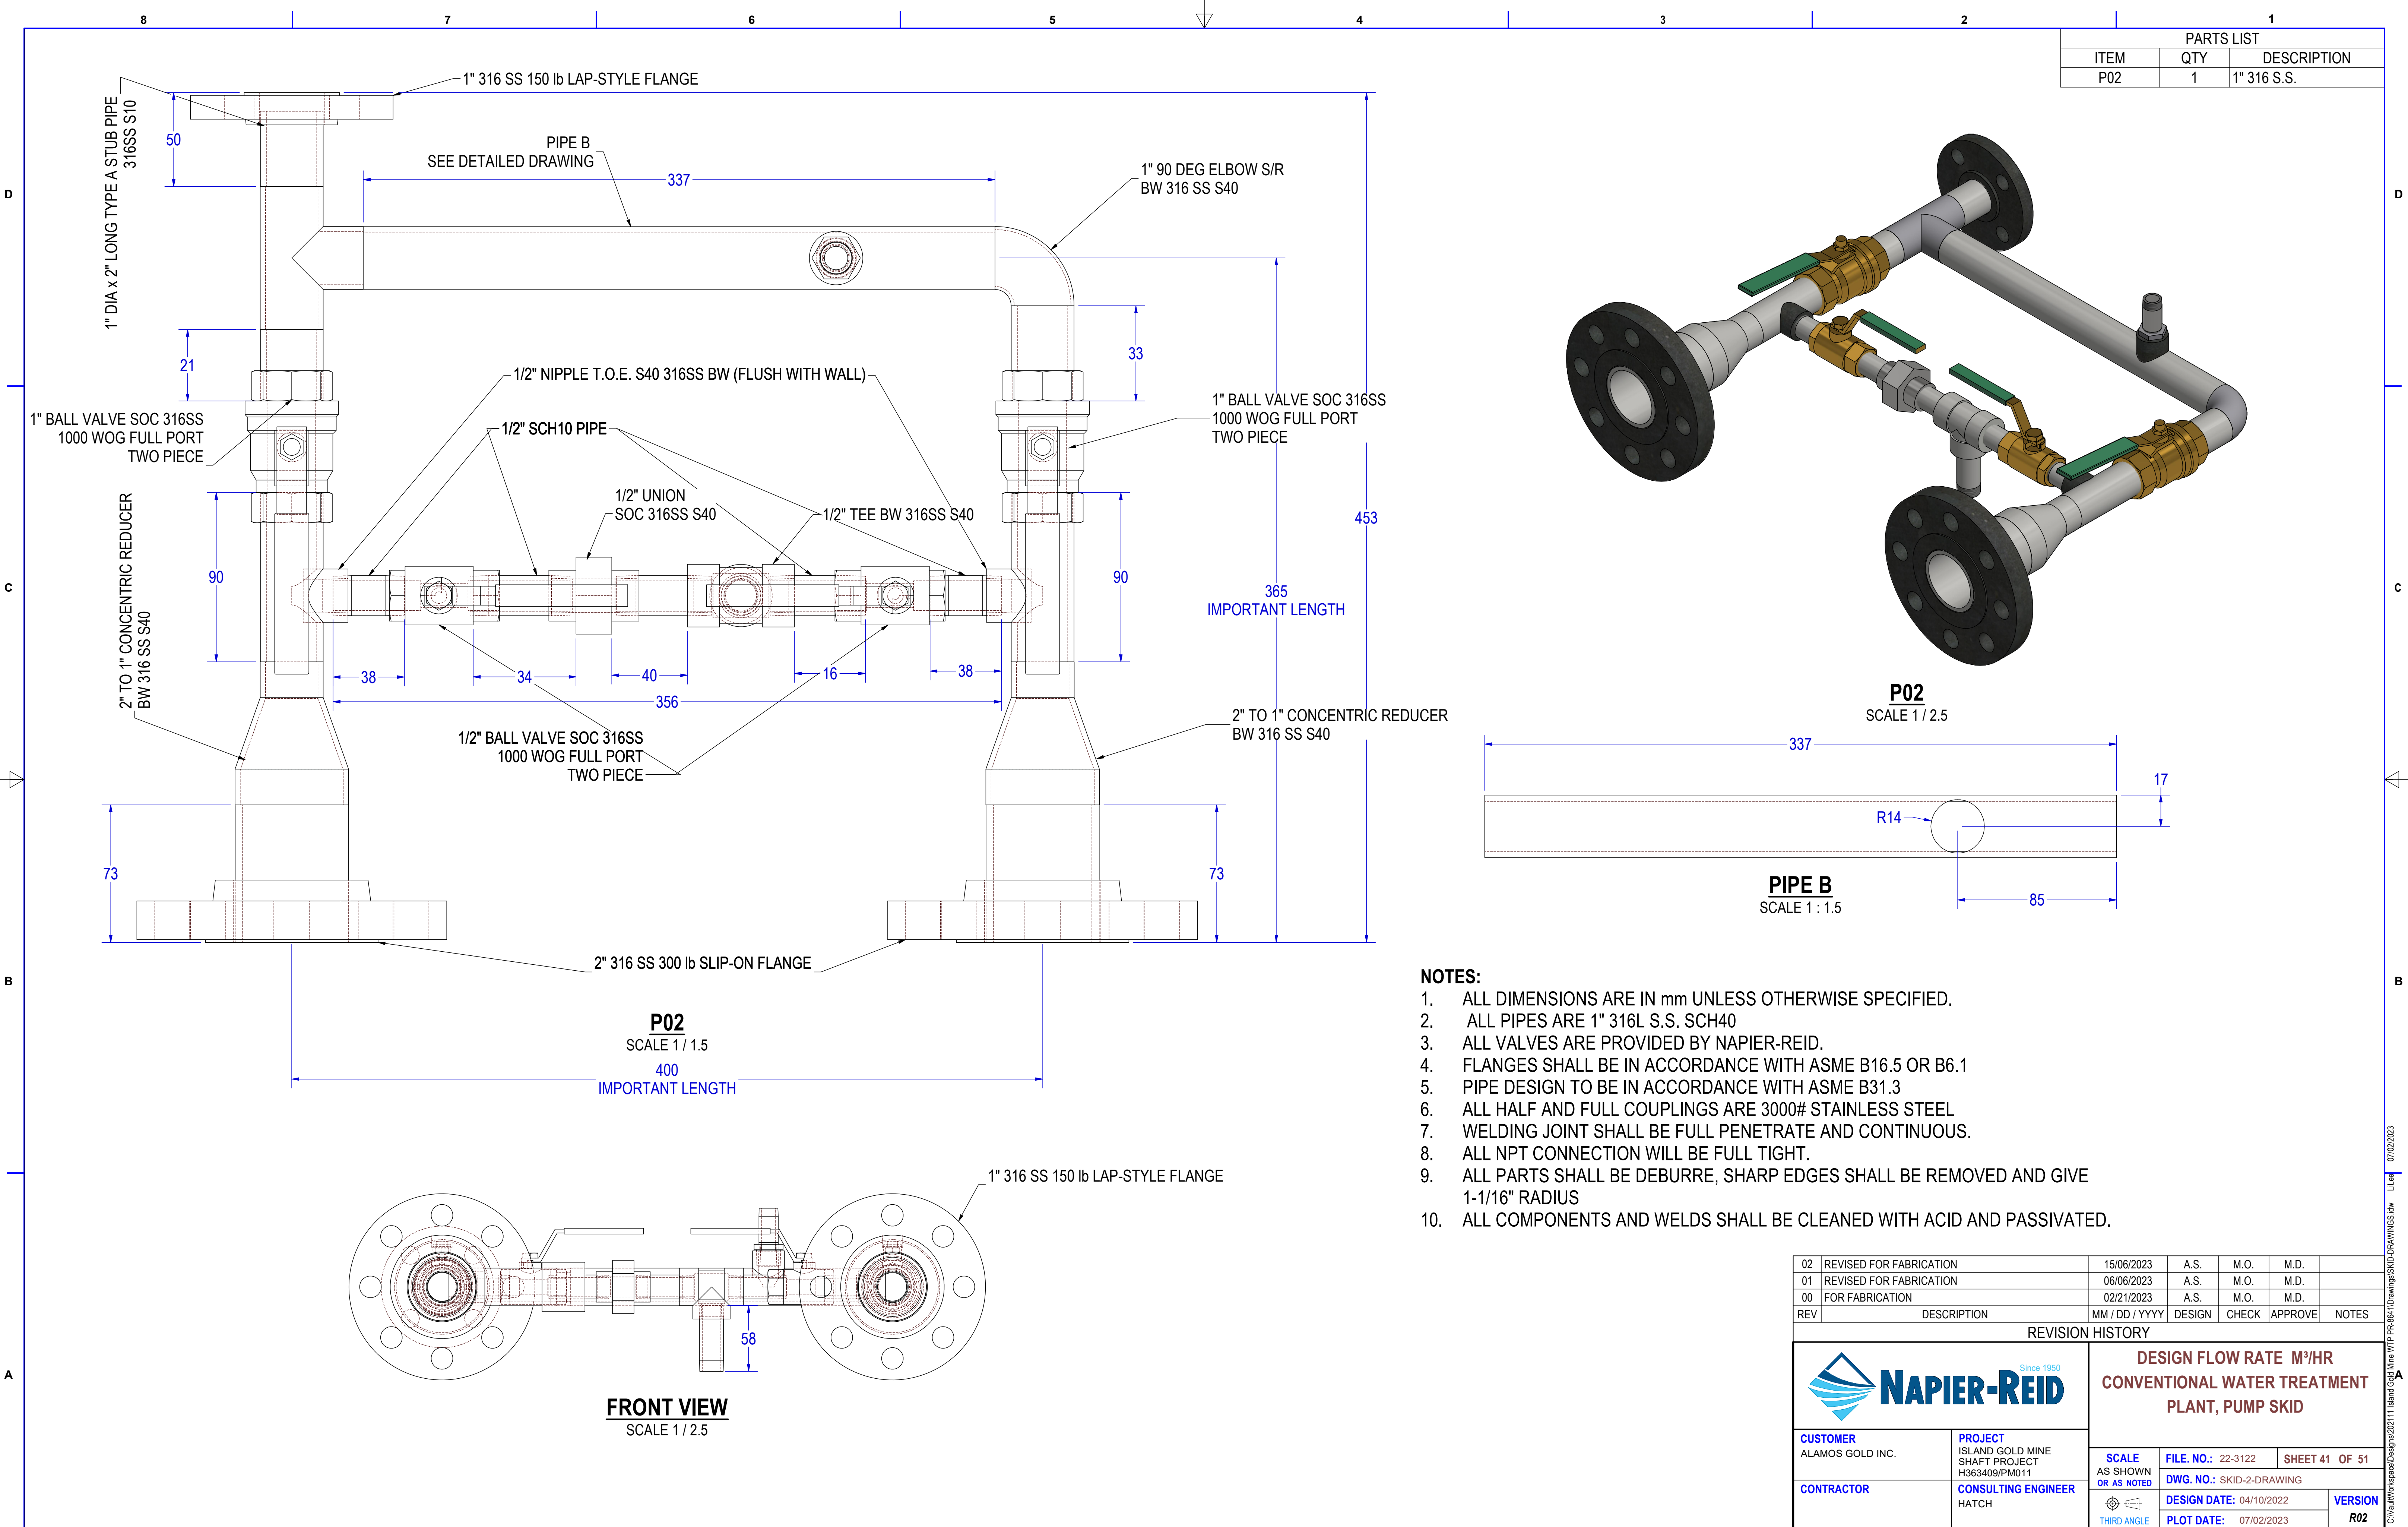

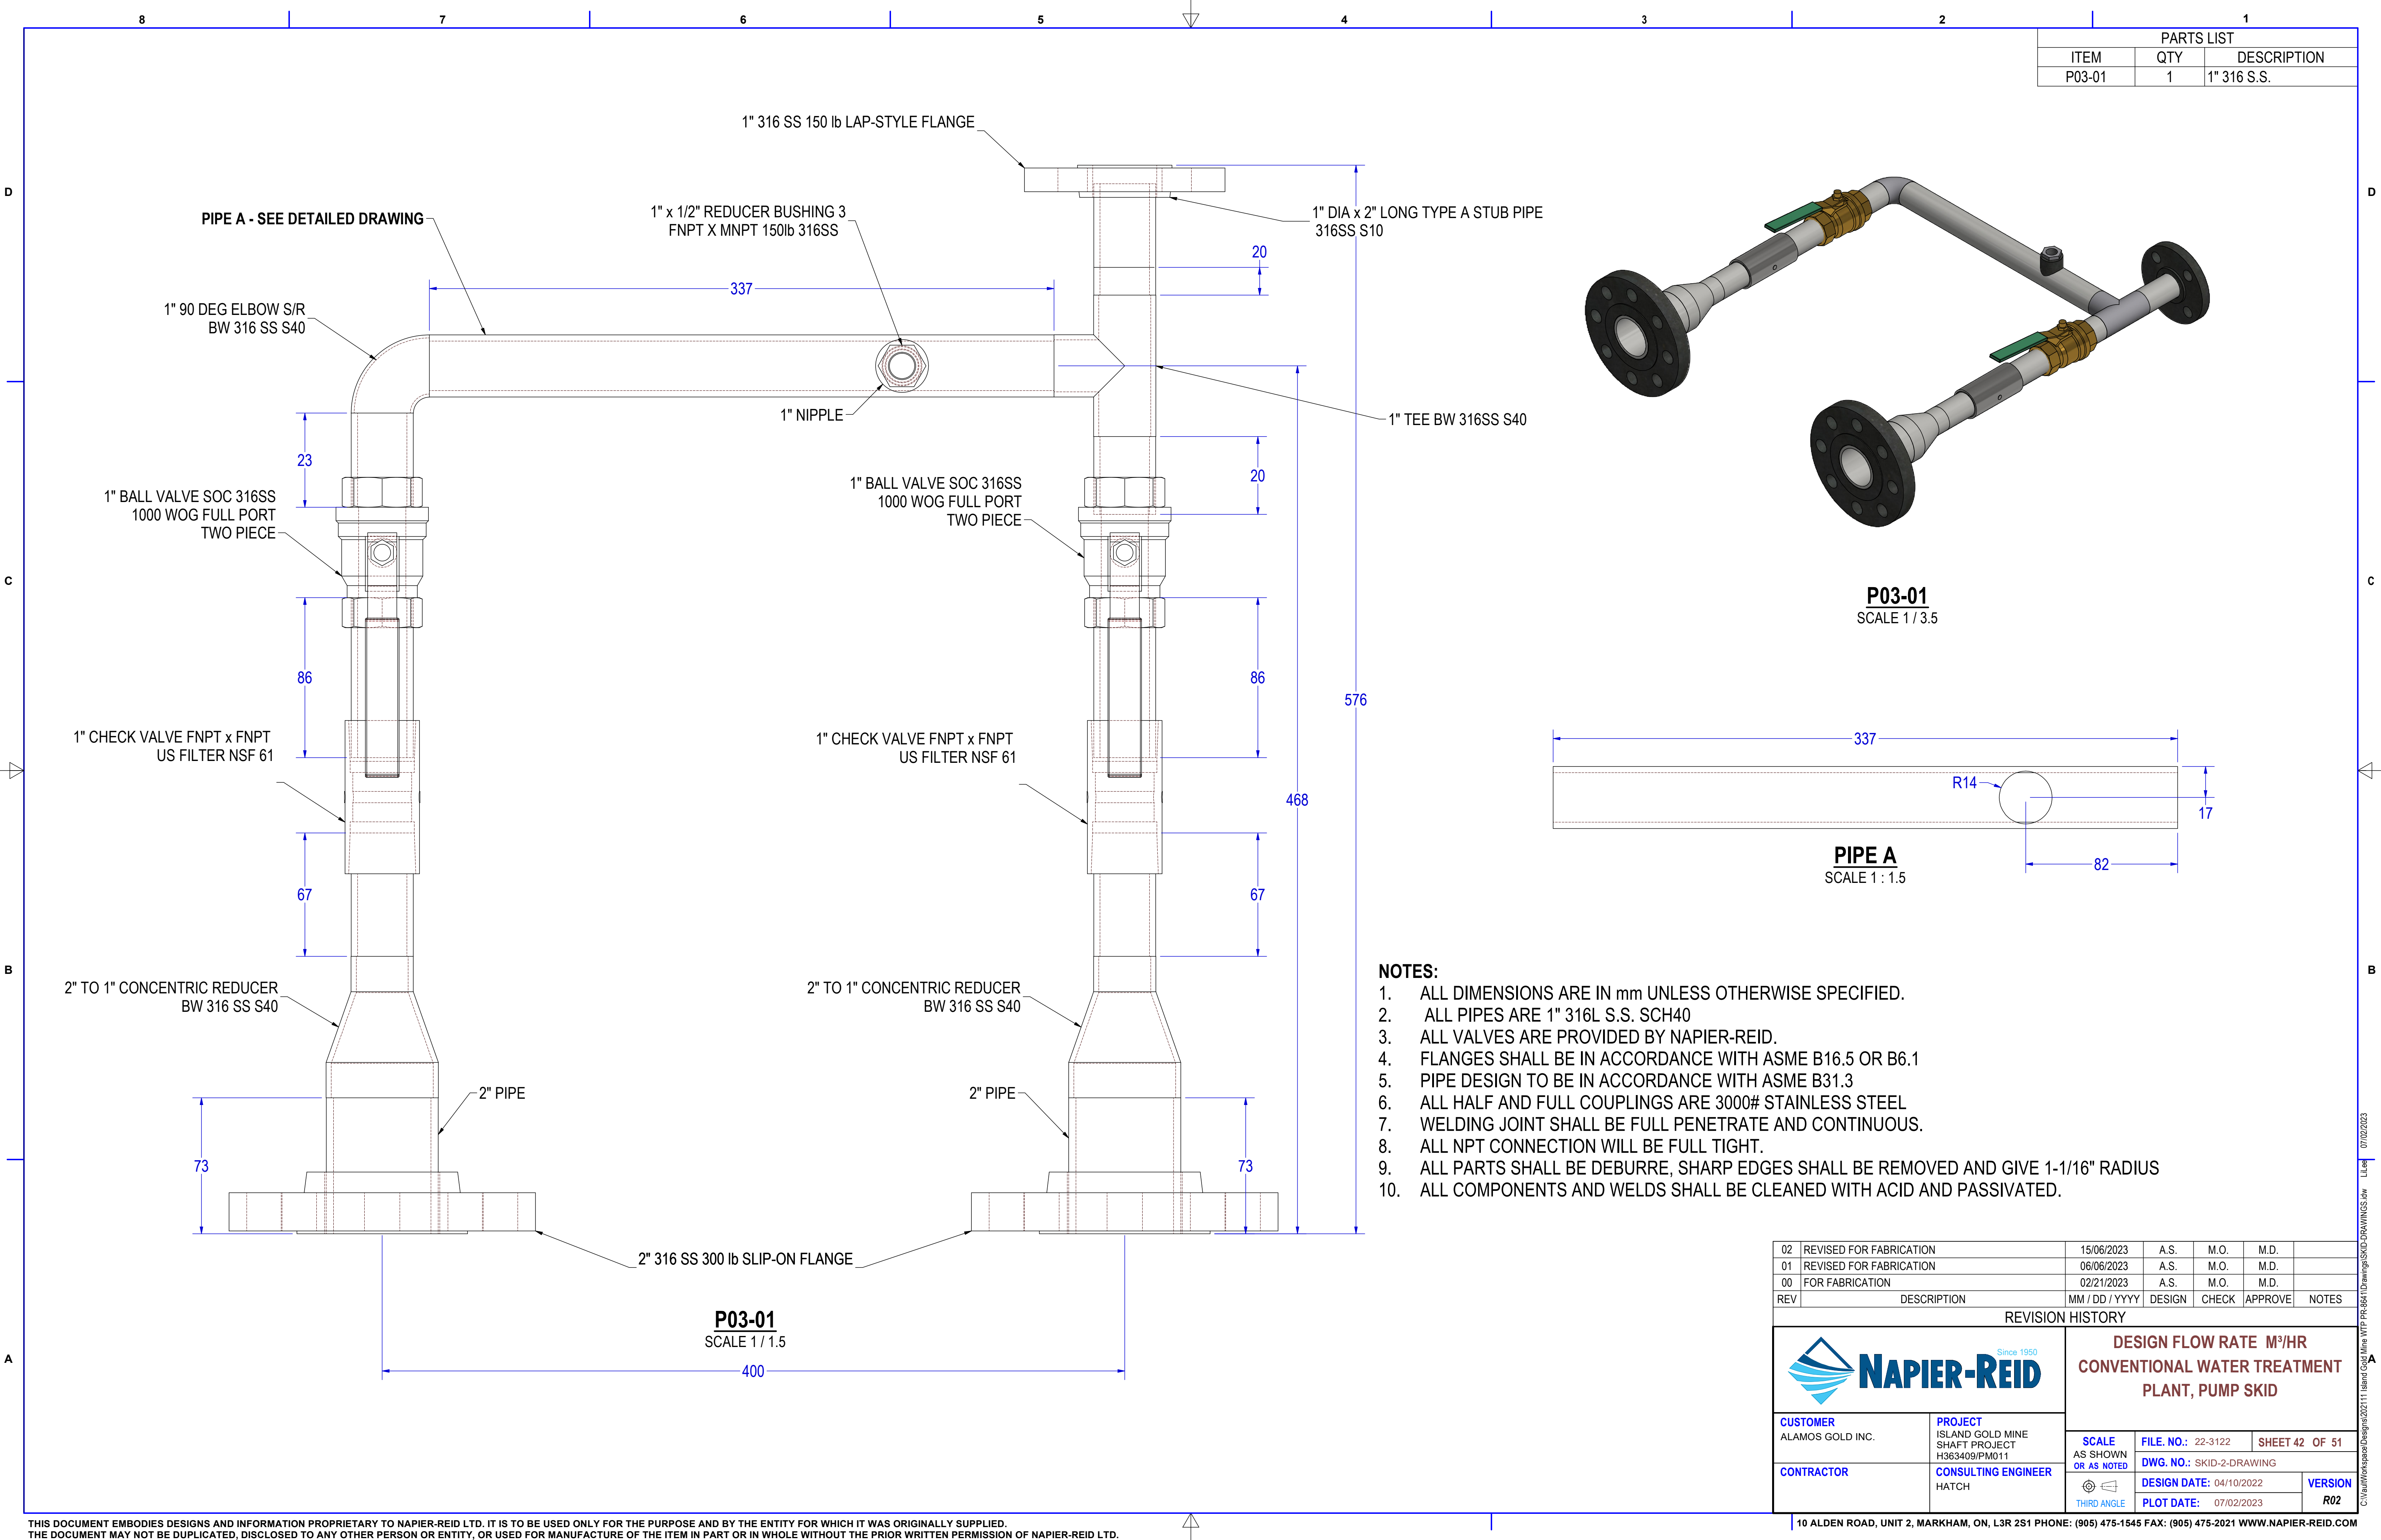


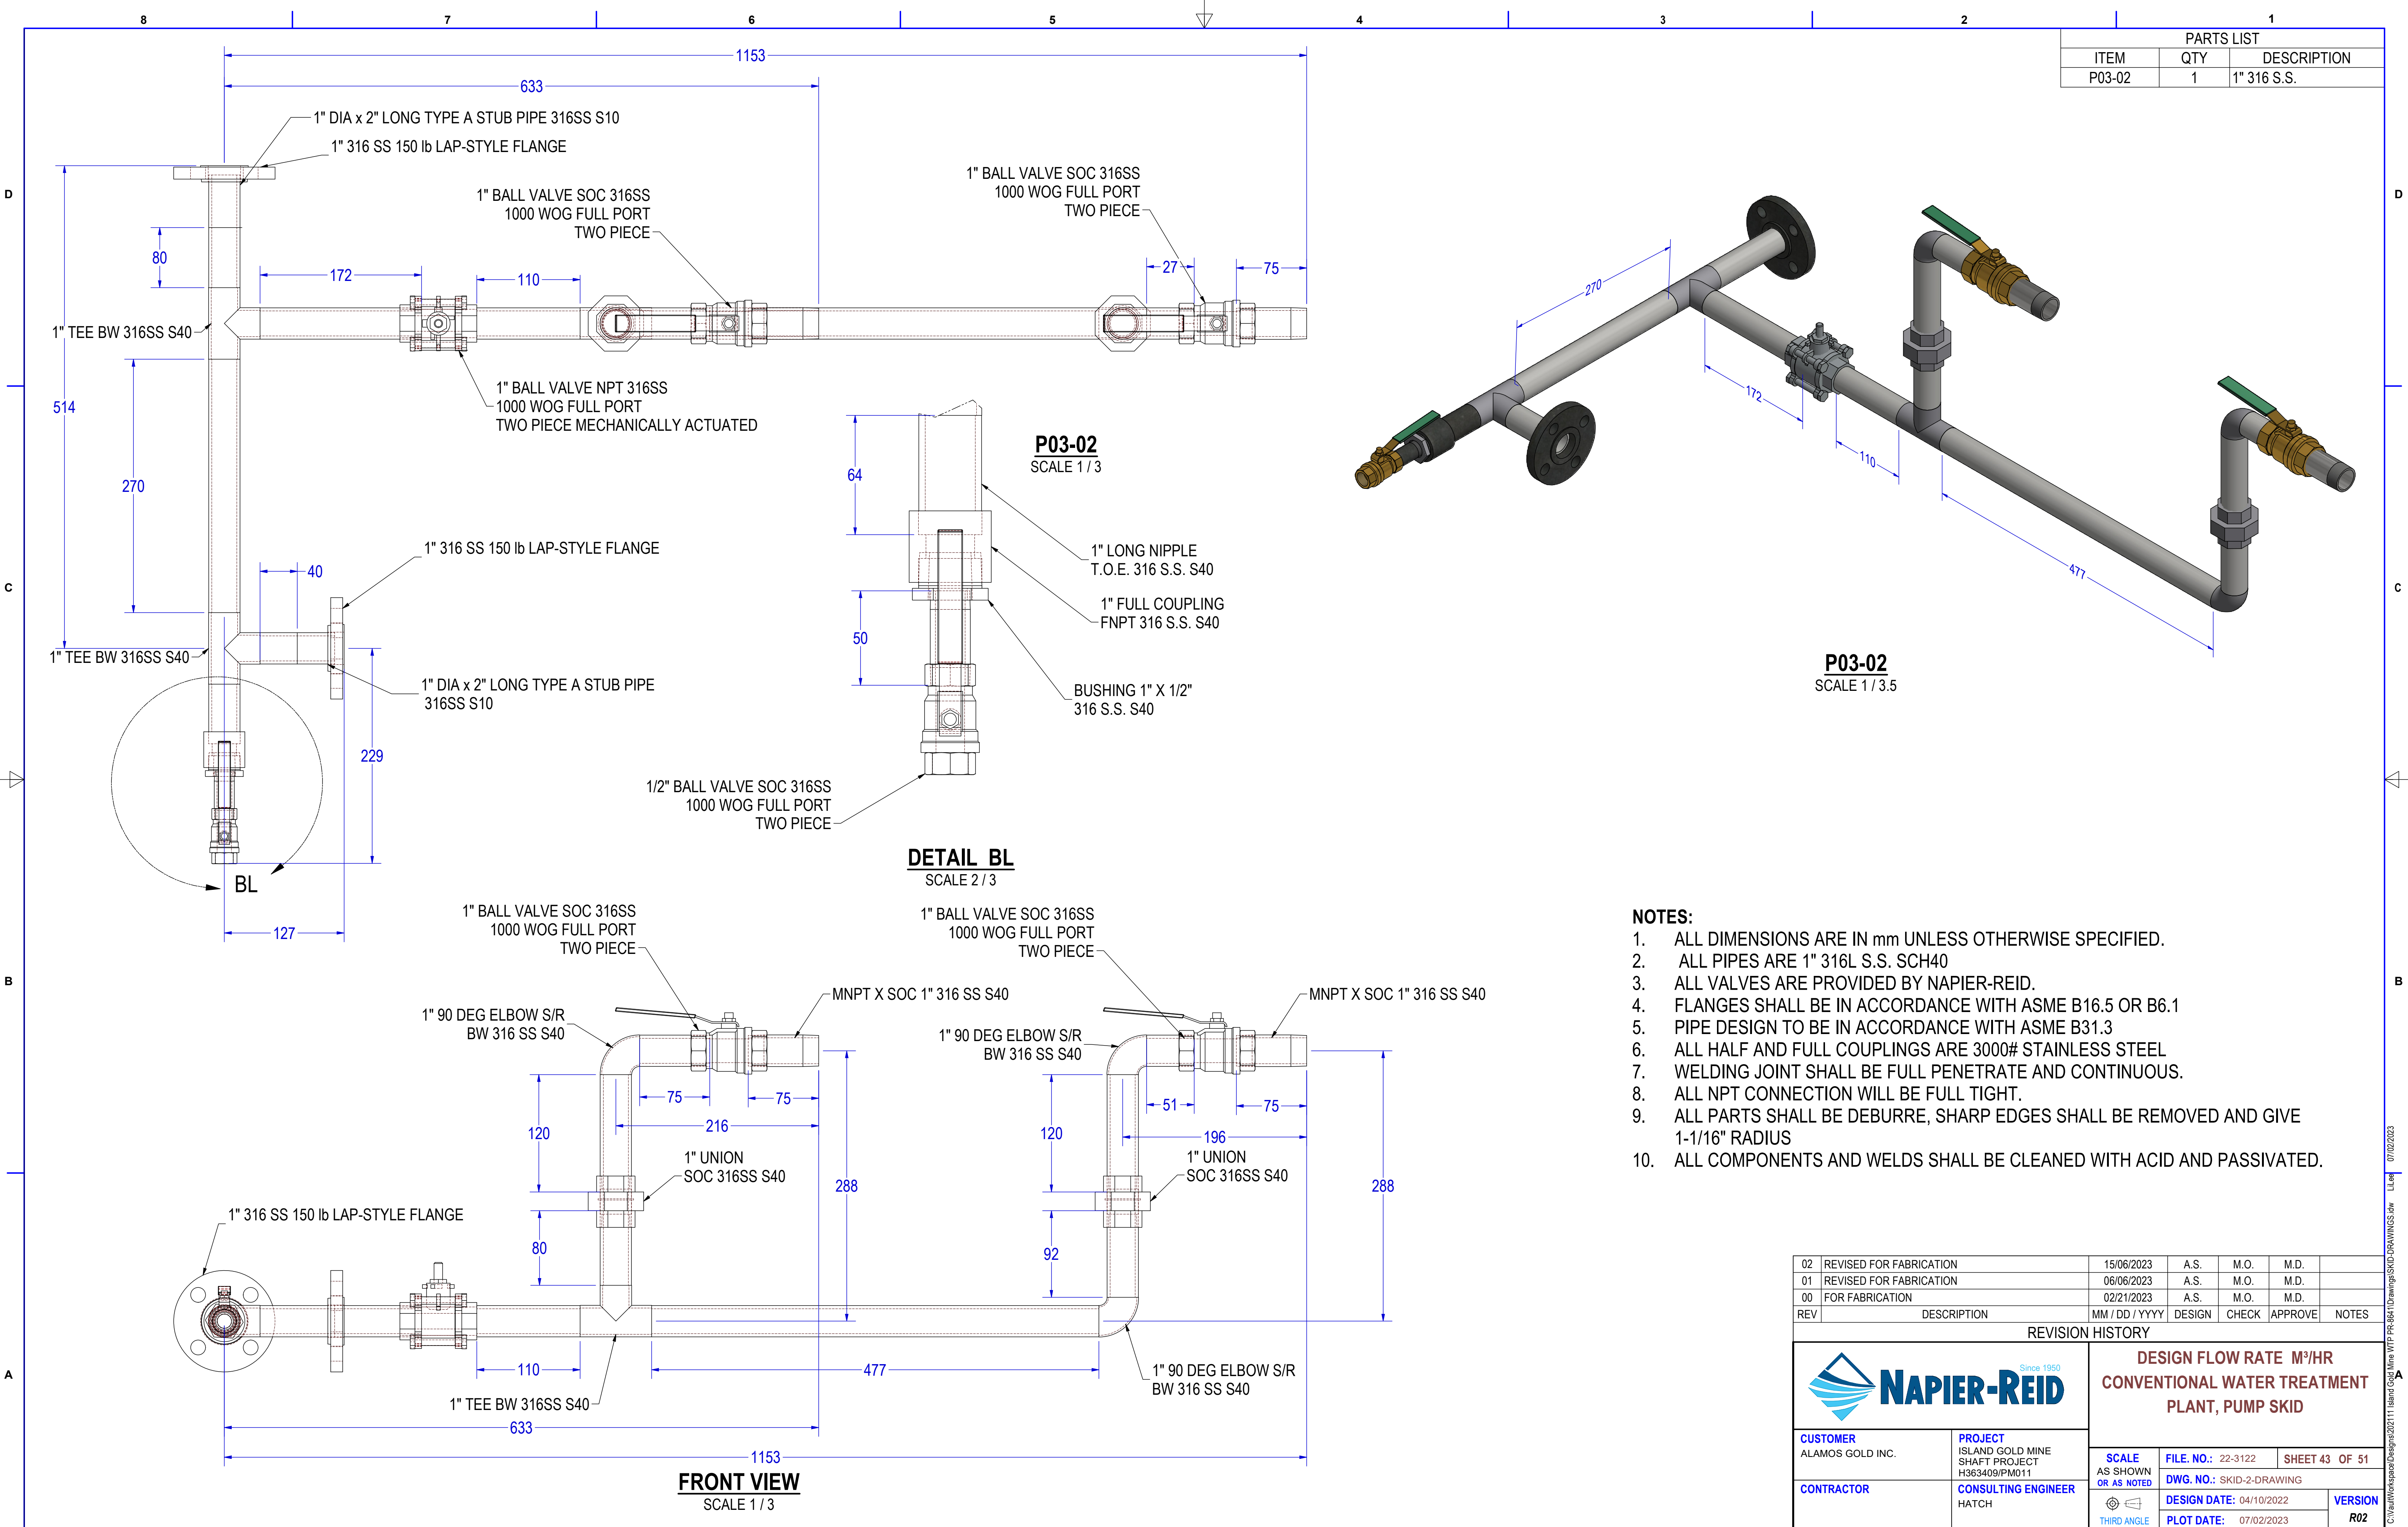
PARTS LIST		
ITEM	QTY	DESCRIPTION
P03-01	1	1" 316 S.S.

P03-01
SCALE 1 / 3.5

PIPE A
SCALE 1 : 1.5

- NOTES:**
- ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE SPECIFIED.
 - ALL PIPES ARE 1" 316L S.S. SCH40
 - ALL VALVES ARE PROVIDED BY NAPIER-REID.
 - FLANGES SHALL BE IN ACCORDANCE WITH ASME B16.5 OR B6.1
 - PIPE DESIGN TO BE IN ACCORDANCE WITH ASME B31.3
 - ALL HALF AND FULL COUPLINGS ARE 3000# STAINLESS STEEL
 - WELDING JOINT SHALL BE FULL PENETRATE AND CONTINUOUS.
 - ALL NPT CONNECTION WILL BE FULL TIGHT.
 - ALL PARTS SHALL BE DEBURRE, SHARP EDGES SHALL BE REMOVED AND GIVE 1-1/16" RADIUS
 - ALL COMPONENTS AND WELDS SHALL BE CLEANED WITH ACID AND PASSIVATED.


02	REVISED FOR FABRICATION	15/06/2023	A.S.	M.O.	M.D.	
01	REVISED FOR FABRICATION	06/06/2023	A.S.	M.O.	M.D.	
00	FOR FABRICATION	02/21/2023	A.S.	M.O.	M.D.	
REV	DESCRIPTION	MM / DD / YYYY	DESIGN	CHECK	APPROVE	NOTES
REVISION HISTORY						
			<div>DESIGN FLOW RATE M³/HR</div> <div>CONVENTIONAL WATER TREATMENT</div> <div>PLANT, PUMP SKID</div>			
CUSTOMER		PROJECT				
ALAMOS GOLD INC.		ISLAND GOLD MINE SHAFT PROJECT H363409/PM011				
CONTRACTOR		CONSULTING ENGINEER		VERSION		
HATCH				R02		



PARTS LIST		
ITEM	QTY	DESCRIPTION
P03-02	1	1" 316 S.S.

P03-02
SCALE 1/3.5

- NOTES:**
1. ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE SPECIFIED.
 2. ALL PIPES ARE 1" 316L S.S. SCH40
 3. ALL VALVES ARE PROVIDED BY NAPIER-REID.
 4. FLANGES SHALL BE IN ACCORDANCE WITH ASME B16.5 OR B6.1
 5. PIPE DESIGN TO BE IN ACCORDANCE WITH ASME B31.3
 6. ALL HALF AND FULL COUPLINGS ARE 3000# STAINLESS STEEL
 7. WELDING JOINT SHALL BE FULL PENETRATE AND CONTINUOUS.
 8. ALL NPT CONNECTION WILL BE FULL TIGHT.
 9. ALL PARTS SHALL BE DEBURRE, SHARP EDGES SHALL BE REMOVED AND GIVE 1-1/16" RADIUS
 10. ALL COMPONENTS AND WELDS SHALL BE CLEANED WITH ACID AND PASSIVATED.

02	REVISED FOR FABRICATION	15/06/2023	A.S.	M.O.	M.D.	
01	REVISED FOR FABRICATION	06/06/2023	A.S.	M.O.	M.D.	
00	FOR FABRICATION	02/21/2023	A.S.	M.O.	M.D.	
REV	DESCRIPTION	MM / DD / YYYY	DESIGN	CHECK	APPROVE	NOTES
REVISION HISTORY						
<div></div>			DESIGN FLOW RATE M ³ /HR CONVENTIONAL WATER TREATMENT PLANT, PUMP SKID			
CUSTOMER ALAMOS GOLD INC.		PROJECT ISLAND GOLD MINE SHAFT PROJECT H363409/PM011		SCALE AS SHOWN OR AS NOTED		
CONTRACTOR		CONSULTING ENGINEER HATCH		FILE. NO.: 22-3122		SHEET 43 OF 51
				DWG. NO.: SKID-2-DRAWING		
				DESIGN DATE: 04/10/2022		VERSION
				PLOT DATE: 07/02/2023		R02