

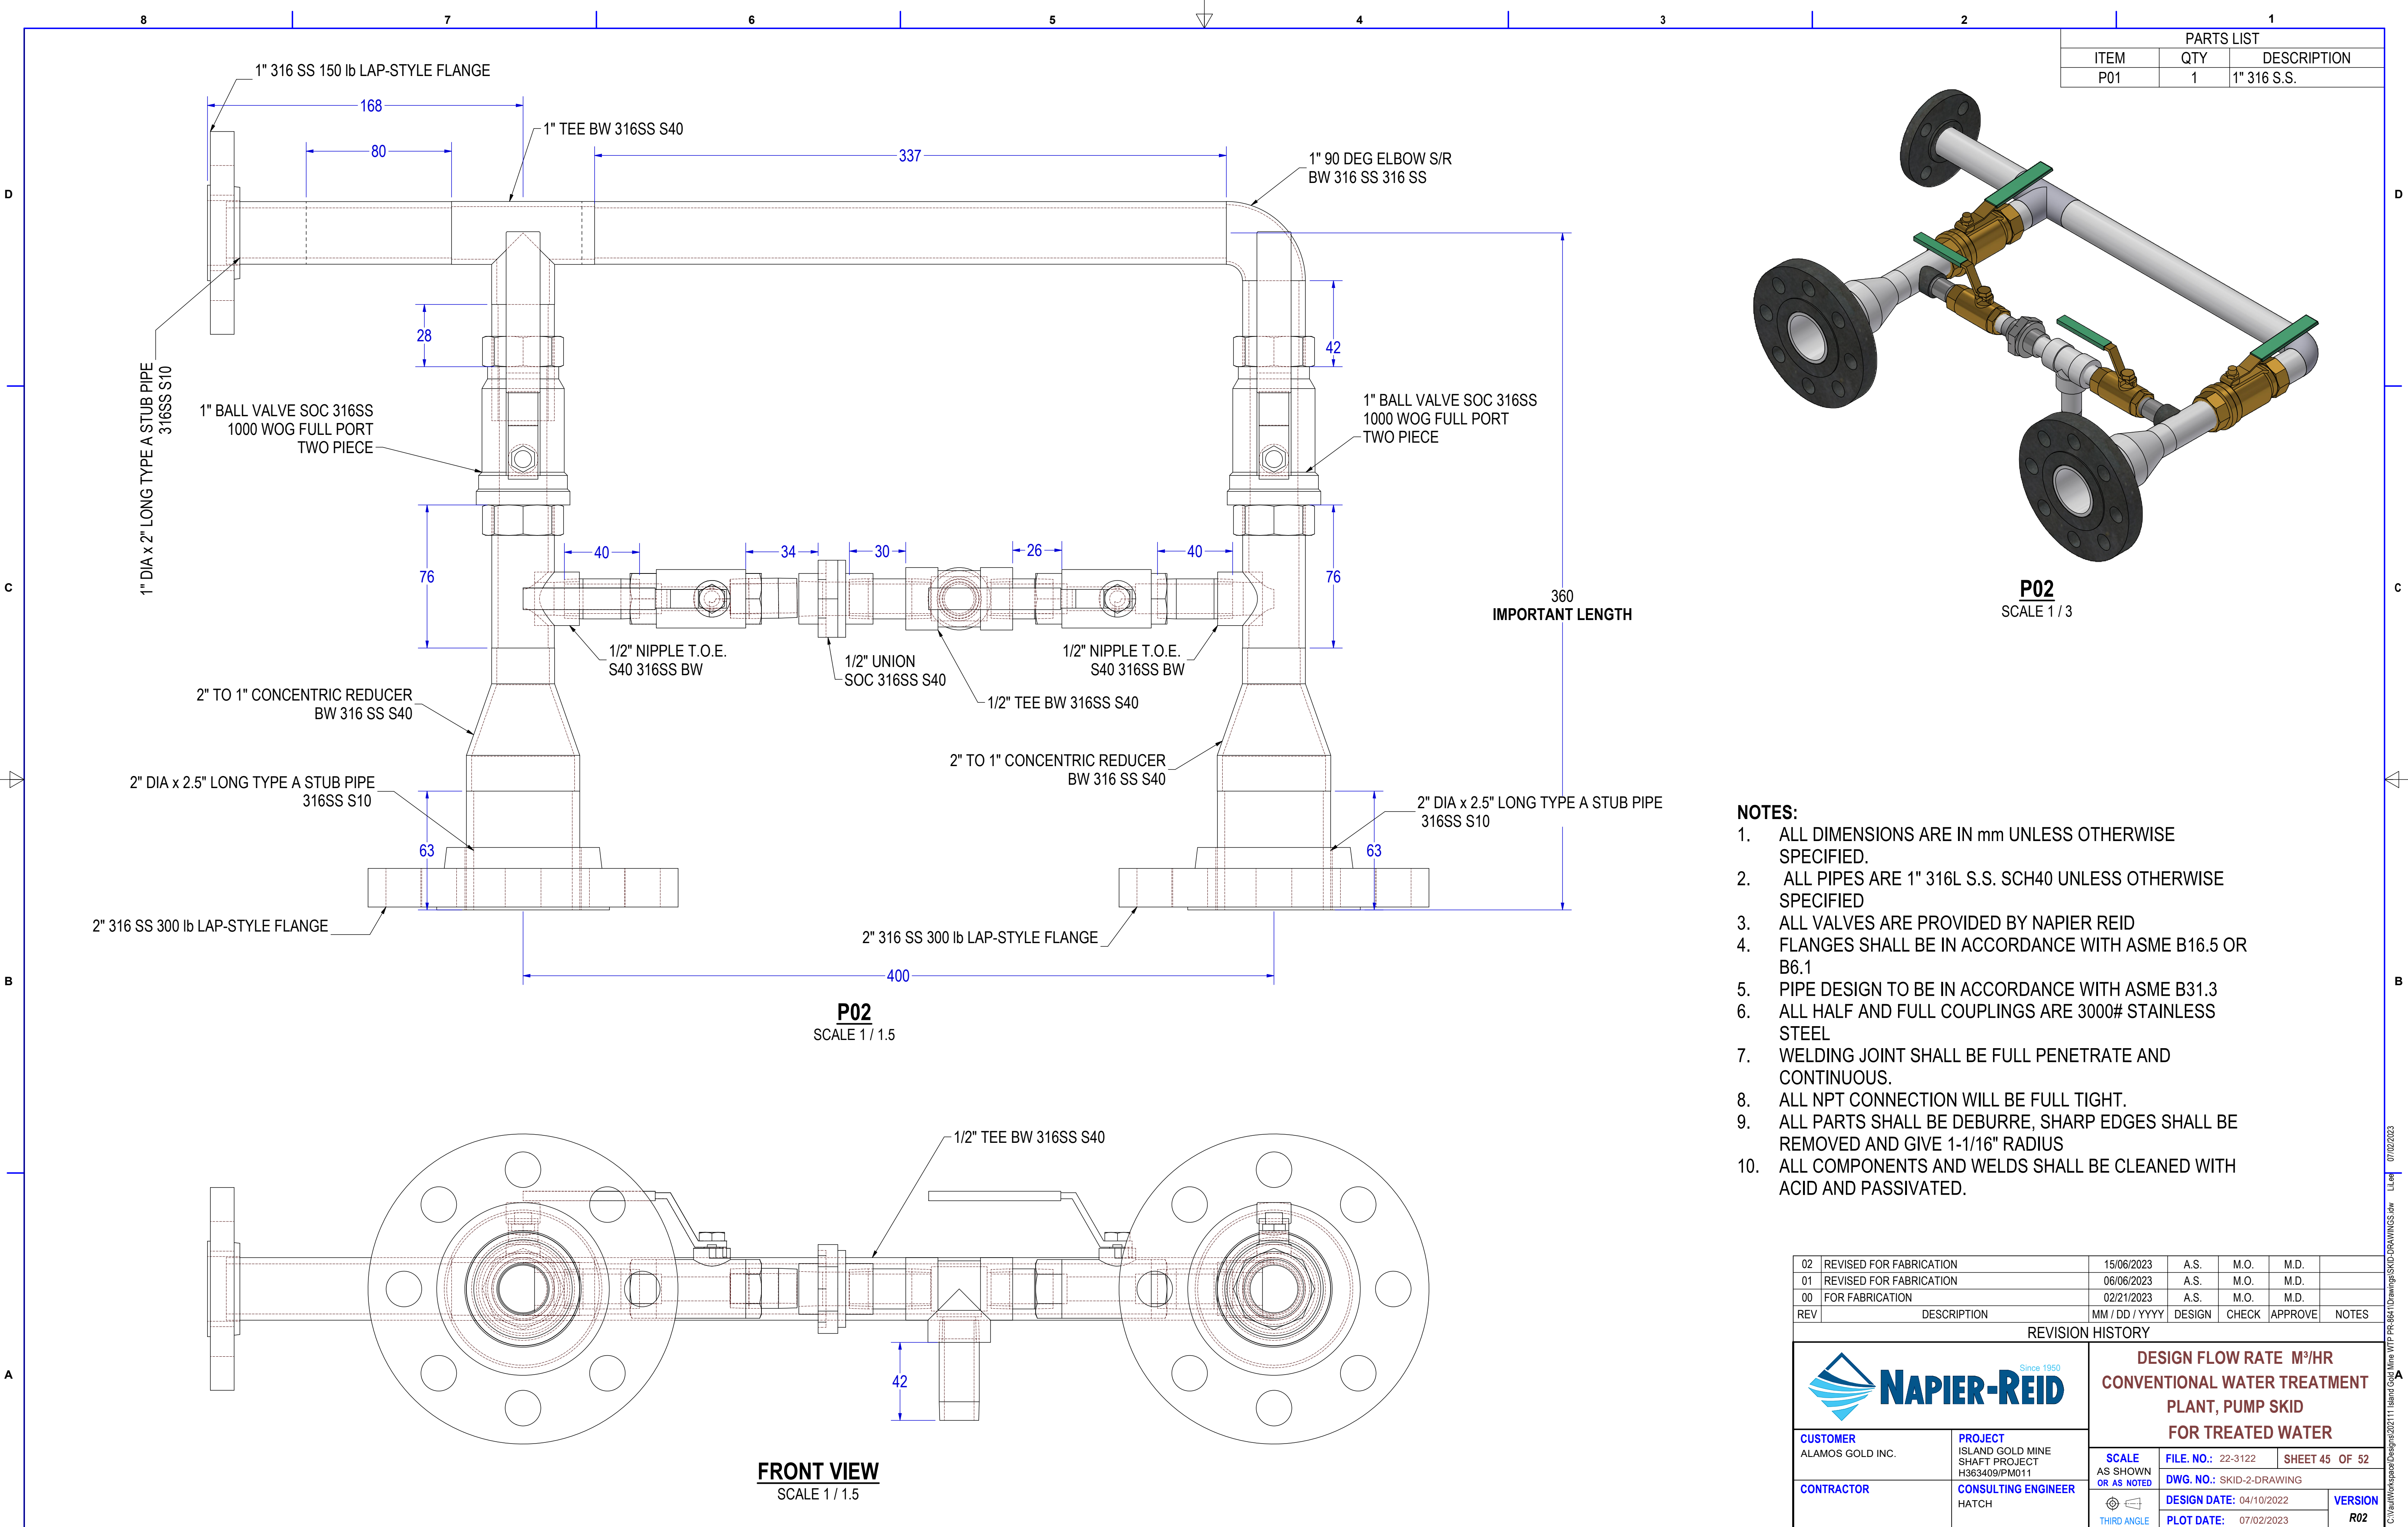
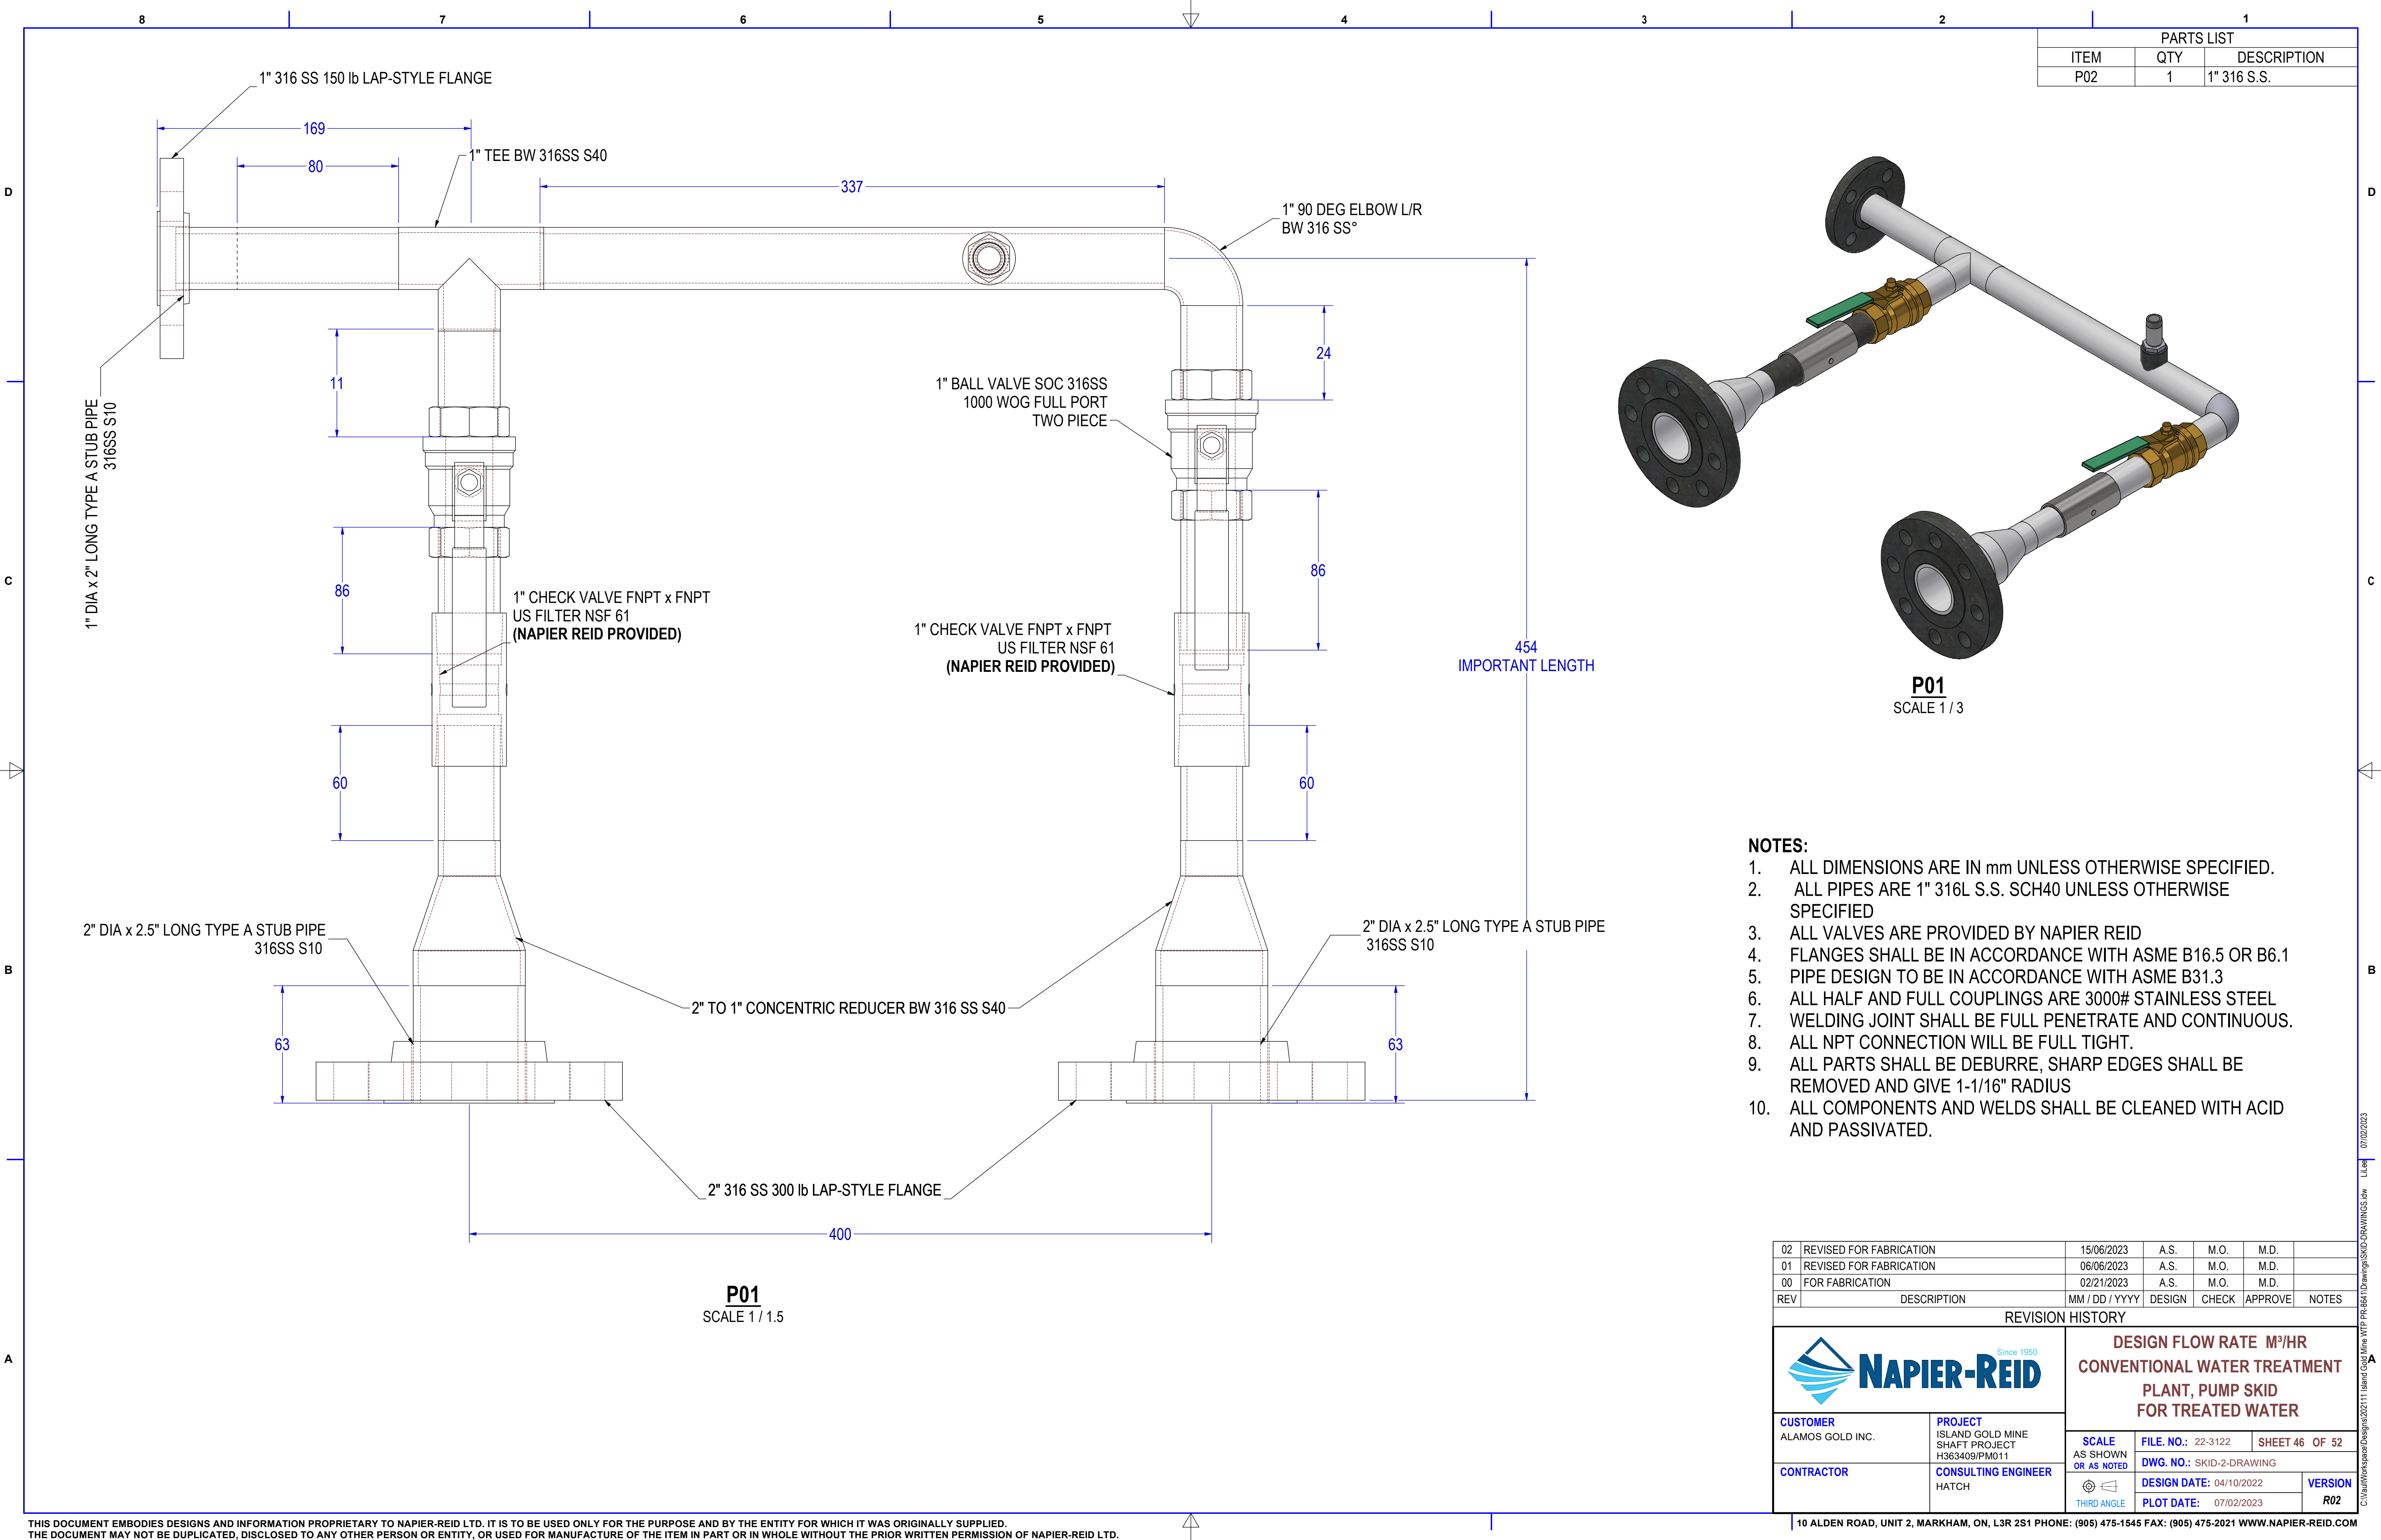


- NOTES:**
- ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE SPECIFIED.
 - ALL PIPES ARE 1" 316L S.S. SCH40 UNLESS OTHERWISE SPECIFIED
 - ALL VALVES ARE PROVIDED BY NAPIER REID
 - FLANGES SHALL BE IN ACCORDANCE WITH ASME B16.5 OR B6.1
 - PIPE DESIGN TO BE IN ACCORDANCE WITH ASME B31.3
 - ALL HALF AND FULL COUPLINGS ARE 3000# STAINLESS STEEL
 - WELDING JOINT SHALL BE FULL PENETRATE AND CONTINUOUS.
 - ALL NPT CONNECTION WILL BE FULL TIGHT.
 - ALL PARTS SHALL BE DEBURRE, SHARP EDGES SHALL BE REMOVED AND GIVE 1-1/16" RADIUS
 - ALL COMPONENTS AND WELDS SHALL BE CLEANED WITH ACID AND PASSIVATED.


PARTS LIST		
ITEM	QTY	DESCRIPTION
P01	1	1" 316 S.S.
P02	1	1" 316 S.S.

02	REVISED FOR FABRICATION	15/06/2023	A.S.	M.O.	M.D.	
01	REVISED FOR FABRICATION	06/06/2023	A.S.	M.O.	M.D.	
00	FOR FABRICATION	02/21/2023	A.S.	M.O.	M.D.	
REV	DESCRIPTION	MM / DD / YYYY	DESIGN	CHECK	APPROVE	NOTES
REVISION HISTORY						
<div></div>			<div>DESIGN FLOW RATE M³/HR</div> <div>CONVENTIONAL WATER TREATMENT</div> <div>PLANT, PUMP SKID</div> <div>FOR TREATED WATER</div>			
CUSTOMER ALAMOS GOLD INC.		PROJECT ISLAND GOLD MINE SHAFT PROJECT H363409/PM011		SCALE AS SHOWN OR AS NOTED		
CONTRACTOR		CONSULTING ENGINEER HATCH		FILE. NO.: 22-3122		SHEET 44 OF 52
<div></div> <div>THIRD ANGLE</div>				DWG. NO.: SKID-2-DRAWING		VERSION R02
				DESIGN DATE: 04/10/2022		
				PLOT DATE: 07/02/2023		






PARTS LIST		
ITEM	QTY	DESCRIPTION
P02	1	1" 316 S.S.

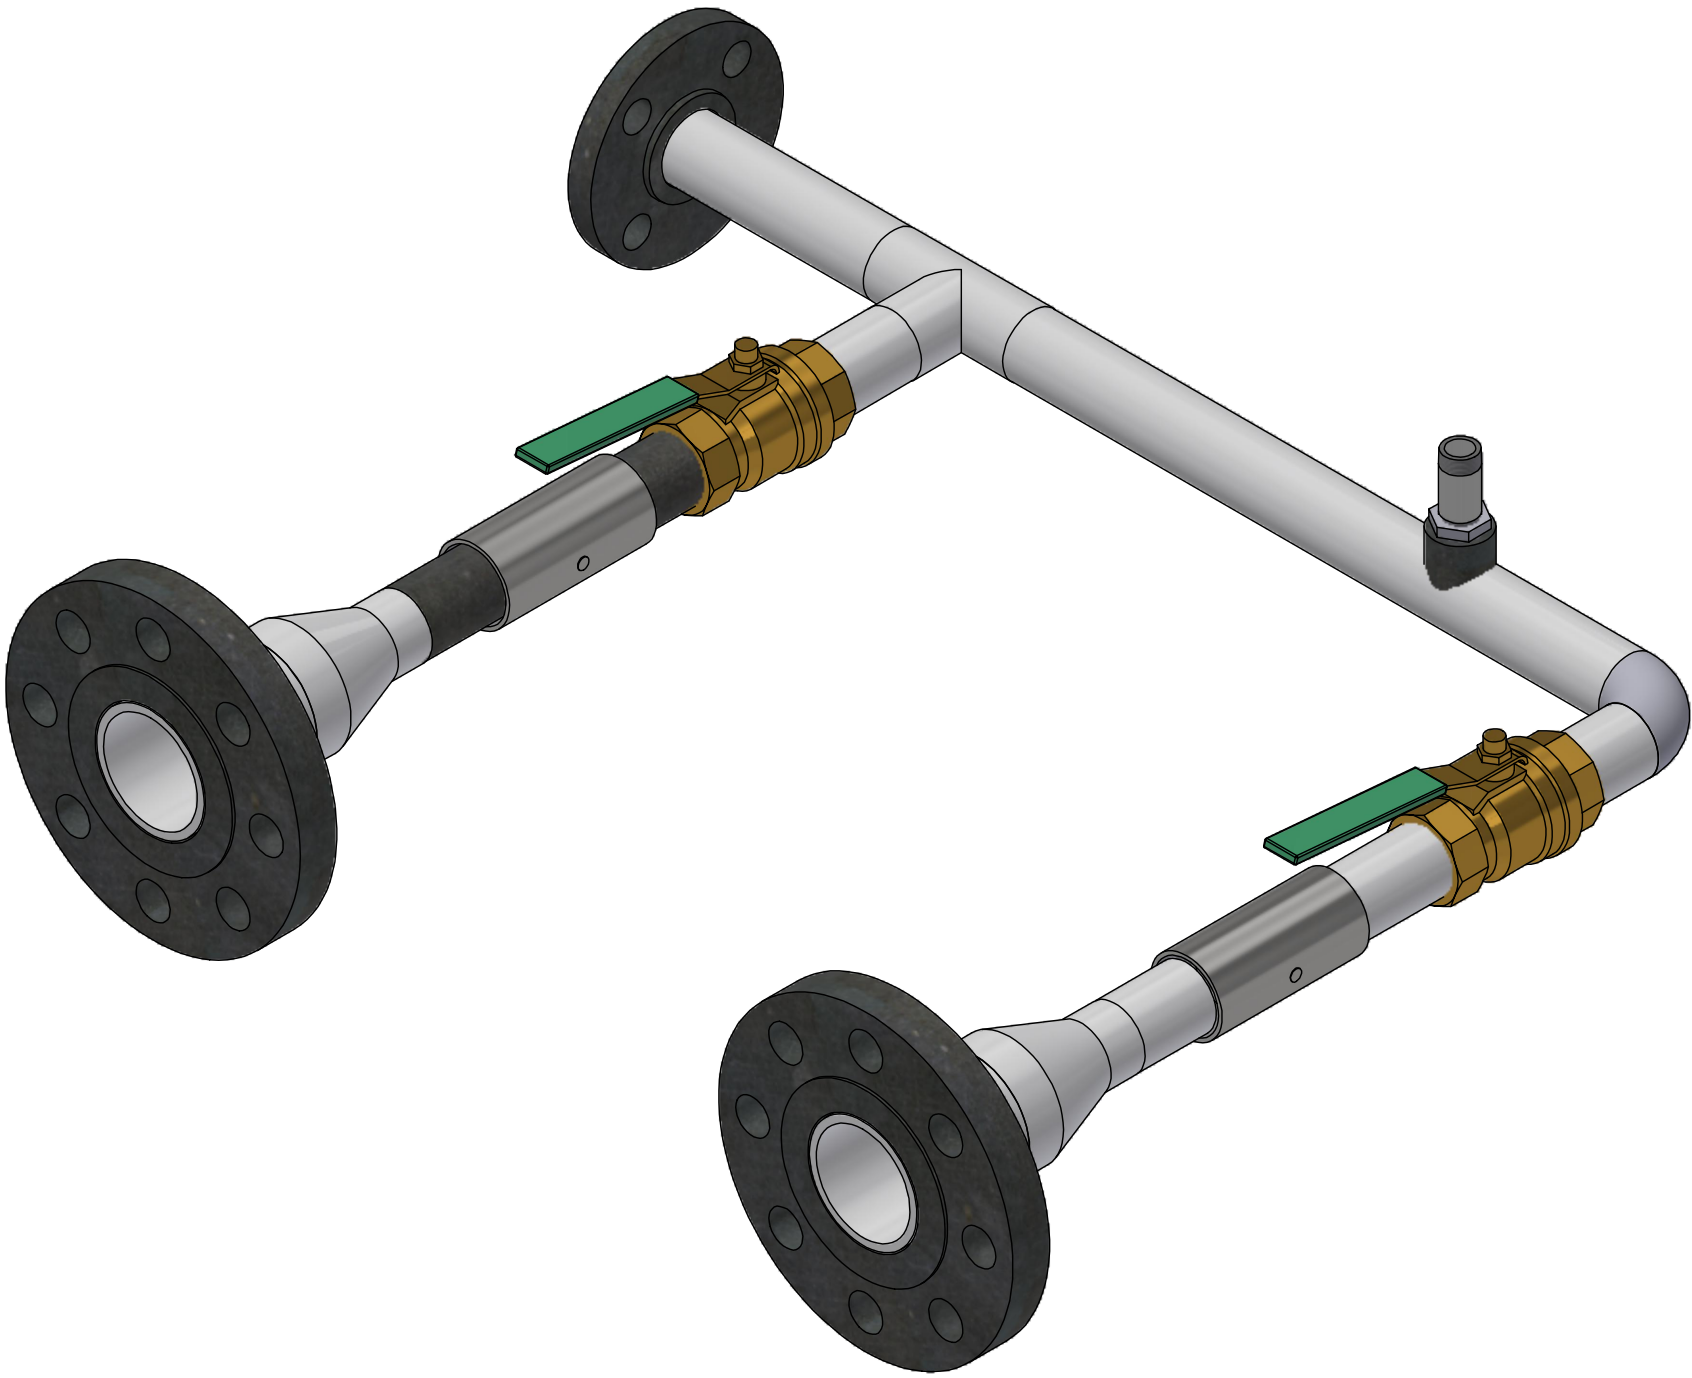

P01
SCALE 1 / 3

- NOTES:**
- ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE SPECIFIED.
 - ALL PIPES ARE 1" 316L S.S. SCH40 UNLESS OTHERWISE SPECIFIED
 - ALL VALVES ARE PROVIDED BY NAPIER REID
 - FLANGES SHALL BE IN ACCORDANCE WITH ASME B16.5 OR B6.1
 - PIPE DESIGN TO BE IN ACCORDANCE WITH ASME B31.3
 - ALL HALF AND FULL COUPLINGS ARE 3000# STAINLESS STEEL
 - WELDING JOINT SHALL BE FULL PENETRATE AND CONTINUOUS.
 - ALL NPT CONNECTION WILL BE FULL TIGHT.
 - ALL PARTS SHALL BE DEBURRE, SHARP EDGES SHALL BE REMOVED AND GIVE 1-1/16" RADIUS
 - ALL COMPONENTS AND WELDS SHALL BE CLEANED WITH ACID AND PASSIVATED.

02	REVISED FOR FABRICATION	15/06/2023	A.S.	M.O.	M.D.	
01	REVISED FOR FABRICATION	06/06/2023	A.S.	M.O.	M.D.	
00	FOR FABRICATION	02/21/2023	A.S.	M.O.	M.D.	
REV	DESCRIPTION	MM / DD / YYYY	DESIGN	CHECK	APPROVE	NOTES
REVISION HISTORY						
			DESIGN FLOW RATE M³/HR CONVENTIONAL WATER TREATMENT PLANT, PUMP SKID FOR TREATED WATER			
CUSTOMER ALAMOS GOLD INC.		PROJECT ISLAND GOLD MINE SHAFT PROJECT H363409/PM011		SCALE AS SHOWN OR AS NOTED	FILE. NO.: 22-3122	SHEET 46 OF 52
CONTRACTOR		CONSULTING ENGINEER HATCH		DESIGN DATE: 04/10/2022	VERSION R02	
				PLOT DATE: 07/02/2023		