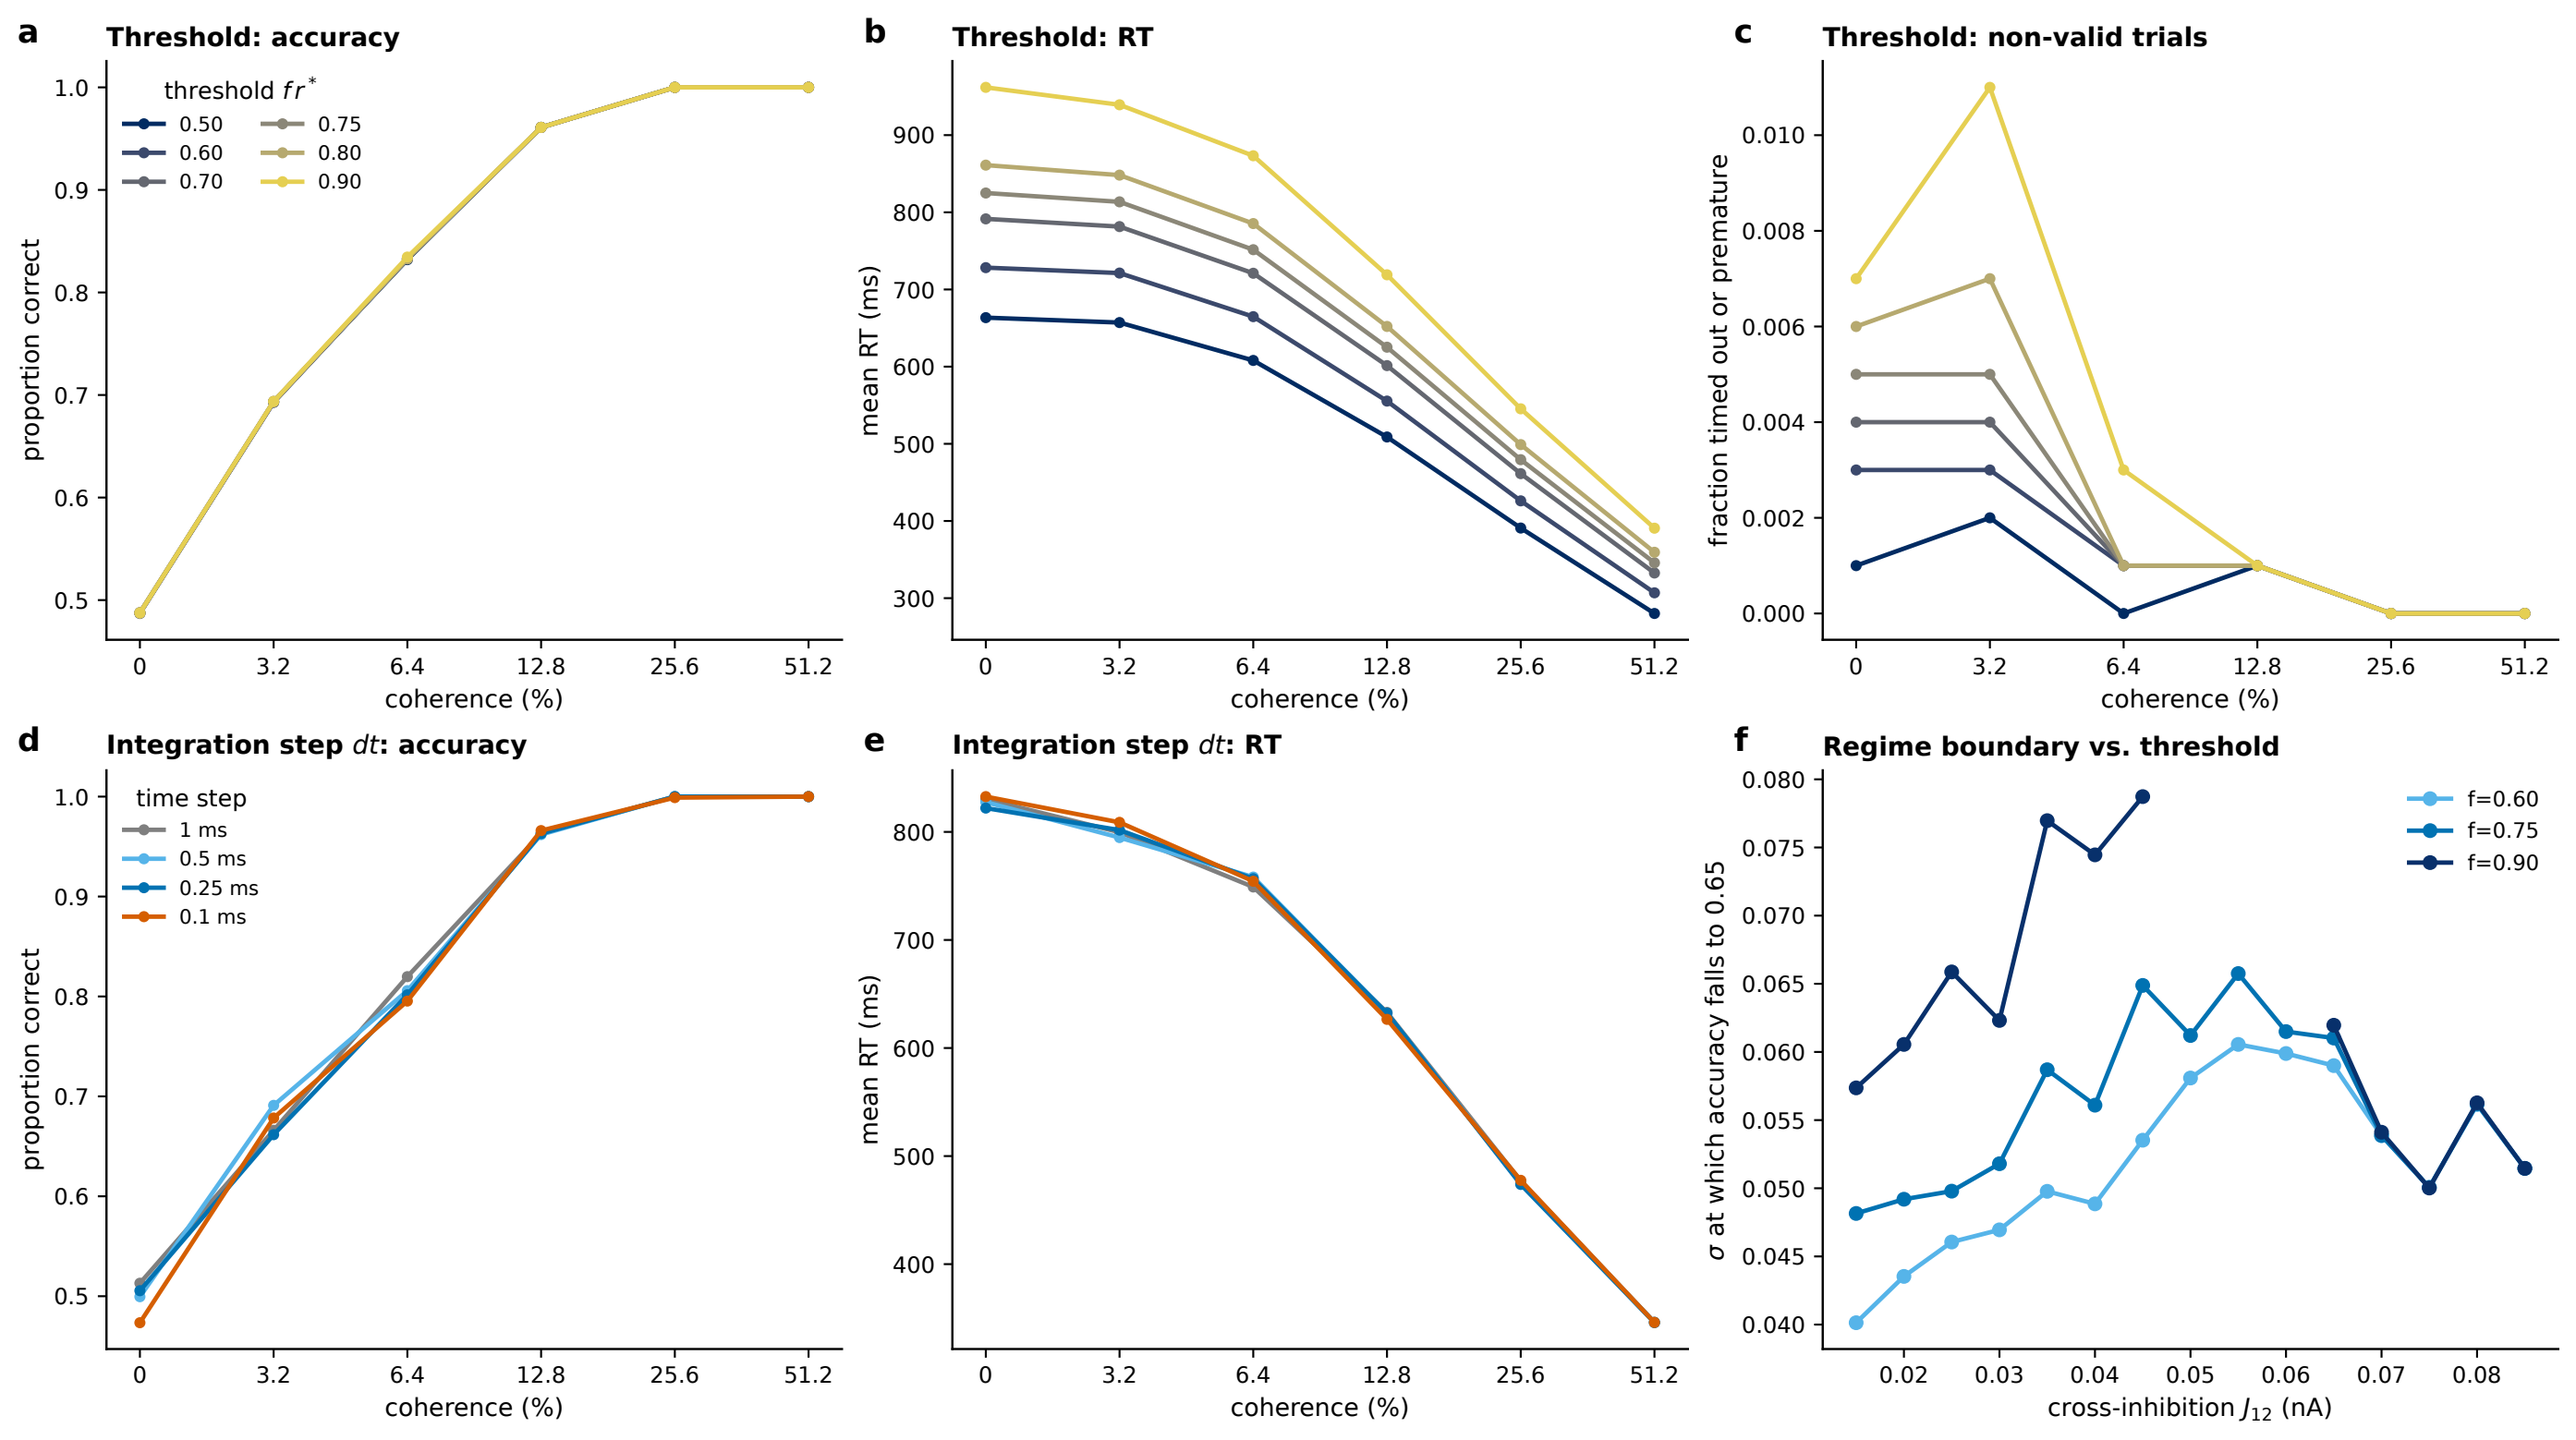
a
Threshold: accuracy
threshold fr^*
0.50
0.60
0.70
0.75
0.80
0.90
proportion correct
coherence (%)
b
Threshold: RT
mean RT (ms)
coherence (%)
c
Threshold: non-valid trials
fraction timed out or premature
coherence (%)
d
Integration step dt: accuracy
time step
1 ms
0.5 ms
0.25 ms
0.1 ms
proportion correct
coherence (%)
e
Integration step dt: RT
mean RT (ms)
coherence (%)
f
Regime boundary vs. threshold
f=0.60
f=0.75
f=0.90
σ at which accuracy falls to 0.65
cross-inhibition J_{12} (nA)