




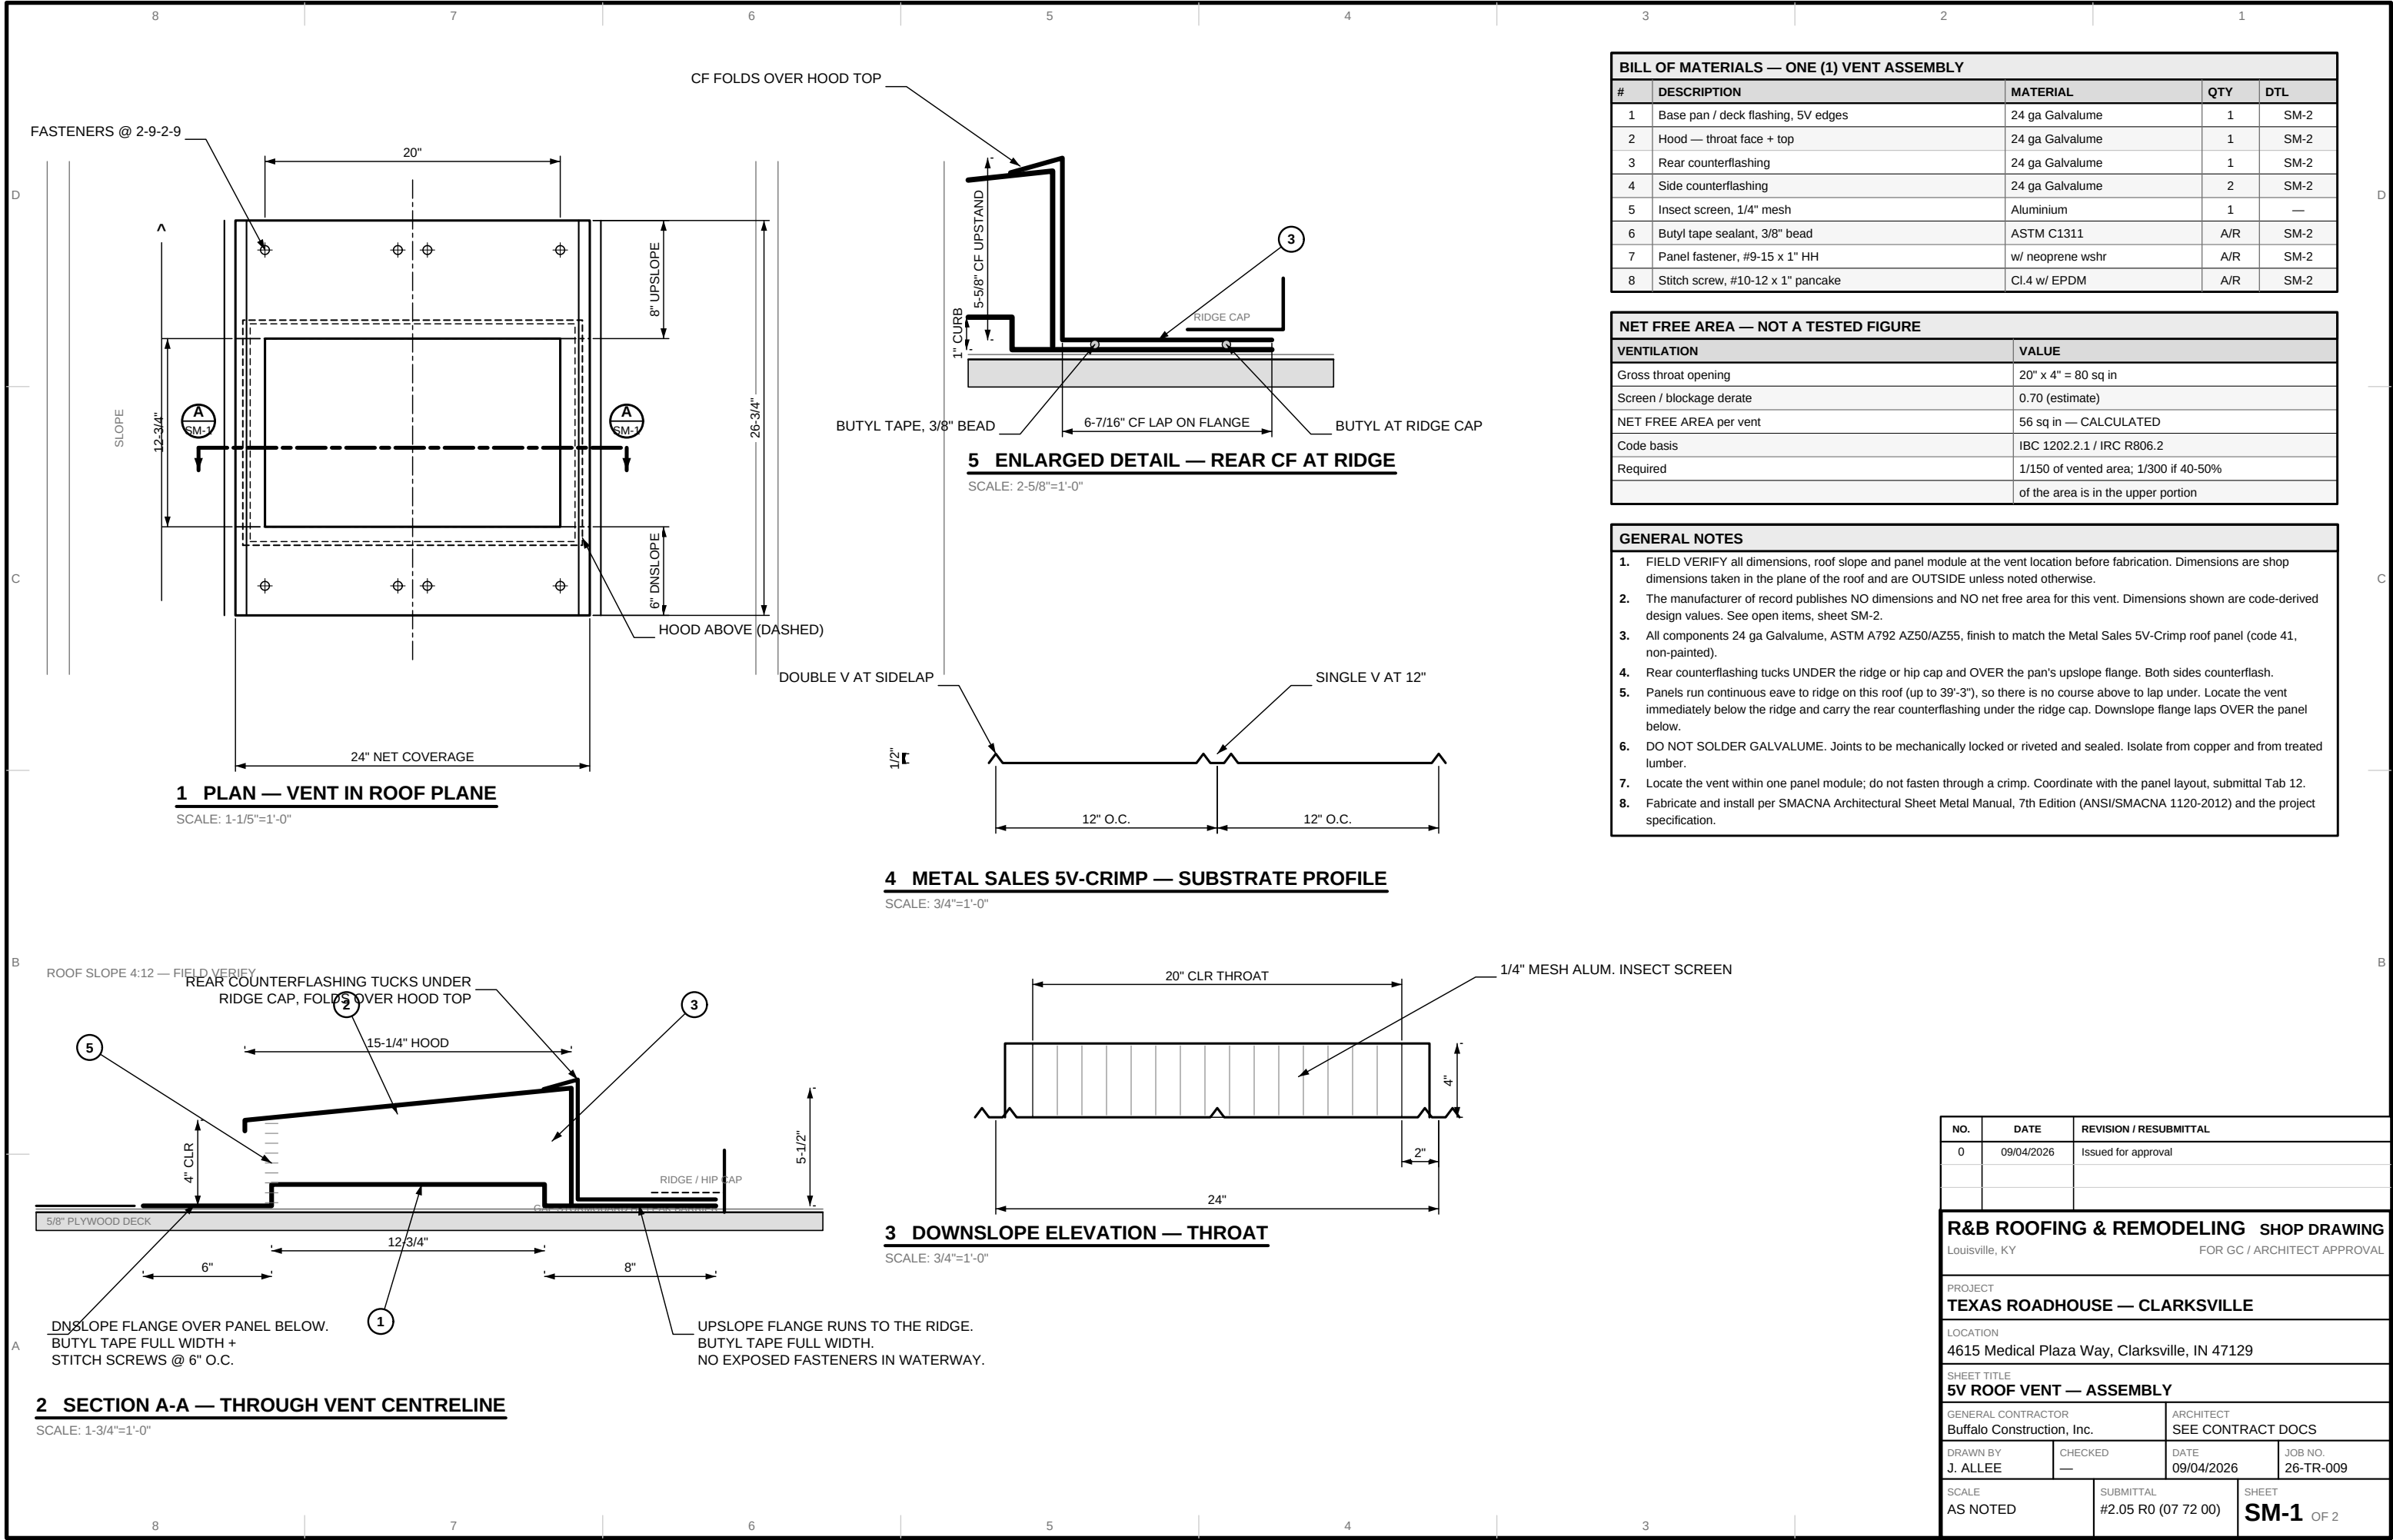

CUT LIST — PER VENT					
PART	MATERIAL	QTY	GIRTH	FLAT	BLANK L x W
1 BASE PAN	24ga galv	1	29.750"	29.555"	29.555" x 24.000"
2 HOOD	24ga galv	1	22.224"	22.118"	22.118" x 34.000"
3 REAR CF	24ga galv	1	13.850"	13.744"	13.744" x 24.000"
4 SIDE CF	24ga galv	2	8.000"	7.902"	7.902" x 15.250"

OPEN ITEMS — RESOLVE BEFORE FABRICATION	
1.	SUBMITTAL DEFECT: the Tab 9 cut sheet is titled "Proper Installation of a Vent on a STANDING SEAM Metal Roof System" and states the vent "sits on TOP of the standing seam rather than on the flat section of the panel." The TOC and tab divider call it 5V. No 5V vent literature was submitted and nothing describes how it laps into a 5V panel.
2.	Tab 9 carries NO dimensions, NO model number, NO gauge and NO net free area — it is a one-page sales flyer. Every dimension on this drawing is therefore new information not covered by the approved submittal.
3.	No metal-roof penetration detail was submitted. Metal Sales manual p.17 cross-references "ROOF PENETRATION (SEE PAGE 25)" but only manual pages 17-19 are in the binder.
4.	Net free area — not published by DCSM for any size. Ventilation compliance under IBC 1202.2.1 / IRC R806.2 cannot be demonstrated until a tested figure is obtained.
5.	No project roof slope appears anywhere in the 65-page binder; only Metal Sales' generic 3:12 minimum. Confirm the actual pitch at the vent.
6.	DCSM's own 5V spec sheet states 23-1/2" coverage while their Miami-Dade NOA 19-0109.04 drawing shows 24". The specified Metal Sales panel is 24". Confirm the vent is built to the 24" module.
7.	Sidelap double-V spread, V rib base width and V included angle are not published by Metal Sales, DCSM or the NOA. Measure from an actual panel.
8.	Fastener conflict within the binder: p.35 lists #10-14 x 1" ABMP XL, UL 580 Const. #435; p.58 cites Const. #579 & #453, which specify #9-15 x 1" Type A. Confirm which governs.
9.	Vent gauge: 26 ga to match the roof panel per DCSM's "same gauge as your main roof" rule, or 24 ga per UFGS Table I for base flashing. This drawing shows 24 ga.
10.	Quantity of vents is not stated in the submittal and no vent line item appears on the QXO cut list. Confirm count and locations.

FORMING NOTES	
1.	24 ga Galvalume, t = 0.0276" coated (0.0239" base steel, ASTM A792). Minimum inside bend radius 1t. Confirm against the mill cert.
2.	Flats developed with $K = 0.42$: $BA = (\pi/180) \cdot A \cdot (R + K \cdot t)$; $BD = 2 \cdot \tan(A/2) \cdot (R + t) - BA$. $FLAT = GIRTH - \text{sum of deductions}$.
3.	K-factor varies with tooling, temper and grain. Bend a coupon and measure before running production coil.
4.	Phantom lines are FOLD lines — do not cut.
5.	Hem all exposed edges 1/2". Corners lapped and riveted, then sealed.
6.	DO NOT SOLDER GALVALUME — the Al-Zn coating will not tin and the joint will corrode.
7.	Protect the coating: clean non-marring dies, no abrasive marking.

R&B ROOFING & REMODELING SHOP DRAWING Louisville, KY FOR GC / ARCHITECT APPROVAL			
PROJECT TEXAS ROADHOUSE — CLARKSVILLE			
LOCATION 4615 Medical Plaza Way, Clarksville, IN 47129			
SHEET TITLE 5V ROOF VENT — FABRICATION			
GENERAL CONTRACTOR Buffalo Construction, Inc.		ARCHITECT SEE CONTRACT DOCS	
DRAWN BY J. ALLEE	CHECKED —	DATE 09/04/2026	JOB NO. 26-TR-009
SCALE AS NOTED	SUBMITTAL #2.05 R0 (07 72 00)		SHEET SM-2 OF 2