

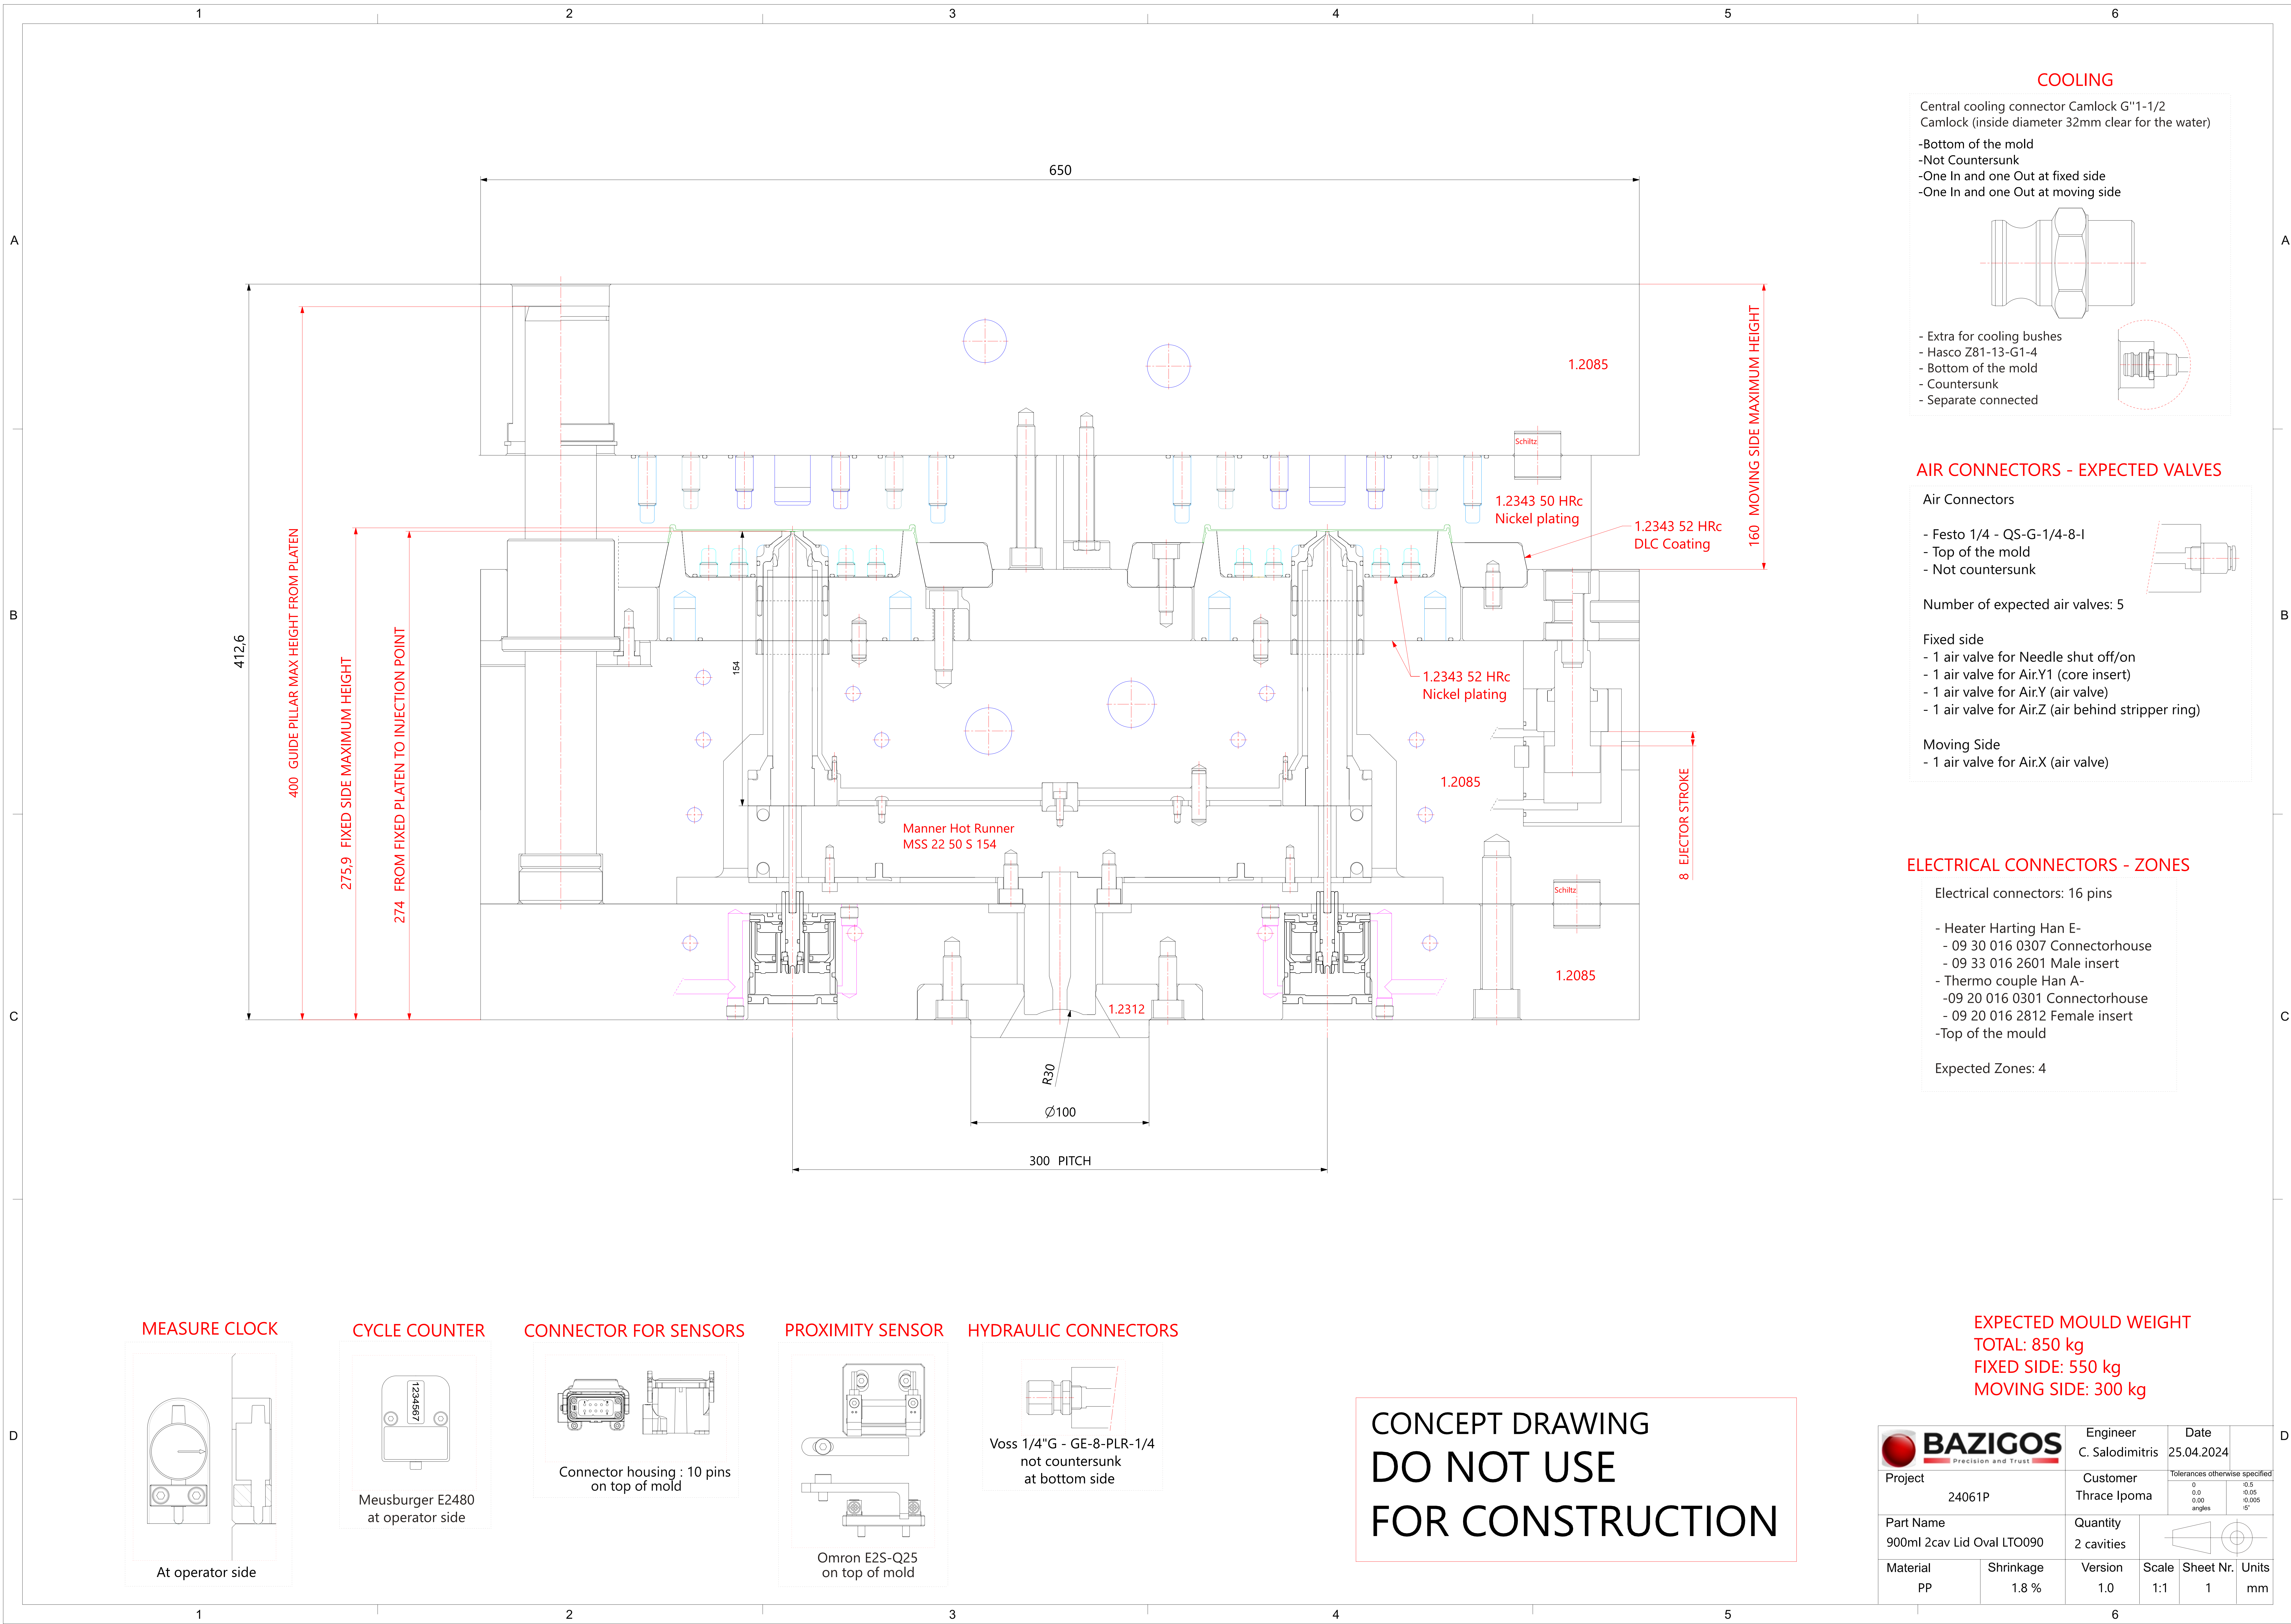


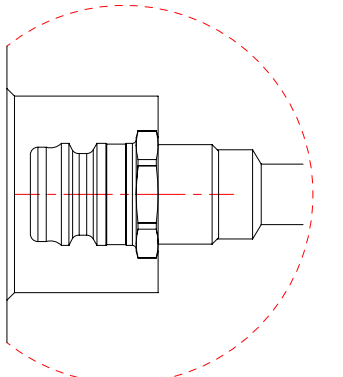

COOLING

Central cooling connector Camlock G"1-1/2
Camlock (inside diameter 32mm clear for the water)

- Bottom of the mold
- Not Countersunk
- One In and one Out at fixed side
- One In and one Out at moving side

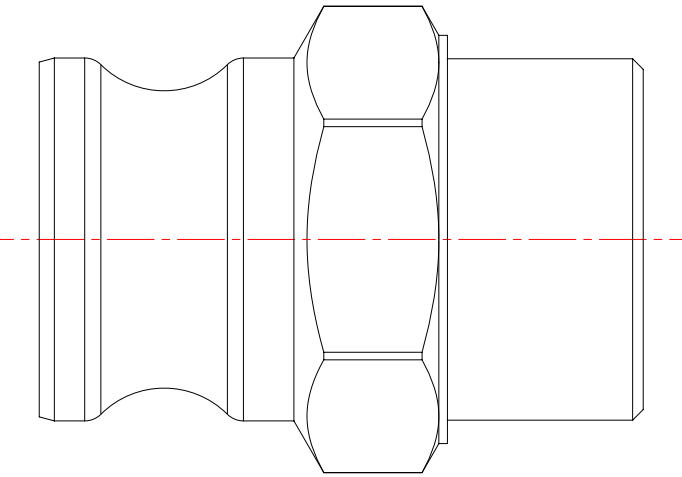


- Extra for cooling bushes
- Hasco Z81-13-G1-4
- Bottom of the mold
- Countersunk
- Separate connected

AIR CONNECTORS - EXPECTED VALVES

Air Connectors

- Festo 1/4 - QS-G-1/4-8-I
- Top of the mold
- Not countersunk

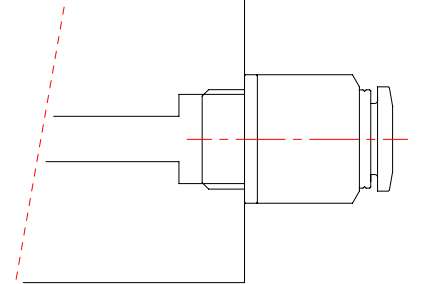

Number of expected air valves: 5

Fixed side

- 1 air valve for Needle shut off/on
- 1 air valve for Air.Y1 (core insert)
- 1 air valve for Air.Y (air valve)
- 1 air valve for Air.Z (air behind stripper ring)

Moving Side

- 1 air valve for Air.X (air valve)


ELECTRICAL CONNECTORS - ZONES

Electrical connectors: 16 pins


- Heater Harting Han E-
- 09 30 016 0307 Connectorhouse
- 09 33 016 2601 Male insert
- Thermo couple Han A-
- 09 20 016 0301 Connectorhouse
- 09 20 016 2812 Female insert
- Top of the mould

Expected Zones: 4


MEASURE CLOCK

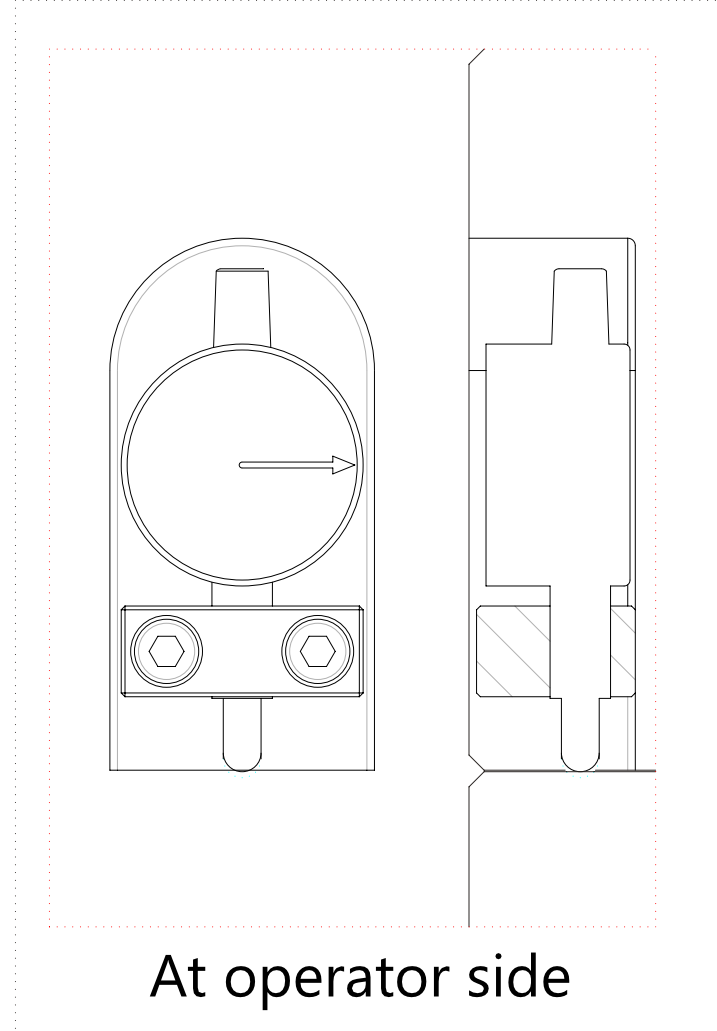


CYCLE COUNTER

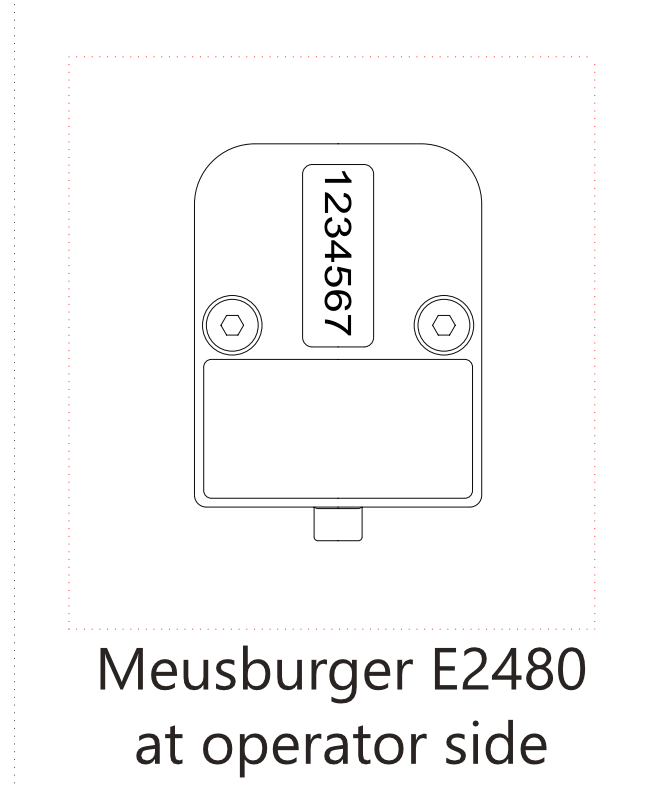


CONNECTOR FOR SENSORS

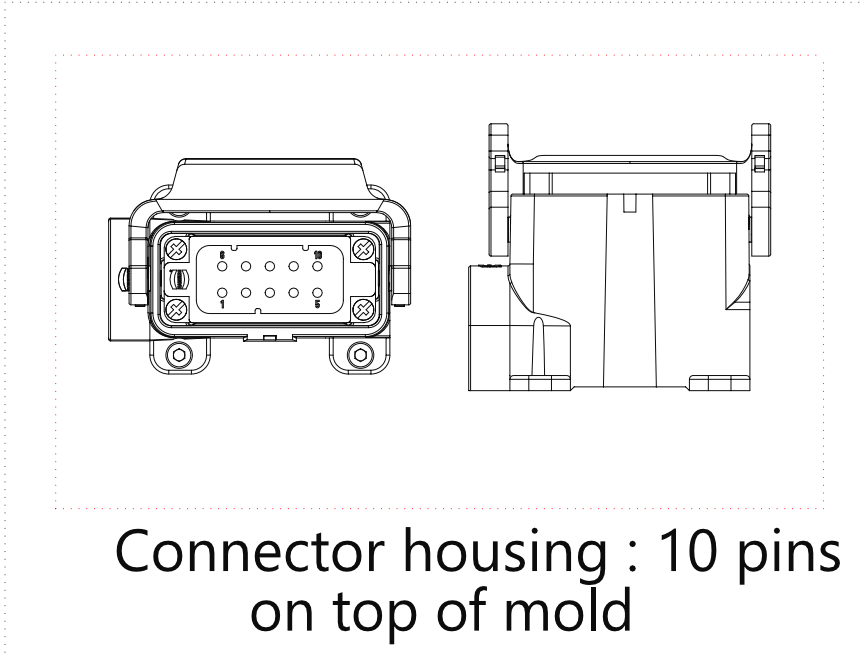

PROXIMITY SENSOR

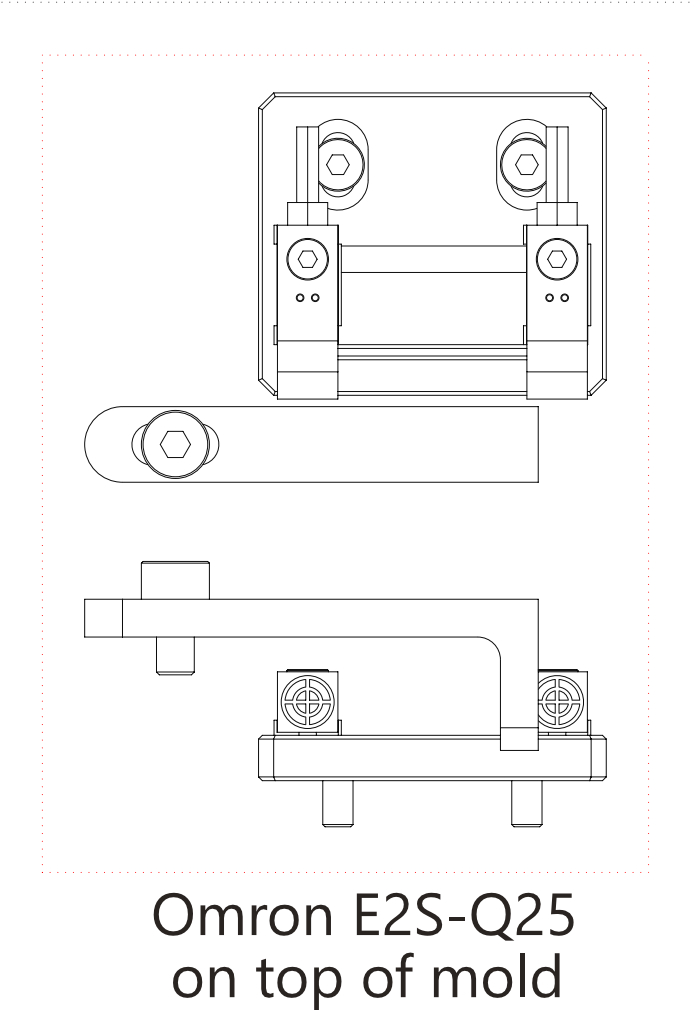


HYDRAULIC CONNECTORS

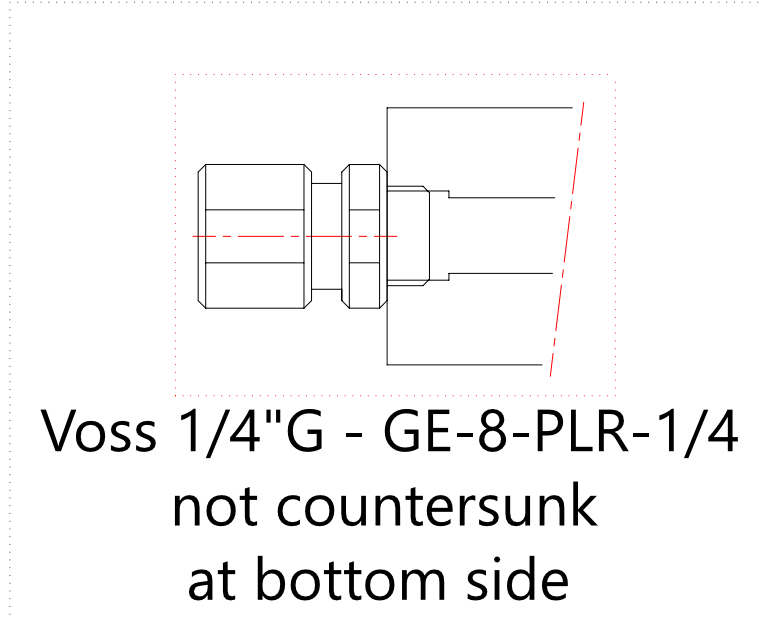

CONCEPT DRAWING
DO NOT USE
FOR CONSTRUCTION

EXPECTED MOULD WEIGHT
TOTAL: 850 kg
FIXED SIDE: 550 kg
MOVING SIDE: 300 kg

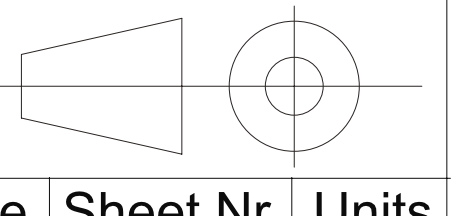 BAZIGOS Precision and Trust	Engineer C. Salodimitris	Date 25.04.2024		
	Customer Thrace Ipoma	Tolerances otherwise specified 0 0.0 0.05 angles 0.5 0.05 0.05 5°		
Project 24061P	Quantity 2 cavities	Scale 1:1	Sheet Nr. 1	Units mm
Part Name 900ml 2cav Lid Oval LTO090	Material PP	Shrinkage 1.8 %	Version 1.0	