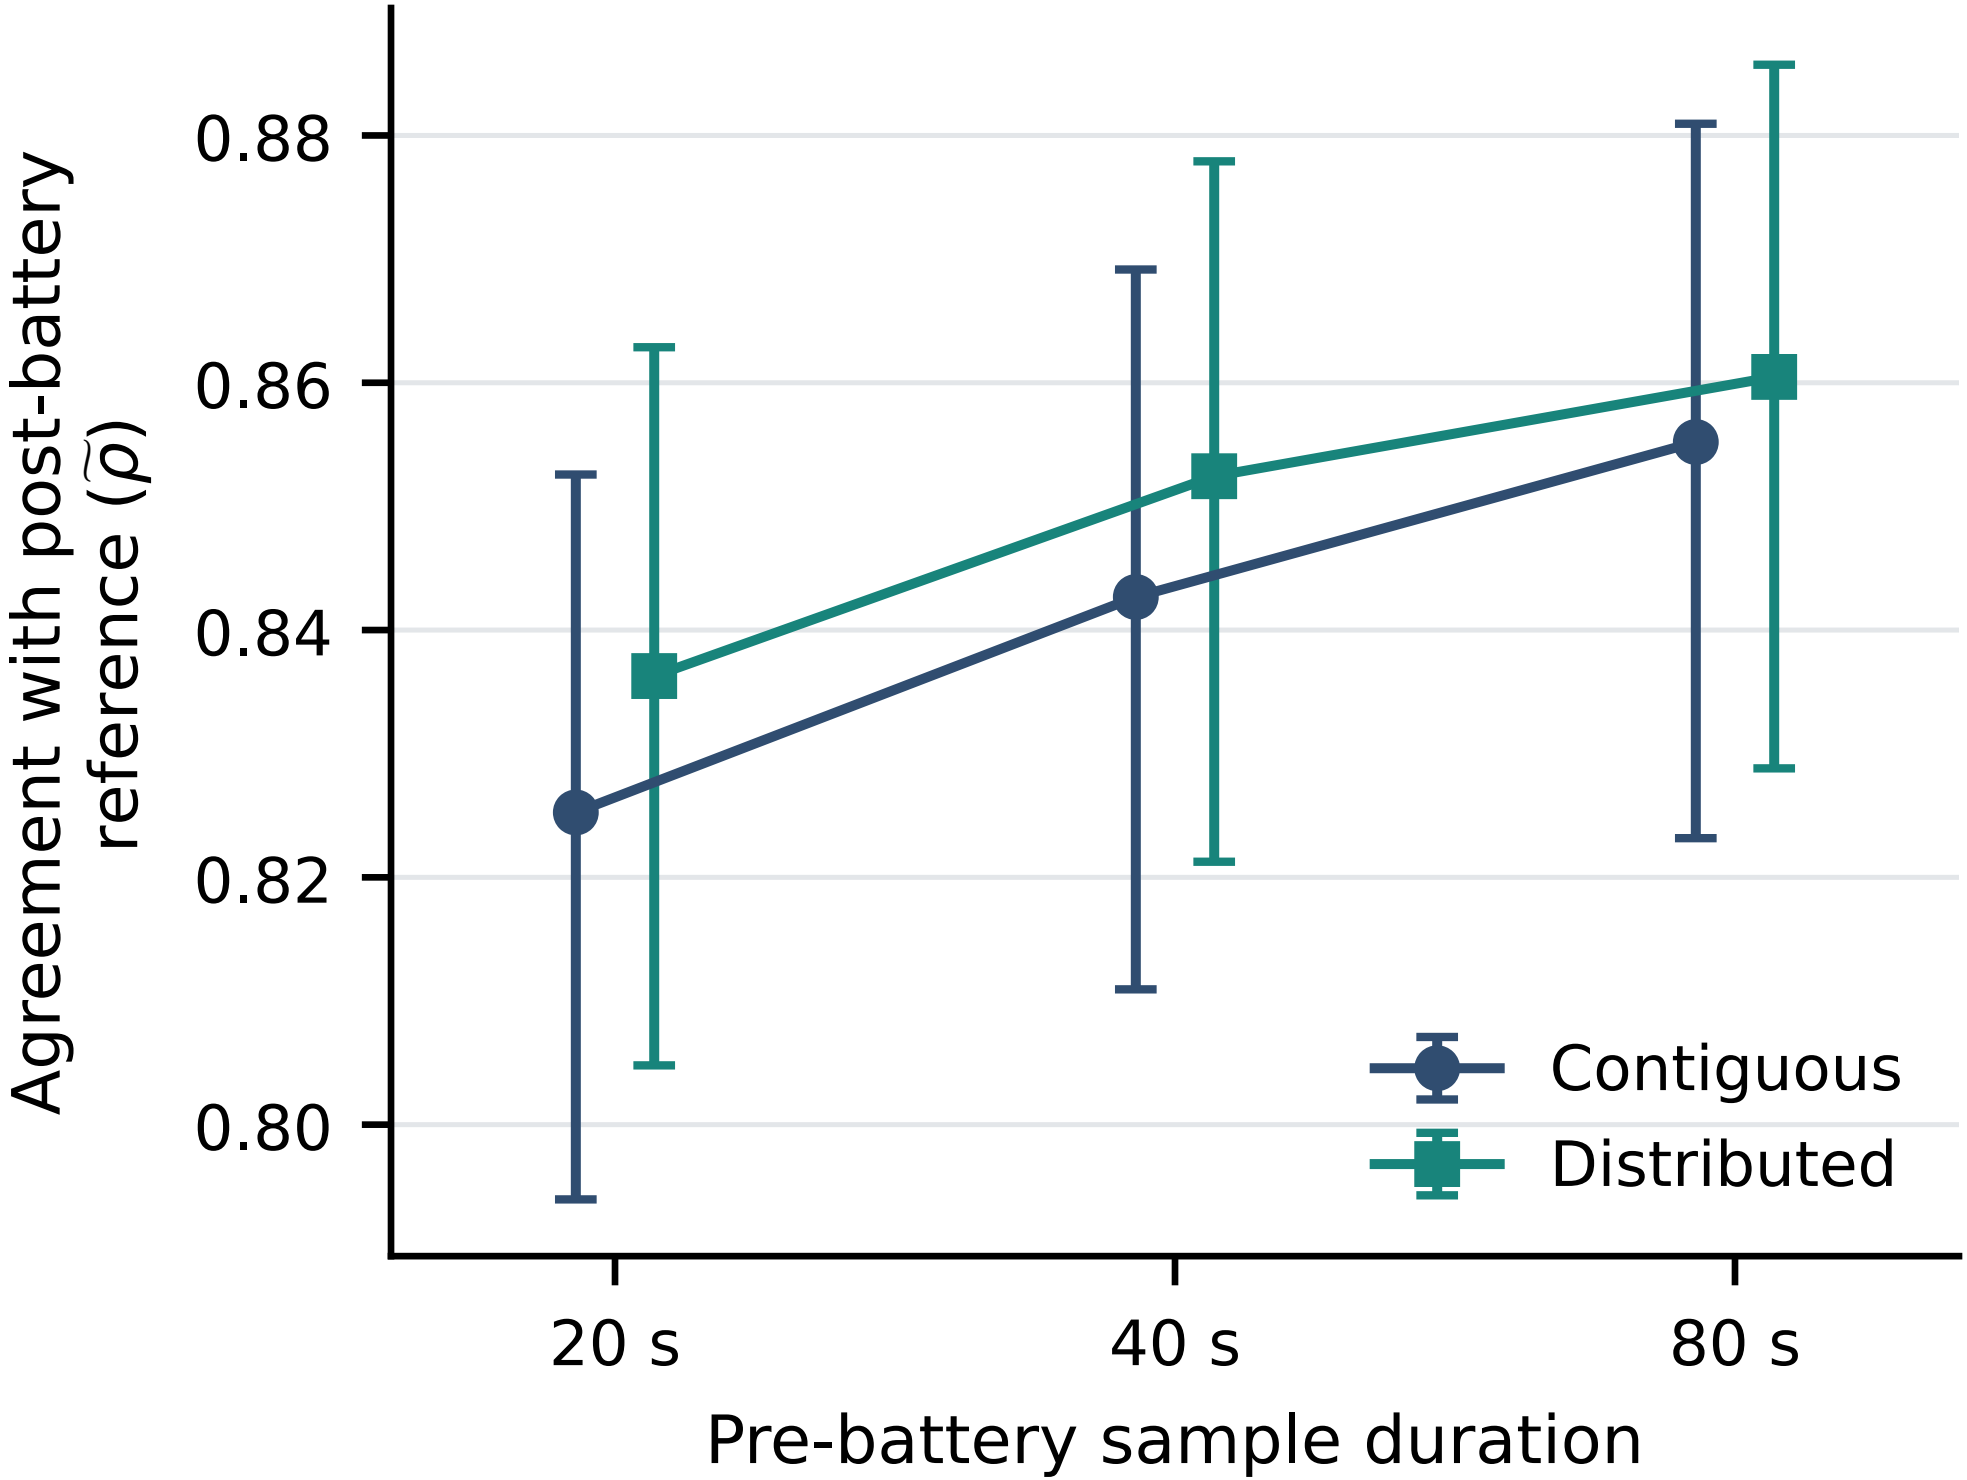
0.88
0.86
0.84
0.82
0.80
Agreement with post-battery reference ($\tilde{\rho}$)
Contiguous
Distributed
20 s
40 s
80 s
Pre-battery sample duration