

# Geospatial Analysis of Grid Alerts and Warnings - TGI Use Case Notes



## [UC21-01] - Awesense Energy Transition Platform Use Case

### Overview

This manual is intended to:


- Provide instructions to create the selected use case in True Grid Intelligence (TGI).

For more details about Geospatial Analysis of Grid Alerts & Warnings and how it can be analyzed using Awesense's Energy Transition Platform, please refer to the [UC21-01 - Geospatial Analysis of Grid Alerts and Warnings.pdf](#) document.

### TGI Use Case Notes

This document shows the implementation process of mentioned use case in the TGI visualization interface along with a description of how to create such a use case on your data.

Grid Alerts can be found directly in TGI in the main menu (select from the main menu - top hamburger icon).

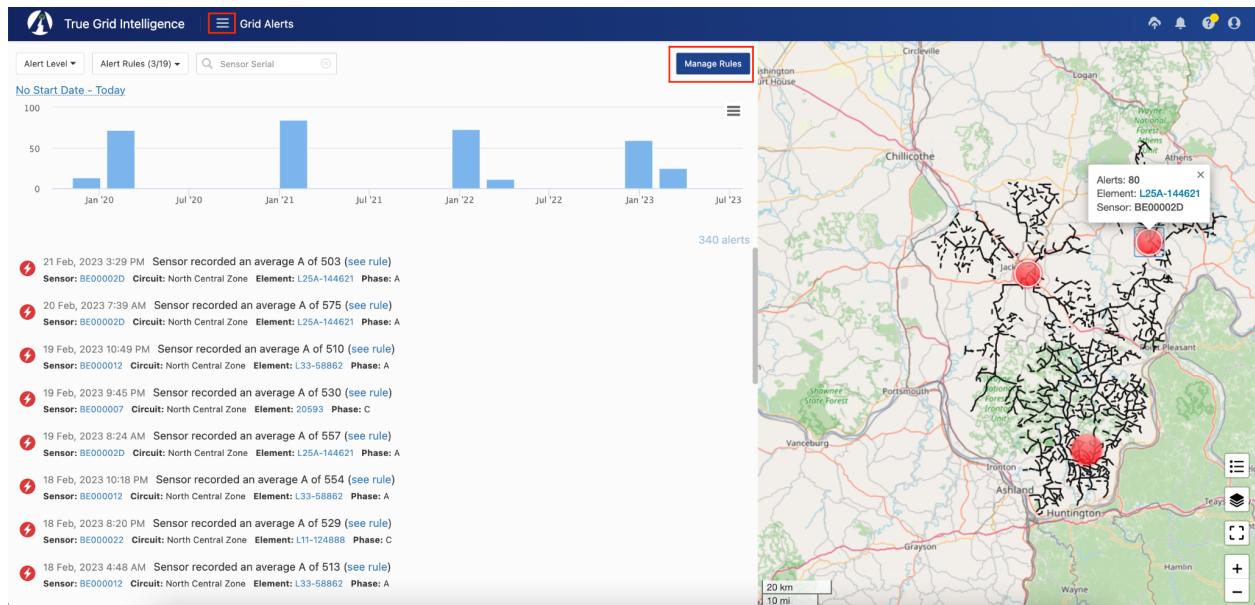

Basic interface of TGI's Grid Alerts page offer possibilities:

- to filter different alert types and warnings,
- to filter different alert rules,
- adjust the shown time period,

# Geospatial Analysis of Grid Alerts and Warnings - TGI Use Case Notes



## [UC21-01] - Awesense Energy Transition Platform Use Case

- search specific sensors' alerts,
- manage new alert rules.

The user interface further shows grid alerts and warnings in three sections:

- histogram view,
- table view,
- map view.

Creating new alerts & warnings is possible by clicking on "Manage Rules".

Alert Rules ✕

Rule Name

PF

Alert Level: Alarm

Sensor Type: Raptor

Sensor Serial:

Circuit: awefice

Element:

☐ Permanent placements only

Unit: PF

Operator: <

Threshold: 0.9

Time Interval: 1

Time Unit: minutes

An alert will be triggered if average value in provided time interval passes specified threshold.

Cancel Save

**High Current** ✎ ✕

Alert Level: Alarm

Sensor Type: Raptor

Current > 500 A on average for 5 minutes

**Low PF** ✎ ✕

Alert Level: Alarm

Sensor Type: Raptor

Power Factor < 0.65 PF on average for 1 minute

To display these alerts & warnings it is necessary to select at least some parameters - see the example in the picture. In the picture, some examples of created alerts & warnings can be seen - High Current, Low PF. Users can edit or delete existing alert rules.

### General Note

- This description was created for TGI version 3.10.0. For future versions of TGI, the process might be slightly different.
- Access to the different parts of TGI varies depending on the permissions of the user.

## Geospatial Analysis of Grid Alerts and Warnings - TGI Use Case Notes



### [UC21-01] - Awesense Energy Transition Platform Use Case

---

- Users on the Sandbox environments currently have read-only permissions, therefore, this use case may be accessible only for viewing, not creation or editing. If you are interested in the latter, please contact Awesense.
- Some of the data for this use case may be available only on Sandbox tiers 2 & 3, but not on tier 1. If you are interested in upgrading your tier access, please contact Awesense.
- For more information please contact [tools@awesense.com](mailto:tools@awesense.com).