

Work Orders - TGI Use Case Notes

[UC50-01] - Awesense Energy Transition Platform Use Case



Overview

This manual is intended to:

- Provide instructions to create the selected use case in True Grid Intelligence (TGI).


For more details about Grid Alerts & Warnings and how it can be analyzed using Awesense's Energy Transition Platform, please refer to the [UC50-01 - Work Order Management.pdf](#) document.

TGI Use Case Notes

This document shows the implementation process of mentioned use case in the TGI visualization interface along with a description of how to create such a use case on your data.

Work Orders can be found directly in TGI in the main menu (select from the main menu - top hamburger icon).

On the map, the Work orders are marked in colour according to priority. This list/table is as well located at the bottom of the map with additional information.

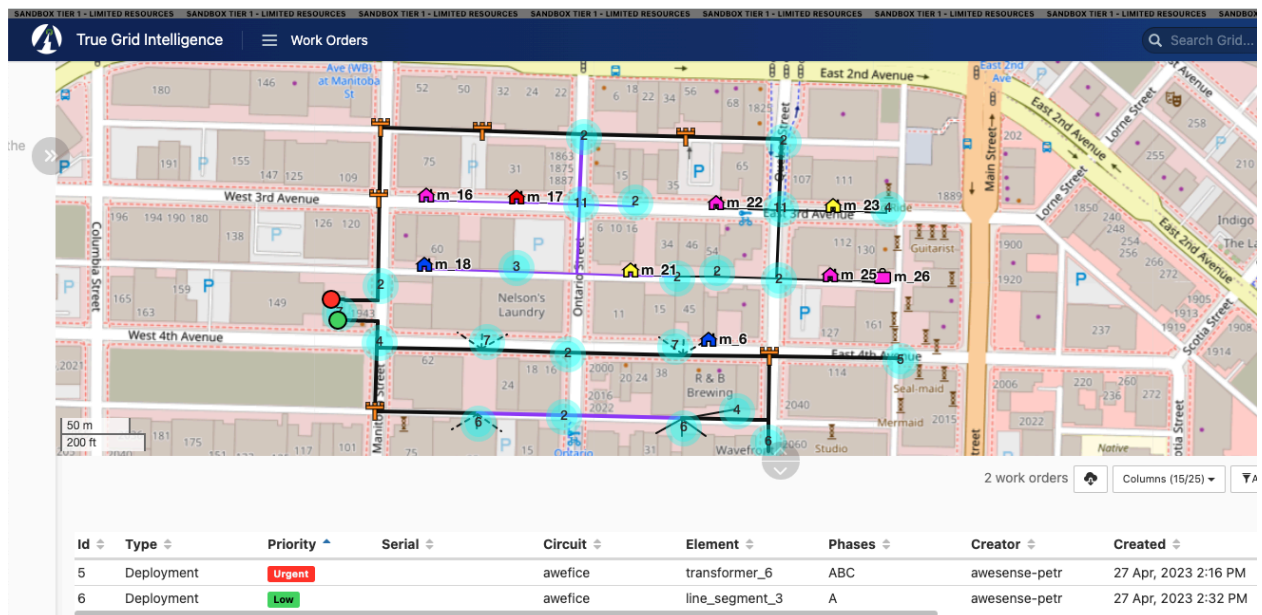

Work Orders can be created on multiple places in TGI:

1. On the Placements page:

Work Orders - TGI Use Case Notes

[UC50-01] - Awesense Energy Transition Platform Use Case



- a. After selecting one of the Placements, there is a Work Order section at the bottom of the left sidebar where you can assign a Work Order to that Placement.
2. On the Sensor page:
 - a. After clicking on the sensor serial, the work order can be created by clicking on the top right hamburger button.

The screenshot displays the True Grid Intelligence (TGI) interface. The top navigation bar includes the TGI logo and a 'Placements' menu. The left sidebar contains several sections: 'Placement' (showing 't_type' and 'voltage_level' as 'MV'), 'Time-Series Data' (a line chart for the 'Past week' showing voltage fluctuations), 'Phase Balance' (a section with a warning 'No data for the last week.'), and 'Work Order' (highlighted with a red box, showing a warning 'No work order was issued.' and an 'Issue Work Order' button).

The main area features a map of a city grid with various street names like 'West 3rd Avenue', 'West 4th Avenue', 'Columbia Street', and 'Manitoba Street'. A blue location pin is placed on the map. Below the map, a table lists various elements and their details.

Id	Category	Element Type	Circuit
switchable_element...	Planning	switchable_element	awefice
switchable_element...	Planning	switchable_element	awefice
evch_10	Investigation (bounding)	ev_charger	awefice
line_segment_3	Investigation (bounding)	line_segment	awefice
transformer_6	Investigation (bounding)	transformer	awefice

At the bottom of the table, there is a pagination control showing '10' items per page and 'Page: 1 / 1'.

The assignee of the work order can use TGI Mobile (iOS) application to execute the work order. The mobile application help to guide work order executor through the required workflow. After the work order is completed additional information can be seen on the completed work order.

Work Orders - TGI Use Case Notes

[UC50-01] - Awesense Energy Transition Platform Use Case



The screenshot displays the 'Work Order' Triage interface. It is divided into several sections: 'Triage' at the top with fields for ID (5), Priority (High), Placement (L18-52070), Reason (Accuracy), Creator (michael), Assignee (michael), Description (No Description), Phases (C), Sensor (BE00001C), Action (Restart), Created (25 Jan 2019), and Resolved (25 Jan 2019). Below this is the 'Location' section with fields for Region (North Central Zone), Sub-Region (--), Circuit (North Central Zone), Element (L18-52070), and Location (--). The 'Resolution Details' section includes 'Collected Sensors' and 'Deployed Sensors' (both listing BE00001C), a 'Raptor Measurements' table, and 'Supporting Data'. The 'Supporting Data' section contains a note about comments and photos, a link to the element's comments, and an error message: 'Error: An internal error has occurred.' A map is visible on the right side of the interface.

Raptor Measurements			
	A	B	C
Current	-	-	2
Power Factor	-	-	1

No manual line stick measurements were taken.

Supporting Data

You can find comments and photos that were taken in the field in grid element "Comments" section: [L18-52070](#)

Error: An internal error has occurred.

Information which is available after work order completion can be:

- Resolved date/time
- Element ID
- Notes & Images

This information serves as vital data for further auditing and reporting.

General Note

- This description was created for TGI version 3.10.0. For future versions of TGI, the process might be slightly different.

Work Orders - TGI Use Case Notes



[UC50-01] - Awesense Energy Transition Platform Use Case

- Access to the different parts of TGI varies depending on the permissions of the user.
- Users on the Sandbox environments currently have read-only permissions, therefore, this use case may be accessible only for viewing, not creation or editing. If you are interested in the latter, please contact Awesense.
- Some of the data for this use case may be available only on Sandbox tiers 2 & 3, but not on tier 1. If you are interested in upgrading your tier access, please contact Awesense.
- For more information please contact tools@awesense.com.