

Geospatial Analysis of Grid Alerts and Warnings -

TGI Use Case Notes

[UC21] - Awesense Platform Use Case



Overview

This manual is intended to:


- Provide instructions to create the selected use case in True Grid Intelligence (TGI).

For more details about Geospatial Analysis of Grid Alerts and Warnings and how it can be analyzed using Awesense Platform, please refer to the [UC21 - Geospatial Analysis of Grid Alerts and Warnings.pdf](#) document.

TGI Use Case Notes

This document shows the implementation process of the mentioned use case in the TGI visualization interface, along with a description of how to create such a use case on your data.

Grid Alerts can be found directly in TGI in the main menu (select from the main menu - top hamburger icon).

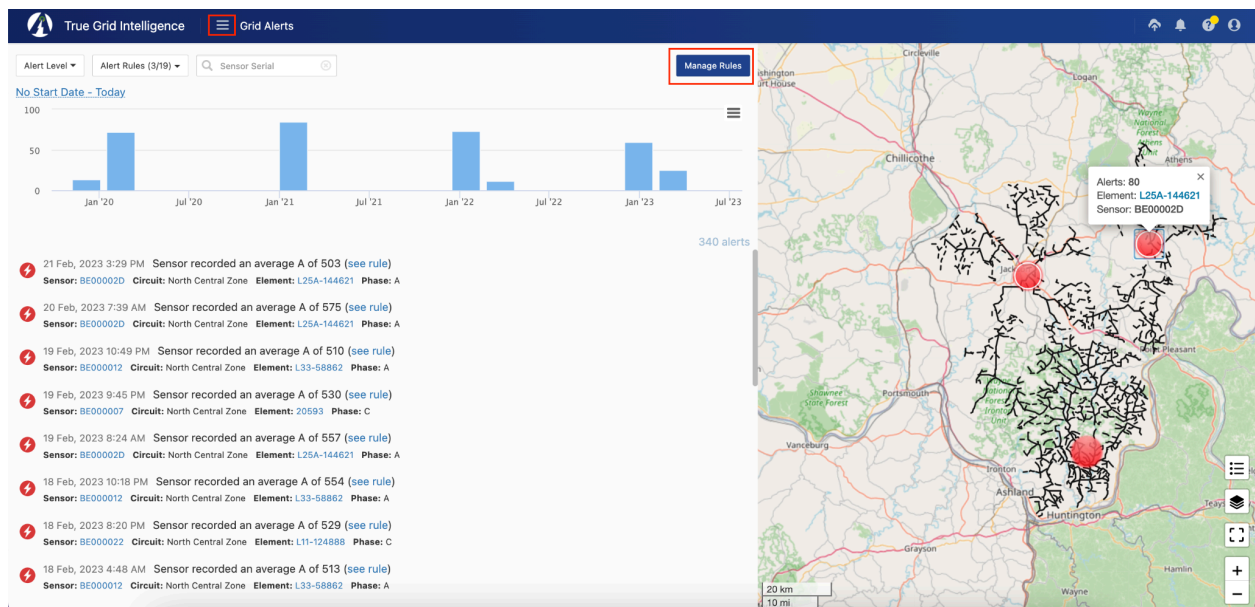

Basic interface of TGI's Grid Alerts page offer possibilities:

- to filter different alert types and warnings,
- to filter different alert rules,
- adjust the shown time period,

Geospatial Analysis of Grid Alerts and Warnings -

TGI Use Case Notes

[UC21] - Awesense Platform Use Case



- search specific sensors' alerts,
- manage new alert rules.

The user interface further shows grid alerts and warnings in three sections:

- histogram view,
- table view,
- map view.

Creating new alerts & warnings is possible by clicking on "Manage Rules".

Alert Rules ×

Rule Name

PF

Alert Level: Alarm

Sensor Type: Raptor

Sensor Serial:

Circuit: awefice

Element:

☐ Permanent placements only

Unit: PF

Operator: <

Threshold: 0.9

Time Interval: 1

Time Unit: minutes

An alert will be triggered if average value in provided time interval passes specified threshold.

Cancel Save

High Current ✎ 🗑

Alert Level: Alarm

Sensor Type: Raptor

Current > 500 A on average for 5 minutes

Low PF ✎ 🗑

Alert Level: Alarm

Sensor Type: Raptor

Power Factor < 0.65 PF on average for 1 minute

To display these alerts & warnings it is necessary to select at least some parameters - see the example in the picture. In the picture, some examples of created alerts & warnings can be seen - High Current, Low PF. Users can edit or delete existing alert rules.

General Note

- This description was created for TGI version 3.10.0. For future versions of TGI, the process might be slightly different.
- Access to the different parts of TGI varies depending on the permissions of the user.

Geospatial Analysis of Grid Alerts and Warnings - TGI Use Case Notes



[UC21] - Awesense Platform Use Case

- Users on the Sandbox environments currently have read-only permissions, therefore, this use case may be accessible only for viewing, not creation or editing. If you are interested in the latter, please contact Awesense.
- Some of the data for this use case may be available only on Sandbox tiers 2 & 3, but not on tier 1. If you are interested in upgrading your tier access, please contact Awesense.
- For more information please contact tools@awesense.com.