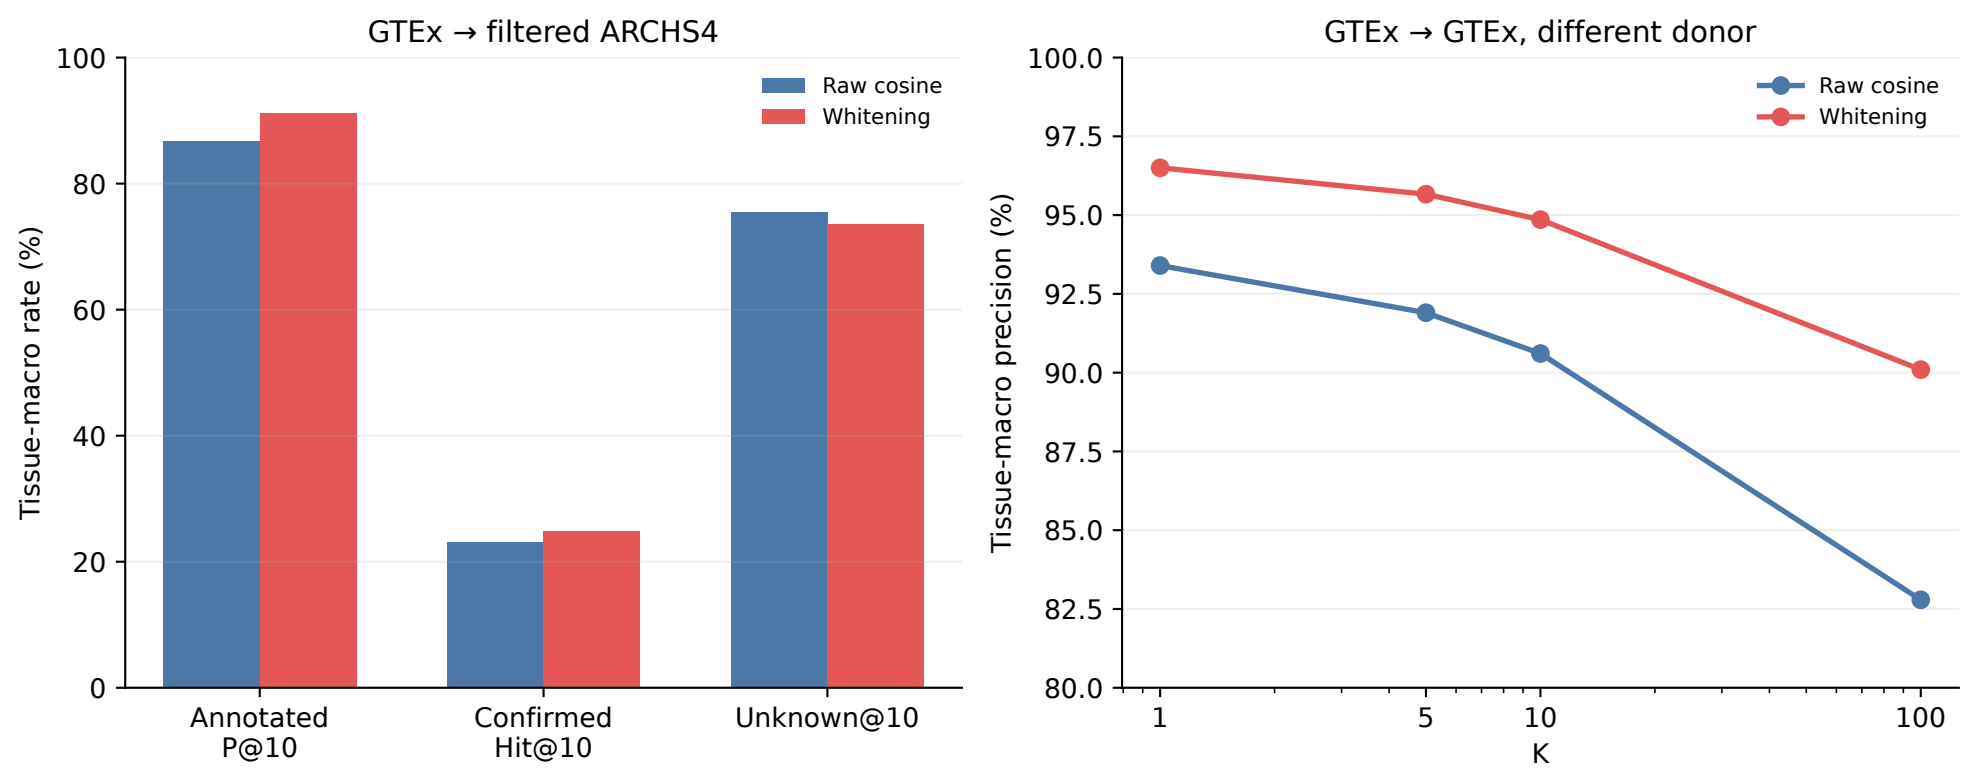
GTEx → filtered ARCHS4
Raw cosine
Whitening
Tissue-macro rate (%)
100
80
60
40
20
0
Annotated
P@10
Confirmed
Hit@10
Unknown@10
GTEx → GTEx, different donor
Raw cosine
Whitening
Tissue-macro precision (%)
100.0
97.5
95.0
92.5
90.0
87.5
85.0
82.5
80.0
1
5
10
100
K