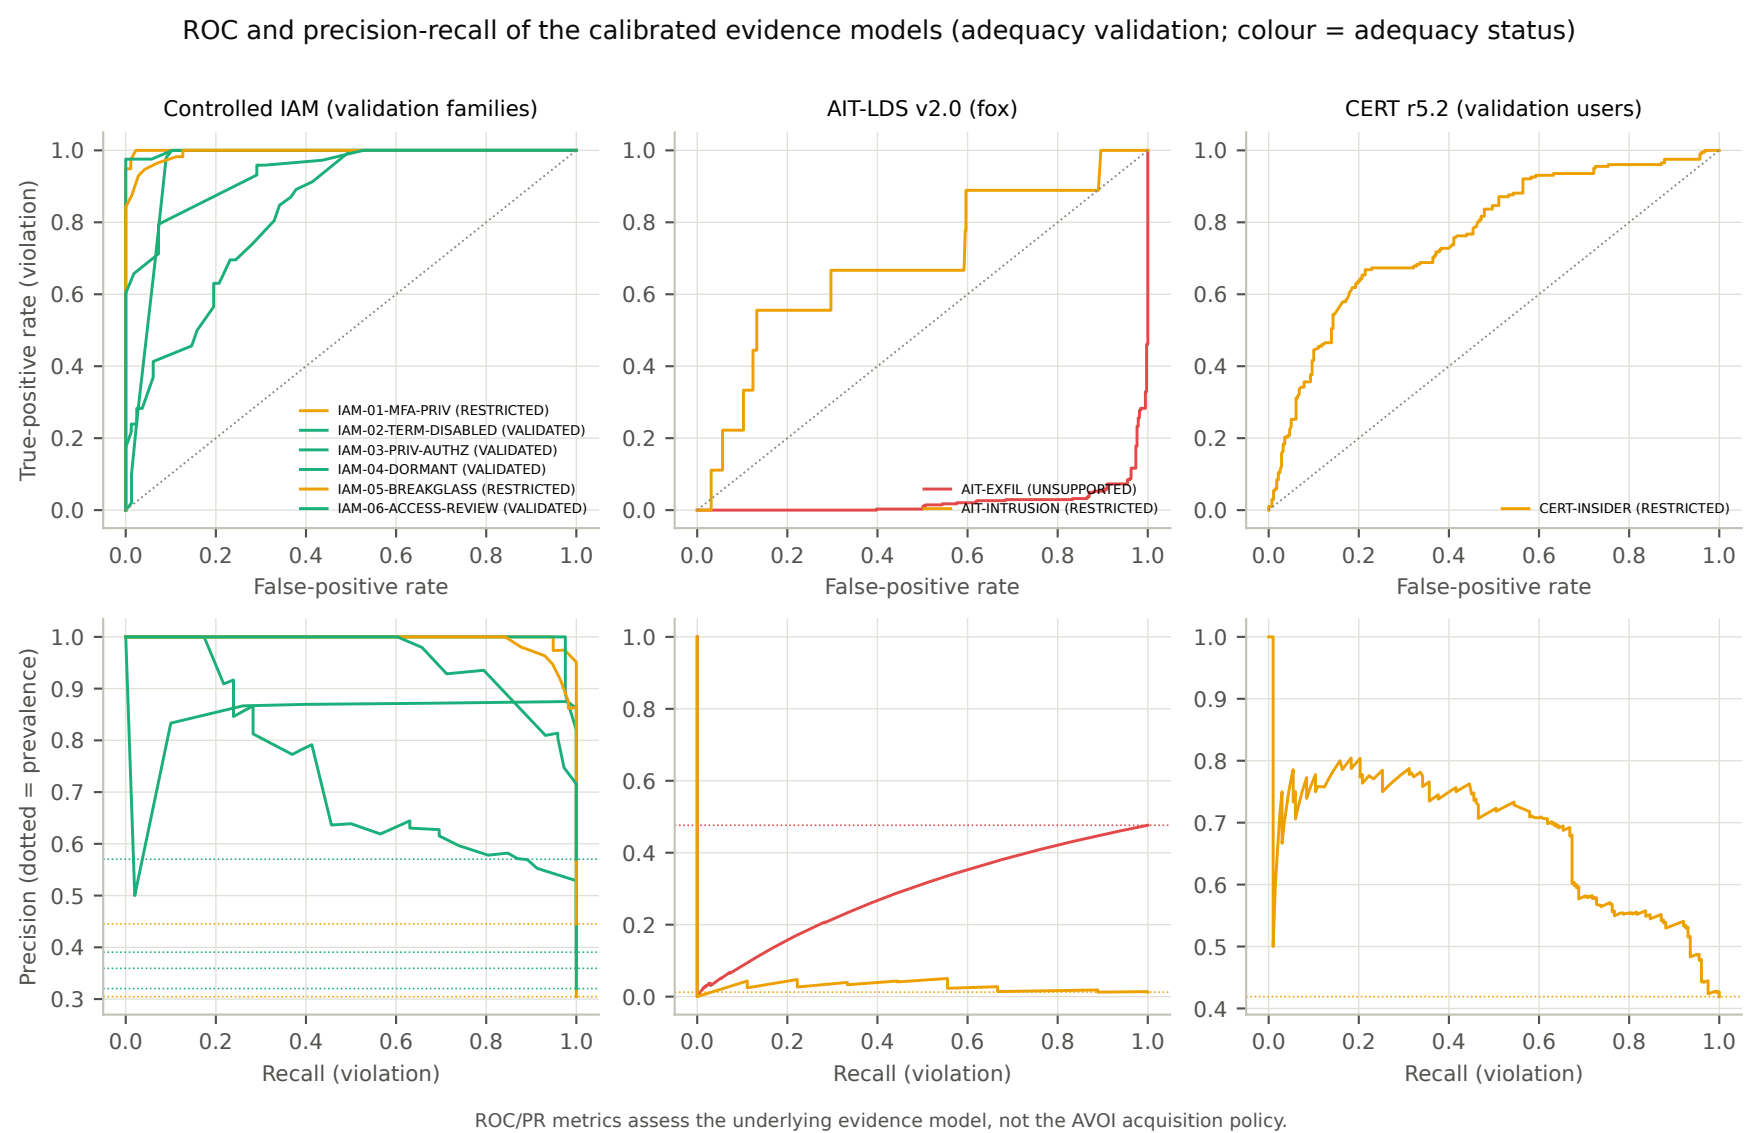
ROC and precision-recall of the calibrated evidence models (adequacy validation; colour = adequacy status)
Controlled IAM (validation families)
AIT-LDS v2.0 (fox)
CERT r5.2 (validation users)
True-positive rate (violation)
False-positive rate
IAM-01-MFA-PRIV (RESTRICTED)
IAM-02-TERM-DISABLED (VALIDATED)
IAM-03-PRIV-AUTHZ (VALIDATED)
IAM-04-DORMANT (VALIDATED)
IAM-05-BREAKGLASS (RESTRICTED)
IAM-06-ACCESS-REVIEW (VALIDATED)
AIT-EXFIL (UNSUPPORTED)
AIT-INTRUSION (RESTRICTED)
CERT-INSIDER (RESTRICTED)
Precision (dotted = prevalence)
Recall (violation)
ROC/PR metrics assess the underlying evidence model, not the AVOI acquisition policy.