

VMC Water Flow — Daily Analysis Report

Benchmark: last calendar month | Report day: most recent complete day | Generated: 08 Aug 2026 11:43 IST

Tag: DLP-4954-A

PostgreSQL tag: VMC.DLP1.JAM.JAM-4954.Tags.FMA.AI1

QoS Score: 66.6%

Summary

Metric	Value	Metric	Value
Readings	79	QoS Score	66.6%
Average Flow	66.5 m³/hr	Status	POOR
Peak Flow	162.1 m³/hr	Supply Windows	1
Spike Anomalies	0	Night Anomalies	0
Total Final Anomalies	0	Peak Time	2026-08-07 20:23

Benchmark supply slots (last month)

Window threshold = 23.22 m³/hr (10% of meter peak 232.16 m³/hr). Timings below this are ignored as passing/low flow.

Slot	Start	End	Duration	Peak (m³/hr)	Avg (m³/hr)	Samples
#1	00:01	23:56	1436 min	204.8	45.4	5
#2	04:43	23:10	1108 min	197.1	58.6	2
#3	05:44	23:57	1093 min	222.5	52.0	1
#4	06:53	22:27	932 min	109.1	62.4	18
#5	13:46	18:52	305 min	112.5	112.5	1
#6	15:41	23:56	495 min	103.8	103.8	1


Supply Windows

#	Start	End	Duration (min)	Peak (m³/hr)	Avg (m³/hr)
1	05:02	22:23	1041	162.1	69.2


Benchmark Anomalies

#	Description
1	End time off by 47 min (benchmark: 23:10)
2	Duration deviated by 66 min (benchmark: 1108 min)

24-hour flow with anomalies and benchmark

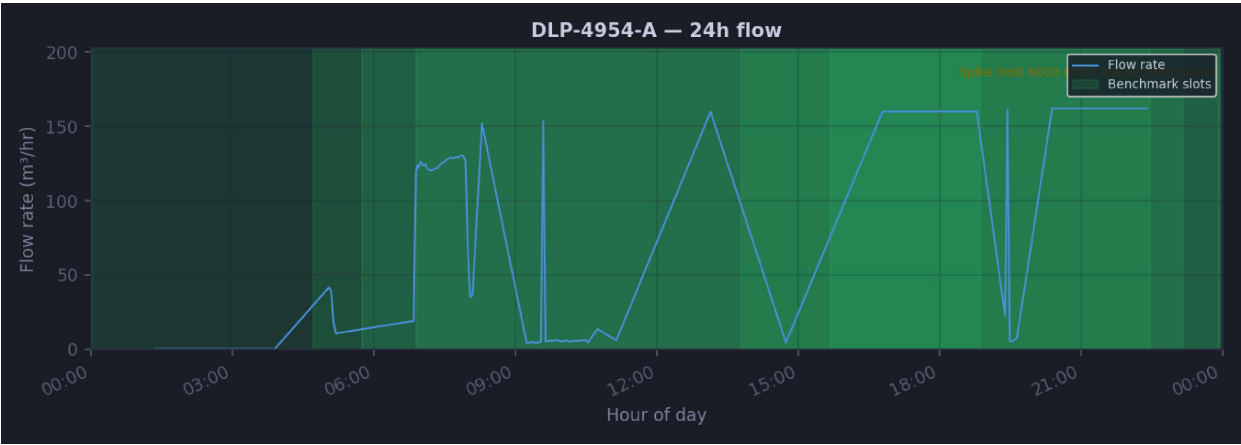

Today's flow vs last-month median pattern band

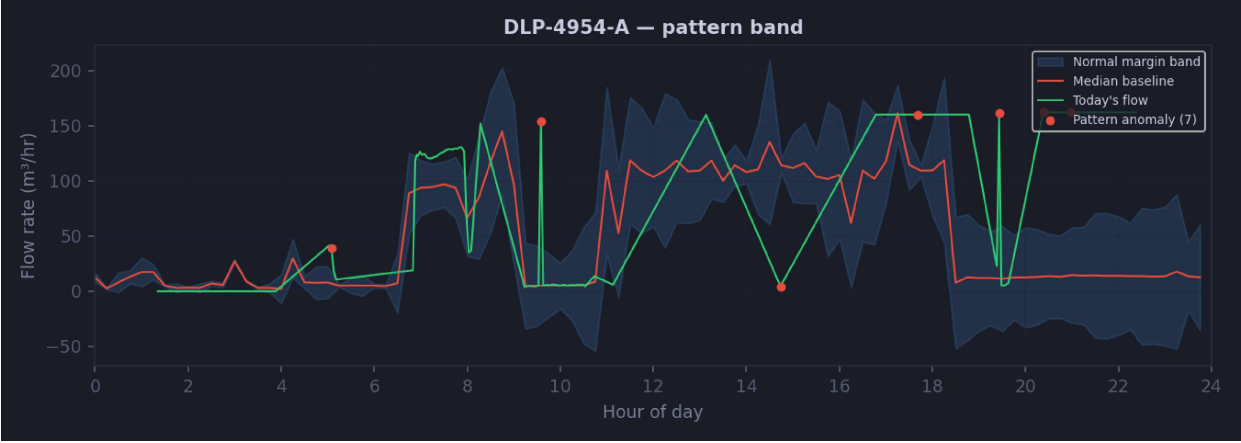

Tag: DLP-4962-B

PostgreSQL tag: VMC,DLP2,JAM,JAM-4962,Tags,FMB,BI1

QoS Score: 78.1%

Summary

Metric	Value	Metric	Value
Readings	396	QoS Score	78.1%
Average Flow	310.3 m³/hr	Status	GOOD
Peak Flow	404.3 m³/hr	Supply Windows	1
Spike Anomalies	0	Night Anomalies	0
Total Final Anomalies	0	Peak Time	2026-08-07 23:56

Benchmark supply slots (last month)

Window threshold = 66.89 m³/hr (10% of meter peak 668.86 m³/hr). Timings below this are ignored as passing/low flow.

Slot	Start	End	Duration	Peak (m³/hr)	Avg (m³/hr)	Samples
#1	00:10	23:57	1429 min	572.7	342.6	5
#2	05:20	23:26	1085 min	478.4	368.7	2

#3	06:50	23:59	1027 min	315.4	292.7	20
#4	07:45	23:26	941 min	331.6	320.8	2
#5	10:31	23:59	807 min	301.0	300.8	1


Supply Windows

#	Start	End	Duration (min)	Peak (m³/hr)	Avg (m³/hr)
1	06:48	23:59	1031	404.3	359.2

Benchmark Anomalies

#	Description
1	Peak flow deviated by 28% (benchmark: 315.4 m³/hr)
2	Avg flow deviated by 23% (benchmark: 292.7 m³/hr)

24-hour flow with anomalies and benchmark

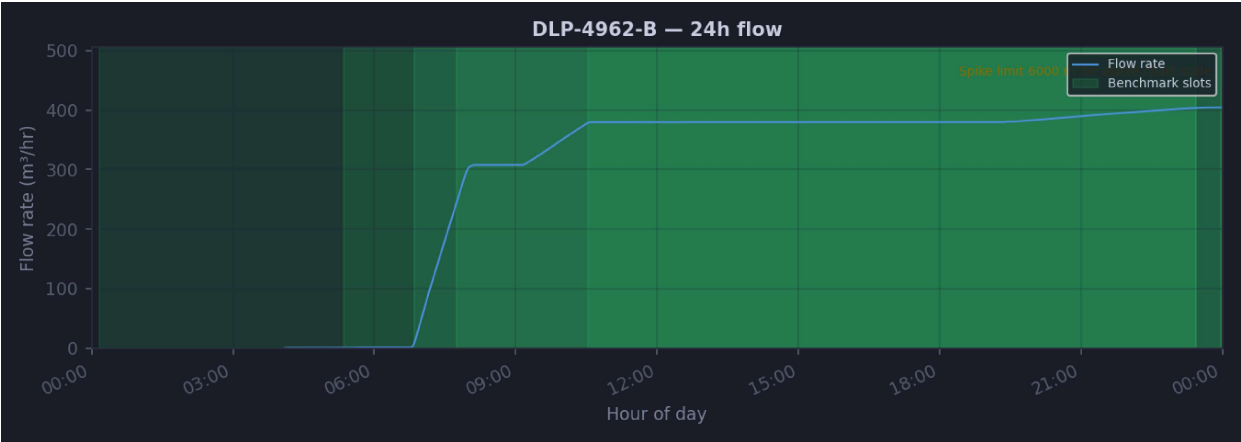

Today's flow vs last-month median pattern band

