
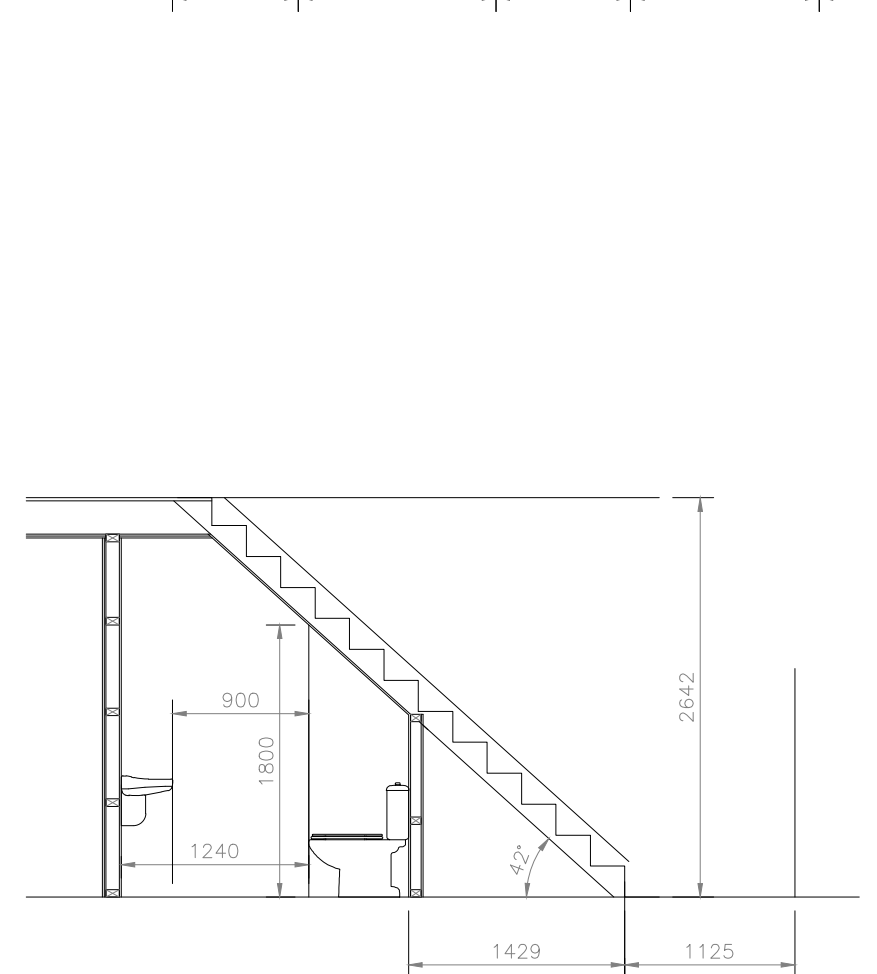


FIRST FLOOR PLAN

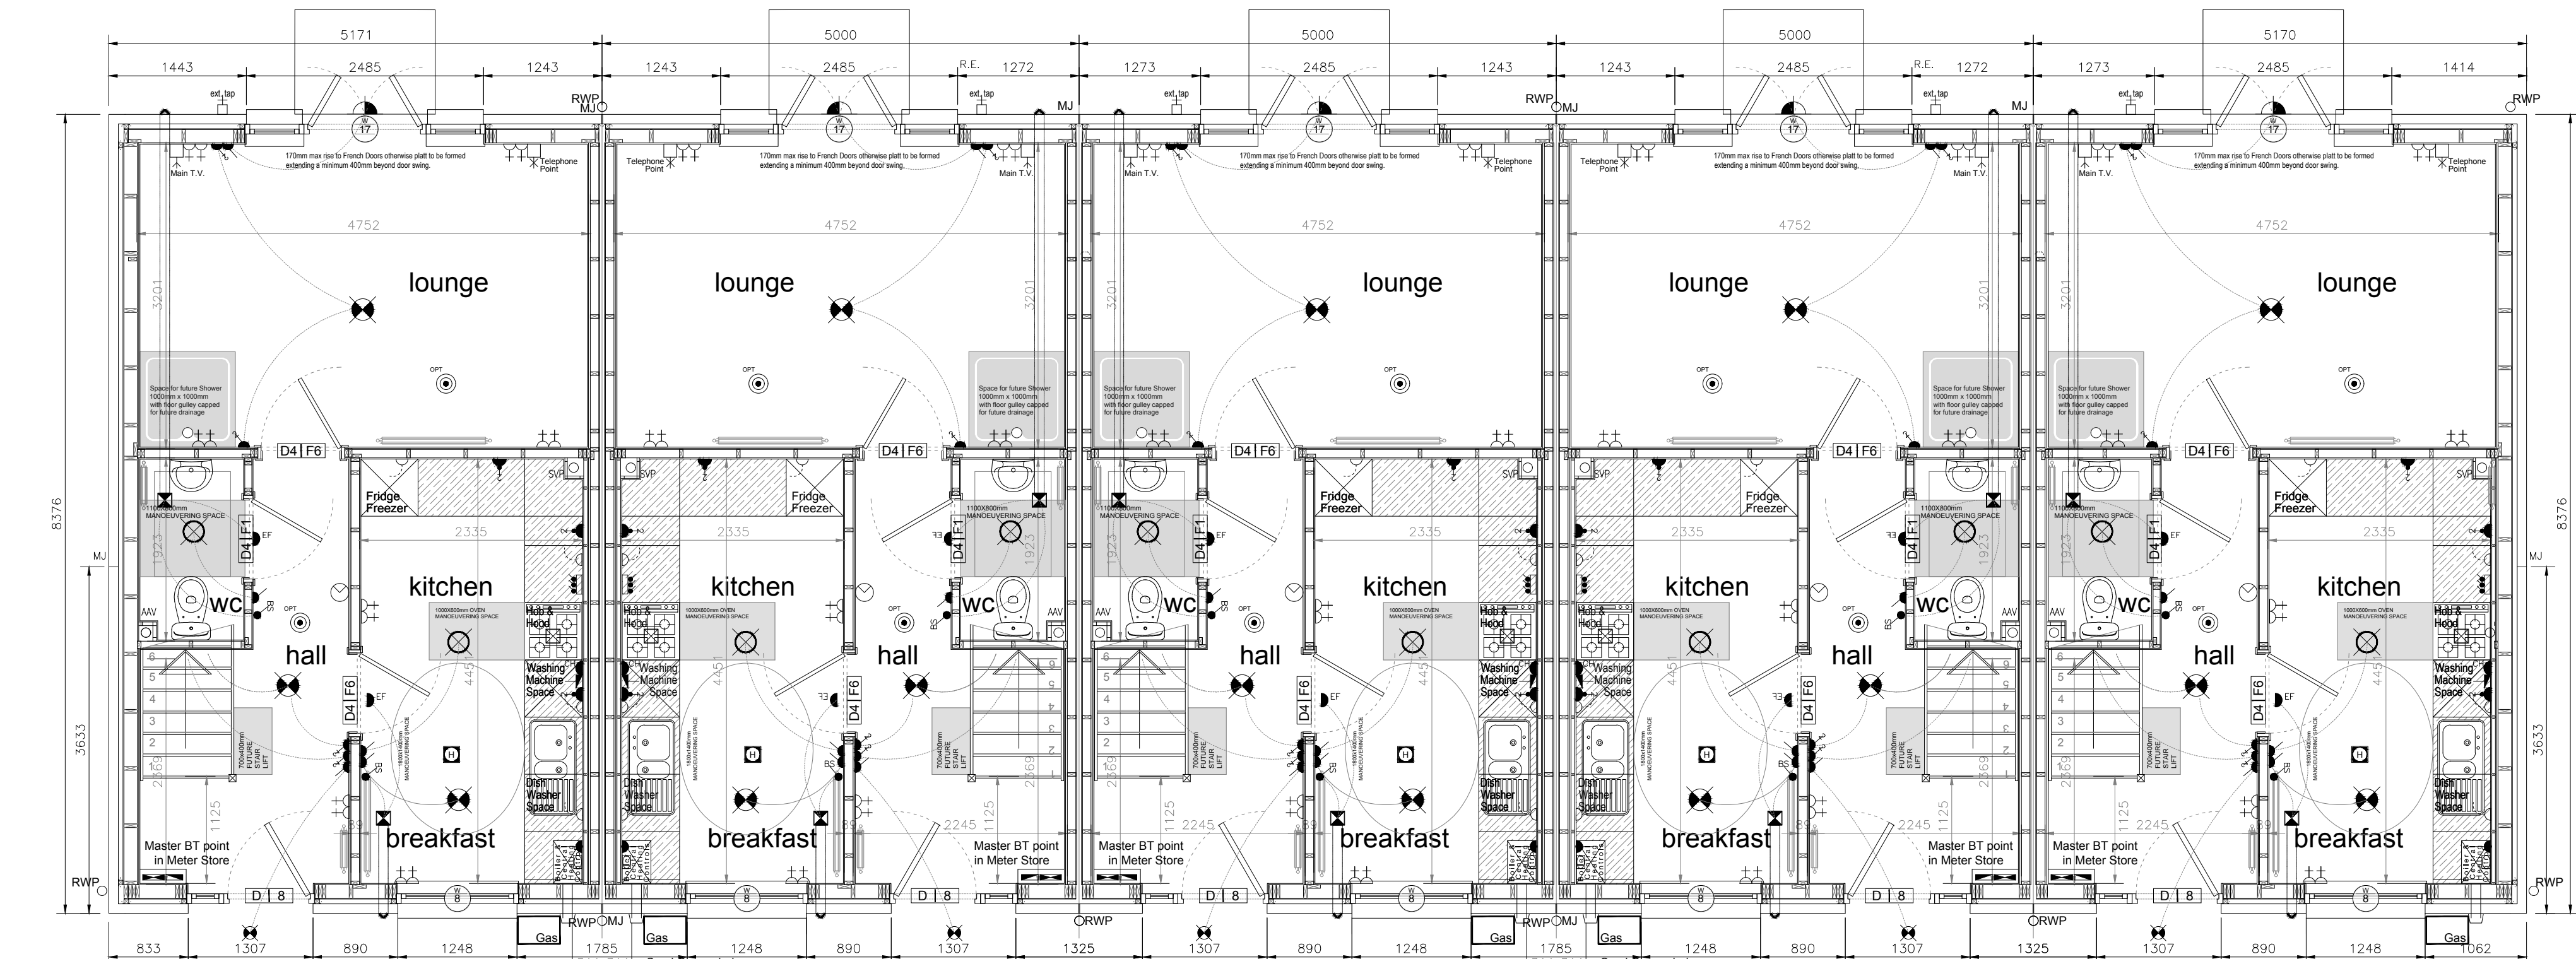

WC SECTION 1:50

GENERAL NOTES

- All works to be in accordance with current Building [Scotland] Regulations.
- No dimensions are to be scaled from this or any other associated drawing.
 - The dwelling has been designed and will be built following the guidance in the Accredited Construction Details [Scotland].
 - No H.A.C. to be used in the works.
 - All works are to be carried out in a tradesman like manner and in accordance with all current British Standards and Code of Practice.
 - All Carpentry timber to be treated with pressure impregnated preservative 'Supatimba ST15' in accordance with BS 4072: BS 5268 part 5.
 - All structural timber shall be in accordance with BS 5268: part 2: 2001 and BS 5268: part 3: 1998.
 - All materials and workmanship not otherwise specified shall be in accordance with the current British Standards, Code of Practice and NBS guidelines including all amendments to date.
 - Minimum distance of 1m from dwellings to boundaries.
 - A minimum of 1800mm Headroom to be provided over activity spaces and Showers.
 - Access and facilities to dwellings - To comply with current Building [Scotland] Regulations and Scottish Building Standards Part 4.2. All new access doors within accessible storey will have a minimum clear opening width of not less than 800mm as detailed in Part 4.2.2.6 within the Accessible entrance to have low threshold in accordance with Part 4.1.8.4.1.3.
 - Collision with projections - All parts of the building and access paths to comply with current Building [Scotland] Regulations & Part 4.8.1.6.1 of the Scottish Building Standards.
 - Collision with Glazing - All glazing to comply with current Building [Scotland] Regulations and to comply with BS 6262: Part 4: 2005.
 - All Electrical installations are to be carried out in accordance with the current I.E.E. (17th Edition) Regulations. Including all necessary earth bonding and earthing. All electrical works to be carried out in accordance with BS 7671 (2008) as amended.
 - 100 percent of lighting points to be fitted with low energy bulbs.
 - Automatic (PIR) illumination to be provided to all accessible entrances. Max. 100 watts per fitting in access with BS EN 12066-2: 2000.
 - All Drainage to be carried out and tested to the entire satisfaction of the local authority, Building Control Department and in compliance with current Building [Scotland] Regulations & to comply with part 3.6 & 3.7 of the Scottish Building Standards.
 - Rainwater gutters and down pipes to comply with BS EN 12056-3: 2000.
 - Surface water drainage system to be tested to BS EN 1610: 1998.
 - Sanitary pipe work to comply with BS EN 12056-2: 2000.
 - Drainage system to comply with BS EN 12056-1: 2000, BS EN 752-3: 1997 (amendment 2) BS EN 752-4: 1998 and BS EN 1610: 1998 and ventilated in accordance with BS EN 12056-2: 2000.
 - Waste water drainage system under and around the building to be tested in accordance with BS EN 1610: 1998.
 - Sanitary pipework tested in accordance with BS EN 12056-2: 2000.
 - Air admittance valves to be installed in accordance with BS EN 12380: 2002 (Where required an air inlet grille to be provided on stack house).
 - Dual flush WCs will have an average flush volume of not more than 4.5 litres.
 - Plumbing - Single flush WCs will have a flush volume of not more than 4.5 litres. Tap saving wash in hot and cold basins will have a flow rate of not more than 6 litres/min. Anti-Scald valve to be fitted to bath taps, limiting water temperature to 42°C.
 - Interstitial condensation - All walls, roofs and floors to comply with Part 3.15.10.15.3 of the Scottish Building Standards and comply with current Building [Scotland] Regulations and Appendix D and Clause 9.1.1 to 9.5.5.2 of BS 5250:2011. Eaves ventilation provided at the equivalent to a continuous 10mm gap. Where roof pitch exceeds 35° the span exceeds 10m ridge ventilation to be provided equivalent to a continuous 5mm gap. All lean to roofs with accommodation below to be provided with adjacent ventilation equivalent to a continuous 5mm gap where roof abuts main house wall. Where Tilt Vents are used, number of vents required to be confirmed by roofing contractor.
 - Ventilation - All window trickle ventilators to provide not less than:
 - 12000mm² to Apartments
 - 10000mm² to Kitchens, Utility Room, Bathroom, WCs and ShowerIf trickle ventilation is ducted the above amounts should be doubled. Trickle ventilators to be positioned minimum 1750mm above floor level.
 - All Mechanical Ventilation to comply with current Building [Scotland] Regulations, Part 3.14.1.1 of the Scottish Building Standards, and the C.I.B.S.E. Regulations 1998.
 - When the infiltration rate is not less than 3m³/h/m² @ 50 Pa, Decentralised Mechanical Exhaust (DMEV) units should be installed in rooms where there is likely to be high humidity such as Kitchens, Bathrooms and Shower Rooms. DMEV should be designed, installed and commissioned to provide minimum continuous extraction rates in accordance with the following:
 - Kitchen 6 litres/sec with 12 litres/sec boost
 - Utility room 4 litres/sec with 8 litres/sec boost
 - Bathroom 4 litres/sec with 8 litres/sec boost
 - Toilet 3 litres/sec with 6 litres/sec boost
 - Heating - Boiler, Hot Water Cylinder and Heating Controls to be as specified in SAP 2012 circulation. Radiators to have panels and grilles. T.R.V.'s to all rooms except room with thermostat. Heating system to comply with Parts 11.2.1.3.1.7.4 and 11.7.5 of the Scottish Building Standards. The gas appliance is to carry a CE mark in accordance with the Gas Appliance (Safety) Regulations 1998. Condensate from condensing boilers to be plumbed into adjacent house plumbing system at kitchen sink or sink in garage. Where the gas appliance is located within an appliance compartment, cooling air is to be supplied in accordance with BS 5440: Part 2: 2000.
 - Heating and hot water system will be commissioned and tested prior to handover. Manufacturer's instructions for the operation and maintenance of the system will be provided for the building occupier to encourage optimum efficiency in the conservation of fuel and power.
 - The Heating system should be designed to be capable of maintaining temperatures of 21° C in at least 1 apartment and 18° C elsewhere, when the outside temperature is minus 1° C.
 - Fire Detection - Provide 1 No. smoke detector per storey, 1 No. to Principal Room, 1 No. Heat detector to Kitchen all with standby supply complying with BS 5446: Part 1: 2000 of Part 2.11.10.1.2.1.2 of the Scottish Building Standards and complying with and installed with the provision of current Building [Scotland] Regulations, see table for type & location.
 - Carbon Monoxide Detector - Detectors to comply with BS EN 60211:2010 and be powered by a battery designed to operate for the working life of the detector. The detector will incorporate a warning device to alert users when its working life is about to expire. A CO detector will be fitted in every space containing a fixed combustion appliance (excluding an appliance solely used for cooking) and a detector provided in a bedroom or principal habitable room, where a flue passes through that room. CO detectors will be located either on a ceiling min 300mm away from a wall or wall mounted min 150mm below a ceiling and above any door or window in the room. CO detectors will be located between 1m & 8m from the appliance.
 - Ventilation Awareness - CO2 detector required to the Principal Bedroom. Monitoring equipment for CO2 detection should be mains operated and may take the form of a self-contained monitor/detector or a separate monitor and detector head. The monitor should have an easily understood visual indicator and be capable of logging data to allow the occupant to gain information on CO2 levels for at least the preceding 24 hour period. If the detector monitor has an audible alarm this should be capable of being permanently deactivated.
 - Where applicable, all services within garages will be surface mounted to maintain the separation between garages and main house.
 - All Ground Floor Windows & Doors to have limited glass to comply with Secure by Design and Technical standards 4.13 (Security).
 - Escape windows (FE) to have a clear opening of at least 0.30m² and be at least 450mm high and 450mm wide, with the bottom of the opening not more than 1100mm above the floor and providing unobstructed egress (Upper Floor only).
 - Cleaning of Windows and Rooflights - All Upper Floor windows to comply with current Building [Scotland] Regulations, & comply with Parts 4.9.3.1 & 4.9.4 Scottish Building Standards, and Clause 10.2.10.3 & 10.4 of BS 8213 Part 1:1991 with regard to cleaning Windows and Rooflights.
 - External steps at French Patio doors to be maximum 170mm rise, 300mm treads. Maximum projection of door frame oil to be 25mm above finished floor level. Protective barriers to external steps and landings at change in direction to be minimum 1100mm.
 - Stairs to comply fully with Building [Scotland] Regulations, & Scottish Building Standards Part 4.3.9.3.1.4.3.1.1 (including) with MDF treads and risers, pine stringers, newels and balusters.
 - Minimum going 227.6mm
 - Maximum rise 204mm
 - Maximum pitch 42°Handrail to be 840mm above pitch line on one side only and to comply with BS 5180: 1999 Protective barriers to stairs and any Upper Floor French Doors to be minimum 1100mm high and comply with BS EN 1991-1-1 and PD 6688-1-1. Barrier will be designed & constructed so that it cannot be easily climbed by young children. A maximum spacing of 96mm between balusters. A minimum of 2000mm clear headroom over pitch line. Stairs with a wider section require a continuous handrail to the outer portion of the stair. The effective width of the stair between handrails should be min 900mm.
 - Conservation of fuel and power - All buildings to comply with Part 6.0/6.16.2/6.3/6.4/6.7/6.8 of the Scottish Building Standards, & current Building [Scotland] Regulations and due consideration given to be compliant with Directive 2010/31 EU. Ensure all gaps between draughts, window inlets, door openings, ceilings and floor joints to be sealed. Service penetrations and radiator pipes properly sealed. Draught seals fitted to windows, external doors and loft hatches. Thermostatic radiator valves fitted to all radiators. Heating system controlled with ACS TEMPLUS 2 electronic line switch and room ssi. Heating pipes for supply of hot water to be suitably insulated against heat loss.
 - Energy Performance Certificate to be provided to Local Authority on completion of works. A copy of the EPC will be displayed on the boiler of each property.
 - Reference should be made to the Domestic Building Standards Compliance Guide for Scotland 2015 Edition to provide guidance on compliance with Building Regulations, namely standards 6.3 to 6.7, as set out in section 6 (energy) of the 2015 Domestic Technical Handbook.

BENBECULA			
3 BEDROOM	TERRACED	73 SQ. FT.	783

ELECTRICAL LEGEND	
	LOW ENERGY CEILING MOUNTED PENDANT LIGHT
	LOW ENERGY CEILING SHROUDED LIGHT FITTING
	WALL MOUNTED BULKHEAD
	ENTRANCE LIGHTING
	32 AMP COOKER SWITCH
	HIGH LEVEL SPUR FOR COOKER HOOD
	16 AMP LOW LEVEL SINGLE GANG SOCKET
	16 AMP FUSED SPUR WITH REMOTE SWITCH
	SHAVER POINT
	B.T. POINT
	REMOTE WALL POINT SWITCH
	WALL MOUNTED LIGHT SWITCH
	C.U. ELECTRIC METER
	JME CONTINUOUS EXTRACT FAN DUCTED EXTERNALLY
	BOOSTER SWITCH FOR JME EXTRACT FAN
	IGNISATION SMOKE DETECTOR
	MULTI-SENSOR ALARM
	CARBON MONOXIDE DETECTOR
	PIR SENSOR PHOTO CELL
	16 AMP FUSED SPUR FOR JME EXTRACT FAN
	16 AMP LOW LEVEL DOUBLE GANG SOCKET
	16 AMP HIGH LEVEL DOUBLE GANG SOCKET
	T.V. POINT
	INCOMING B.T. DOUBLE BACK BOX
	PV INVERTER PANEL
	WALL MOUNTED 2 WAY LIGHT SWITCH
	COOKER HOOD FAN RECIRCULATION TYPE ONLY
	CENTRAL HEATING THERMO CONTROLS
	OPTICAL SMOKE DETECTOR
	HEAT DETECTOR
	CARBON DIOXIDE DETECTOR

STANDARD 2.11.1	FIRE DETECTION AND FIRE ALARM SYSTEMS
TYPE	RECOMMENDED LOCATION
OPTICAL SMOKE ALARM to BS EN 14864: 2005	PRINCIPAL HABITABLE ROOM - LOUNGE OR OPEN PLAN AREA - HALLWAYS AND STAIRWELLS ADJACENT TO KITCHENS
IONISATION SMOKE ALARM to BS EN 14864: 2005	HALLWAYS AND STAIRWELLS ADJACENT TO BATHROOMS OR SHOWER ROOMS
MULTI SENSOR ALARM to BS 5836: Part 6: 2004	UPPER AND LOWER HALLWAYS WITHIN 3 METRES OF BEDROOM DOORS
HEAT ALARM to BS 5446: Part 2: 2003	KITCHEN

STANDARD 3.14.2	VENTILATION AWARENESS IN DWELLINGS
TYPE	RECOMMENDED LOCATION
CO2 MONITORING EQUIPMENT to EUROPEAN DIRECTIVE 2006/95/EC	PRINCIPAL BEDROOM

STANDARD 3.20.20	CARBON MONOXIDE DETECTION
TYPE	RECOMMENDED LOCATION
CO DETECTION SYSTEM to BS EN 60211: 2010	EVERY SPACE CONTAINING A FIXED COMBUSTION APPLIANCE - BOILER INCLUDING EXTENDED FLUES

Ground Floor Habitable Compartment Partitions (GROUND FLOOR HALL TO APARTMENT)

ITCHER TO HALL

- 12.5mm Wallboard 10 to either side of 75mm timber stud
- 25mm Super glass Multi-Purpose Acoustic Mat within wall min density of 10kg/m³

Standard Upper Floor Internal Partitions (1st FLOOR HALL TO APARTMENT & APARTMENT TO APARTMENT)

- 12.5mm Wallboard 10 to either side of 75mm timber stud
- 25mm Super glass Multi-Purpose Acoustic Mat within wall min density of 10kg/m³

Bathroom Ensuite Internal Partitions (APARTMENT TO BATHROOM)

- 12.5mm Mtd Sound Block to Bathroom side of 75mm timber stud and 12.5mm Wallboard 10 to other side
- 25mm Super glass Multi-Purpose Acoustic Mat within wall min density of 10kg/m³

Ground Floor Ceiling

- 20mm Dropboard Ceiling @ min 15kg/m³
- 220mm Engineered timber Joist max 600mm cts
- 100mm Super glass Multi-Roll within floor space
- 15mm Falsine board on 15mm Rastars @ max 400mm cts


Partition to receive 'Robust Wall Detailing' refer detail AA (2) 078

AMENDMENTS:

B Dec '17 General Notes amended. External tap shown.

A Jul '17 STAS Drawing revised to comply with 2015 Building Regulations. Refer to separate notes.

Issue: Date: Description:

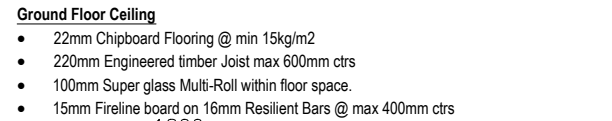

Bellway Homes Limited (Scotland)

Borwell House

Hamilton Business Park

Caith Street

Hamilton

ML3 0QA

Tel: 01698 477440 Fax: 01698 4774 Web: www.bellway.co.uk

Project:

STANDARD HOUSE TYPES

(2015 BUILDING REGULATIONS)

TIMBER KIT - ENHANCED SPEC.

Drawing:

BENBECULA 3 BED TERRACE - 5 BLOCK 783 SQ. FT.

Scale: 1:50 / 1:100 Date: JUL '17 Drawn: LM

Drawing No. BENBECULA (5) (2015) (EN) T-KIT-001 Rev. B