


Figure 1 · Preprocessing & quality control

A

Preprocessing & stratified split

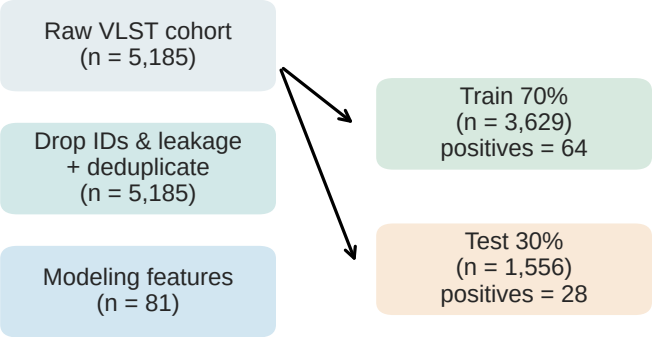


B



C

Stratified hold-out (random_state = 42)

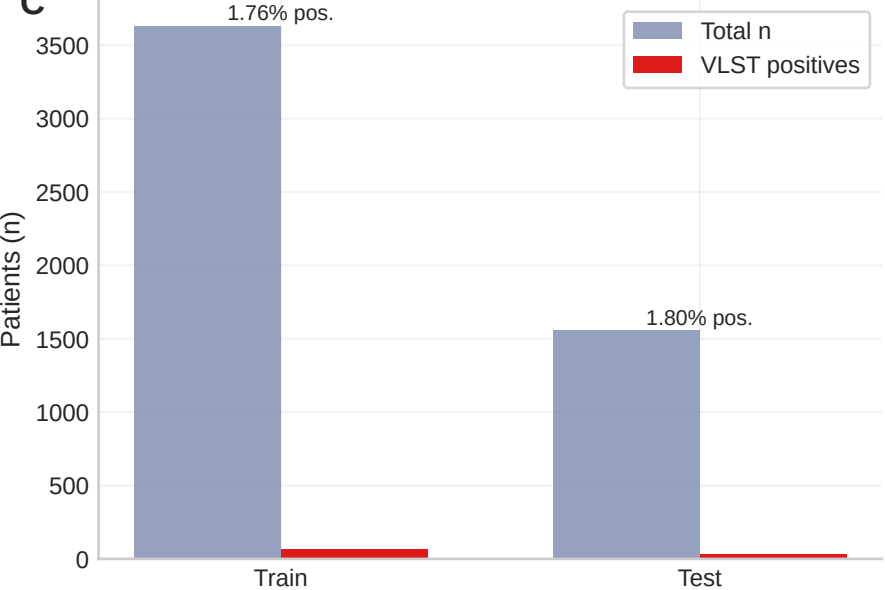

D

Quality control summary

Missing values (features):	0
Duplicate rows removed:	0
Leakage column dropped:	Time since stent implantation
Binary features:	57
Continuous features:	24
Categorical (stent brand):	1
Scaled + OHE output dims:	88