PRELIMINARY CONCEPT DIAGRAM: NOT FOR CONSTRUCTION. NOT VERIFIED. ALL RATINGS ARE PRELIMINARY ASSUMPTIONS.

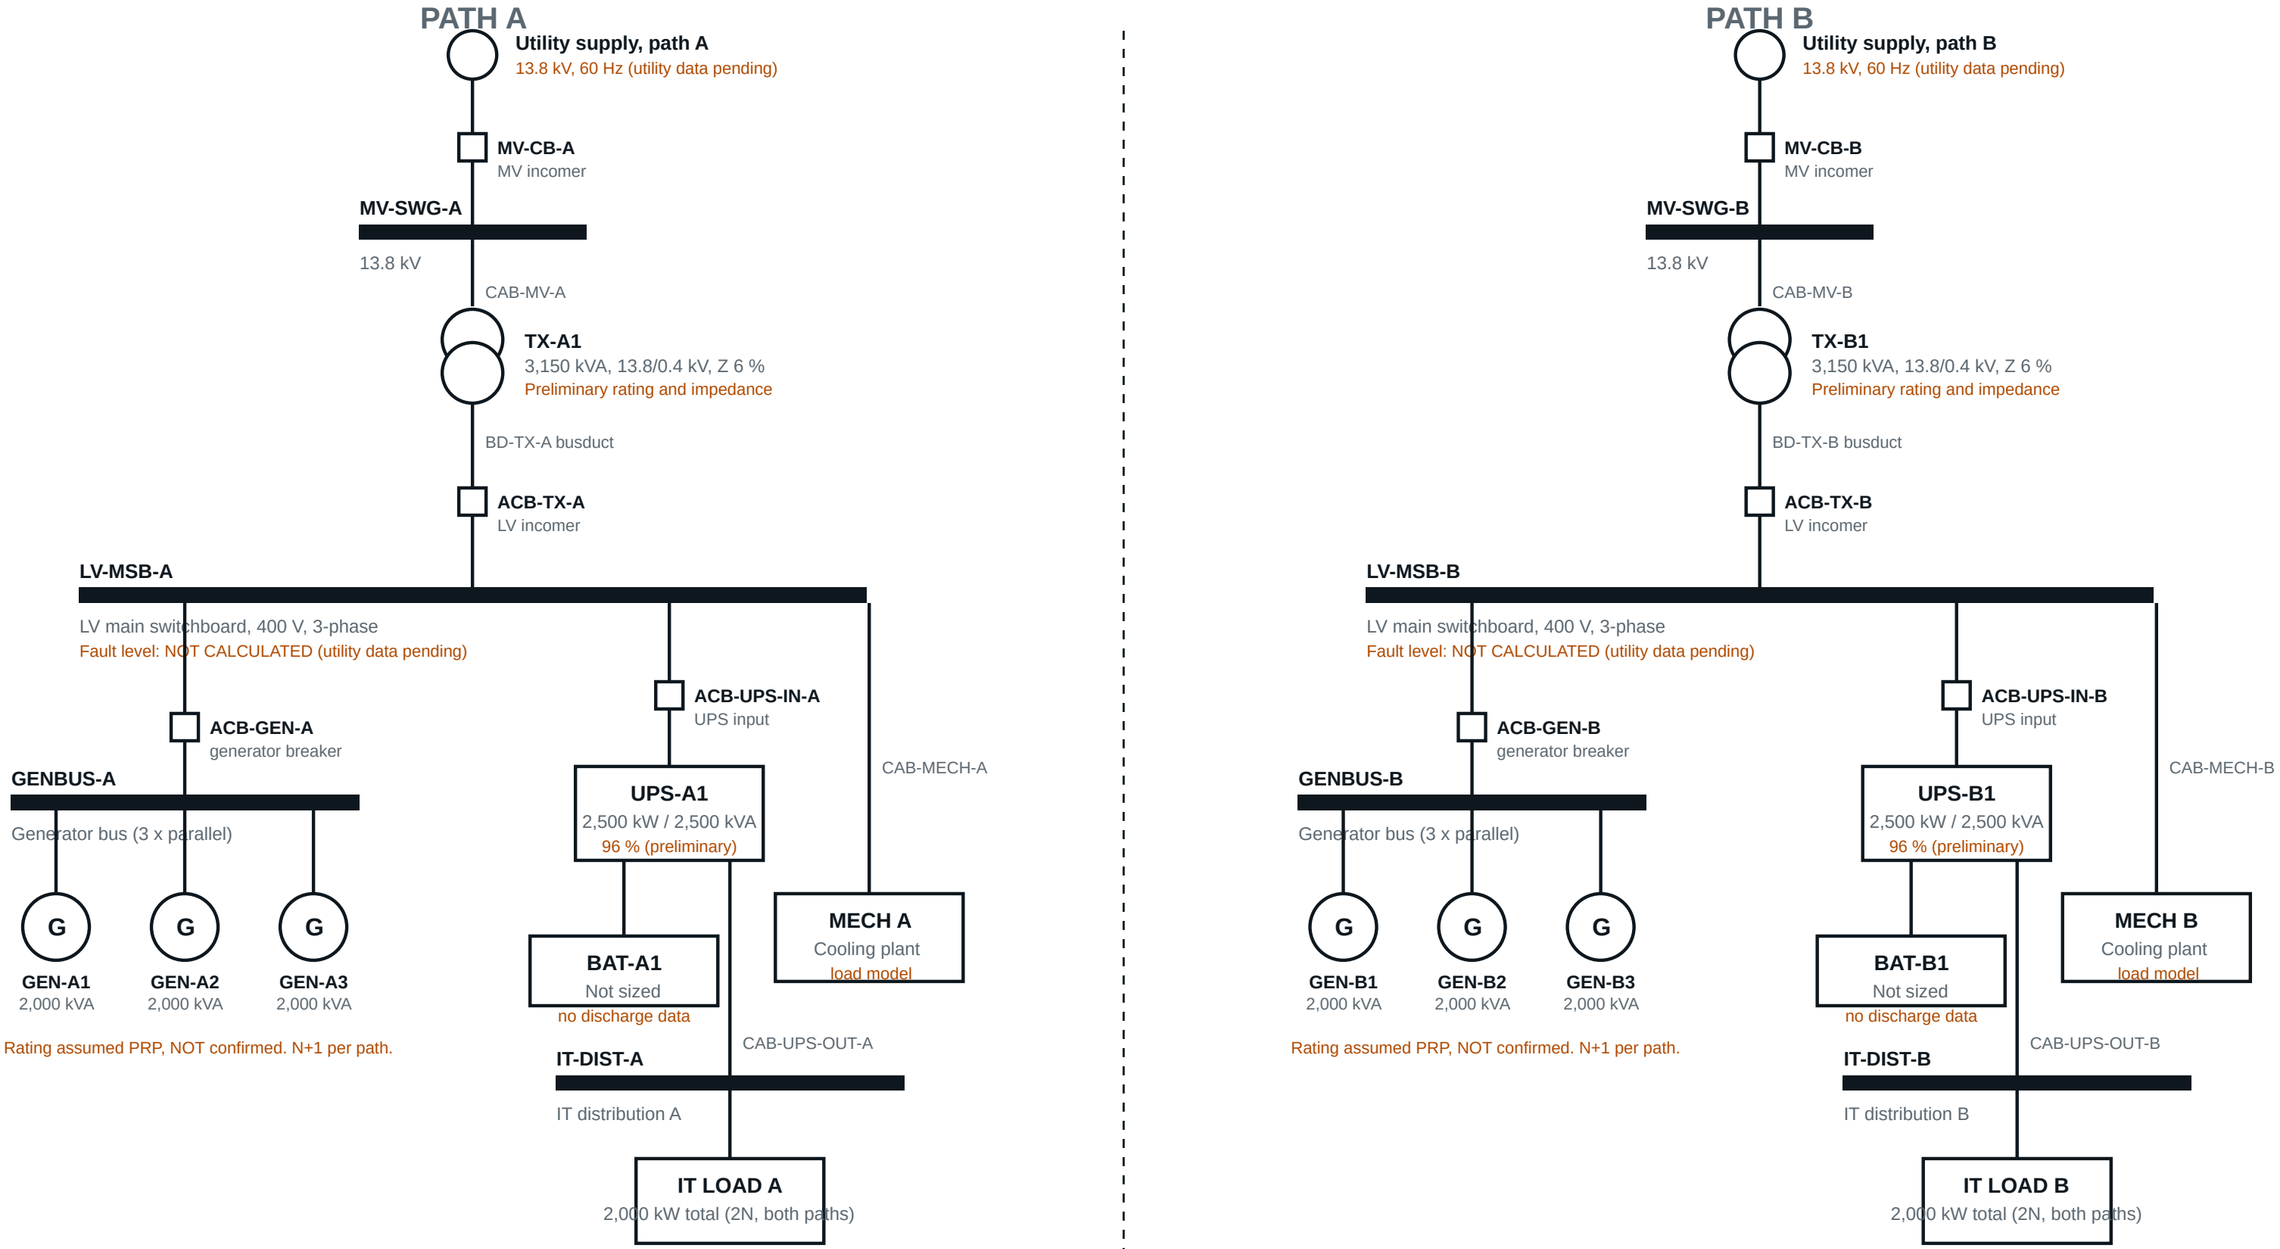

No electrical tie between paths (2N). Path independence of the two utility supplies is a design decision, not shown.

Equipment in path B is identical to path A (assumed by symmetry). Dual-corded IT loads are fed from both IT distribution boards.

OHMETRY 2 MW DATA CENTRE: PRELIMINARY SINGLE-LINE DIAGRAM	Drawing OHM-DC-2000-SLD-001 Rev A5	
1. Generated from the master configuration. Every rating shown is a PRELIMINARY ASSUMPTION or UNVERIFIED PLACEHOLDER (see the registers).	**Project:**	OHM-DC-2000
2. Fault levels, device ratings, cable sizes, settings and earthing are NOT shown: not calculated or not verified (data pending).	**Revision:**	A5
3. Generator basis (ISO 8528 PRP) assumed, not confirmed. Battery not sized. Open transition is a design decision.	**Release state:**	DEVELOPMENT
4. Educational and reference use only. Independent review and manufacturer data are needed before any project use.	**Generated:**	2026-11-05 07:48 UTC
	Drawn / checked / approved:	not assigned / not assigned / not assigned