



Universiti Malaysia Pahang Al-Sultan Abdullah
Pusat Reka Bentuk Inovasi & Teknologi

26600, Pekan, Pahang

Malaysia

Phone. +609 431 5047

Company / customer	JABATAN PENGURUSAN PENGETAHUAN DAN TEKNOLOGI MAKLUMAT
Project description	INDUSTRIAL POWER MONITORING SYSTEM
Job number	PR000001
Project Type	Energy Monitoring System

Manufacturer (company)

Project name	Energy_Substation
Installation Year	2025
Place of installation	Substation Power UMPSA
Responsible for project	AmirulA

Created on 20/12/2024

Edit date 16/12/2025

by (short name) yatih

Number of pages 12

SAFETY REGULATIONS

Universiti Malaysia Pahang Al-Sultan Abdullah
Pusat Reka Bentuk Inovasi & Teknologi
26600, Pekan, Pahang
Malaysia



GENERAL SAFETY REGULATIONS



DANGER !

During plant operation certain items are under dangerous voltage!
Non-observance of safety instructions can result in death, serious injuries or material damage.

Only specialist personnel may carry out transport, installation and commissioning work.

The applicable valid standards as well as the national and / or company-specific accident prevention regulations are to be observed.

The following safety instructions are to be observed:

The erection, commissioning, troubleshooting as well as repair of the plant may only be carried out by qualified personnel that is familiar with the corresponding operating instructions.

Mounting of the devices has to be effected in accordance with the valid standards, state and local regulations.
Proper grounding and conductor dimensioning as well as proper short-circuit proofing have to be ensured.
These measures serve to ensure the safety of the plant and of the operating personnel.

Before carrying out safety checks, maintenance work and repair measures ensure that all the power supplies are switched off, are secured against being switched on unintentionally and are marked correspondingly.

Only test devices that are in a technically perfect condition and are suitable for the respective measurement may be used to carry out measurements!

The instructions specified in the respective operating instructions are to be followed strictly!
It is mandatory that hazard, warning and safety instructions be observed!

All doors and covers are to be kept closed during the plant operation.
If cooling devices are installed in the plant, ensure that these systems operate trouble-free.
These include the regular cleaning of the filters, in as far as they exist.

Plant designation INDUSTRIAL POWER MONITORING SYSTEM						Drawing number PR000001				
Modification						Customer Name				
Date	Name		Date	Name	Company					
			Ed.	20/12/2024	Universiti Malaysia Pahang Al-Sultan Abdullah					
			Appr.	9/8/2023	Pusat Reka Bentuk Inovasi & Teknologi					
					26600, Pekan, Pahang					
					Malaysia					
Original				Safety Regulation		Higher-level function	=	Mounting Location	+	
Replacement of										
Replaced by				Commission		Page 2				
Previous page				1	Total no. of pages	12	Page group	4.1	Next page	3

Table of contents

F06_UMP_001

Higher-level function	Mounting location:	Page	Page description	supplementary page field	Date	Edited by
DCB		1	Title page		9/8/2023	Alinuh
		2	Safety Regulation		9/8/2023	Alinuh
		3	Table of Content		11/8/2025	yatih
		1	Cover Sheet		9/8/2023	Alinuh
	A1	1	Main Control Panel AC Input 230 VAC 50 Hz		10/8/2025	yatih
	A1	2	24 VDC device power supply		10/8/2025	yatih
	A1	3	Input Diagram		11/8/2025	yatih
	A1	4	Network Switch		11/8/2025	yatih
	A1	5	ENCLOSURE 380x300x200 Overall View		11/8/2025	yatih
	A1	6	ENCLOSURE 400x300x200 Overall View		11/8/2025	yatih
	A1	7	ENCLOSURE 500X400X200 Overall View		11/8/2025	yatih

Plant designation INDUSTRIAL POWER MONITORING SYSTEM						Drawing number PR000001	
Customer Name							
Modification		Date	Name	Company			
		Ed.	20/12/2024	EFUN			
		Appr.	11/8/2025	yatih			
Original		Table of Content				Higher-level function = Mounting Location +	
Replacement of							
Replaced by							
Previous page		Commission		Page 3			
2		Total no. of pages 12		Page group 4.1 Next page 4			

1. Project description INDUSTRIAL POWER MONITORING SYSTEM					2. Position stay put, complete selector switch				
Modification Date Name Date Name Ed. 20/12/2024 EFA/AM Appr. 11/01/2025 yeth					Customer Name Company University Malaysia Paiseang Al-Sultan Abdullah Pusat Raka Benuk Inovasi & Teknologi 26600, Pekan, Pahang Malaysia				
Original Replacement of Replaced by Previous page 3 Total no. of pages 12					Summarized Part list Higher-level function = Mounting Location + Commission Page 4 Next page 4.1				

0

1

2

3

4

5

6

7

8

9

A

B

C

D

E

F

G

Summarized parts list

F02_2900_V1

Position	Quantity	Unit	Part number	Designation	Manufacturer	Order number	Technical characteristics
30	1	pcs	MR0000291	Convesional Power Supply	IFM	ZB0805	Output current 10 A, regulated
31	1		TW 004	Temperature measurement with resistance thermometer 1- and 2-fold	ESS		
32	13		LW 001	Measuring set-up for filling level: measurement triggered by float with contact	ESS		
33	10						
34	20		not yet known				

Plant designation

INDUSTRIAL POWER MONITORING SYSTEM

Drawing number

PR000001

Customer Name

Company

University Malaysia Pahang Al-Sultan Abdullah

Pusat R&D Inovasi & Teknologi

26600, Pekan, Pahang

Malaysia



Modification

Date

Name

Ed.

Date

Name

Appr.

Date

Name

Original

Replacement of

Replaced by

Previous page

4

Total no. of pages

12

Page group

4.1

Next page

4.1

Page

4.1

Commission

DCB/1

Summarized Part list

Higher-level function

=

Mounting Location

+

This drawing depicted herein is protected by copyright law, and explicit permission from the University Malaysia Pahang, as the copyright owner, is required for any reproduction, distribution, or use

Plant designation INDUSTRIAL POWER MONITORING SYSTEM						Drawing number PR000001									
Modification						Customer Name									
Date	Name	Ed.	Date	Name	Company										
			20/12/2024	EFAN	University Malaysia Pahang Al-Sultan Abdullah										
			14/6/2025	yeh	Pusat Reka Bentuk Inovasi & Teknologi										
						26600, Pekan, Pahang Malaysia									
Original						Summarized Part list						Higher-level function	=	Mounting Location	+
Replacement of															
Replaced by						Commission						Page 4.1			
Previous page						4	Total no. of pages		12	Page group		4.1	Next page		=DCB/1

This drawing depicted herein is protected by copyright law, and explicit permission from the University Malaysia Pahang, as the copyright owner, is required for any reproduction, distribution, or use

COVER SHEET

Universiti Malaysia Pahang Al-Sultan Abdullah
Pusat Reka Bentuk Inovasi & Teknologi
26600, Pekan, Pahang
Malaysia



INDUSTRIAL POWER MONITORING SYSTEM


Energy Monitoring System

Work Station:


Distribution Control Board

F26_UMP_003

Plant designation INDUSTRIAL POWER MONITORING SYSTEM					Drawing number PR000001			
					Customer Name			
Modification	Date	Name		Date	Name	Company		
			Ed.	20/12/2024	EPLAN	 Universiti Malaysia Pahang Al-Sultan Abdullah Pusat Reka Bentuk Inovasi & Teknologi 26600, Pekan, Pahang Malaysia		
			Appr.	9/8/2023	Amm			
Original			Cover Sheet			Higher-level function =DCB	Mounting Location	+
Replacement of						Distribution Control Board		
Replaced by			Commission			Page 1		
Previous page	=4.1		Total no. of pages		12	Page group	1	Next page +A1&EFS1/1


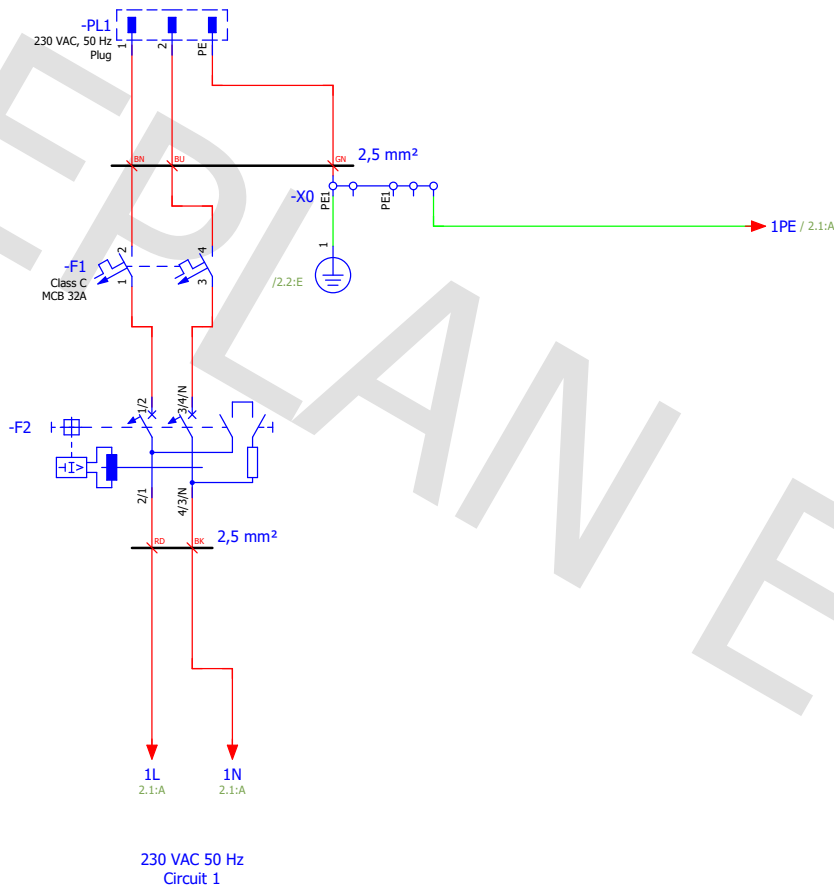


Plant designation INDUSTRIAL POWER MONITORING SYSTEM					Drawing number PR000001		
Customer Name							
Modification		Date		Company			
Date		Name		University Malaysia Pinarang Al-Sultan Abdullah			
Ed.		20/12/2024		Pusat Raka Bentuk Inovasi & Teknologi			
Appr.		21/06/2025		26500, Pekan, Pahang Malaysia			
				yath			
Original		Main Control Panel AC Input 230 VAC 50 Hz				Higher-level function =DCB	
Replacement of						Mounting Location	
Replaced by		Commission				Distribution Control Board	
Previous page		+8AAA1/1		Total no. of pages 12		Enclosure 1	
						Page 1	
						Next page 2	

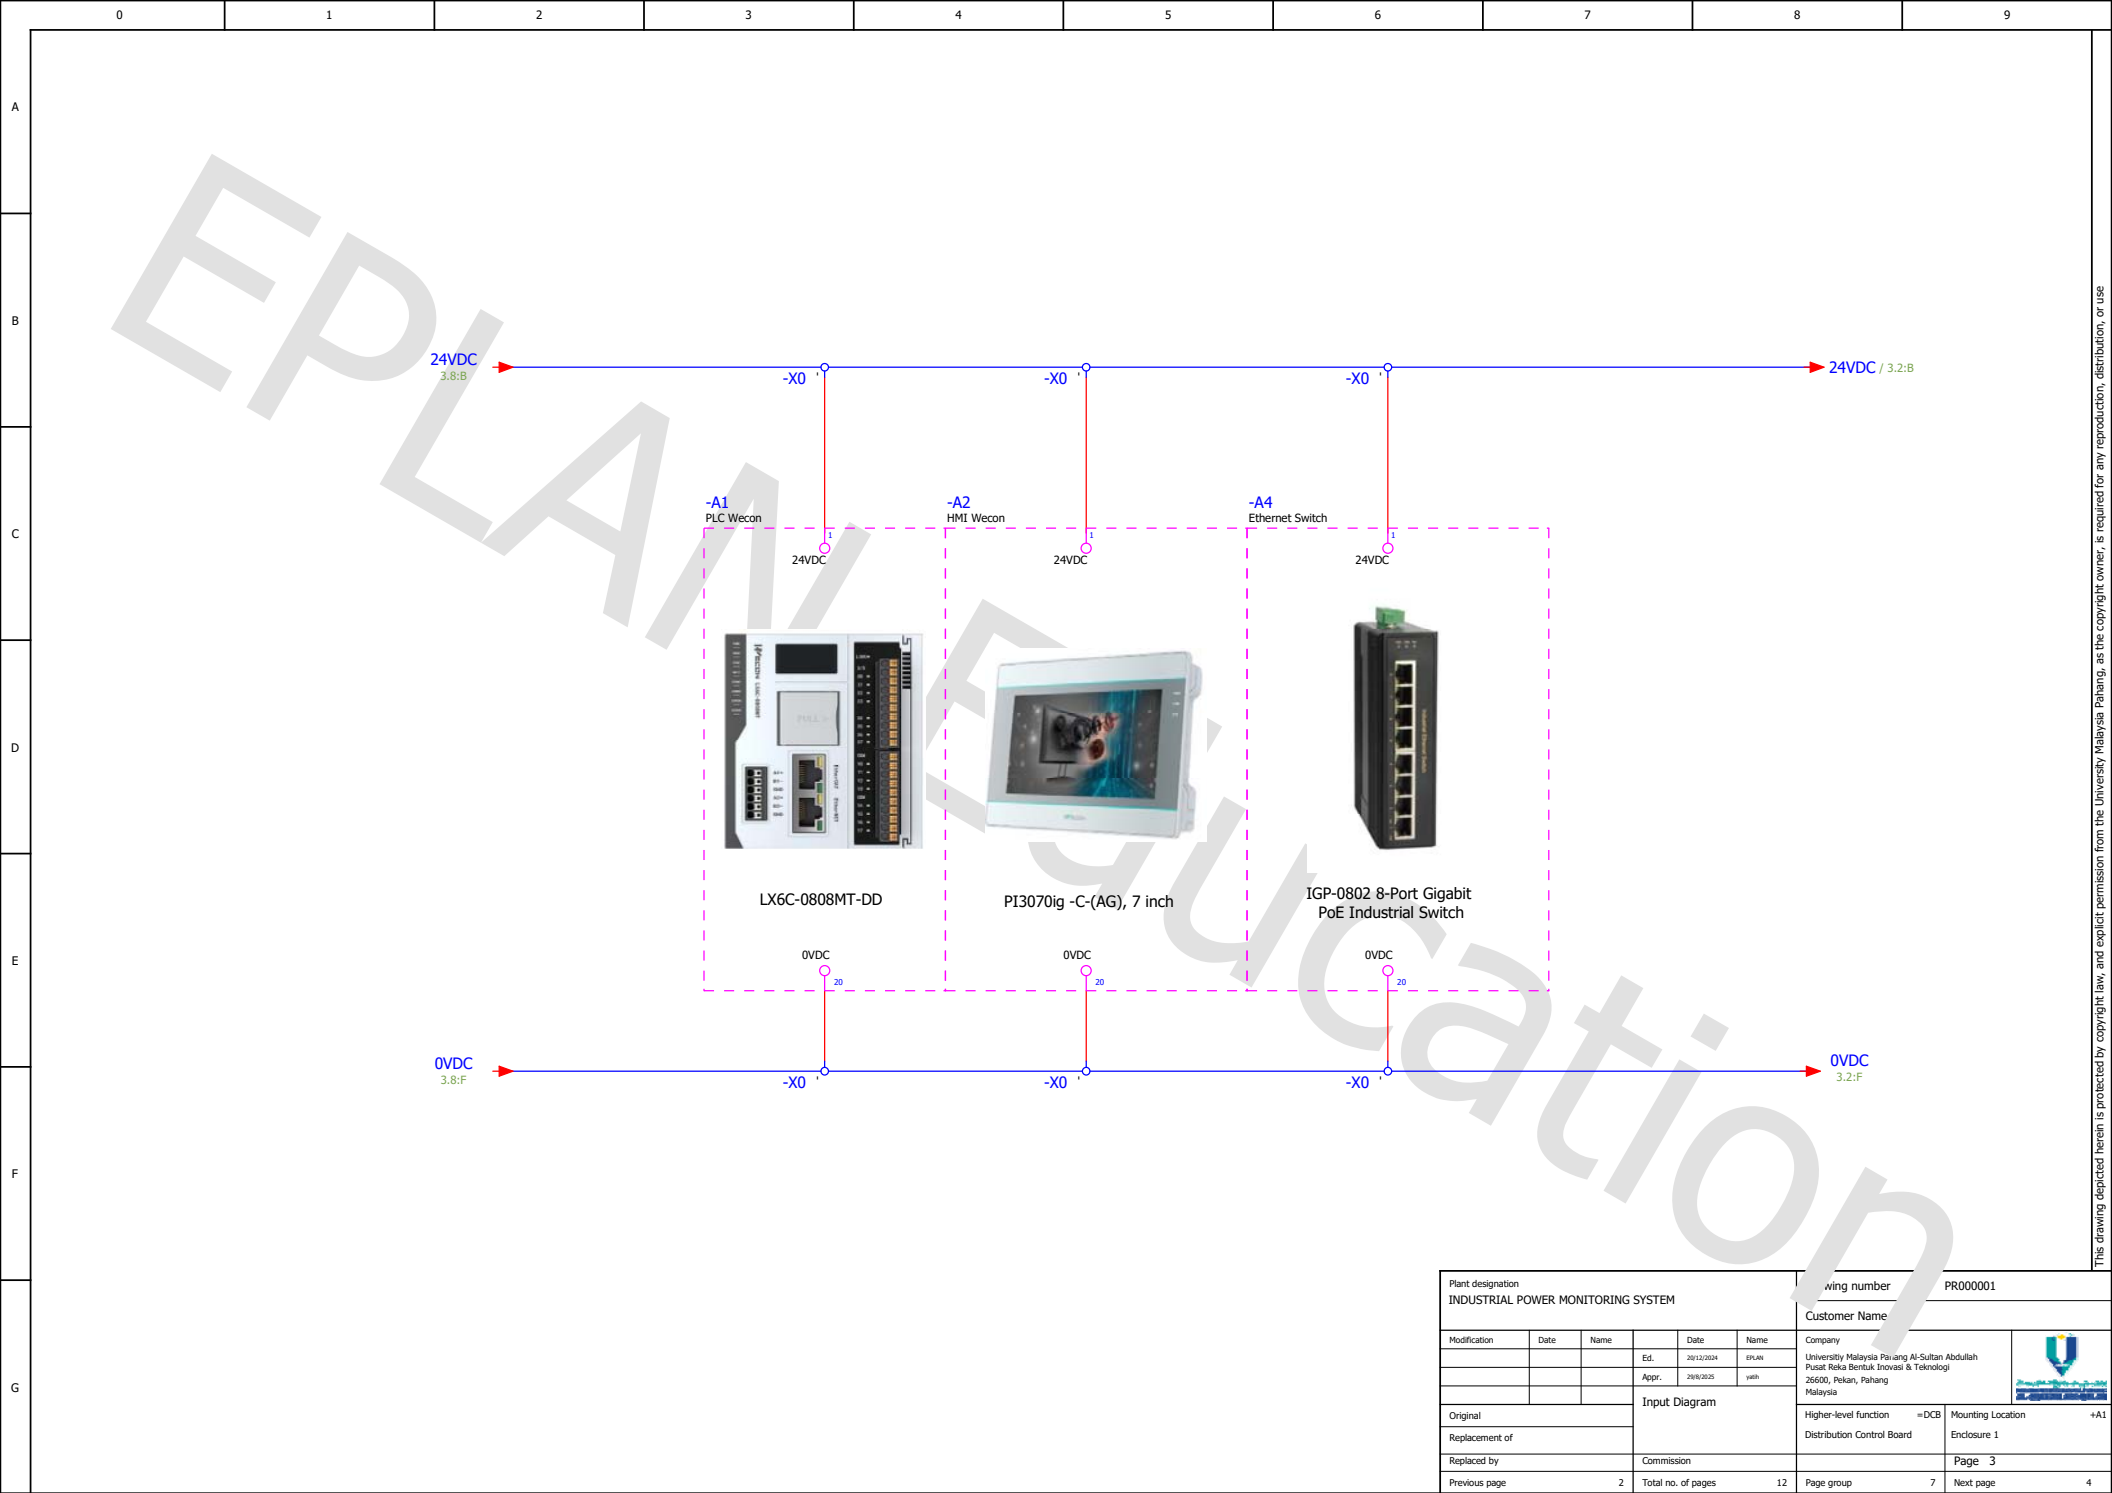


LEGEND

- Modbus TCP/IP
- Modbus RTU / RS-485

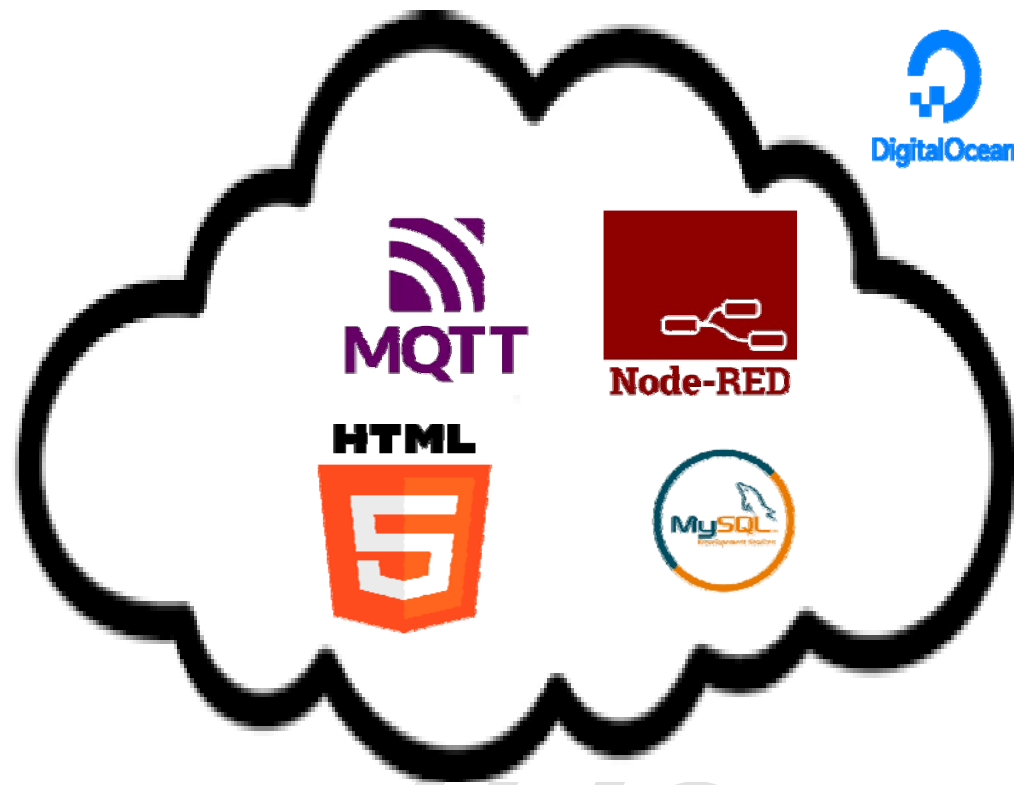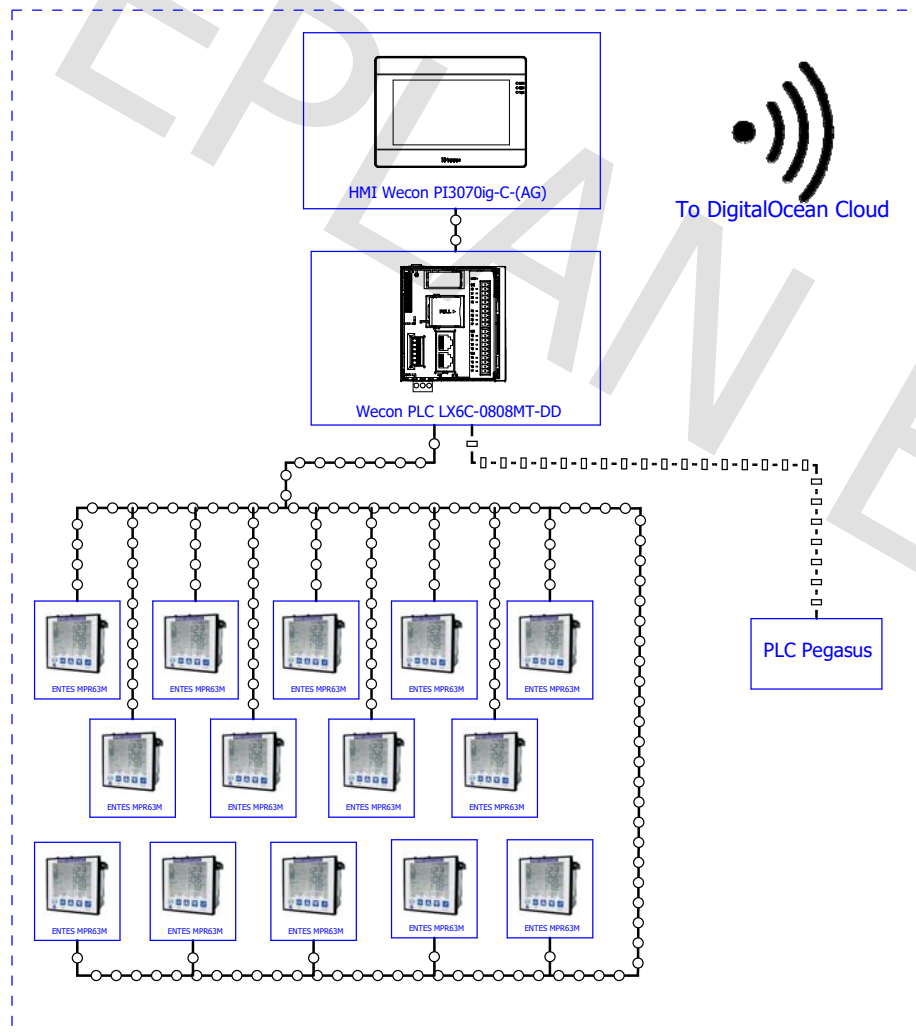

Plant designation INDUSTRIAL POWER MONITORING SYSTEM					Drawing number PR000001			
Customer Name								
Modification	Date	Name	Date	Name				
			Ed.	30/12/2024	SPK			
			Appr.	29/01/2025	yeth			
			Network Switch					
Original				Higher-level function	= DCB	Mounting Location	+A1	
Replacement of				Distribution Control Board		Enclosure 1		
Replaced by				Commission		Page 4		
Previous page	3	Total no. of pages		12	Page group	7	Next page	6

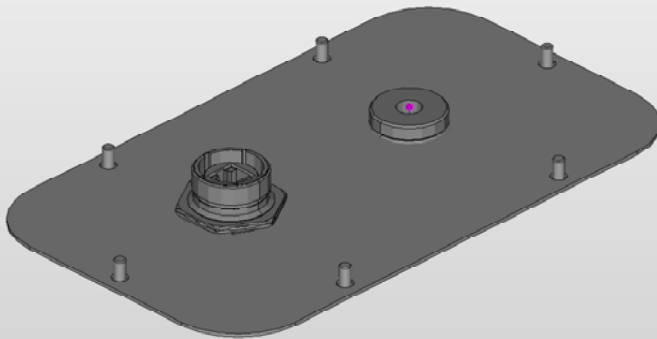

Plant designation INDUSTRIAL POWER MONITORING SYSTEM						Drawing number PR000001	
Modification						Customer Name	
Date		Name		Date		Company	
				Ed.		Universiti Malaysia Pahang Al-Sultan Abdullah	
				Appr.		Pusat R&D Inovasi & Teknologi	
						26600, Pekan, Pahang	
						Malaysia	
Original				ENCLOSURE 400x300x200		Higher-level function =DCB	
Replacement of				Overall View		Mounting Location	
Replaced by				Commission		Enclosure 1	
Previous page		4		Total no. of pages		Page 6	
				12		Next page	
						7	
						7	

