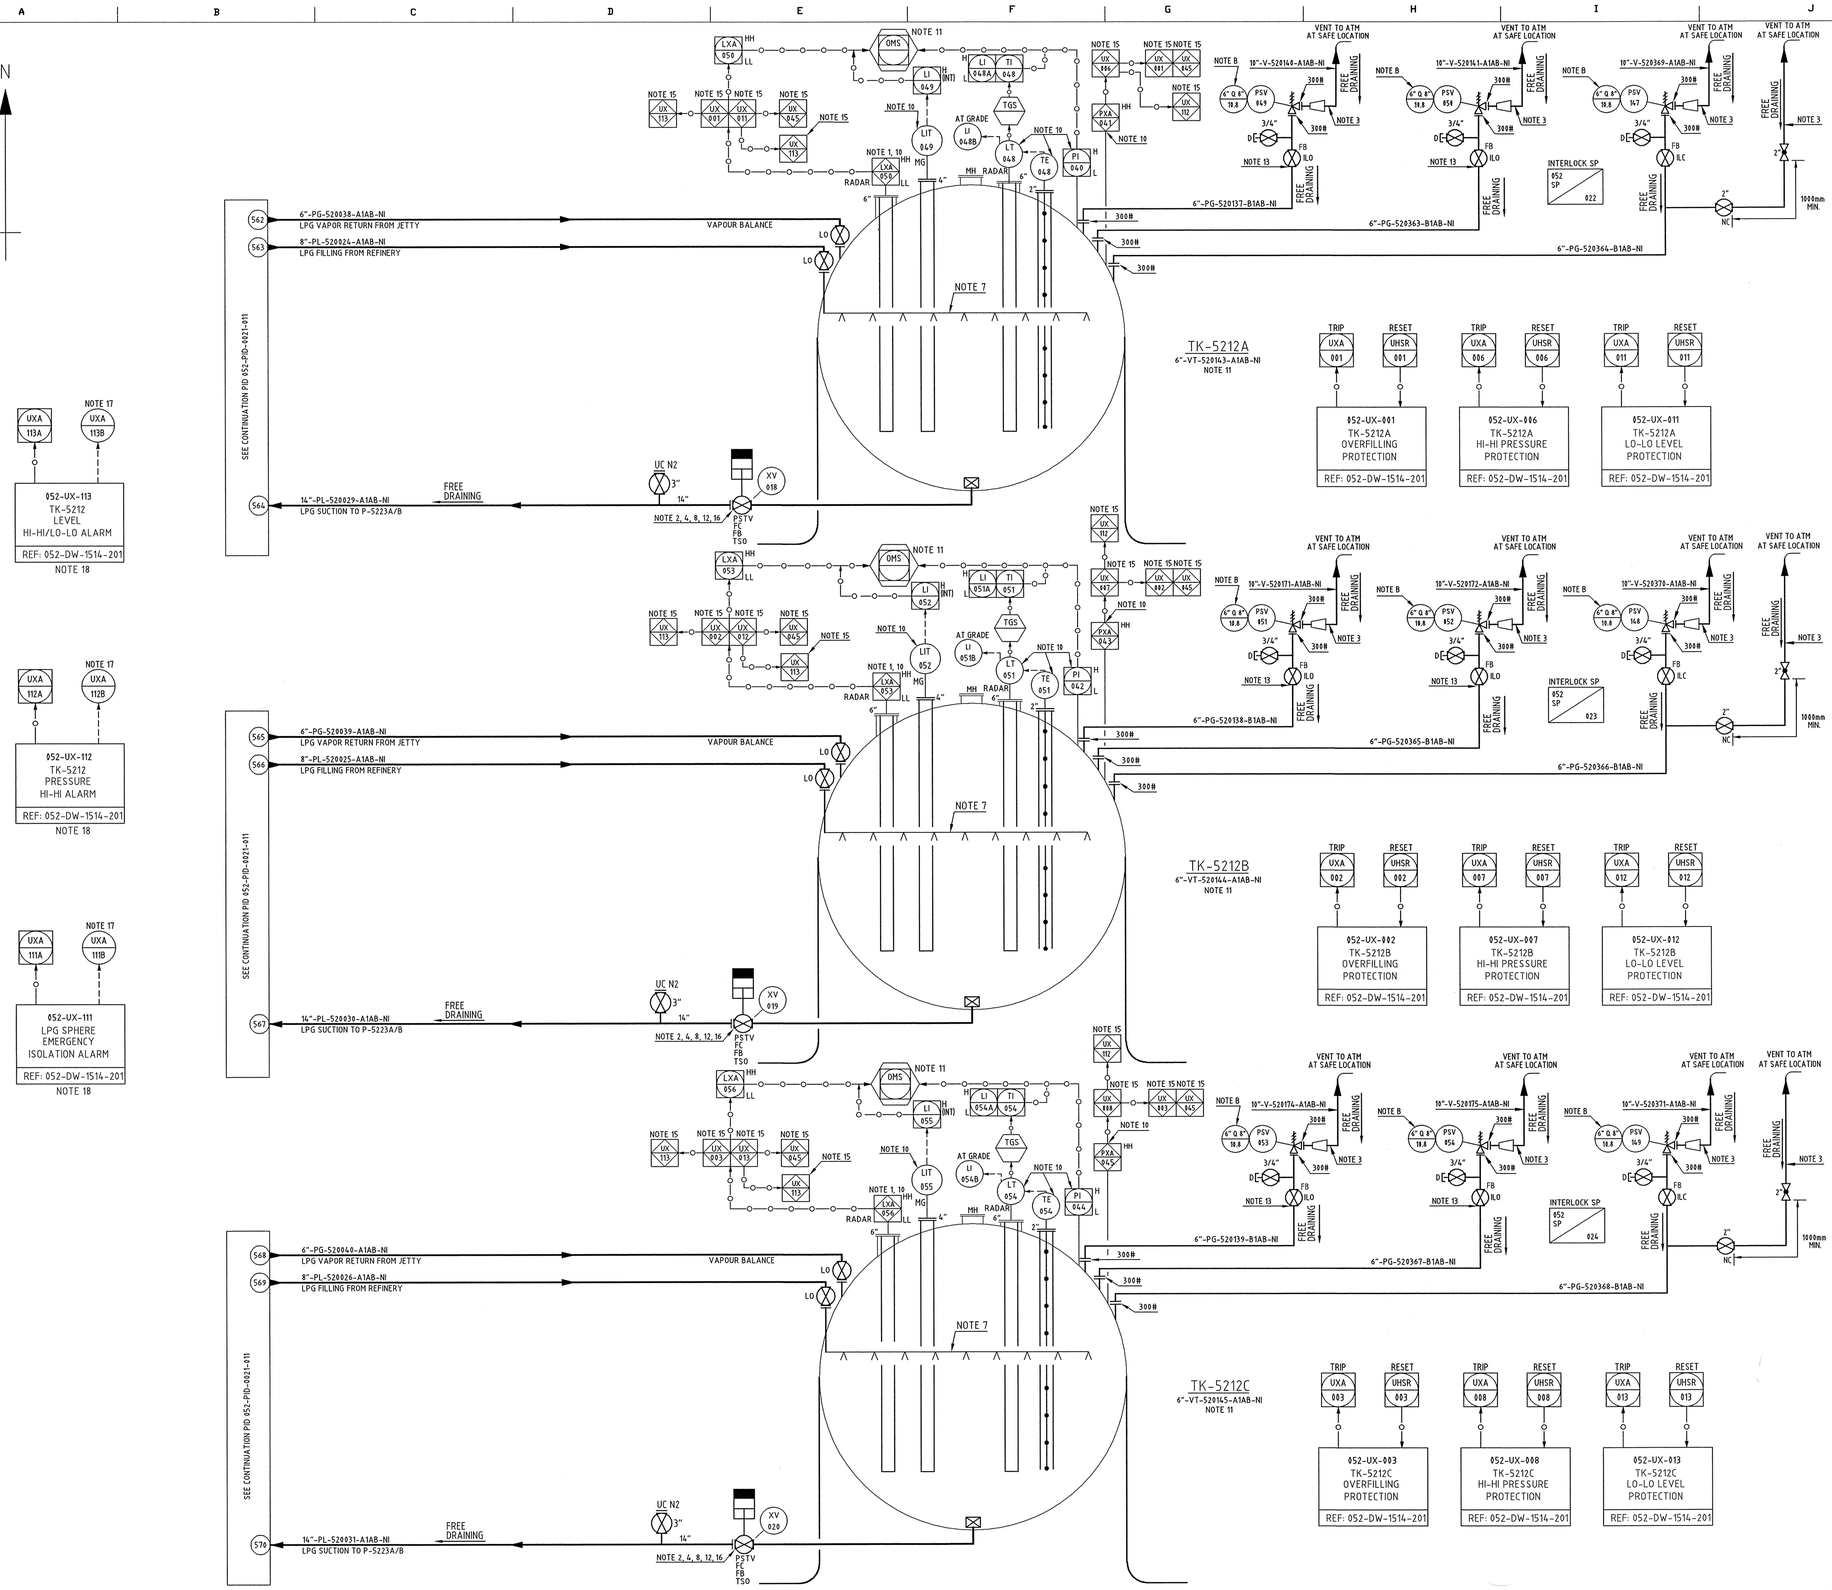


GENERAL NOTES

A. ALL INSTRUMENT TAG NUMBERS IN THIS DRAWING HAVE 052 AS PREFIX.
B. PSV SUPPLY BY SPHERE VENDOR.

SPECIFIC NOTES

1. LXAHH AND LXALL ARE INTEGRATED AND ACTIONS ARE FROM ONE LEVEL INSTRUMENT.
2. FIRE RESISTANT VALVE INVENTORY ISOLATION VALVES AIR ACCUMULATOR SIZED FOR THREE SUCCESSIVE STROKES SHALL BE PROVIDED.
3. PROVIDE ø 13mm WEEP HOLE AT LOW POINT.
4. LOCAL ESD SWITCHES TO BE LOCATED OUTSIDE OF KERB AREA.
5. DELETED.
6. DELETED.
7. SPHERE TOP FILLING, INCLUDING BUILT-IN SPRAY RING TO BE PROVIDED.
8. FOR XV'S INSTRUMENTATION DETAILS SEE PID 8474L-052-PID-0021-041.
9. DELETED.
10. FOR DETAILS OF TYPICAL SEE PID'S: 8474L-000-PID-0090-030, 031, 032 FOR TABLE DETAILS OF INSTRUMENTS ON EQUIPMENTS AND LINES, SEE PID NO: 8474L-052-PID-0021-022, 023, 024.
11. FOR OMS INSTRUMENTATION DETAILS SEE PID: 8474L-052-PID-0021-031.
12. STROKE TEST OF ESD VALVE SHALL BE INITIATED MANUALLY AND PERFORMED WHEN P-5223A/B IS NOT RUNNING.
13. INSTALLED FLANGE TO FLANGE WITH SPHERE NOZZLE.
14. DELETED.
15. REFER TO CAUSE AND EFFECT CHART DOCUMENT 8474L-052-DW-1514-201.
16. THE FIRST ISOLATION VALVE SHALL BE LOCATED OUTSIDE THE SPHERE LEG AND WELDED TO THE SPHERE OUTLET NOZZLE.
17. ALARM TO ADP ON THE HARD-WIRED CONSOLE.
18. ADP ALARM FOR 052-UX-111, 112 AND 113 ON TK-5212D AND E ON 8474L-052-PID-0021-013 HAS THE SAME ALARM AS TK-5212A, B AND C.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.
5. DELETED.
6. DELETED.

REV	DATE	DESCRIPTION	DRN	CHK	APP
2	19-OCT-07	REISSUE FOR CONSTRUCTION 2	JCS	NM	AM
1	03-MAY-07	REISSUE FOR CONSTRUCTION	JCS	NM	JS
0	22-SEP-06	ISSUE FOR CONSTRUCTION	JCS	NM	JS
C	08-JUN-06	REISSUE FOR DESIGN	JCS	NM	JS
B	13-APR-06	ISSUE FOR DESIGN	JCS	PN	JS
A	25-OCT-05	ISSUE FOR APPROVAL	JCS	PN	JS

REVISIONS

O.P. CENTER JOB CODE : 5406B
O.P. CENTER DWG NO :

VIETNAM OIL AND GAS CORPORATION (PETROVIETNAM)

PROJECT:
DUNG QUAT REFINERY PROJECT
DUNG QUAT , VIETNAM

Technip JGC TPI

PIPING AND INSTRUMENT DIAGRAM
PRODUCT TANKAGE
LPG SPHERES (TK-5212 A/B/C)
UNIT 52

ITEM NO.	TK-5212A/B/C
SERVICE NAME	LPG SPHERES
SIZE, DIAMETER, m	21.2
WORKING CAPACITY, m^3	4511
DESIGN PRESSURE AND TEMPERATURE, kg/cm g, °C	10.8/FV, 50/-30
INSULATION TYPE AND THICKNESS, mm	NI

FEED DOCUMENT NUMBER | DOCUMENT CLASS : Z
N.A
TP-C NUMBERING SYSTEM | SCALE : NONE | REV.
8474L-052-PID-0021-012 | 2

FILENAME: 8474L-052-PID-0021-012-2.DWG

THE PRESENT DOCUMENT OR DRAWING IS THE PROPERTY OF TECHNIP AND SHALL NOT, UNDER ANY CIRCUMSTANCES, BE TOTALLY OR PARTIALLY, DIRECTLY OR UNDIRECTLY, TRANSFERRED, REPRODUCED, COPIED, DISCLOSED OR USED WITHOUT ITS PRIOR WRITTEN CONSENT, FOR ANY PURPOSE AND IN ANY WAY OTHER THAN THAT FOR WICH IT IS SPECIFICALLY FURNISHED OR OUTSIDE THE EXTENT OF THE AGREED UPON RIGHT OF USE.