General description

The evacuation rack, type M-4, is designed for stationary installation on floor, and is used for, together with an evacuation system, manual evacuation of domestic LPG cylinders before pressure testing or repair. It is also used for evacuation of cylinders that have been overfilled and for evacuation of leaking cylinders which are to have the valve replaced.

The evacuation rack type M-4 consists of the following main components:

- Rack accommodating 4 domestic cylinders
- Piping system with manometer, safety valve, opening and closing valve, and welding flange for 1" pipe for connection to evacuation system

The evacuation rack can be supplied for right or left execution and the evacuation heads are adapted to one cylinder valve type according to the specifications of the customer.

Scope of supply

The evacuation rack is supplied complete for stationary installation on floor including corresponding rack accommodating 4 domestic cylinders, piping system with manometer, safety valve, opening and closing valve and welding flange for 1" pipe for connection to evacuation system.

Additional equipment

(Only included if specified in quotation)

- Evacuation system
- 4 evacuation heads suited for one type of cylinder valve including corresponding hoses and opening and closing valves
- Additional evacuation heads adapted to other cylinder valve types according to the specifications of the customer
- Quick couplings for rapid shift between different types of evacuation heads
- Throttle valves for regulation of the gas flow when evacuating cylinders with valves with flow limiter
- Inspection glass for visual control of the gas flow
- Pipe connections to other evacuation racks
- Standard spare parts set


© Kosan Crisplant 2003

Technical data

Capacity and conditions	• Max. 4 cylinders/operation. The number of cylinders/hour depends on the following factors: – The capacity of the evacuation system – The number of cylinders evacuated per operation (from 1 to max. 4 cylinders/operation) – The quantity of gas and sludge in each cylinder – Desired evacuation degree (only evacuation of liquid gas or evacuation of both liquid gas and vapour gas) – The form of the cylinder valves (orifice size of the valve, valve with or without flow limiter etc.) – The mixture of the gas (butane, propane or a mixture) and the temperature of the surroundings
Cylinder dimensions (requirements and limitations)	• Cylinder diameter: – Min. 220 mm - Max. 400 mm
Necessary connections (specifications and quality requirements)	• Evacuation system: – Connection size: Welding flange for 1” pipe • Earth net: – Max. transition resistance between earth wire and earth: ≤ 2.0 Ohm
Weight	• Approx. 200 kg
Static surface load	• < 0.25 N/mm² (2.5 kp/cm²)
Approvals	• The evacuation rack is designed for use in hazardous areas classified as Zone 1 according to IEC 79-10 and Class I, Division 1 according to NEC (USA), article 500

© Kosan Crisplant 2003

Dimensions in mm

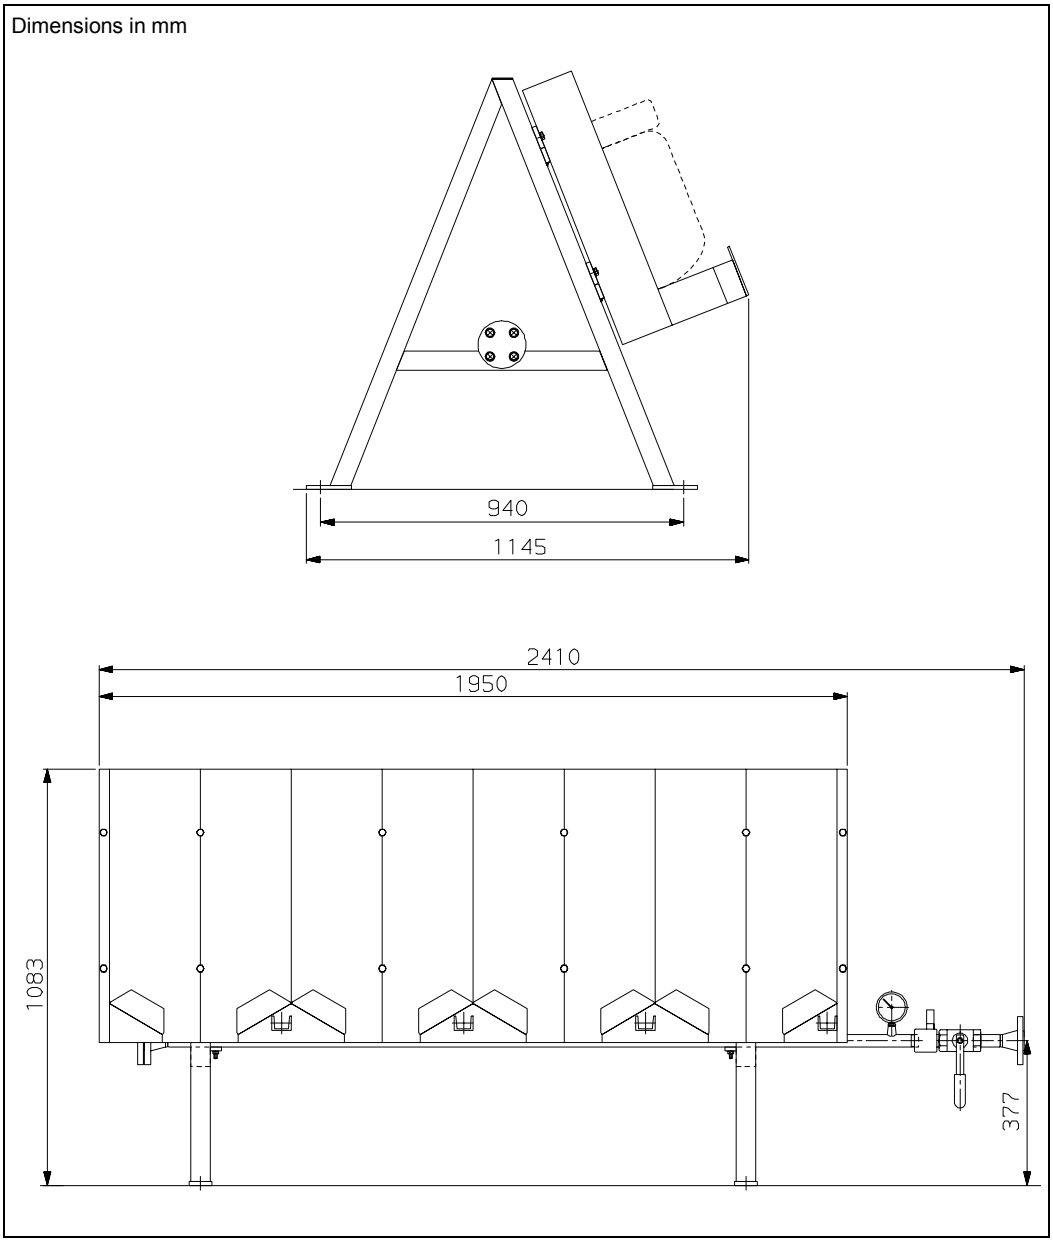

© Kosan Crisplant 2003