
Crisplant a/s

Costummer	:	Standard drawing
Project description	:	#xxxx DRÄGER GAS SENSOR, 4-20mA
Drawing Number	:	325B876.4.E
Subject	:	Flammeproof housing for 1 amplifiers

Placement	:	Line voltage, freq.	: 24VDC
Speciel terms	: Ex area	Control voltage	: 24VDC
Norm/standards	: EN 50014/IEC 204-1	Power consumption.	: 0.1kW
Capsuling Class	: Plant EEx d/ib IIB T5	Rated current	: ~0.5A
Ambient temperature	: max 40°C	Short-circuit Ikmax.	:
Relative humidity	:	Short-circuit Ikmin.	:
Distribution system	: TN-S	Main cable	: 3x1.5mm²
Cubicles	: Cortem	Incoming cable	:
Fabrication year	: 1996	Outgoing cables	:

Project start	: 18.Aug.1999	Largest page no.	: 11
Project responsible	: KHO	Total pages	: 4
Latest change	: 23.Okt.2001		
Latest Constructor	: JHV		


Title	SPECIFICATION	Drawn	18.Aug.1999	App.		Rev.	Date	Drawing No. 325B876.4.E	Cont. page 4
Subject	Flammeproof housing for 1 amplifiers	Plotted	08.Jan.2003	Eng.	KHO		27.Maj.1997		Page no. 1
Project	#xxxx DRÄGER GAS SENSOR, 4-20mA			Drw.	JHV				

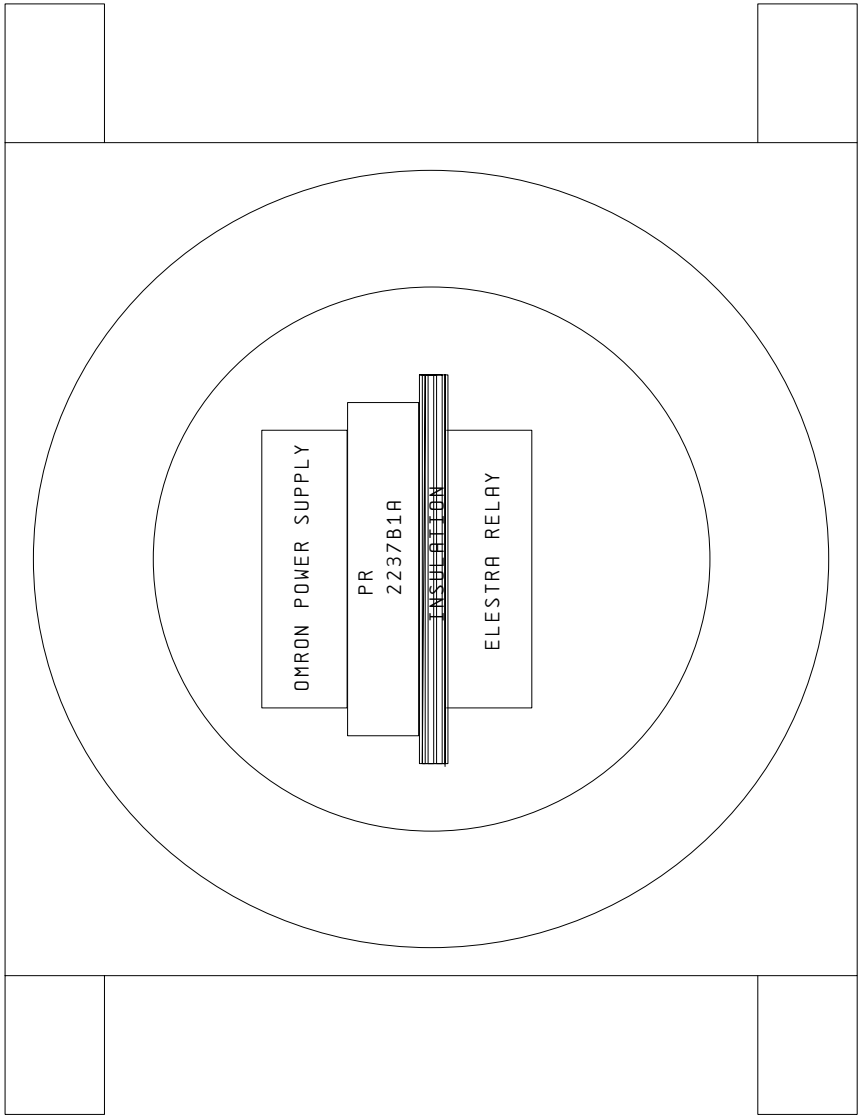

Cable Glands EEx d
1 pcs. 9.1 - 14,3 mm
1 pcs. 4,9 - 9,1mm
1 pcs. 6,4 - 11,8mm


1

Title	FRONTVIEW	Drawn 18. Aug. 1999	App.	Rev.	Date	Crisplant a/s	Drawing No. 325B876.4.E	Cont. page 10
Subject	Flammeproof housing for 1 amplifiers	Plotted 08. Jan. 2003	Eng. KHO		18. Maj. 2001			Page no. 4
Project	#xxxx DRÄGER GAS SENSOR, 4-20mA		Drw. JHV					

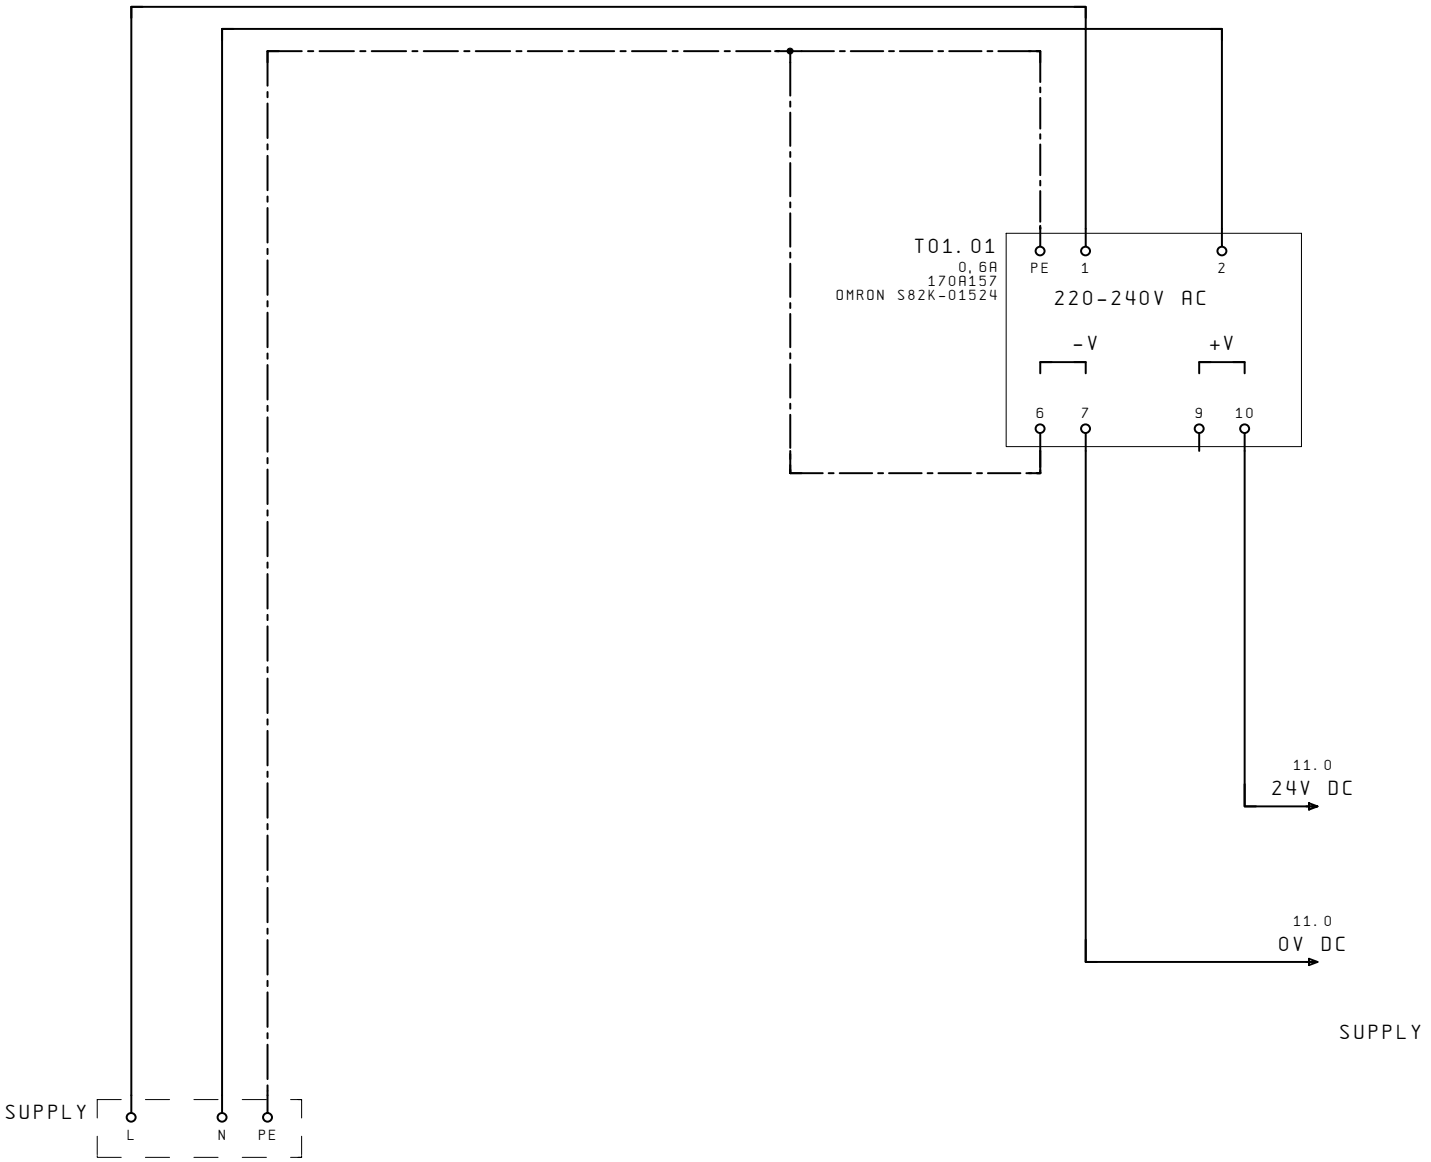

4

Title	POWER SUPPLY,	Drawn 18. Aug. 1999	App.	Rev.	Date	Crisplant a/s	Drawing No. 325B876.4.E	Cont. page 11
Subject	Flammeproof housing for 1 amplifiers	Plotted 08. Jan. 2003	Eng. KHO		01. Nov. 1999			Page no. 10
Project	#xxxx DRÄGER GAS SENSOR, 4-20mA		Drw. KHO					

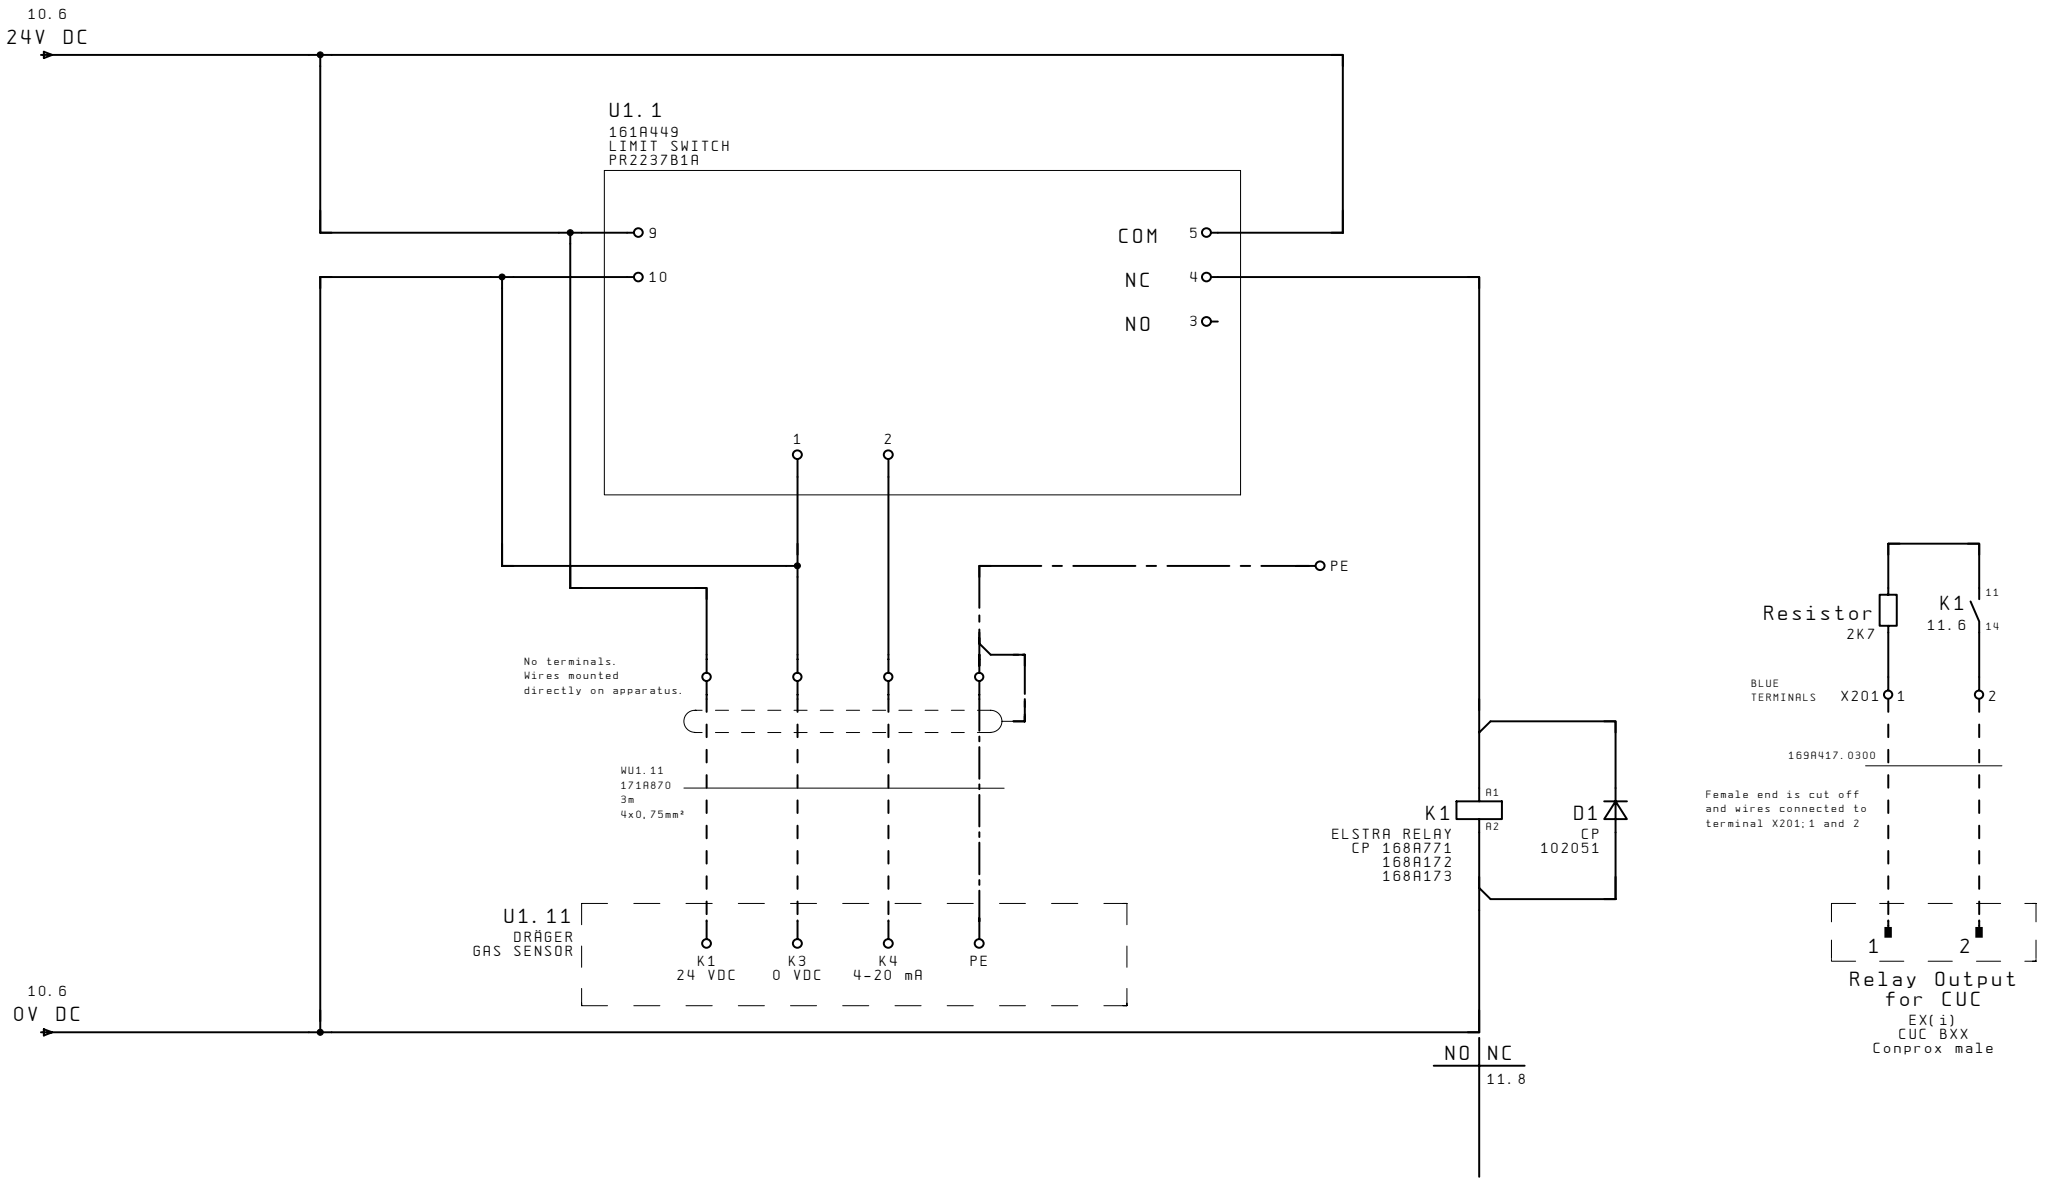

Terminals
mounted with
3m cable
for 4-20mA loop

Relay
Leak Detected

Leak Detected

10

Title	PRESSURETRANSMITTER	Drawn	18. Aug. 1999	App.		Rev. / Date	23. Okt. 2001
Subject	Flammeproof housing for 1 amplifiers	Plotted	08. Jan. 2003	Eng.	KHO		
Project	#xxxx DRÄGER GAS SENSOR, 4-20mA			Drw.	KHO		

Crisplant a/s

Drawing No. 325B876.4.E

Cont. page

Page no. 11