General Description

The manually operated leak detector, type TSV, is an independent unit designed to be suspended on a gallows suspension at e.g. a chain conveyor plant or a roller conveyor and is used for manual leak testing of the valve seat on filled LPG cylinders with screw valves.

The leak detector is particularly suitable for test of screw valves on domestic and industrial cylinders being handled in minor series (< 600 cylinders/hour).

The leak detector consists of a metal handle, on which a hook, a connecting test socket and a special detector tube are fitted. The connecting test socket is adapted to the actual cylinder valve according to the specifications of the customer. The detector tube consists of a system with 3 concentric plexiglass tubes that contain kerosene. The liquid is visible up to a height of approx. 7 mm.

Functional Description

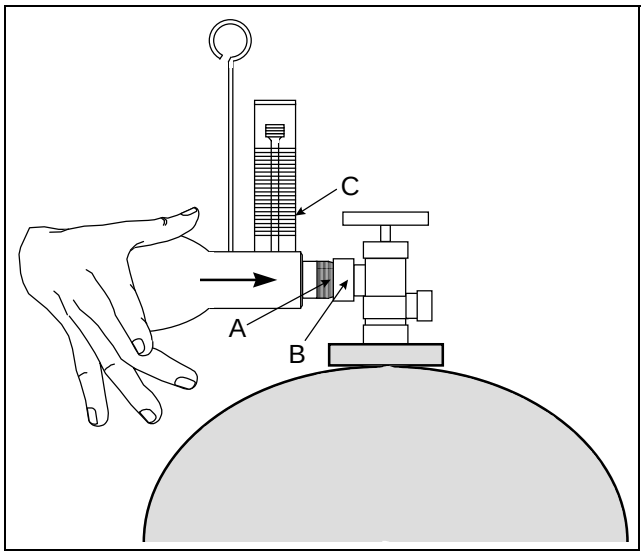

The connecting test socket of the leak tester (pos. A) is manually pressed against the outlet of the cylinder valve (pos. B). Thereby the liquid level in the outer plexiglass tube (pos. C) will rise slightly due to the compression of the rubber gasket in the valve seat.

If the liquid level remains stable, the valve is tight. If the liquid level rises further, or if bubbles appear in the liquid, the valve is leaky.

Scope of Supply

The leak tester is supplied ready to be suspended on a gallows suspension including corresponding metal handle fitted with a hook, a connecting test socket and a detector tube system. The connecting test socket is adapted to the actual cylinder valve according to the specifications of the customer.

Additional Equipment

(Only included if specified in quotation)

- Gallows with balance device for suspension of leak detector
- Standard spare parts set

© Kosan Crisplant LPG 1999

Technical Data

Capacity and conditions	• Max. 600 cylinders/hour, depending on the following factors: – The operator – The cylinder flow to and from the leak detector – Eventual variations of the conditions of the valves
Weight	• Approx. 0.4 kg
Other data	• The leak detector is designed for installation in places in which the temperature may vary between -10°C and +40°C • Test zone: The leak detector type TSV is designed for manual leak testing of the valve seat (pos. A) on screw valves

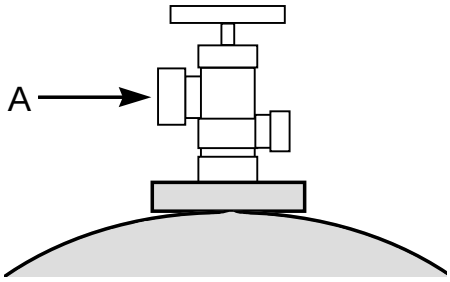

Dimensions in mm

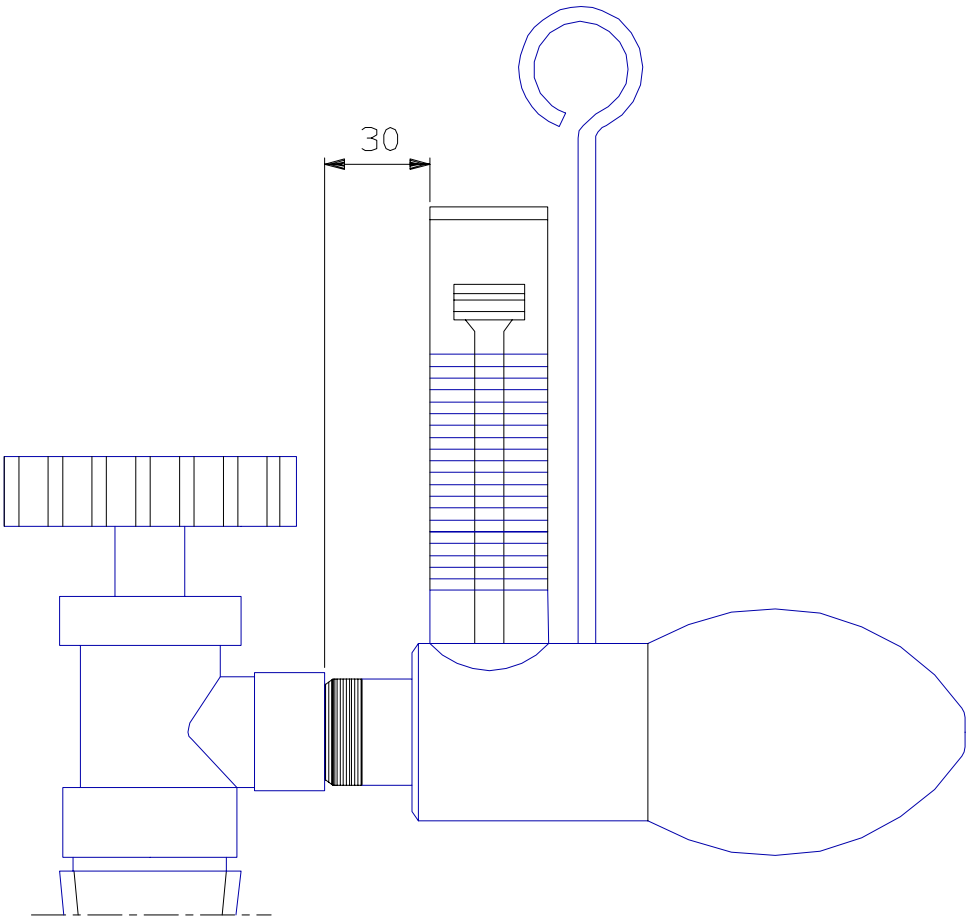

© Kosan Crisplant LPG 1999