

Zero Air Pollution and Zero Carbon From All Energy Without Blackouts at Low Cost in Wyoming

By Mark Z. Jacobson, Stanford University, March 15, 2021

This infographic summarizes results from simulations that demonstrate the ability of Wyoming to match all-purpose energy demand with wind-water-solar (WWS) supply, storage, and demand response continuously every 30 seconds for the years 2050-2051. All-purpose energy is energy for electricity, transportation, buildings, and industry. Results are shown for the Wyoming grid interconnected within the Western Electricity Coordinating Council (WECC) grid (AZ, CA, CO, ID, MT, NV, NM, OR, UT, WA, and WY). The ideal transition timeline is 100% WWS by 2035; however, results are shown for 2050-2051, after additional population growth has occurred.

WWS electricity-generating technologies include onshore and offshore wind, solar photovoltaics (PV) on rooftops and in power plants, concentrated solar power (CSP), geothermal, hydro, tidal, and wave power. WWS direct heat-sources include geothermal and solar. WWS storage includes electricity, heat, cold, and hydrogen storage. WWS equipment includes electric and hydrogen fuel cell vehicles, heat pumps, induction cooktops, arc furnaces, induction furnaces, resistance furnaces, lawnmowers, etc. No fossil fuels, nuclear bioenergy, or carbon capture is included.

The results are derived from the LOADMATCH grid model using 2050 U.S. state-specific business-as-usual (BAU) and wind-water-solar (WWS) all-sector load data projected from 2018 EIA state load data. The model also uses 30-second resolution WWS supply plus building heating/cooling load data from the GATOR-GCMOM weather-prediction model. The models and results are described, respectively, in the following publications:

Jacobson, M.Z. (2021) On the correlation between building heat demand and wind energy supply and how it helps to avoid blackouts, Smart Energy, 1, 100009, doi:10.1016/j.segy.2021.100009, <http://web.stanford.edu/group/efmh/jacobson/Articles/Others/21-Wind-Heat.pdf>

Jacobson, M.Z., A.-K. von Krauland, S.J. Coughlin, F.C. Palmer, and M.M. Smith (2021), Zero air pollution and zero carbon from all energy at low cost and without blackouts in variable weather throughout the U.S. with 100% win-water-solar (WWS) and storage, in review.

Main results. Transitioning Wyoming to 100% WWS for all energy purposes...

- **Keeps the grid stable 100% of the time. This is helped by the fact that, during cold storms, winds are stronger (Figure 1) and wind/solar are complementary in nature;**
- **Creates -31,000 more long-term, full-time jobs than lost;**
- **Saves 50 lives from air pollution per year in 2050 in Wyoming;**
- **Eliminates 76 million tonnes-CO₂e per year in 2050 in Wyoming;**
- **Reduces 2050 all-purpose, end-use energy requirements by 56.2%;**
- **Reduces Wyoming's 2050 annual energy costs by 65.5% (from \$14.6 to \$5 b/y);**
- **Reduces annual energy, health, plus climate costs by 91.3% (from \$57 to \$5 b/y);**
- **Costs ~\$42 b upfront. Upfront costs are paid back through energy sales. Costs are for WWS electricity, heat, and H₂ generation; electricity, heat, cold, and H₂ storage; heat pumps for district heating; all-distance transmission; and distribution;**
- **Requires 0.08% of Wyoming land for footprint, 0.28% for spacing.**

Table of Contents

Table 1. Reduced End-Use Demand Upon a Transition From BAU to WWS
Table 2. 2050 WWS End-Use Demand by Sector
Table 3. WWS End-Use Demand by Load Type
Table 4. Nameplate Capacities Needed by 2050 and Installed as of 2019/2020
Table 5. Capacity Factors of WWS Generators
Table 6. Percent of Load Met by Different WWS Generators
Table 7. Characteristics of Storage Resulting in Matching Demand With 100% WWS Supply
Figure 1. Keeping the Electric Grid Stable With 100% WWS + Storage + Demand Response
Table 8. Summary of Energy Budget Resulting in Grid Stability
Table 9. Details of Energy Budget Resulting in Grid Stability
Table 10. Breakdown of Energy Costs Required to Keep Grid Stable
Table 11. Energy, Health, and Climate Costs of WWS Versus BAU
Table 12. Air Pollution Mortalities, Carbon Dioxide Emissions, and Associated Costs
Table 13. Land Areas Needed
Table 14. Changes in Employment

Table 1. Reduced End-Use Demand (Load) Upon a Transition From BAU to WWS

1st row: 2018 annually-averaged end-use load (GW) and percentage of the load by sector in Wyoming. 2nd row: estimated 2050 total annually-averaged end-use load (GW) and percentage of the total load by sector if conventional fossil-fuel, nuclear, and biofuel use continues to 2050 under a BAU trajectory. 3rd row: estimated 2050 total end-use load (GW) and percent of total load by sector if 100% of BAU end-use all-purpose delivered load in 2050 is instead provided by WWS. Column (i) shows the percent reductions in total 2050 BAU load due to switching from BAU to WWS, including the effects of (f) energy use reduction due to the higher work to energy ratio of electricity over combustion, (g) eliminating energy use for the upstream mining, transporting, and/or refining of coal, oil, gas, biofuels, bioenergy, and uranium, and (h) policy-driven increases in end-use efficiency beyond those in the BAU case. Column (j) is the ratio of electricity load (=all energy load) in the 2050 WWS case to the electricity load in the 2050 BAU case. Whereas Column (j) shows that electricity consumption increases in the WWS versus BAU cases, Column (i) shows that all energy decreases.

Scenario	(a) Total annual average end-use load (GW)	(b) Resid- ential percent of total end-use load	(c) Com- mercial per-cent of total end-use load	(d) Indus- try per- cent of total end-use load	(e) Trans- port per- cent of total end-use load	(f) Percent change end-use load w/WWS due to higher work: energy ratio	(g) Percent change end-use load w/WWS due to elim- inating upstream	(h) Percent change end-use load w/WWS due to effic- iency beyond BAU	(i) Overall percent change in end-use load with WWS	(j) WWS: BAU elec- tricity load
Wyoming										
BAU 2018	13.5	7.7	7.7	55.5	29.1					
BAU 2050	16.7	5.8	7.3	63.0	23.9					
WWS 2050	7.3	5.4	7.8	75.2	11.6	-30.55	-21.33	-4.34	-56.22	2.91

Table 2. 2050 WWS End-Use Demand by Sector

2050 annual average end-use electric plus heat load (GW) by sector in the WECC region after energy in all sectors has been converted to WWS. Instantaneous loads can be higher or lower than annual average loads. Values for each region equal the sum over all state values from Table 1.

State/region	Total	Residential	Commercial	Transport	Industrial
WECC	195.5	35.55	36.94	72.82	50.20

Table 3. WWS End-Use Demand by Load Type

Annual average WWS all-sector inflexible and flexible loads (GW) for 2050 in the WECC region. “Total load” is the sum of “inflexible load” and “flexible load.” “Flexible load” is the sum of “cold load subject to storage,” “low-temperature heat load subject to storage,” “load for H₂” production, compression, and storage (accounting for leaks as well), and “all other loads subject to demand response (DR).” Annual average loads are distributed in time at 30-s resolution, as described in the text. Instantaneous loads, either flexible or inflexible, can be much higher or lower than annual average loads. Also shown is the annual hydrogen mass needed in each region, estimated as the H₂ load multiplied by 8,760 hr/yr and divided by 59.01 kWh/kg-H₂.

State/region	Total end- use load (GW)	Inflex- ible load (GW)	Flex- ible load (GW)	Cold load subject to storage (GW)	Low-temp- erature heat load subject to storage (GW)	Load sub- ject to DR	Load for H ₂ (GW)	H ₂ needed (Tg- H ₂ /yr)
WECC	195.5	97.6	97.9	0.41	8.18	21.5	67.8	3.19

Table 4. Nameplate Capacities Needed by 2050 and Installed as of 2019/2020

Final (from LOADMATCH) 2050 total (existing plus new) nameplate capacity (GW) of WWS generators needed to match power demand with supply, storage, and demand response continuously during 2050-2051 in Wyoming (when interconnected within WECC) and in the WECC region as a whole. Also provided are nameplate capacities already installed as of 2019 or 2020 end. Nameplate capacity equals the maximum possible instantaneous discharge rate.

Year	Onshore wind	Off-shore wind	Residential rooftop PV	Comm /govt rooftop PV	Utility PV	CSP with storage	Geothermal -electricity	Hydro power	Wave	Tidal	Solar thermal	Geothermal heat
2019/20 Wyoming	1.82	0	0.01	0	0.09	0	0	0.30	0	0	0	0
2019/20 WECC	24.30	0	8.07	4.20	18.84	1.80	3.80	51.43	0	0	0	0
2050 Wyoming	11.85	0	2.45	2.73	17.21	0	0.03	0.30	0	0	0	0
2050 WECC	155.53	69.77	91.75	144.9	232.5	3.11	6.73	51.43	1.09	0.15	0	0

Table 5. Capacity Factors of WWS Generators

Simulation-averaged 2050-2051 capacity factors (percent of nameplate capacity produced as electricity before transmission, distribution or maintenance losses) in the WECC region. The mean capacity factors in this table equal the simulation-averaged power supplied by each generator in each region (Table 6) divided by the nameplate capacity of each generator in each region (Table 4).

Scenario	On-shore wind	Off-shore wind	Rooftop PV	Utility PV	CSP with storage	Geo-thermal electricity	Hydro power	Wave	Tidal	Solar thermal	Geo-thermal heat
WECC	0.369	0.297	0.224	0.263	0.95	0.903	0.493	0.298	0.247	0	0

Capacity factors of offshore and onshore wind turbines account for array losses (extraction of kinetic energy by turbines). The symbol "--" indicates no installation of the technology. Rooftop PV panels are fixed-tilt at the optimal tilt angle of the country they reside in; utility PV panels are half fixed optimal tilt and half single-axis horizontal tracking.

Table 6. Percent of Load Met by Different WWS Generators

Projected simulation-averaged 2050-2051 all-sector WWS energy supply before transmission and distribution losses, storage losses, or shedding losses, in the WECC region, and percent of supply met by each generator, based on LOADMATCH simulations. Simulation-average power supply (GW) equals the simulation total energy supply (GWh/yr) divided by the number of hours of simulation. The percentages for each region add to 100%. Multiply each percentage by the 2050 total supply to obtain the GW supply by each generator. Divide the GW supply from each generator by its capacity factor (Table 5) to obtain the 2050 nameplate capacity of each generator needed to meet the supply (Table 4).

Scenario	Total WWS supply (GW)	On-shore wind (%)	Off-shore wind (%)	Roof PV (%)	Utility PV (%)	CSP with storage (%)	Geothermal electricity (%)	Hydro power (%)	Wave (%)	Tidal (%)	Solar thermal heat (%)	Geothermal heat (%)
WECC	227.1	25.29	9.12	23.33	26.96	1.30	2.68	11.18	0.14	0.016	0	0

Figure 1. Keeping the Electric Grid Stable With 100% WWS + Storage + Demand Response

2050-2051 hourly time series showing the matching of all-energy demand with supply and storage in the WECC grid region as a whole. First row: modeled time-dependent total WWS power generation versus load plus losses plus changes in storage plus shedding for the full two-year simulation period. Second row: same as first row, but for a window of 100 days during the simulation. Third row: a breakdown of WWS power generation by source during the window. Fourth row: a breakdown of inflexible load; flexible electric, heat, and cold load; flexible hydrogen load; losses in and out of storage; transmission and distribution losses; changes in storage; and shedding. Fifth row: A breakdown of solar PV+CSP electricity production, onshore plus offshore wind electricity production, building total cold load, and building total heat load (as used in LOADMATCH), summed over each region; Sixth row: correlation plots of building heat load versus wind power output and wind power output versus solar power output, obtained from all hourly data during the simulation. Correlations are very strong for $R=0.8-1$ ($R^2=0.64-1$); strong for $R=0.6-0.8$ ($R^2=0.36-0.64$); moderate for $R=0.4-0.6$ ($R^2=0.16-0.36$); weak for $0.2-0.4$ ($R^2=0.04-0.16$); and very weak for $0-0.2$ ($R^2=0-0.04$) (Evans, 1996). The model was run at 30-s resolution. Results are shown hourly, so units are energy output (TWh) per hour increment, thus also in units of power (TW) averaged over the hour. No load loss occurred during any 30-s interval. Raw GATOR-GCMOM results for solar, wind, heat load, and cold load were provided and fed into LOADMATCH at 30-s time increments. LOADMATCH modified the magnitudes, but not time series, of GATOR-GCMOM results, as described in the main text.

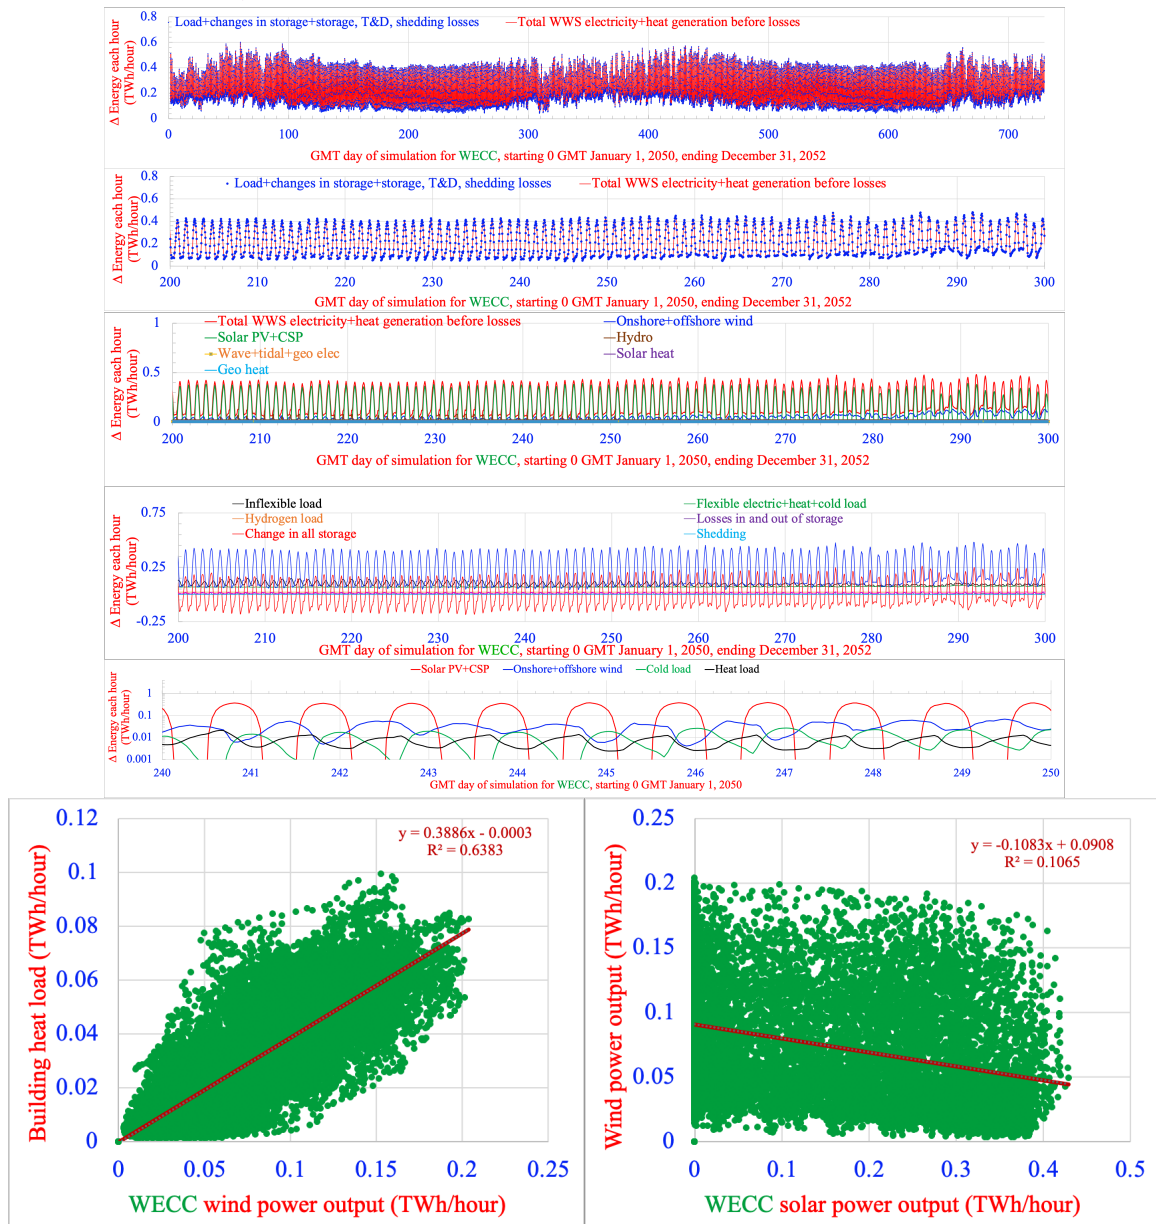


Table 8. Summary of Energy Budget Resulting in Grid Stability

Budget of simulation-averaged end-use power demand met, energy lost, WWS energy supplied, and changes in storage, during the 2-year (17,507.4875 hour) simulations. All units are GW averaged over the simulation and are derived from the data in Table 9 by dividing values from the table in units of TWh per simulation by the number of hours of simulation. TD&M losses are transmission, distribution, and maintenance losses. Wind turbine array losses are already accounted for in the “WWS supply before losses” numbers,” since wind supply values come from GATOR-GCMOM, which accounts for such losses. Results are shown for the WECC region as a whole, within which Wyoming is interconnected.

Scenario	(a) Annual average end-use load (GW)	(b) TD&M losses (GW)	(c) Storage losses (GW)	(d) Shedding losses (GW)	(e) End-use load+ losses =a+b+ c+d (GW)	(f) WWS supply before losses (GW)	(g) Changes in storage (GW)	(h) Supply+ch anges in storage =f+g (GW)
WECC	195.5	13.85	7.42	10.67	227.5	227.1	0.36	227.5

Table 9. Details of Energy Budget Resulting in Grid Stability

Budget of simulation-total end-use energy demand met, energy lost, WWS energy supplied, and changes in storage, during the 2-year (17,507.4875 hour) simulations. All units are TWh over the simulation. Divide by the number of hours of simulation to obtain simulation-averaged power values, which are provided in Table 8 for key parameters. Results are shown for the WECC region as a whole, within which Wyoming is interconnected.

	WECC
A1. Total end use demand	3,423
Electricity for electricity inflexible demand	1,730
Electricity for electricity, heat, cold storage + DR	1,317
Electricity for H ₂ direct use + H ₂ storage	377
A2. Total end use demand	3,423
Electricity for direct use, electricity storage, + H ₂	3,296
Low-T heat load met by heat storage	125
Cold load met by cold storage	0.89
A3. Total end use demand	3,423
Electricity for direct use, electricity storage, DR	2,896
Electricity for H ₂ direct use + H ₂ storage	377
Electricity + heat for heat subject to storage	143
Electricity for cold load subject to storage	7.26
B. Total losses	559
Transmission, distribution, downtime losses	243
Losses CSP storage	0.25
Losses PHS storage	3.64
Losses battery storage	74
Losses CW-STES + ICE storage	0
Losses HW-STES storage	16
Losses UTES storage	36
Losses from shedding	187
Net end-use demand plus losses (A1 + B)	3,982
C. Total WWS supply before T&D losses	3,976
Onshore + offshore wind electricity	1,368
Rooftop + utility PV+ CSP electricity	2,051
Hydropower electricity	444.4
Wave electricity	5.67
Geothermal electricity	106.402
Tidal electricity	0.6511

Solar heat	0
Geothermal heat	0
D. Net taken from (+) or added to (-) storage	6.2842
CSP storage	-0.007
PHS storage	-0.0442
Battery storage	-0.0967
CW-STES+ICE storage	-0.0006
HW-STES storage	0.1407
UTES storage	7.7945
H ₂ storage	-1.5025
Energy supplied plus taken from storage (C+D)	3,982

End-use demands in A1, A2, A3 should be identical. Generated electricity is shed when it exceeds the sum of electricity demand, cold storage capacity, heat storage capacity, and H₂ storage capacity.

Onshore and offshore wind turbines in GATOR-GCMOM, used to calculate wind power output for use in LOADMATCH, are assumed to be Senvion (formerly Repower) 5 MW turbines with 126-m diameter blades, 100 m hub heights, a cut-in wind speed of 3.5 m/s, and a cut-out wind speed of 30 m/s.

Rooftop PV panels in GATOR-GCMOM were modeled as fixed-tilt panels at the optimal tilt angle of the country they resided in; utility PV panels were modeled as half fixed optimal tilt and half single-axis horizontal tracking. All panels were assumed to have a nameplate capacity of 390 W and a panel area of 1.629668 m², which gives a 2050 panel efficiency (Watts of power output per Watt of solar radiation incident on the panel) of 23.9%, which is an increase from the 2015 value of 20.1%.

Each CSP plant before storage is assumed to have the mirror and land characteristics of the Ivanpah solar plant, which has 646,457 m² of mirrors and 2.17 km² of land per 100 MW nameplate capacity and a CSP efficiency (fraction of incident solar radiation that is converted to electricity) of 15.796%, calculated as the product of the reflection efficiency of 55% and the steam plant efficiency of 28.72%. The efficiency of the CSP hot fluid collection (energy in fluid divided by incident radiation) is 34%.

Table 10. Breakdown of Energy Costs Required to Keep Grid Stable

Summary of 2050 WWS mean capital costs of new electricity plus heat generators; electricity, heat, cold, and hydrogen storage (including heat pumps to supply district heating and cooling), and all-distance transmission/distribution (\$ trillion in 2020 USD) and mean levelized private costs of energy (LCOE) (USD ¢/kWh-all-energy or ¢/kWh-electricity-replacing-BAU-electricity) averaged over each simulation. Also shown is the energy consumed per year in each case and the resulting aggregate annual energy cost. Results are shown for Wyoming when its grid is isolated from the outside world. Results are shown for the WECC region as a whole, within which Wyoming is interconnected.

	WECC
Capital cost new generators only (\$trillion)	0.799
Cap cost new generators + storage (\$trillion)	1.083
<i>Components of total LCOE (¢/kWh-all-energy)</i>	
Short-dist. transmission	1.050
Long-distance transmission	0.062
Distribution	2.375
Electricity generators	3.257
Additional hydro turbines	0
Solar thermal collectors	0
CSP-PCM+PHS+battery storage	0.293
CW-STES+ICE storage	0.001
HW-STES storage	0.009
UTES storage	0.069
Heat pumps for filling district heating/cooling	0.038
H ₂ production/compression/storage	0.675
Total LCOE (¢/kWh-all-energy)	7.829
LCOE (¢/kWh-replacing BAU electricity)	7.032
GW annual avg. end-use demand (Table 1)	195.5
TWh/y end-use demand (GW x 8,760 h/y)	1,713
Annual energy cost (\$billion/yr)	134.1

The LCOEs are derived from capital costs, annual O&M, and end-of-life decommissioning costs that vary by technology (and that are a function of lifetime and a social discount rate for an intergenerational project of 2.0 (1-3)%, all divided by the total annualized end-use demand met, given in the present table.

Capital cost of generators-storage-H₂-HVDC (\$trillion) is the capital cost of new electricity and heat generators; electricity, heat, cold, and hydrogen storage; hydrogen electrolyzers and compressors; and long-distance (HVDC) transmission.

Since the total end-use load includes heat, cold, hydrogen, and electricity loads (all energy), the “electricity generator” cost, for example, is a cost per unit all energy rather than per unit electricity alone. The ‘Total LCOE’ gives the overall cost of energy, and the ‘Electricity LCOE’ gives the cost of energy for the electricity portion of load replacing BAU electricity end use. It is the total LCOE less the costs for UTES and HW-STES storage, H₂, and less the portion of long-distance transmission associated with H₂.

Short-distance transmission costs are \$0.0105 (0.01-0.011)/kWh.

Distribution costs are \$0.02375 (0.023-0.0245)/kWh.

Long-distance transmission costs are \$0.0089 (0.0042-0.010)/kWh (in USD 2020), which assumes 1,500 to 2,000 km HVDC lines, a capacity factor usage of the lines of ~50% and a capital cost of ~\$400 (300-460)/MWtr-km.

Table 11. Energy, Health, and Climate Costs of WWS Versus BAU

2050 Wyoming and WECC annual-average end-use (a) BAU load and (b) WWS load; (c) percent difference between WWS and BAU load; (d) present value of the mean total capital cost for new WWS electricity, heat, cold, and hydrogen generation and storage and all-distance transmission and distribution; mean levelized private costs of all (e) BAU and (f) WWS energy (¢/kWh-all-energy-sectors, averaged between today and 2050); (g) mean WWS private (equals social) energy cost per year, (h) mean BAU private energy cost per year, (i) mean BAU health cost per year, (j) mean BAU climate cost per year, (k) BAU total social cost per year; (l) percent difference between WWS and BAU private energy cost; and (m) percent difference between WWS and BAU social energy cost. All costs are in 2020 USD. H=8760 hours per year.

Scenario	(a) ¹ 2050 BAU Annual avg. end-use load (GW)	(b) ¹ 2050 WWS Annual avg. end-use load (GW)	(c) 2050 WWS minus BAU load = (b-a)/a (%)	(d) ² WWS mean total cap- ital cost (\$tril 2020)	(e) ³ BAU mean private energy cost ¢/kWh- all energy	(f) ⁴ WWS mean private energy cost ¢/kWh- all energy	(g) ⁵ WWS mean annual all- energy private and social cost = bfH \$bil/	(h) ⁵ BAU mean annual all- energy private cost = aeH \$bil/y	(i) ⁶ BAU mean annual BAU health cost \$bil/y	(j) ⁷ BAU mean annual climate cost (\$bil/y)	(k) BAU mean annual BAU total social cost =h+i+j \$bil/y	(l) WWS minus BAU private energy cost = (g-h)/h (%)	(m) WWS minus BAU social energy cost = (g-k)/k (%)
Wyoming	16.7	7.3	-56.2	0.042	9.94	7.83	5.0	14.6	0.6	42.3	57	-65.5	-91.3
WECC	472.0	195.5	-58.6	1.083	9.94	7.83	134.1	410.9	208.8	627.4	1,247	-67.4	-89.2

¹From Table 1.

²Capital cost of generators-storage-H₂-HVDC (\$trillion) is the capital cost of new electricity and heat generators; electricity, heat, cold, and hydrogen storage; hydrogen electrolyzers and compressors; and long-distance (HVDC) transmission.

³This is the BAU electricity-sector cost of energy per unit energy. It is assumed to equal the BAU all-energy cost of energy per unit energy.

⁴The WWS cost per unit energy is for all energy, which is almost all electricity (plus a small amount of direct heat)

⁵The annual private cost of WWS or BAU energy equals the cost per unit energy from Column (f) or (g), respectively, multiplied by the energy consumed per year, which equals the end-use load from Column (b) or (a), respectively, multiplied by 8,760 hours per year.

⁶The 2050 annual BAU health cost equals the number of total air pollution mortalities per year in 2050 from Table 12, Column (a), multiplied by 90% (the estimated percent of total air pollution mortalities that are due to energy) and by a statistical cost of life of \$11.56 (\$7.21-\$17.03) million/mortality (2020 USD) and a multiplier of 1.15 for morbidity and another multiplier of 1.1 for non-health impacts (Jacobson et al., 2019).

⁷The 2050 annual BAU climate cost equals the 2050 CO₂e emissions from Table 12, Column (b), multiplied by the social cost of carbon in 2050 of \$548 (\$315-\$1,188)/metric tonne-CO₂ (in 2020 USD), which is updated from values in Jacobson et al. (2019), which were in 2013 USD.

Table 12. Air Pollution Mortalities, Carbon Dioxide Emissions, and Associated Costs

Wyoming and WECC (a) estimated air pollution mortalities per year in 2050-2051 due to anthropogenic sources (90% of which are energy); (b) carbon-equivalent emissions (CO₂e) in the BAU case; (c) cost per tonne-CO₂e of eliminating CO₂e with WWS; (d) BAU energy cost per tonne-CO₂e emitted; (e) BAU health cost per tonne-CO₂e emitted; (f) BAU climate cost per tonne-CO₂e emitted; (g) BAU total social cost per tonne-CO₂e emitted; (h) BAU health cost per unit all-BAU-energy produced; and (i) BAU climate cost per unit-all-BAU-energy produced.

Scenario	(a) ¹ 2050 (Deaths/y)	(b) ² 2050 BAU CO ₂ e (Mtonne/y)	(c) ³ 2050 WWS (\$/ tonne- CO ₂ e- elim- inated)	(d) ⁴ 2050 BAU energy cost (\$/ tonne- CO ₂ e- emitted)	(e) ⁴ 2050 BAU health cost (\$/ tonne- CO ₂ e- emitted)	(f) ⁴ 2050 BAU climate cost (\$/ tonne- CO ₂ e- emitted)	(g) ⁴ 2050 BAU social cost = d+e+f (\$/ tonne- CO ₂ e- emitted)	(h) ⁵ 2050 BAU health cost (¢/kWh)	(i) ⁵ 2050 BAU climate cost (¢/kWh)
Wyoming	46	76	66.4	192	7.9	558	759	0.41	28.8
WECC	15,867	1,124	119.3	366	185.8	558	1,110	5.05	15.2

¹2050 state mortalities due to air pollution are scaled from 2010-12 state values from Jacobson et al. (2015) using the ratio of the total 2050 air pollution mortalities for the U.S. from Jacobson et al. (2019) 53,199/yr (36,394/yr-73,614/yr) to the total 2010-12 number of deaths across the U.S. from Jacobson et al. (2015) 62,381/yr (19,363/yr-115,723/yr).

²CO₂e=CO₂-equivalent emissions. This accounts for the emissions of CO₂ plus the emissions of other greenhouse gases multiplied by their global warming potentials.

³Calculated as the WWS private energy and total social cost from Table 11, Column (g) divided by the CO₂e emissions from Column (b) of the present table.

⁴Columns (d)-(g) are calculated as the BAU private energy, health, climate, and total social costs from Table 11, Columns (h)-(k), respectively, each divided by the CO₂e emissions from Column (b) of the present table.

⁵Columns (h)-(i) are calculated as the BAU health and climate costs from Table 11, Columns (i)-(j), respectively, each divided by the BAU end-use load from Table 11, Column (a) and by 8760 hours per year.

Table 13. Land Areas Needed

Footprint areas for *new* utility PV farms, CSP plants, solar thermal plants for heat, geothermal plants for electricity and heat, and hydropower plants and spacing areas for new onshore wind turbines.

Scenario	State or region land area (km ²)	Footprint Area (km ²)	Spacing area (km ²)	Footprint area as percentage of state or region land area (%)	Spacing area as a percentage of state or region land area (%)
Wyoming	251,489	209	713	0.08	0.28
WECC	3,042,090	2,659	9,317	0.09	0.31

Spacing areas are areas between wind turbines needed to avoid interference of the wake of one turbine with the next. Such spacing area can be used for multiple purposes, including farmland, rangeland, open space, or utility PV. Footprint areas are the physical land areas, water surface areas, or sea floor surface areas removed from use for any other purpose by an energy technology. Rooftop PV is not included in the footprint calculation because it does not take up new land. Conventional hydro new footprint is zero because no new dams are proposed as part of these roadmaps. Offshore wind, wave, and tidal are not included because they don't take up new land. Areas are given both as an absolute area and as a percentage of the state or regional land area, which excludes inland or coastal water bodies. For comparison, the total area and land area of Earth are 510.1 and 144.6 million km², respectively.

Table 14. Changes in the Employment

Estimated long-term, full-time jobs created and lost due to transitioning from BAU energy to WWS across all energy sectors when Wyoming is isolated versus interconnected to a larger grid. The job creation accounts for new jobs in the electricity, heat, cold, and hydrogen generation, storage, and transmission (including HVDC transmission) industries. It also accounts for the building of heat pumps to supply district heating and cooling. However it does not account for changes in jobs in the production of electric appliances, vehicles, and machines or in increasing building energy efficiency. Construction jobs are for new WWS devices only. Operation jobs are for new and existing devices. The losses are due to eliminating jobs for mining, transporting, processing, and using fossil fuels, biofuels, and uranium. Fossil-fuel jobs due to non-energy uses of petroleum, such as lubricants, asphalt, petrochemical feedstock, and petroleum coke, are retained. For transportation sectors, the jobs lost are those due to transporting fossil fuels (e.g., through truck, train, barge, ship, or pipeline); the jobs not lost are those for transporting other goods. The table does not account for jobs lost in the manufacture of combustion appliances, including automobiles, ships, or industrial machines.

Scenario	Construction jobs produced	Operation jobs produced	Total jobs produced	Jobs lost	Net change in jobs
Wyoming	21,480	26,956	48,435	79,173	-30,738
WECC	494,314	561,341	1,055,655	500,351	555,304