


The MEANS Procedure

Analysis Variable : FD521 Fluid whole milk										
N	N Miss	Mean	Median	Mode	Minimum	Maximum	Range	Quartile Range	Lower 95% CL for Mean	Upper 95% CL for Mean
14462249	0	38.96	0.00	0.00	0.00	1872.00	1872.00	0.00	38.89	39.03

Fluid whole milk

(FD521)

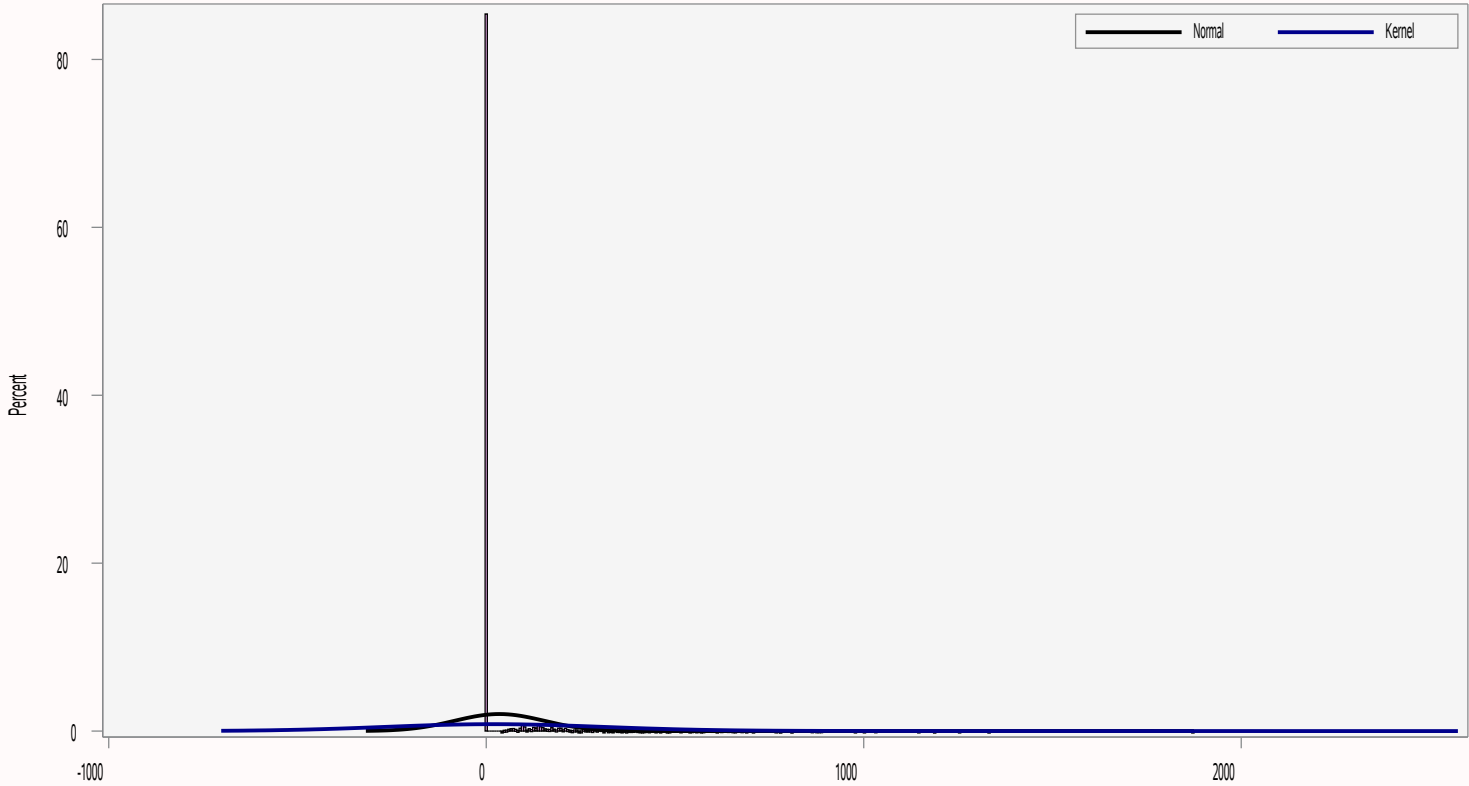

Fluid whole milk

(FDS21)

