


## The MEANS Procedure

Analysis Variable : SH032 Electricity										
N	N Miss	Mean	Median	Mode	Minimum	Maximum	Range	Quartile Range	Lower 95% CL for Mean	Upper 95% CL for Mean
14462249	0	1357.42	1188.00	0.00	0.00	9612.00	9612.00	1140.00	1356.85	1358.00

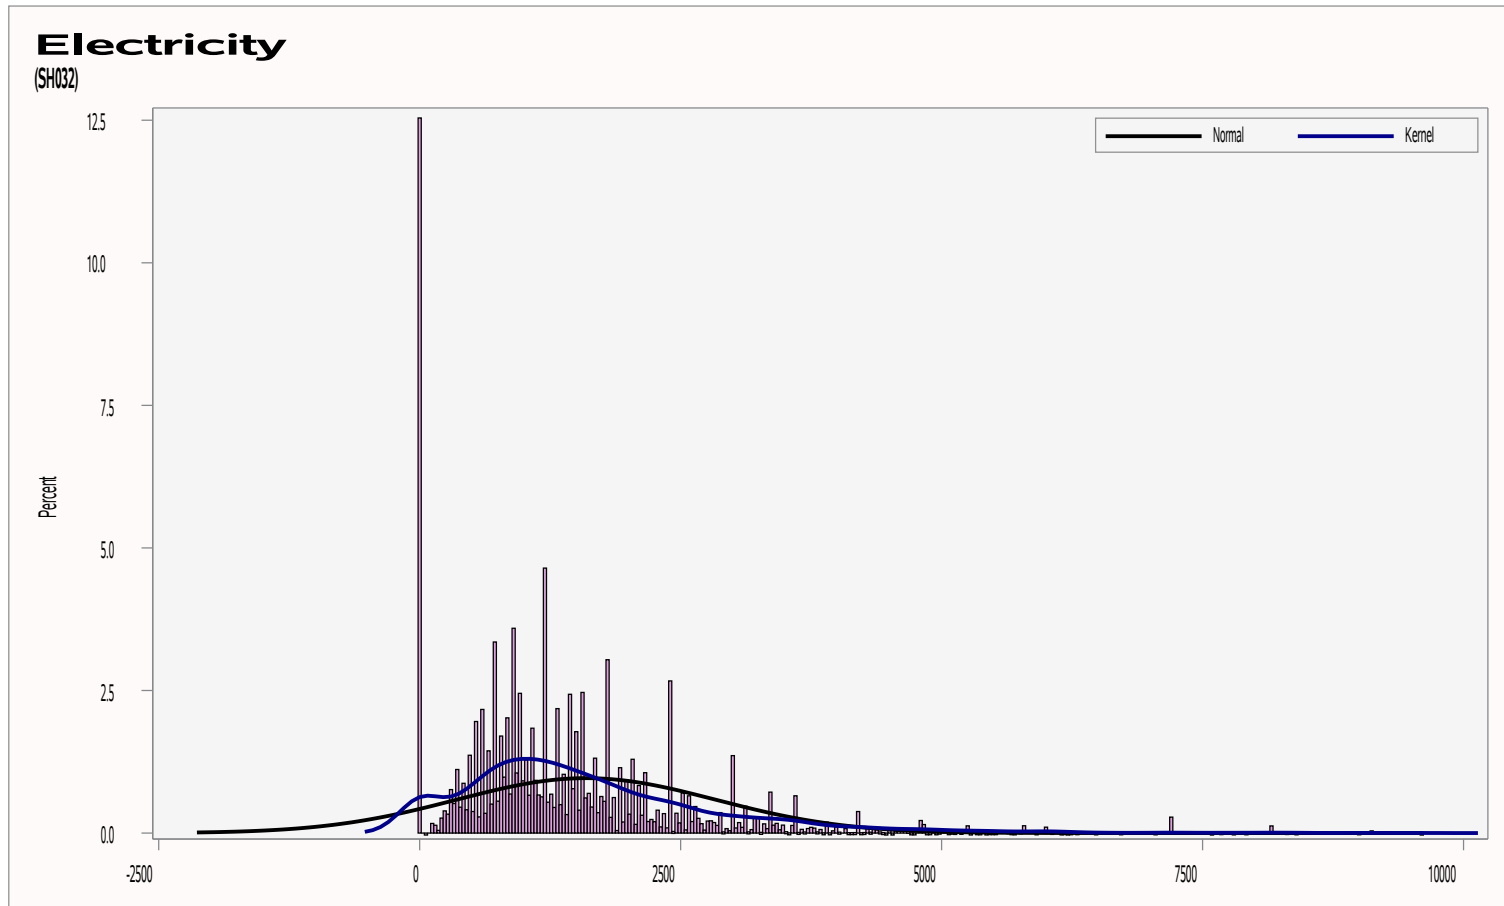

# Electricity

(SH032)

