


## The MEANS Procedure

Analysis Variable : SH031 Water and sewage										
N	N Miss	Mean	Median	Mode	Minimum	Maximum	Range	Quartile Range	Lower 95% CL for Mean	Upper 95% CL for Mean
14462249	0	386.64	0.00	0.00	0.00	4860.00	4860.00	708.00	386.34	386.94

**Water and sewage**

(SH031)

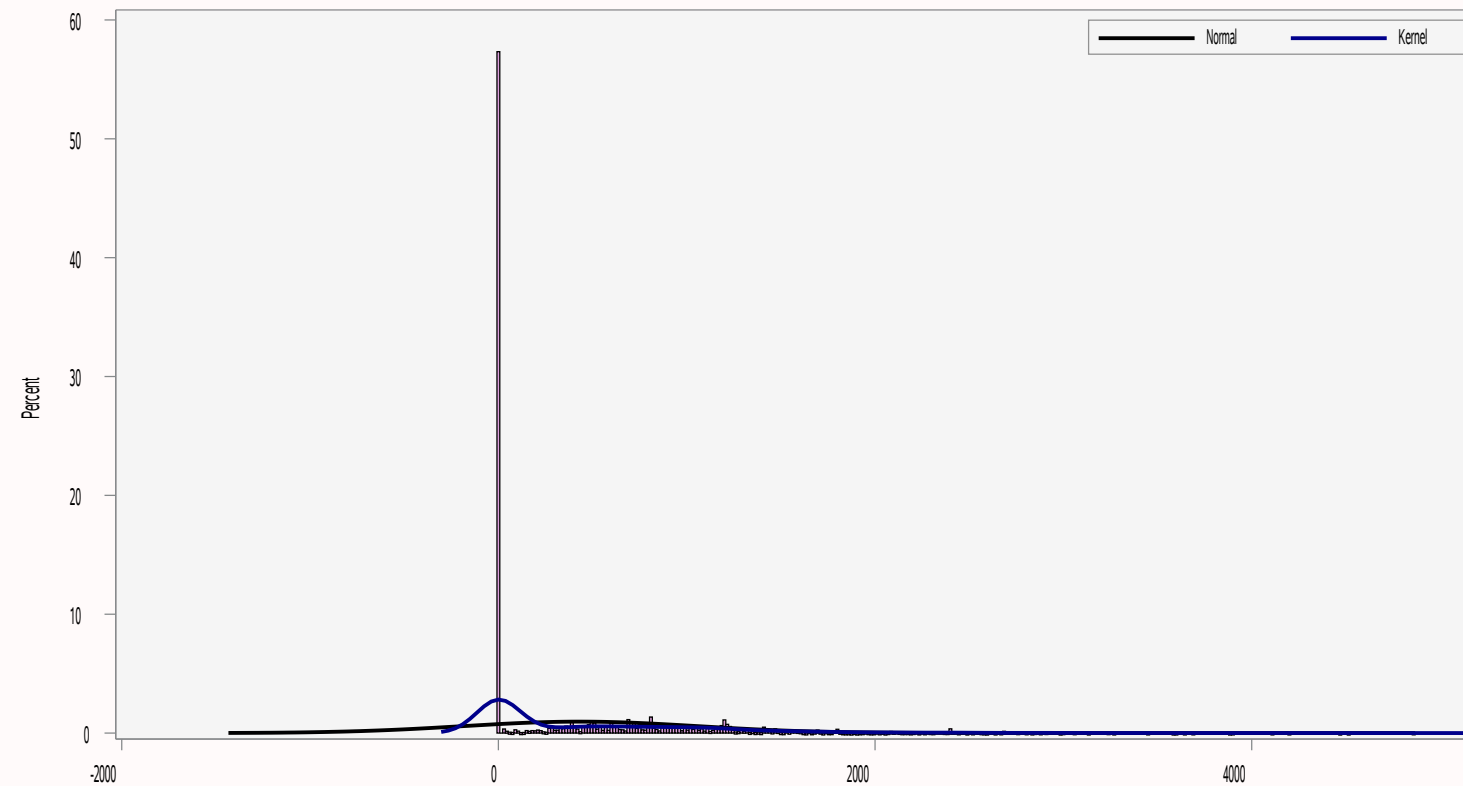

## Water and sewage

(SH031)

