

Calculation Report: «1750 OX Residences - 1750 N Oxford Ave. - Eau Claire, WI»

XC structural engineering

August 16, 2019

Contents

1	Introduction and scope	7
2	Building codes	7
3	Loading criteria	7
3.1	Gravity loading	7
3.2	Wind design criteria	7
3.3	Snow loading	7
4	Seismic design criteria	9
5	Materials	9
6	Design and analysis software	9
7	Load combinations	9
8	Wood framing	12
8.1	Gravity	12
8.2	Trusses	12
8.2.1	Trusses A and B. Roof	12
8.2.2	Trusses A and B. Third floor	12
8.2.3	Trusses A and B. Second floor	15
8.2.4	Trusses C and D. Roof	15
8.2.5	Trusses C and D. Third floor	16
8.2.6	Trusses C and D. Second floor	17
8.2.7	Truss E. Roof	18
8.2.8	Truss E. Third floor	19
8.2.9	Truss E. Second floor	20
8.3	Joists and headers	21
8.3.1	Corridor floor sheathing	21
8.3.2	Joists	22
8.3.3	Joists under storage/HVAC floor	25
8.3.4	Facade headers	26
8.3.5	Corridor headers	27
8.4	Steel beams	27
8.4.1	Steel beam at courtyard facade	27

8.4.2	Steel beam at corridor	29
8.5	Cantilevers	31
8.5.1	Cantilevers C1, C3, C4, C6, C11 and C12	31
8.5.2	Cantilevers C2 and C5	31
8.5.3	Cantilevers C7, C8, C9 and C10	33
8.5.4	Cantilever C13	34
8.5.5	Cantilever C14	34
8.6	Columns	35
8.6.1	Columns P3.1 to P3.6	35
8.6.2	Column P3.7	39
8.6.3	Column P2.1	39
8.6.4	2x6 wood stud capacity	40
8.7	Lateral. Diaphragms/Shear walls	40
8.7.1	East and West facades shear walls	40
8.7.2	Courtyard facades shear walls	41
8.7.3	South facades shear walls	43
8.7.4	North facade shear walls	44
9	Basement	49
9.1	Structural model	49
9.2	Footings	53
9.2.1	Loads	53
9.2.2	Load combinations	53
9.2.3	Footing dimensions and reinforcement	53
9.2.4	Limit state checking	53
9.3	Basement walls	53
9.3.1	Introduction	53
9.3.2	Load determination	56
9.3.3	Load combinations	57
9.3.4	Stem dimensions and reinforcement	58
9.4	Ramp	64
9.4.1	Design criteria	64
9.4.2	Acceptance criteria	64
Appendices		68
A	Loading criteria	68
A.1	Dead loads	68
A.2	Live loads	69
A.3	Snow loads	69
A.4	Wind loads	70
A.5	Earthquake loads	71
B	Calculation results. Internal forces on columns	72
B.1	Ultimate limit states	72
B.2	Serviceability limit states	98

List of Tables

1	Gravity Loads	8
2	Wind Design Criteria	8
3	Snow Design Criteria	8
4	Seismic Design Criteria	9

5	Concrete properties	9
6	Reinforcement properties	9
7	Combinations Ultimate Limit States	10
8	Combinations Serviceability Limit States	11
9	Time assigned to wallboard membranes	23
10	Steel beam at courtyard facade. Trusses reactions.	28
11	Steel beam at corridor. Trusses reactions.	30
12	Cantilever schedule.	35
17	Column footing schedule.	53
18	Soil bearing pressures. Capacity factors	54
19	Shear design. Capacity factors	54
20	Two-way shear design. Capacity factors	55
21	Concrete walls reinforcing schedule	58
22	Wall materials and dimensions T1	58
23	Wall materials and dimensions T2	59
24	Wall materials and dimensions T3	59
25	Wall materials and dimensions T4	60
26	Wall materials and dimensions T5	60
27	Wall materials and dimensions T6	61

List of Figures

1	Trusses key plan.	13
2	Roof trusses at zones A and B (see key plan in figure 1).	14
3	Third floor trusses at zones A and B (see key plan in figure 1).	14
4	Second floor trusses at zones A and B (see key plan in figure 1).	15
5	Roof trusses at zones C and D (see key plan in figure 1).	16
6	Third floor trusses at zones C and D (see key plan in figure 1).	17
7	Second floor trusses at zones C and D (see key plan in figure 1).	18
8	Roof truss at zone E (see key plan in figure 1).	19
9	Third floor truss at zone E (see key plan in figure 1).	20
10	Second floor truss at zone E (see key plan in figure 1).	21
11	Second floor beams key plan.	28
12	Second floor cantilevers key plan.	32
13	Columns key plan. Roof	36
14	Columns key plan. Third floor	37
15	Columns key plan. Second floor	38
16	Shear walls on the third floor.	46
17	Shear walls on the second floor.	47
18	Shear walls on the first floor.	48
19	Elastic model, mesh.	50
20	Load case D: dead load (include slab selfweight) [units: kN,m].	50
21	Load case Lru: live load (uniform on rooms) [units: kN,m].	50
22	Load case Lrs: live load (staggered pattern on rooms) [units: kN,m].	50
23	Load case Lpu: live load (uniform on patios) [units: kN,m].	50
24	Load case S: snow [units: kN,m].	50
25	Load case Lps: live load (staggered pattern on patios) [units: kN,m].	51
26	Load case W_WE: wind West-East [units: kN,m].	51
27	Load case W_NS: wind North-South [units: kN,m].	51
28	Load layout on first floor.	52
29	Flexure in the longitudinal direction. Capacity factor.	55

30	Flexure in the transverse direction. Capacity factor.	56
31	Ramp. Reinforcing layout.	64
32	Ramp elastic model, mesh.	65
33	Load case D: dead load (include slab selfweight) [units: kN/m ²].	65
34	Load case Lv _{unif} : uniform live load (vehicles) [units: kN/m ²].	65
35	Load case Lv _{conc,s1} : concentrated live load (vehicles) on mid-span 1 [units: kN].	65
36	Load case Lv _{conc,s2} : concentrated live load (vehicles) on mid-span 2 [units: kN].	65
37	Load case Lv _{conc,s3} : concentrated live load (vehicles) on mid-span 3 [units: kN].	65
38	ULS normal stresses check. Efficiency in longitudinal direction	66
39	ULS normal stresses check. Efficiency in transversal direction	66
40	ULS normal stresses check. Bending moment in longitudinal direction [units: kN.m].	66
41	ULS shear check. Efficiency in longitudinal direction	66
42	ULS shear check. Efficiency in transversal direction	66
43	ULS shear check. Internal shear force in longitudinal direction [units: kN].	66
44	ULS shear check. Internal shear force in transversal direction [units: kN].	67
45	ULS01: 1.4*D. Columns, internal axial force [kN]	72
46	ULS01: 1.4*D. Columns, bending moment about local axis y [m.kN]	72
47	ULS01: 1.4*D. Columns, bending moment about local axis z [m.kN]	73
48	ULS01: 1.4*D. Columns, internal shear force in local direction y [kN]	73
49	ULS01: 1.4*D. Columns, internal shear force in local direction z [kN]	73
50	ULS02_a: 1.2*D + 1.6*Lru + Lpu + 0.5*S. Columns, internal axial force [kN]	74
51	ULS02_a: 1.2*D + 1.6*Lru + Lpu + 0.5*S. Columns, bending moment about local axis y [m.kN]	74
52	ULS02_a: 1.2*D + 1.6*Lru + Lpu + 0.5*S. Columns, bending moment about local axis z [m.kN]	74
53	ULS02_a: 1.2*D + 1.6*Lru + Lpu + 0.5*S. Columns, internal shear force in local direction y [kN]	75
54	ULS02_a: 1.2*D + 1.6*Lru + Lpu + 0.5*S. Columns, internal shear force in local direction z [kN]	75
55	ULS02_b: 1.2*D + 1.6*Lrs + Lps + 0.5*S. Columns, internal axial force [kN]	75
56	ULS02_b: 1.2*D + 1.6*Lrs + Lps + 0.5*S. Columns, bending moment about local axis y [m.kN]	76
57	ULS02_b: 1.2*D + 1.6*Lrs + Lps + 0.5*S. Columns, bending moment about local axis z [m.kN]	76
58	ULS02_b: 1.2*D + 1.6*Lrs + Lps + 0.5*S. Columns, internal shear force in local direction y [kN]	76
59	ULS02_b: 1.2*D + 1.6*Lrs + Lps + 0.5*S. Columns, internal shear force in local direction z [kN]	77
60	ULS03_a: 1.2*D + 1.6*S + 0.5*Lru + Lpu. Columns, internal axial force [kN]	77
61	ULS03_a: 1.2*D + 1.6*S + 0.5*Lru + Lpu. Columns, bending moment about local axis y [m.kN]	77
62	ULS03_a: 1.2*D + 1.6*S + 0.5*Lru + Lpu. Columns, bending moment about local axis z [m.kN]	78
63	ULS03_a: 1.2*D + 1.6*S + 0.5*Lru + Lpu. Columns, internal shear force in local direction y [kN]	78
64	ULS03_a: 1.2*D + 1.6*S + 0.5*Lru + Lpu. Columns, internal shear force in local direction z [kN]	78
65	ULS03_b: 1.2*D + 1.6*S + 0.5*Lrs + Lps. Columns, internal axial force [kN]	79
66	ULS03_b: 1.2*D + 1.6*S + 0.5*Lrs + Lps. Columns, bending moment about local axis y [m.kN]	79
67	ULS03_b: 1.2*D + 1.6*S + 0.5*Lrs + Lps. Columns, bending moment about local axis z [m.kN]	79

LIST OF FIGURES

68	ULS03_b: 1.2*D + 1.6*S + 0.5*Lrs + Lps. Columns, internal shear force in local direction y [kN]	80
69	ULS03_b: 1.2*D + 1.6*S + 0.5*Lrs + Lps. Columns, internal shear force in local direction z [kN]	80
70	ULS04_a: 1.2*D + 1.6*S + 0.5*W_WE. Columns, internal axial force [kN]	80
71	ULS04_a: 1.2*D + 1.6*S + 0.5*W_WE. Columns, bending moment about local axis y [m.kN]	81
72	ULS04_a: 1.2*D + 1.6*S + 0.5*W_WE. Columns, bending moment about local axis z [m.kN]	81
73	ULS04_a: 1.2*D + 1.6*S + 0.5*W_WE. Columns, internal shear force in local direction y [kN]	81
74	ULS04_a: 1.2*D + 1.6*S + 0.5*W_WE. Columns, internal shear force in local direction z [kN]	82
75	ULS04_b: 1.2*D + 1.6*S + 0.5*W_NS. Columns, internal axial force [kN]	82
76	ULS04_b: 1.2*D + 1.6*S + 0.5*W_NS. Columns, bending moment about local axis y [m.kN]	82
77	ULS04_b: 1.2*D + 1.6*S + 0.5*W_NS. Columns, bending moment about local axis z [m.kN]	83
78	ULS04_b: 1.2*D + 1.6*S + 0.5*W_NS. Columns, internal shear force in local direction y [kN]	83
79	ULS04_b: 1.2*D + 1.6*S + 0.5*W_NS. Columns, internal shear force in local direction z [kN]	83
80	ULS05_a: 1.2*D + W_WE + 0.5*Lru + Lpu. Columns, internal axial force [kN]	84
81	ULS05_a: 1.2*D + W_WE + 0.5*Lru + Lpu. Columns, bending moment about local axis y [m.kN]	84
82	ULS05_a: 1.2*D + W_WE + 0.5*Lru + Lpu. Columns, bending moment about local axis z [m.kN]	84
83	ULS05_a: 1.2*D + W_WE + 0.5*Lru + Lpu. Columns, internal shear force in local direction y [kN]	85
84	ULS05_a: 1.2*D + W_WE + 0.5*Lru + Lpu. Columns, internal shear force in local direction z [kN]	85
85	ULS05_b: 1.2*D + W_NS + 0.5*Lru + Lpu. Columns, internal axial force [kN] .	86
86	ULS05_b: 1.2*D + W_NS + 0.5*Lru + Lpu. Columns, bending moment about local axis y [m.kN]	86
87	ULS05_b: 1.2*D + W_NS + 0.5*Lru + Lpu. Columns, bending moment about local axis z [m.kN]	86
88	ULS05_b: 1.2*D + W_NS + 0.5*Lru + Lpu. Columns, internal shear force in local direction y [kN]	87
89	ULS05_b: 1.2*D + W_NS + 0.5*Lru + Lpu. Columns, internal shear force in local direction z [kN]	87
90	ULS05_c: 1.2*D + W_WE + 0.5*Lrs + Lps. Columns, internal axial force [kN] .	87
91	ULS05_c: 1.2*D + W_WE + 0.5*Lrs + Lps. Columns, bending moment about local axis y [m.kN]	88
92	ULS05_c: 1.2*D + W_WE + 0.5*Lrs + Lps. Columns, bending moment about local axis z [m.kN]	88
93	ULS05_c: 1.2*D + W_WE + 0.5*Lrs + Lps. Columns, internal shear force in local direction y [kN]	88
94	ULS05_c: 1.2*D + W_WE + 0.5*Lrs + Lps. Columns, internal shear force in local direction z [kN]	89
95	ULS05_d: 1.2*D + W_NS + 0.5*Lrs + Lps. Columns, internal axial force [kN] .	89
96	ULS05_d: 1.2*D + W_NS + 0.5*Lrs + Lps. Columns, bending moment about local axis y [m.kN]	89

97	ULS05_d: 1.2*D + W_NS + 0.5*Lrs + Lps. Columns, bending moment about local axis z [m.kN]	90
98	ULS05_d: 1.2*D + W_NS + 0.5*Lrs + Lps. Columns, internal shear force in local direction y [kN]	90
99	ULS05_d: 1.2*D + W_NS + 0.5*Lrs + Lps. Columns, internal shear force in local direction z [kN]	90
100	ULS06_a: 1.2*D + 0.5*Lru + Lpu + 0.2*S. Columns, internal axial force [kN]	91
101	ULS06_a: 1.2*D + 0.5*Lru + Lpu + 0.2*S. Columns, bending moment about local axis y [m.kN]	91
102	ULS06_a: 1.2*D + 0.5*Lru + Lpu + 0.2*S. Columns, bending moment about local axis z [m.kN]	91
103	ULS06_a: 1.2*D + 0.5*Lru + Lpu + 0.2*S. Columns, internal shear force in local direction y [kN]	92
104	ULS06_a: 1.2*D + 0.5*Lru + Lpu + 0.2*S. Columns, internal shear force in local direction z [kN]	92
105	ULS06_b: 1.2*D + 0.5*Lrs + Lps + 0.2*S. Columns, internal axial force [kN]	92
106	ULS06_b: 1.2*D + 0.5*Lrs + Lps + 0.2*S. Columns, bending moment about local axis y [m.kN]	93
107	ULS06_b: 1.2*D + 0.5*Lrs + Lps + 0.2*S. Columns, bending moment about local axis z [m.kN]	93
108	ULS06_b: 1.2*D + 0.5*Lrs + Lps + 0.2*S. Columns, internal shear force in local direction y [kN]	93
109	ULS06_b: 1.2*D + 0.5*Lrs + Lps + 0.2*S. Columns, internal shear force in local direction z [kN]	94
110	ULS07_a: 0.9*D + W_WE. Columns, internal axial force [kN]	94
111	ULS07_a: 0.9*D + W_WE. Columns, bending moment about local axis y [m.kN]	94
112	ULS07_a: 0.9*D + W_WE. Columns, bending moment about local axis z [m.kN]	95
113	ULS07_a: 0.9*D + W_WE. Columns, internal shear force in local direction y [kN]	95
114	ULS07_a: 0.9*D + W_WE. Columns, internal shear force in local direction z [kN]	95
115	ULS07_b: 0.9*D + W_NS. Columns, internal axial force [kN]	96
116	ULS07_b: 0.9*D + W_NS. Columns, bending moment about local axis y [m.kN]	96
117	ULS07_b: 0.9*D + W_NS. Columns, bending moment about local axis z [m.kN] .	96
118	ULS07_b: 0.9*D + W_NS. Columns, internal shear force in local direction y [kN]	97
119	ULS07_b: 0.9*D + W_NS. Columns, internal shear force in local direction z [kN]	97
120	SLS01: 1.0*D. Columns, bending moment about local axis y [m.kN]	98
121	SLS02_a: 1.0*D + 1.0*Lru + Lpu + 0.3*S. Columns, bending moment about local axis y [m.kN]	98
122	SLS02_b: 1.0*D + 1.0*Lrs + Lps + 0.3*S. Columns, bending moment about local axis y [m.kN]	99
123	SLS03_a: 1.0*D + 1.0*S + 0.3*Lru + 0.3*Lpu. Columns, bending moment about local axis y [m.kN]	99
124	SLS03_b: 1.0*D + 1.0*S + 0.3*Lrs + 0.3*Lps. Columns, bending moment about local axis y [m.kN]	99
125	SLS04_a: 1.0*D + W_WE + 1.0*Lru + Lpu. Columns, bending moment about local axis y [m.kN]	100
126	SLS04_b: 1.0*D + W_NS + 1.0*Lru + Lpu. Columns, bending moment about local axis y [m.kN]	100
127	SLS05_a: 1.0*D + W_WE. Columns, bending moment about local axis y [m.kN]	100
128	SLS05_b: 1.0*D + W_NS. Columns, bending moment about local axis y [m.kN] .	101

1 Introduction and scope

This report describes the calculation procedure and data considered in order to design the structure of a new apartment building in Eau Claire, Wisconsin.

The construction consists in a three-story apartment building with a first-floor footprint of about 19,500 square feet, a below-grade parking garage with a footprint of about 27,200 square feet, perimeter retaining walls, a slab-on-grade, and a conventional foundation system.

The first floor system is precast hollow core concrete plank on precast beams and columns. For the upper floors and roof, the system is wood-framed. Retaining walls and slab on grade are comprised of cast in place concrete, except for three reinforced CMU walls next to the garage aisles, that will be demolished during the second phase of construction.

The foundation uses conventional cast in place concrete footings to transfer axial compression and lateral loads to the ground.

2 Building codes

The following building and material codes were used for the design:

- Building code
 - International Building Code, 2018 Edition (IBC 2018) with reference to Minimum Design Loads for Buildings and Other Structures by the American Society of Civil Engineers, 2016 Edition (ASCE 7).
- Material codes
 - Reinforced Concrete: Building Code Requirements for Structural Concrete and Commentary by the American Concrete Institute, 2019 Edition (ACI 318).
 - Masonry: Building Code Requirements and Specification for Masonry Structures and Companion Commentaries, 2013 Edition (ACI 530/530).

3 Loading criteria

A summary of the project-specific loading criteria follows (see appendix A for a detailed list of load values).

3.1 Gravity loading

The gravity loads listed in Table 1 are in addition to the self weight of the structure. The minimum loading requirements were taken from ASCE 7 as well as the loading criteria supplied by the engineer of record. Loads are given in pounds per square foot (psf).

In addition to these uniform slab loads, a perimeter dead load of 12 psf was applied to the structure to account for the weight of the cladding system.

3.2 Wind design criteria

Wind loading is in accordance with the IBC and ASCE 7 requirements as shown in Table 2.

3.3 Snow loading

Wind loading is in accordance with the ASCE 7 requirements as shown in Table 3.

Table 1: Gravity Loads

Use	Live Loading	Superimposed Dead Loading
Parking Garage	40	3
Storage/HVAC	125	28
Stairways, exits	100	28
Level 1 residential	40	28
Level 1 corridors	100	28
Level 1 office, recreational	100	28
Level 1 courtyard (footprint)	150	150
Elevated levels residential	40	28
Elevated levels corridors	40	28
Cornices	60	-
Balconies	40	28
Roof	20	28

Table 2: Wind Design Criteria

Parameter	Value
Basic Wind Speed, 3-second gust (ultimate)	115 mph
Basic Wind Speed, 3-second gust (nominal)	90 mph
Exposure	B
Occupancy Category	II
Importance Factor (I_w)	1.0
Topographic Factor (K_{zt})	1.0
Enclosure Classification	Enclosed
Mean Roof Height (h)	33'

Table 3: Snow Design Criteria

Parameter	Value
Ground snow load p_g	60 psf
Terrain category	B
Exposure factor C_e	1.0
Thermal factor C_t	1.0
Occupancy Category	II
Snow load importance factor I_s	1.0
Snow load flat roof	42 psf

4 Seismic design criteria

Seismic loads are in accordance with the IBC requirements as shown in Table 4.

Table 4: **Seismic Design Criteria**

Parameter	Value
Building Latitude/Longitude	44°49'01.8"N 91°30'34.8"W
Occupancy Category	II
Importance Factor I_e	1.0
Mapped Spectral Acceleration	$S_s = 0.045; S_1 = 0.038$
Site Class	B
Site Class Coefficients	$F_a = 1.0; F_v = 1.0$
Spectral Response Coefficients	$S_{DS} = 0.03; S_{D1} = 0.025$
Seismic Design Category	A

5 Materials

The material properties used for the design are summarized in Tables 5 and 6.

Table 5: **Concrete properties**

Member	Nominal f'_c
Footings	3.0 ksi
Basement Walls	4.0 ksi
Foundation frost walls	4.0 ksi
Stair landings and treads	4.0 ksi
Slab on grade	4.0 ksi

Table 6: **Reinforcement properties**

Standard	Nominal f_y
All ASTM A615 Grade 60	60 ksi

6 Design and analysis software

The computer software employed for the analysis of the structure is the Finite Element Program called **XC** (see program description at http://xcengineering.xyz/html_files/software.html).

7 Load combinations

The load combinations shown in tables 7 and 8 follow the strength design load combinations listed in IBC, section 1605.

Table 7: Combinations Ultimate Limit States

Identifier	Load Combination
ULS01:	1.4*D
ULS02_a:	1.2*D + 1.6*Lru + Lpu + 0.5*S
ULS02_b:	1.2*D + 1.6*Lrs + Lps + 0.5*S
ULS03_a:	1.2*D + 1.6*S + 0.5*Lru + Lpu
ULS03_b:	1.2*D + 1.6*S + 0.5*Lrs + Lps
ULS04_b:	1.2*D + 1.6*S + 0.5*W_NS
ULS04_a:	1.2*D + 1.6*S + 0.5*W_WE
ULS05_a:	1.2*D + W_WE + 0.5*Lru + Lpu
ULS05_b:	1.2*D + W_NS + 0.5*Lru + Lpu
ULS05_c:	1.2*D + W_WE + 0.5*Lrs + Lps
ULS05_d:	1.2*D + W_NS + 0.5*Lrs + Lps
ULS06_a:	1.2*D + 0.5*Lru + Lpu + 0.2*S
ULS06_b:	1.2*D + 0.5*Lrs + Lps + 0.2*S
ULS07_a:	0.9*D + W_WE
ULS07_b:	0.9*D + W_NS

Where:

D = dead load

Lru = live load (uniform on rooms)

Lrs = live load (staggered pattern on rooms)

Lpu = live load (uniform on patios)

Lps = live load (staggered pattern on patios)

S = snow load

W_WE = Wind West-East

W_NS = Wind North-South

Table 8: Combinations Serviceability Limit States

Identifier	Load Combination
SLS01:	1.0*D
SLS02_a:	1.0*D + 1.0*Lru + Lpu + 0.3*S
SLS02_b:	1.0*D + 1.0*Lrs + Lps + 0.3*S
SLS03_a:	1.0*D + 1.0*S + 0.3*Lru + 0.3*Lpu
SLS03_b:	1.0*D + 1.0*S + 0.3*Lrs + 0.3*Lps
SLS04_a:	1.0*D + W_WE + 1.0*Lru + Lpu
SLS04_b:	1.0*D + W_NS + 1.0*Lru + Lpu
SLS04_c:	1.0*D + W_WE + 1.0*Lrs + Lps
SLS04_d:	1.0*D + W_NS + 1.0*Lrs + Lps
SLS05_a:	1.0*D + W_WE
SLS05_b:	1.0*D + W_NS

Where:

- D = dead load
- Lru = live load (uniform on rooms)
- Lrs = live load (staggered pattern on rooms)
- Lpu = live load (uniform on patios)
- Lps = live load (staggered pattern on patios)
- S = snow load
- W_WE = Wind West-East
- W_NS = Wind North-South

8 Wood framing

8.1 Gravity

8.2 Trusses

8.2.1 Trusses A and B. Roof

The deflection results for those trusses (see figure 2) are as follows ¹:

Load	truss	deflection	truss	deflection
EQ1608	roof(A):	-1.94 mm (L/5782; L= 11.22 m)	roof(B):	-1.12 mm (L/9586; L= 10.77 m)
EQ1609	roof(A):	-5.63 mm (L/1994; L= 11.22 m)	roof(B):	-3.82 mm (L/2819; L= 10.77 m)
EQ1610	roof(A):	-9.66 mm (L/1161; L= 11.22 m)	roof(B):	-6.76 mm (L/1591; L= 10.77 m)
EQ1611	roof(A):	-10.49 mm (L/1069; L= 11.22 m)	roof(B):	-7.38 mm (L/1459; L= 10.77 m)
EQ1612	roof(A):	0.99 mm (L/11391; L= 11.22 m)	roof(B):	1.02 mm (L/10598; L= 10.77 m)
EQ1613	roof(A):	-8.30 mm (L/1352; L= 11.22 m)	roof(B):	-5.77 mm (L/1865; L= 10.77 m)
EQ1615	roof(A):	1.76 mm (L/6370; L= 11.22 m)	roof(B):	1.47 mm (L/7348; L= 10.77 m)
LIVE	roof(A):	-3.69 mm (L/3044; L= 11.22 m)	roof(B):	-2.69 mm (L/3995; L= 10.77 m)

The truss depth is allways greater than 24 inches due to the geometry of the roof. The spacing of the trusses is 12 inches.

$$\Delta_{LL,A} = 3.69 \text{ mm} = \frac{L}{3044} < \frac{L}{540} \implies OK \quad (1)$$

$$\Delta_{LL,B} = 2.69 \text{ mm} = \frac{L}{3995} < \frac{L}{540} \implies OK \quad (2)$$

$$\Delta_{TL,A} = 10.49 \text{ mm} = \frac{L}{1069} < \frac{L}{360} \implies OK \quad (3)$$

$$\Delta_{TL,B} = 7.38 \text{ mm} = \frac{L}{1459} < \frac{L}{360} \implies OK \quad (4)$$

8.2.2 Trusses A and B. Third floor

The deflection results for those trusses (see figure 3) are as follows:

Load	truss	deflection	truss	deflection
EQ1608	A	-9.14 mm (L/1228; L= 11.22 m)	B	-7.75 mm (L/1389; L= 10.77 m)
EQ1609	A	-26.45 mm (L/424; L= 11.22 m)	B	-22.46 mm (L/479; L= 10.77 m)
EQ1610	A	-9.13 mm (L/1228; L= 11.22 m)	B	-7.74 mm (L/1389; L= 10.77 m)
EQ1611	A	-22.12 mm (L/507; L= 11.22 m)	B	-18.78 mm (L/573; L= 10.77 m)
EQ1612	A	-9.14 mm (L/1228; L= 11.22 m)	B	-7.75 mm (L/1389; L= 10.77 m)
EQ1613	A	-22.12 mm (L/507; L= 11.22 m)	B	-18.78 mm (L/573; L= 10.77 m)
EQ1615	A	-5.48 mm (L/2047; L= 11.22 m)	B	-4.65 mm (L/2315; L= 10.77 m)
LIVE	A	-17.32 mm (L/648; L= 11.22 m)	B	-14.71 mm (L/731; L= 10.77 m)

The truss depth is 24 inches and the spacing of the trusses is 12 inches.

$$\Delta_{LL,A} = 17.32 \text{ mm} = \frac{L}{648} < \frac{L}{540} \implies OK \quad (5)$$

$$\Delta_{LL,B} = 14.71 \text{ mm} = \frac{L}{731} < \frac{L}{540} \implies OK \quad (6)$$

$$\Delta_{TL,A} = 26.45 \text{ mm} = \frac{L}{424} < \frac{L}{360} \implies OK \quad (7)$$

$$\Delta_{TL,B} = 22.46 \text{ mm} = \frac{L}{479} < \frac{L}{360} \implies OK \quad (8)$$

¹The load combinations are listed in 9.3.3.

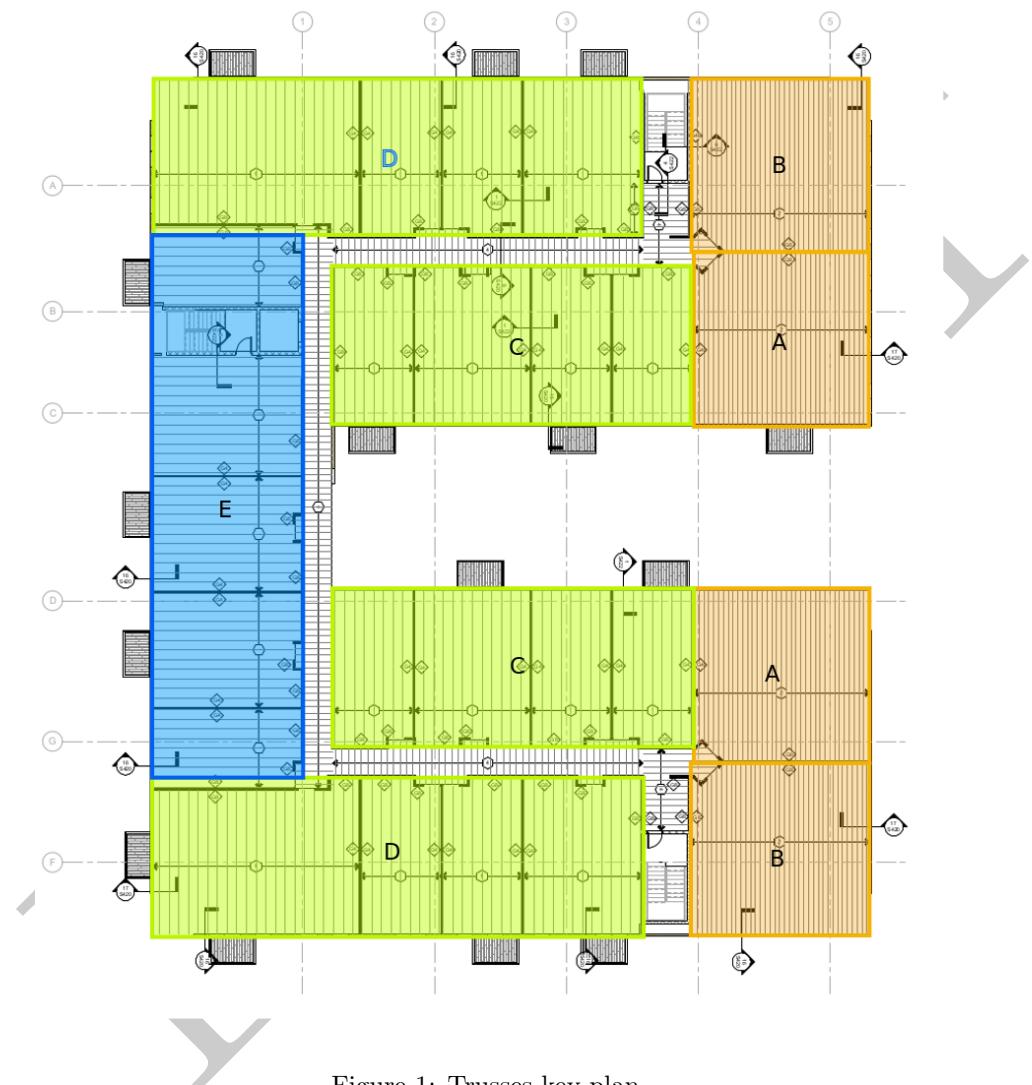


Figure 1: Trusses key plan.



Figure 2: Roof trusses at zones A and B (see key plan in figure 1).

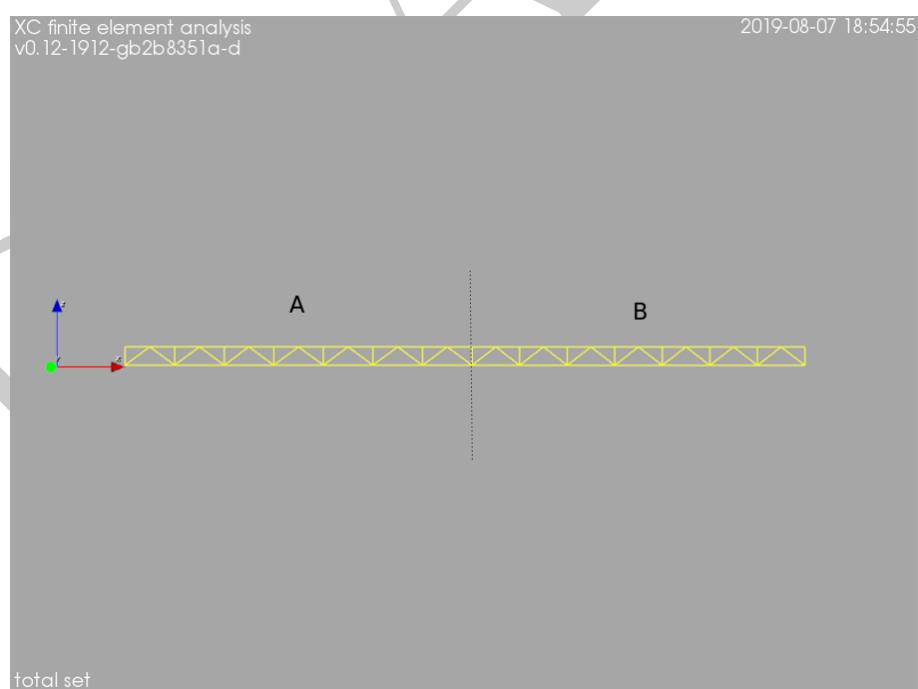


Figure 3: Third floor trusses at zones A and B (see key plan in figure 1).

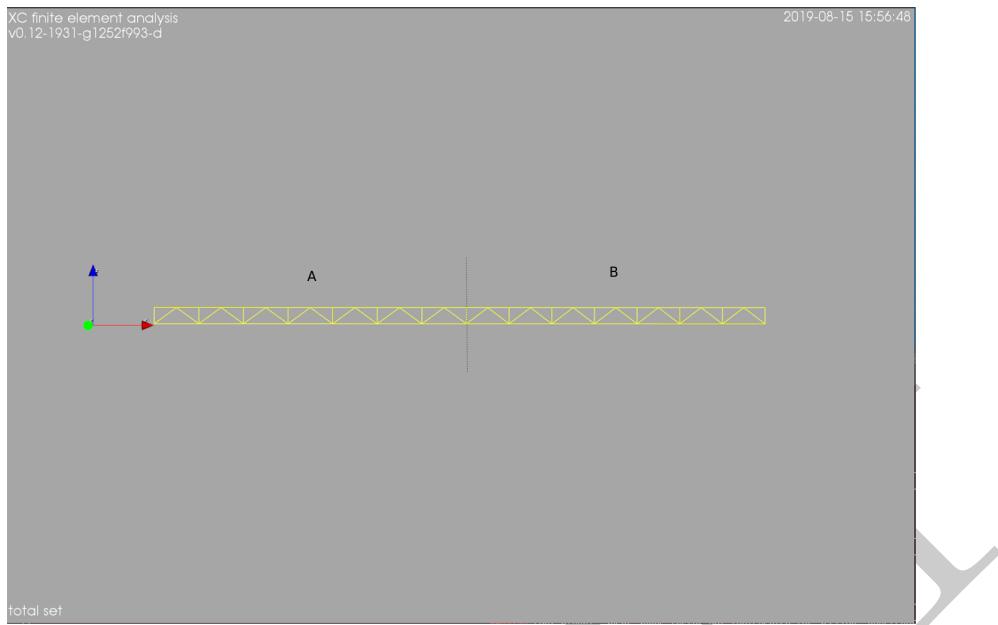


Figure 4: Second floor trusses at zones A and B (see key plan in figure 1).

8.2.3 Trusses A and B. Second floor

The deflection results for those trusses (see figure 4) are as follows:

Load	truss	deflection	truss	deflection
EQ1608	A	-8.13 mm (L/1282; L= 10.42 m)	B	-6.81 mm (L/1464; L= 9.97 m)
EQ1609	A	-23.51 mm (L/443; L= 10.42 m)	B	-19.71 mm (L/505; L= 9.97 m)
EQ1610	A	-8.13 mm (L/1282; L= 10.42 m)	B	-6.81 mm (L/1464; L= 9.97 m)
EQ1611	A	-19.66 mm (L/530; L= 10.42 m)	B	-16.48 mm (L/604; L= 9.97 m)
EQ1612	A	-8.13 mm (L/1282; L= 10.42 m)	B	-6.81 mm (L/1464; L= 9.97 m)
EQ1613	A	-19.66 mm (L/530; L= 10.42 m)	B	-16.48 mm (L/604; L= 9.97 m)
EQ1615	A	-4.88 mm (L/2136; L= 10.42 m)	B	-4.08 mm (L/2440; L= 9.97 m)
LIVE	A	-15.38 mm (L/677; L= 10.42 m)	B	-12.90 mm (L/772; L= 9.97 m)

The truss depth is 22 inches and the spacing of the trusses is 12 inches.

$$\Delta_{LL,A} = 15.38 \text{ mm} = \frac{L}{677} < \frac{L}{540} \implies OK \quad (9)$$

$$\Delta_{LL,B} = 12.90 \text{ mm} = \frac{L}{772} < \frac{L}{540} \implies OK \quad (10)$$

$$\Delta_{TL,A} = 23.51 \text{ mm} = \frac{L}{443} < \frac{L}{360} \implies OK \quad (11)$$

$$\Delta_{TL,B} = 19.71 \text{ mm} = \frac{L}{505} < \frac{L}{360} \implies OK \quad (12)$$

8.2.4 Trusses C and D. Roof

The deflection results for those trusses (see figure 5) are as follows:

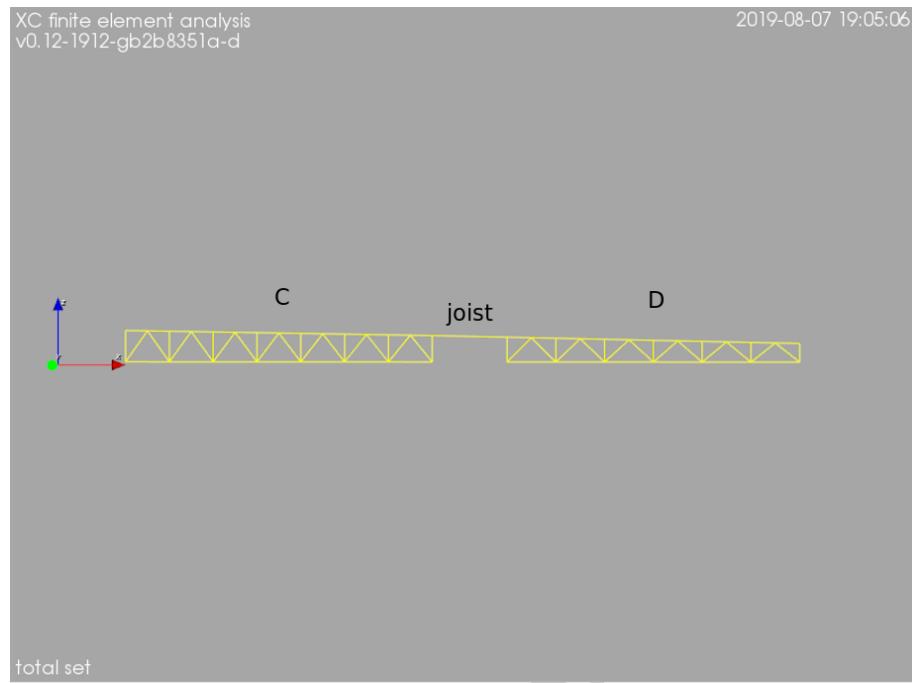


Figure 5: Roof trusses at zones C and D (see key plan in figure 1).

Load	truss	deflection	truss	deflection
EQ1608	roof(C)	-2.92 mm (L/3420; L= 10.00 m)	roof(D)	-5.24 mm (L/1822; L= 9.55 m)
EQ1609	roof(C)	-7.42 mm (L/1347; L= 10.00 m)	roof(D)	-11.87 mm (L/803; L= 9.55 m)
EQ1610	roof(C)	-12.34 mm (L/810; L= 10.00 m)	roof(D)	-19.13 mm (L/498; L= 9.55 m)
EQ1611	roof(C)	-13.36 mm (L/748; L= 10.00 m)	roof(D)	-20.64 mm (L/462; L= 9.55 m)
EQ1612	roof(C)	0.64 mm (L/15512; L= 10.00 m)	roof(D)	0.03 mm (L/323264; L= 9.55 m)
EQ1613	roof(C)	-10.68 mm (L/936; L= 10.00 m)	roof(D)	-16.69 mm (L/572; L= 9.55 m)
EQ1615	roof(C)	1.81 mm (L/5512; L= 10.00 m)	roof(D)	2.12 mm (L/4493; L= 9.55 m)
LIVE	roof(C)	-4.50 mm (L/2224; L= 10.00 m)	roof(D)	-6.64 mm (L/1438; L= 9.55 m)

The truss depth is always greater than 24 inches due to the geometry of the roof. The spacing of the trusses is 24 inches. The spacing of the joists is 32 inches.

$$\Delta_{LL,C} = 4.50 \text{ mm} = \frac{L}{2224} < \frac{L}{540} \implies OK \quad (13)$$

$$\Delta_{LL,D} = 6.64 \text{ mm} = \frac{L}{772} < \frac{L}{540} \implies OK \quad (14)$$

$$\Delta_{TL,C} = 13.36 \text{ mm} = \frac{L}{748} < \frac{L}{360} \implies OK \quad (15)$$

$$\Delta_{TL,D} = 20.64 \text{ mm} = \frac{L}{462} < \frac{L}{360} \implies OK \quad (16)$$

8.2.5 Trusses C and D. Third floor

The deflection results for those trusses (see figure 6) are as follows:

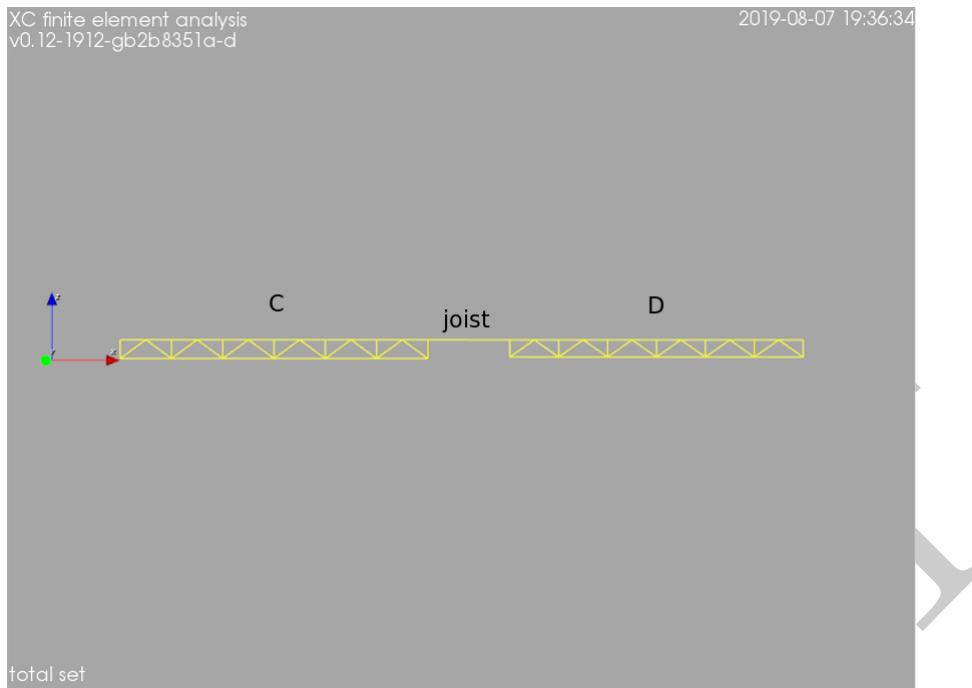


Figure 6: Third floor trusses at zones C and D (see key plan in figure 1).

Load	truss	deflection		truss	deflection		
EQ1608	C	-10.00	mm	(L/982; L= 9.82 m)	D	-8.93 mm	(L/1048; L= 9.37 m)
EQ1609	C	-26.93	mm	(L/364; L= 9.82 m)	D	-24.04 mm	(L/389; L= 9.37 m)
EQ1610	C	-10.00	mm	(L/982; L= 9.82 m)	D	-8.93 mm	(L/1048; L= 9.37 m)
EQ1611	C	-22.70	mm	(L/432; L= 9.82 m)	D	-20.26 mm	(L/462; L= 9.37 m)
EQ1612	C	-10.00	mm	(L/982; L= 9.82 m)	D	-8.93 mm	(L/1048; L= 9.37 m)
EQ1613	C	-22.70	mm	(L/432; L= 9.82 m)	D	-20.26 mm	(L/462; L= 9.37 m)
EQ1615	C	-6.00	mm	(L/1636; L= 9.82 m)	D	-5.36 mm	(L/1747; L= 9.37 m)
LIVE	C	-16.93	mm	(L/580; L= 9.82 m)	D	-15.11 mm	(L/620; L= 9.37 m)

The truss depths are 24 inches for the C truss 22 inches for the D truss. The spacing of the trusses is 24 inches. The spacing of the joists is 32 inches.

$$\Delta_{LL,C} = 16.93 \text{ mm} = \frac{L}{580} < \frac{L}{540} \implies OK \quad (17)$$

$$\Delta_{LL,D} = 15.11 \text{ mm} = \frac{L}{620} < \frac{L}{540} \implies OK \quad (18)$$

$$\Delta_{TL,C} = 26.93 \text{ mm} = \frac{L}{364} < \frac{L}{360} \implies OK \quad (19)$$

$$\Delta_{TL,D} = 24.04 \text{ mm} = \frac{L}{389} < \frac{L}{360} \implies OK \quad (20)$$

8.2.6 Trusses C and D. Second floor

The deflection results for those trusses (see figure 7) are as follows:

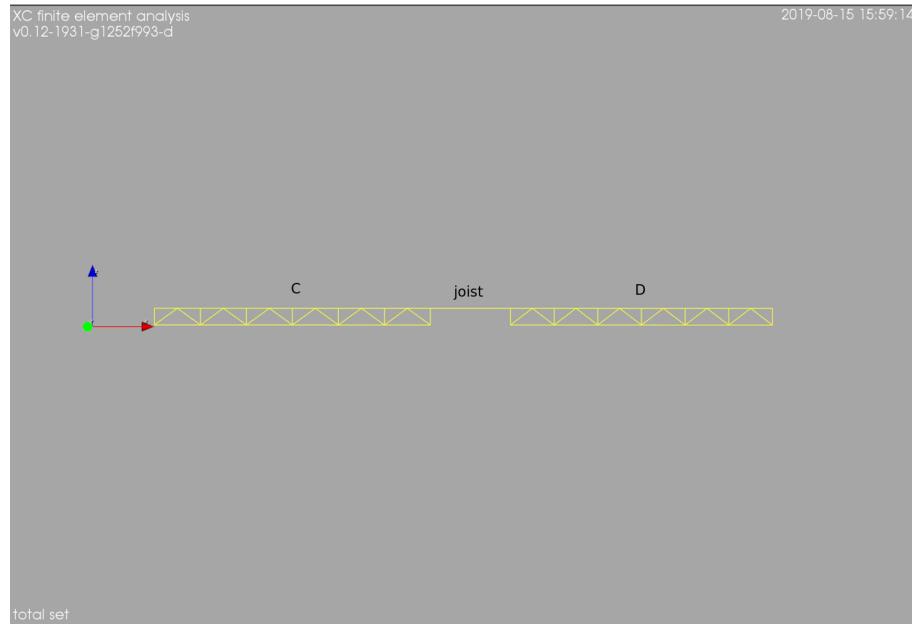


Figure 7: Second floor trusses at zones C and D (see key plan in figure 1).

Load	truss	deflection		truss	deflection	
EQ1608	C	-8.43 mm	(L/1070; L= 9.02 m)	D	-9.01 mm	(L/1039; L= 9.37 m)
EQ1609	C	-22.70 mm	(L/397; L= 9.02 m)	D	-24.24 mm	(L/386; L= 9.37 m)
EQ1610	C	-8.43 mm	(L/1070; L= 9.02 m)	D	-9.01 mm	(L/1039; L= 9.37 m)
EQ1611	C	-19.14 mm	(L/471; L= 9.02 m)	D	-20.43 mm	(L/458; L= 9.37 m)
EQ1612	C	-8.43 mm	(L/1070; L= 9.02 m)	D	-9.01 mm	(L/1039; L= 9.37 m)
EQ1613	C	-19.14 mm	(L/471; L= 9.02 m)	D	-20.43 mm	(L/458; L= 9.37 m)
EQ1615	C	-5.06 mm	(L/1783; L= 9.02 m)	D	-5.41 mm	(L/1732; L= 9.37 m)
LIVE	C	-14.27 mm	(L/632; L= 9.02 m)	D	-15.23 mm	(L/614; L= 9.37 m)

The truss depths are 22 inches. The spacing of the trusses is 24 inches. The spacing of the joists is 32 inches.

$$\Delta_{LL,C} = 14.27 \text{ mm} = \frac{L}{632} < \frac{L}{540} \implies OK \quad (21)$$

$$\Delta_{LL,D} = 15.23 \text{ mm} = \frac{L}{614} < \frac{L}{540} \implies OK \quad (22)$$

$$\Delta_{TL,C} = 22.70 \text{ mm} = \frac{L}{397} < \frac{L}{360} \implies OK \quad (23)$$

$$\Delta_{TL,D} = 24.24 \text{ mm} = \frac{L}{386} < \frac{L}{360} \implies OK \quad (24)$$

8.2.7 Truss E. Roof

The deflection results for those trusses (see figure 8) are as follows:

Load	truss	deflection	
EQ1608	3E	-4.67 mm	(L/2025; L= 9.47 m)
EQ1609	3E	-11.56 mm	(L/819; L= 9.47 m)
EQ1610	3E	-19.09 mm	(L/496; L= 9.47 m)
EQ1611	3E	-20.65 mm	(L/458; L= 9.47 m)
EQ1612	3E	0.79 mm	(L/11978; L= 9.47 m)
EQ1613	3E	-16.55 mm	(L/572; L= 9.47 m)
EQ1615	3E	2.66 mm	(L/3559; L= 9.47 m)
LIVE	3E	-6.89 mm	(L/1375; L= 9.47 m)

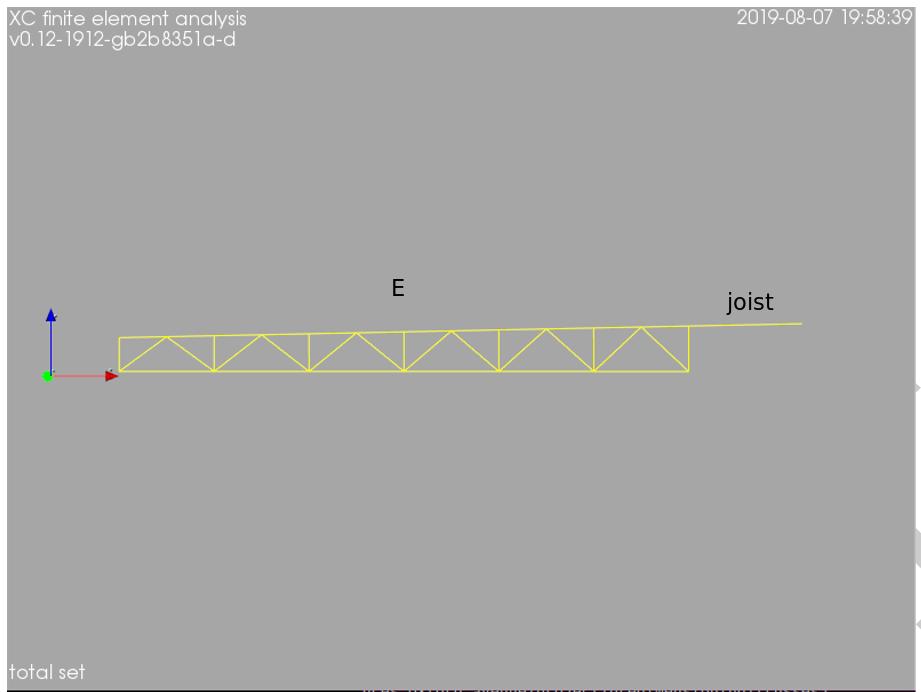


Figure 8: Roof truss at zone E (see key plan in figure 1).

The truss depth is always greater than 24 inches due to the geometry of the roof. The spacing of the trusses is 24 inches. The spacing of the joists is 32 inches.

$$\Delta_{LL,E} = 6.89 \text{ mm} = \frac{L}{1375} < \frac{L}{540} \implies OK \quad (25)$$

$$\Delta_{TL,E} = 20.65 \text{ mm} = \frac{L}{458} < \frac{L}{360} \implies OK \quad (26)$$

(27)

8.2.8 Truss E. Third floor

The deflection results for those trusses (see figure 9) are as follows:

Load	truss	deflection	
EQ1608	2E	-8.65 mm	(L/1095; L= 9.47 m)
EQ1609	2E	-23.30 mm	(L/406; L= 9.47 m)
EQ1610	2E	-8.65 mm	(L/1095; L= 9.47 m)
EQ1611	2E	-19.63 mm	(L/482; L= 9.47 m)
EQ1612	2E	-8.65 mm	(L/1095; L= 9.47 m)
EQ1613	2E	-19.63 mm	(L/482; L= 9.47 m)
EQ1615	2E	-5.19 mm	(L/1825; L= 9.47 m)
LIVE	2E	-14.65 mm	(L/646; L= 9.47 m)

The truss depth 24 inches. The spacing of the trusses is 24 inches and the spacing of the joists is 32 inches.

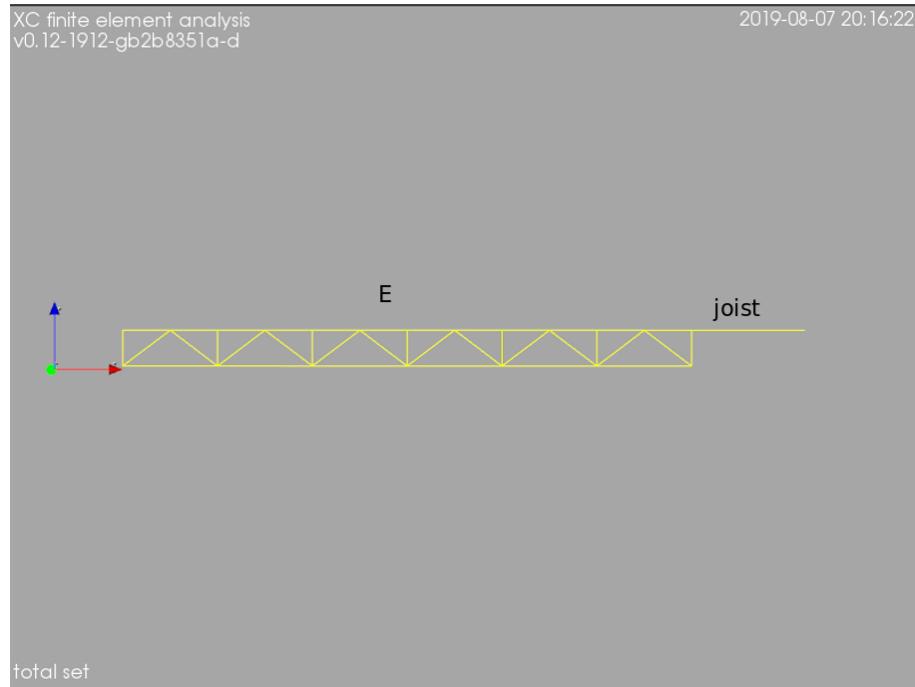


Figure 9: Third floor truss at zone E (see key plan in figure 1).

$$\Delta_{LL,E} = 14.65 \text{ mm} = \frac{L}{646} < \frac{L}{540} \implies OK \quad (28)$$

$$\Delta_{TL,E} = 23.30 \text{ mm} = \frac{L}{406} < \frac{L}{360} \implies OK \quad (29)$$

(30)

8.2.9 Truss E. Second floor

The deflection results for those trusses (see figure 10) are as follows:

Load	truss	deflection
EQ1608 2E: -7.18 mm	(L/1208; L= 8.67 m)	
EQ1609 2E: -19.34 mm	(L/448; L= 8.67 m)	
EQ1610 2E: -7.18 mm	(L/1208; L= 8.67 m)	
EQ1611 2E: -16.30 mm	(L/532; L= 8.67 m)	
EQ1612 2E: -7.18 mm	(L/1208; L= 8.67 m)	
EQ1613 2E: -16.30 mm	(L/532; L= 8.67 m)	
EQ1615 2E: -4.31 mm	(L/2013; L= 8.67 m)	
LIVE 2E: -12.16 mm	(L/713; L= 8.67 m)	

The truss depth 22 inches. The spacing of the trusses is 24 inches and the spacing of the joists is 32 inches.

$$\Delta_{LL,E} = 12.16 \text{ mm} = \frac{L}{713} < \frac{L}{540} \implies OK \quad (31)$$

$$\Delta_{TL,E} = 19.34 \text{ mm} = \frac{L}{448} < \frac{L}{360} \implies OK \quad (32)$$

(33)

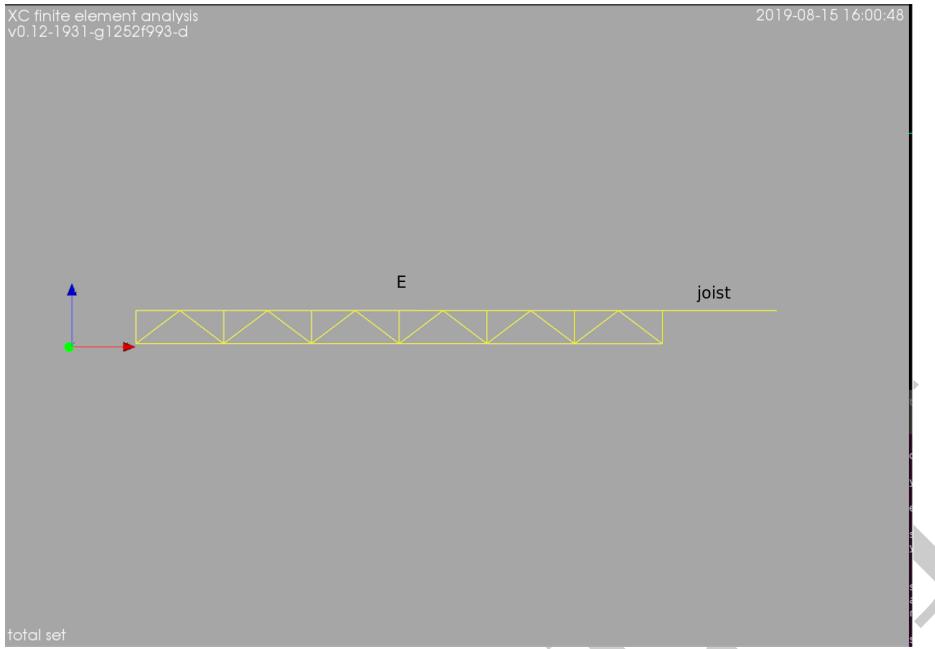


Figure 10: Second floor truss at zone E (see key plan in figure 1).

8.3 Joists and headers

8.3.1 Corridor floor sheathing

Three layers of 4x8 foot, 19/32 plywood panels are installed as corridor floor sheathing over corridors joists (nominal 3.5 inch wide) spaced 32 inches on center. The panels are installed with the long panel direction (strength axis) perpendicular to the corridor joists. The design loads are:

$$q_{live} = 1.92 \text{ kN/m}^2 (40 \text{ psf}) \quad (34)$$

$$q_{dead} = 0.72 \text{ kN/m}^2 (15 \text{ psf}) \quad (35)$$

The allowable live load deflection is $\text{span}/540$ and the allowable total load deflection $\text{span}/360$.

Structural design of the panels.

Mechanical properties of the plywood panel. The mechanical properties used to compute the floor deflection are the elastic modulus $E = 4200 \text{ MPa}$ and its thickness $t = 15.09 \text{ mm}$ (19/32 inch). Each layer works independently, otherwise said, they are connected only over the joists.

Bending stiffness. The deflection obtained under live load is:

$$\Delta_{LL} = 1.34 \text{ mm} = \frac{\text{span}}{607} < \frac{\text{span}}{540} \implies OK \quad (36)$$

and the deflection under total load is:

$$\Delta_{TL} = 1.84 \text{ mm} = \frac{\text{span}}{441} < \frac{\text{span}}{360} \implies OK \quad (37)$$

Bending strength. The allowable bending stress for the 5-ply plywood panel is $F_b = 4.33 \text{ MPa}$ (the panel grade and construction factors are already been applied to this capacity). The load duration factor for the live load on the corridor is $C_D = 1.6$. The adjusted allowable bending stress is therefore $F'_b = 6.94 \text{ MPa}$.

The maximum bending stress obtained under total load (three-span condition) is:

$$\sigma_{max} = 1.69 \text{ MPa} < 6.94 \text{ MPa} = F'_b \implies OK \quad (38)$$

Shear strength. The allowable shear stress of the panel is $F_v = 0.2 \text{ MPa}$ and the adjusted allowable shear stress is (under the same conditions that we used for the bending stress) $F'_v = 0.33 \text{ MPa}$.

The maximum shear stress obtained under total load is:

$$\tau_{max} = 0.04 \text{ MPa} < 0.33 \text{ MPa} = F'_v \implies OK \quad (39)$$

Fire design of the panels. According the table 9 the time assigned to a 19/32 inch panel is 15 minutes, so after 30 minutes of fire only one of the three panels remains in place. Accordingly, we perform the bending and shear checks to the remaining panel.

Bending strength. The maximum bending stress obtained under total load (three-span condition) is:

$$\sigma_{max} = 4.59 \text{ MPa} < 6.94 \text{ MPa} = F'_b \implies OK \quad (40)$$

Shear strength. The maximum shear stress obtained under total load is:

$$\tau_{max} = 0.12 \text{ MPa} < 0.33 \text{ MPa} = F'_v \implies OK \quad (41)$$

8.3.2 Joists

Simply supported 3.5x6 LVL floor joists span a maximum of $L = 2.49 \text{ m}$ (94.25 inches) and are spaced at $s = 0.81 \text{ m}$ (32 inches). The design loads are:

$$q_{live} = 1.92 \text{ kN/m}^2 (40 \text{ psf}) \quad (42)$$

$$q_{dead} = 0.72 \text{ kN/m}^2 (15 \text{ psf}) \quad (43)$$

Timber decking nailed to the compression edge of the joists provides lateral bracing for at least the same fire resistance time as the joists (i.e. $C_L = 1.0$).

Structural design of the joist.

Loads.

$$w_{load} = s \cdot (q_{dead} + q_{live}) = 1.56 \text{ kN/m} \quad (44)$$

722.6.2 Walls, Floors and Roofs

These procedures apply to both load-bearing and nonload-bearing assemblies.

TABLE 722.6.2(1) TIME ASSIGNED TO WALLBOARD MEMBRANES^{a, b, c, d}

DESCRIPTION OF FINISH	TIME ^e (minutes)
3/8-Inch wood structural panel bonded with exterior glue	5
15/32-Inch wood structural panel bonded with exterior glue	10
19/32-Inch wood structural panel bonded with exterior glue	15
3/8-Inch gypsum wallboard	10
1/2-Inch gypsum wallboard	15
5/8-Inch gypsum wallboard	30
1/2-Inch Type X gypsum wallboard	25
5/8-Inch Type X gypsum wallboard	40
Double 3/8-inch gypsum wallboard	25
1/2-Inch + 3/8-Inch gypsum wallboard	35
Double 1/2-Inch gypsum wallboard	40

For SI: 1 inch = 25.4 mm.

Table 9: Time assigned to wallboard membranes

Internal forces. Maximum induced moment:

$$M_{max} = w_{load} \frac{L^2}{8} = 1.54 \text{ kNm} \quad (45)$$

Maximum induced shear:

$$V_{max} = w_{load} \frac{L}{2} = 2.57 \text{ kN} \quad (46)$$

Joist mechanical properties. Joist section modulus:

$$S_s = 344.13 \times 10^{-6} \text{ m}^3 \quad (47)$$

Tabulated bending stress:

$$F_b = 21.59 \text{ MPa} \quad (48)$$

Adjusted allowable bending stress with $C_r = 1.0, C_D = 1.0, C_M = 1.0, C_t = 1.0, C_V = 0.62$:

$$F'_b = 13.59 \text{ MPa} \quad (49)$$

Tabulated shear stress:

$$F_v = 1.97 \text{ MPa} \quad (50)$$

Adjusted allowable shear stress with $C_D = 1.0, C_M = 1.0, C_t = 1.0$:

$$F'_v = 1.97 \text{ MPa} \quad (51)$$

Structural bending check. Design resisting moment:

$$M'_s = 4.67 \text{ kNm} \quad (52)$$

Structural bending check: $M'_s = 4.67 > 1.54 = M_{max} \implies OK$

Structural shear check. Design resisting shear:

$$V'_s = 17.74 \text{ kN} \quad (53)$$

Structural shear check: $V'_s = 17.74 > 2.57 = V_{max} \implies OK$

Fire design of the joist. For the fire design of the joist, mass loss due to charring is conservatively neglected, so the loading is unchanged. Therefore, the maximum induced moment and shear are unchanged. The fire resistance must be calculated.

Mechanical properties of the burned section. Effective char depth:

$$a_{eff} = 0.7 \times 10^{-3} \times 30 + 7 \times 10^{-3} = 28 \text{ mm} \quad (54)$$

section modulus for a joist exposed on three sides:

$$S_s = 84.86 \times 10^{-6} \text{ m}^3 \quad (55)$$

shear area for a beam exposed on three sides:

$$A_f = 40.93 \text{ cm}^2 \quad (56)$$

Adjusted allowable bending stress with $C_{fire} = 2.85, C_r = 1.0, C_D = 1.0, C_M = 1.0, C_t = 1.0, C_V = 0.62$:

$$F'_{b,f} = 38.74 \text{ MPa} \quad (57)$$

Adjusted allowable shear stress with $C_{fire} = 2.85, C_D = 1.0, C_M = 1.0, C_t = 1.0$:

$$F'_{v,f} = 5.40 \text{ MPa} \quad (58)$$

Structural bending check. Design resisting moment:

$$M'_f = 3.28 \text{ kNm} \quad (59)$$

Structural bending check: $M'_s = 3.28 > 1.54 = M_{max} \implies OK$

Structural shear check. Design resisting shear:

$$V'_f = 14.74 \text{ kN} \quad (60)$$

Structural shear check: $V'_s = 14.74 > 2.57 = V_{max} \implies OK$

8.3.3 Joists under storage/HVAC floor

Simply supported 3.5x9.25 LVL floor joists span a maximum of $L = 2.9 \text{ m}$ and are spaced at $s = 0.81 \text{ m}$ (32 inches). The design loads are:

$$q_{live} = 5.99 \text{ kN/m}^2 (125 \text{ psf}) \quad (61)$$

$$q_{dead} = 0.72 \text{ kN/m}^2 (15 \text{ psf}) \quad (62)$$

Timber decking nailed to the compression edge of the joists provides lateral bracing (i.e. $C_L = 1.0$).

Structural design of the joist.

Loads.

$$w_{load} = s \cdot (q_{dead} + q_{live}) = 5.45 \text{ kN/m} \quad (63)$$

Internal forces. Maximum induced moment:

$$M_{max} = w_{load} \frac{L^2}{8} = 5.79 \text{ kNm} \quad (64)$$

Maximum induced shear:

$$V_{max} = w_{load} \frac{L}{2} = 7.94 \text{ kN} \quad (65)$$

Joist mechanical properties.

Joist section modulus:

$$S_s = 817.90 \times 10^{-6} \text{ m}^3 \quad (66)$$

Tabulated bending stress:

$$F_b = 20.58 \text{ MPa} \quad (67)$$

Adjusted allowable bending stress with $C_r = 1.0$, $C_D = 1.0$, $C_M = 1.0$, $C_t = 1.0$

$$F'_b = 20.58 \text{ MPa} \quad (68)$$

Tabulated shear stress:

$$F_v = 1.97 \text{ MPa} \quad (69)$$

Adjusted allowable shear stress with $C_D = 1.0$, $C_M = 1.0$, $C_t = 1.0$:

$$F'_v = 1.97 \text{ MPa} \quad (70)$$

Structural bending check. Design resisting moment:

$$M'_s = 16.83 \text{ kNm} \quad (71)$$

Structural bending check: $M'_s = 16.83 > 5.79 = M_{max} \Rightarrow OK$

Structural shear check. Design resisting shear:

$$V'_s = 27.36 \text{ kN} \quad (72)$$

Structural shear check: $V'_s = 27.36 > 7.94 = V_{max} \Rightarrow OK$

Bending stiffness. The deflection obtained under live load is:

$$\Delta_{LL} = 3.45 \text{ mm} = \frac{\text{span}}{845} < \frac{\text{span}}{540} \Rightarrow OK \quad (73)$$

and the deflection under total load is:

$$\Delta_{TL} = 3.86 \text{ mm} = \frac{\text{span}}{754} < \frac{\text{span}}{360} \Rightarrow OK \quad (74)$$

8.3.4 Facade headers

Simply supported 3.5x11 7/8 LSL 1.55E header.

Structural design of the header.

Design load.

$$w_{load} = 75.91 \text{ kN/m} \quad (75)$$

Internal forces. Maximum induced moment:

$$M_{max} = w_{load} \frac{L^2}{8} = 8.26 \text{ kNm} \quad (76)$$

Maximum induced shear:

$$V_{max} = w_{load} \frac{L}{2} = 43.38 \text{ kN} \quad (77)$$

Structural bending check. Design resisting moment:

$$M'_s = 21.96 \text{ kNm} \quad (78)$$

Structural bending check: $M'_s = 21.96 > 8.26 = M_{max} \Rightarrow OK$

Structural shear check. Design resisting shear:

$$V'_s = 50.53 \text{ kN} \quad (79)$$

Structural shear check: $V'_s = 50.53 > 43.38 = V_{max} \Rightarrow OK$

Bending stiffness. The deflection obtained is:

$$\Delta_{TL} = 0.41 \text{ mm} = \frac{\text{span}}{2758} < \frac{\text{span}}{600} \Rightarrow OK \quad (80)$$

8.3.5 Corridor headers

Simply supported 3.5x16 LSL 1.55E header.

Structural design of the header.

Design load.

$$w_{load} = 118.11 \text{ kN/m} \quad (81)$$

Internal forces. Maximum induced moment:

$$M_{max} = w_{load} \frac{L^2}{8} = 14.63 \text{ kNm} \quad (82)$$

Maximum induced shear:

$$V_{max} = w_{load} \frac{L}{2} = 72.0 \text{ kN} \quad (83)$$

Structural bending check. Design resisting moment:

$$M'_s = 48.00 \text{ kNm} \quad (84)$$

Structural bending check: $M'_s = 48.00 > 14.63 = M_{max} \Rightarrow OK$

Structural shear check. Design resisting shear:

$$V'_s = 76.60 \text{ kN} \quad (85)$$

Structural shear check: $V'_s = 76.60 > 72.0 = V_{max} \Rightarrow OK$

Bending stiffness. The deflection obtained is:

$$\Delta_{TL} = 0.26 \text{ mm} = \frac{\text{span}}{4581} < \frac{\text{span}}{600} \Rightarrow OK \quad (86)$$

8.4 Steel beams

8.4.1 Steel beam at courtyard facade

Continuous beam supporting the second floor trusses between the axes 1, 2 and 3 (see figure 11). The beam has two equal spans; L= 8.31 m (27' - 3").

Design loads. The design loads are show in table 10. The beam then carries a load of 17.22 kN each 0.6m(24").

Structural design of the beam.

Loads.

$$w_{load} = 28.24 \text{ kN/m} \quad (87)$$

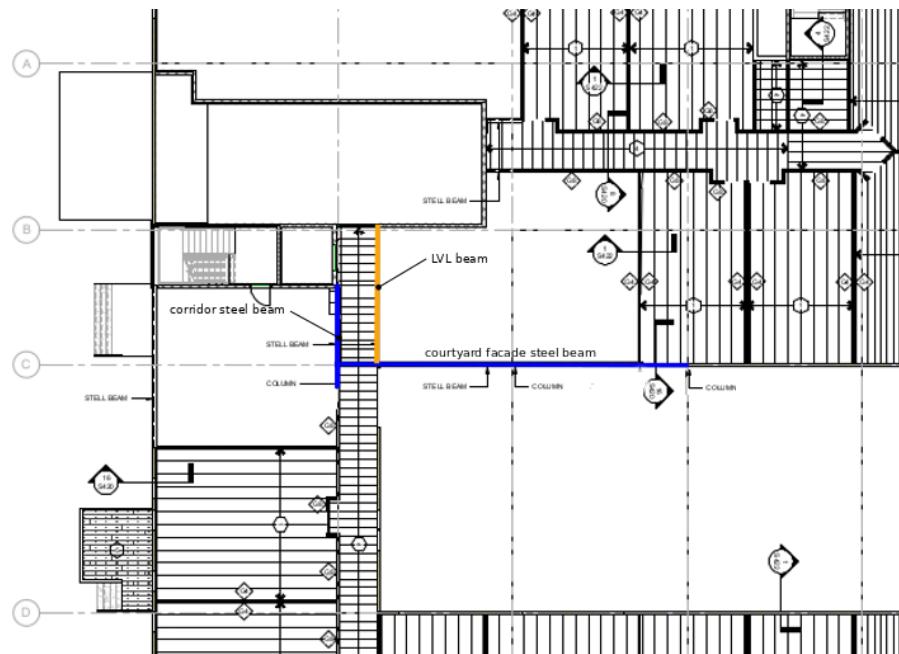


Figure 11: Second floor beams key plan.

comb	floor	truss name	Rz (kN)	Rz (kN)	truss name	Rz (kN)	Rz (kN)
EQ1608	roof	3C	2.25	3.08	3D	2.91	2.11
EQ1609	roof	3C	5.18	6.84	3D	6.42	4.78
EQ1610	roof	3C	8.38	10.96	3D	10.26	7.70
EQ1611	roof	3C	9.04	11.81	3D	11.05	8.30
EQ1612	roof	3C	-0.07	0.09	3D	0.13	-0.02
EQ1613	roof	3C	7.30	9.57	3D	8.96	6.71
EQ1615	roof	3C	-0.97	-1.14	3D	-1.04	-0.86
			9.04	11.81		11.05	8.30
EQ1608	2nd floor	2C	3.78	4.86	2D	4.69	3.62
EQ1609	2nd floor	2C	9.64	12.14	2D	11.71	9.20
EQ1610	2nd floor	2C	3.78	4.86	2D	4.69	3.62
EQ1611	2nd floor	2C	8.17	10.32	2D	9.95	7.81
EQ1612	2nd floor	2C	3.78	4.86	2D	4.69	3.62
EQ1613	2nd floor	2C	8.17	10.32	2D	9.95	7.81
EQ1615	2nd floor	2C	2.27	2.92	2D	2.82	2.17
			9.64	12.14		11.71	9.20
EQ1608		3C+2C	6.03	7.94	3D+2D	7.61	5.72
EQ1609		3C+2C	14.82	18.98	3D+2D	18.13	13.98
EQ1610		3C+2C	12.16	15.82	3D+2D	14.95	11.31
EQ1611		3C+2C	17.22	22.13	3D+2D	21.00	16.11
EQ1612		3C+2C	3.71	4.95	3D+2D	4.82	3.60
EQ1613		3C+2C	15.47	19.89	3D+2D	18.92	14.52
EQ1615		3C+2C	1.30	1.78	3D+2D	1.78	1.31
			17.22	22.13		21.00	16.11

Table 10: Steel beam at courtyard facade. Trusses reactions.

Internal forces on each structural channel. Maximum induced moment:

$$M_{max} = 60.90 \text{ kNm} \quad (88)$$

Maximum induced shear:

$$V_{max} = 146.64 \text{ kN} \quad (89)$$

Structural channel (C380X50.4) mechanical properties. Shear strength:

$$V_u = 560.92 \text{ kN} \quad (90)$$

Structural shear check: $V_u = 560.92 > 146.64 = V_{max} \implies OK$

Resisting moment:

$$M_u = 208.0 \text{ kN} \cdot m \quad (91)$$

Structural bending check: $M_u = 208.0 > 60.90 = M_{max} \implies OK$

Bending stiffness. The deflection obtained is:

$$\Delta_{TL} = 13.36 \text{ mm} = \frac{\text{span}}{622} < \frac{\text{span}}{600} \implies OK \quad (92)$$

8.4.2 Steel beam at corridor

This beam supports supporting the second floor trusses near the elevator well (see figure 11). It has a main span of 3.97 m long (13' - 5/16") and a cantilever that spans 1.04 m (3' - 4").

Design loads. The design loads are show in table 11. The beam then carries a load of 20.98 kN each 0.6m(24").

Structural design of the beam.

Loads.

$$w_{load} = 34.41 \text{ kN/m} \quad (93)$$

Internal forces on each structural channel. Maximum induced moment:

$$M_{max} = 58.56 \text{ kNm} \quad (94)$$

Maximum induced shear:

$$V_{max} = 108.65 \text{ kN} \quad (95)$$

Structural channel (C380X50.4) mechanical properties. Shear strength:

$$V_u = 213.77 \text{ kN} \quad (96)$$

Structural shear check: $V_u = 213.77 > 108.64 = V_{max} \implies OK$

Resisting moment:

$$M_u = 128.25 \text{ kN} \cdot m \quad (97)$$

Structural bending check: $M_u = 128.25 > 58.56 = M_{max} \implies OK$

comb	floor	truss name	Rz (kN)	Rz (kN)
EQ1608	roof	3E	2.19	2.90
EQ1609	roof	3E	4.96	6.41
EQ1610	roof	3E	7.99	10.25
EQ1611	roof	3E	8.62	11.04
EQ1612	roof	3E	-0.01	0.12
EQ1613	roof	3E	6.97	8.95
EQ1615	roof	3E	-0.89	-1.04
			8.619	11.0419
EQ1608	2nd floor	2E	3.59	4.68
EQ1609	2nd floor	2E	9.13	11.69
EQ1610	2nd floor	2E	3.59	4.68
EQ1611	2nd floor	2E	7.74	9.94
EQ1612	2nd floor	2E	3.59	4.68
EQ1613	2nd floor	2E	7.74	9.94
EQ1615	2nd floor	2E	2.15	2.81
			9.129	11.6896
EQ1608		3E+2E	5.78	7.58
EQ1609		3E+2E	14.09	18.10
EQ1610		3E+2E	11.58	14.92
EQ1611		3E+2E	16.36	20.98
EQ1612		3E+2E	3.58	4.79
EQ1613		3E+2E	14.71	18.89
EQ1615		3E+2E	1.27	1.76
			16.36	20.978

Table 11: Steel beam at corridor. Trusses reactions.

Bending stiffness. The deflection obtained is:

$$\Delta_{TL} = 7.77 \text{ mm} = \frac{\text{span}}{510} < \frac{\text{span}}{480} \implies OK \quad (98)$$

8.5 Cantilevers

8.5.1 Cantilevers C1, C3, C4, C6, C11 and C12

Loads.

- Load from trusses (three trusses at 12 inches): 13.21 kN/truss
- Facade weight: 25.76 kN
- Total load: 65.41 kN

Internal forces. Maximum induced moment:

$$M_{max} = 37.98 \text{ kNm} \quad (99)$$

Maximum induced shear:

$$V_{max} = 65.41 \text{ kN} \quad (100)$$

Structural bending check. LSL 1.55E 5.25x14" design resisting moment:

$$M'_s = 44.89 \text{ kNm} \quad (101)$$

Structural bending check: $M'_s = 44.89 > 37.98 = M_{max} \implies OK$

Structural shear check. LSL 1.55E 5.25x14" design resisting shear:

$$V'_s = 89.36 \text{ kN} \quad (102)$$

Structural shear check: $V'_s = 89.36 > 65.41 = V_{max} \implies OK$

Bending stiffness. The deflection obtained under total load is:

$$\Delta_{TL} = 1.88 \text{ mm} = \frac{L}{506} < \frac{L}{360} \implies OK \quad (103)$$

8.5.2 Cantilevers C2 and C5

Loads.

- Load from trusses (2x3 trusses at 12 inches): 13 kN/truss
- Facade weight: 51.55 kN
- Total load: 129.25 kN

Internal forces. Maximum induced moment:

$$M_{max} = 63.79 \text{ kNm} \quad (104)$$

Maximum induced shear:

$$V_{max} = 129.25 \text{ kN} \quad (105)$$

CALCULATION REPORT

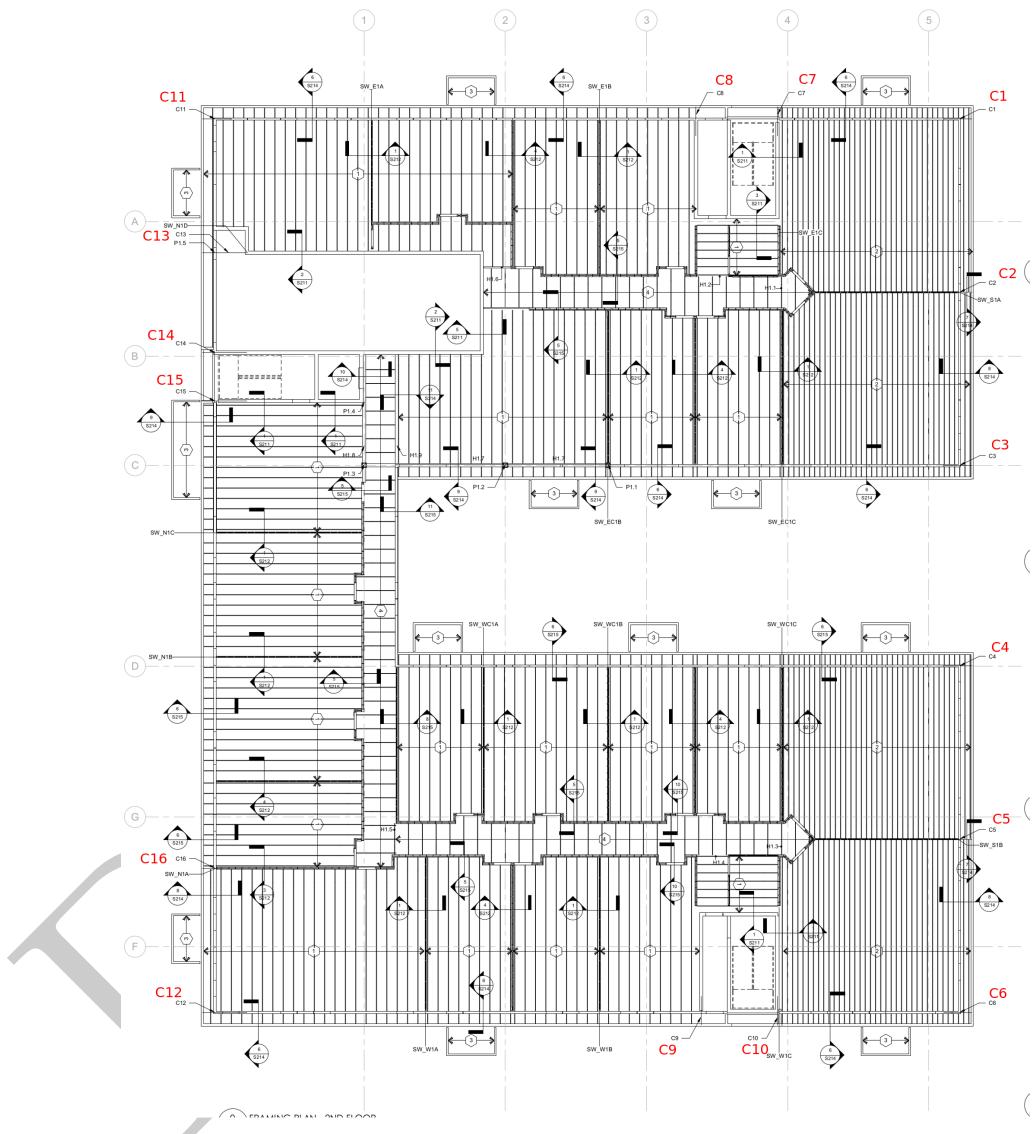


Figure 12: Second floor cantilevers key plan.

Structural bending check. (2) LSL 1.55E 5.25x14" design resisting moment:

$$M'_s = 65.88 \text{ kNm} \quad (106)$$

Structural bending check: $M'_s = 65.88 > 63.79 = M_{max} \Rightarrow OK$

Structural shear check. (2) LSL 1.55E 5.25x14" design resisting shear:

$$V'_s = 151.60 \text{ kN} \quad (107)$$

Structural shear check: $V'_s = 151.60 > 129.25 = V_{max} \Rightarrow OK$

Bending stiffness. The deflection obtained under total load is:

$$\Delta_{TL} = 1.95 \text{ mm} = \frac{L}{442} < \frac{L}{360} \Rightarrow OK \quad (108)$$

8.5.3 Cantilevers C7, C8, C9 and C10

Loads.

- Floor load: 5.78 kN
- Facade weight: 12.93 kN
- Total load: 18.71 kN

Internal forces. Maximum induced moment:

$$M_{max} = 17.77 \text{ kNm} \quad (109)$$

Maximum induced shear:

$$V_{max} = 18.71 \text{ kN} \quad (110)$$

Structural bending check. LSL 1.55E 3.5x14" design resisting moment:

$$M'_s = 29.93 \text{ kNm} \quad (111)$$

Structural bending check: $M'_s = 29.93 > 17.77 = M_{max} \Rightarrow OK$

Structural shear check. LSL 1.55E 3.5x14" design resisting shear:

$$V'_s = 59.58 \text{ kN} \quad (112)$$

Structural shear check: $V'_s = 59.58 > 18.71 = V_{max} \Rightarrow OK$

Bending stiffness. The deflection obtained under total load is:

$$\Delta_{TL} = 1.5 \text{ mm} = \frac{L}{632} < \frac{L}{360} \Rightarrow OK \quad (113)$$

8.5.4 Cantilever C13

Loads.

- Floor load: 16.25 kN
- Facade weight: 36.37 kN
- Total load: 52.62 kN

Internal forces. Maximum induced moment:

$$M_{max} = 49.99 \text{ kNm} \quad (114)$$

Maximum induced shear:

$$V_{max} = 52.62 \text{ kN} \quad (115)$$

Structural bending check. LSL 1.55E 5.25x18" design resisting moment:

$$M'_s = 72.00 \text{ kNm} \quad (116)$$

Structural bending check: $M'_s = 72.00 > 49.99 = M_{max} \Rightarrow OK$

Structural shear check. LSL 1.55E 5.25x18" design resisting shear:

$$V'_s = 114.90 \text{ kN} \quad (117)$$

Structural shear check: $V'_s = 114.90 > 52.62 = V_{max} \Rightarrow OK$

Bending stiffness. The deflection obtained under total load is:

$$\Delta_{TL} = 1.5 \text{ mm} = \frac{L}{717} < \frac{L}{360} \Rightarrow OK \quad (118)$$

8.5.5 Cantilever C14

Loads.

- Floor load: 10.84 kN
- Facade weight: 24.25 kN
- Total load: 35.08 kN

Internal forces. Maximum induced moment:

$$M_{max} = 33.33 \text{ kNm} \quad (119)$$

Maximum induced shear:

$$V_{max} = 35.08 \text{ kN} \quad (120)$$

Structural bending check. LSL 1.55E 3.5x18" design resisting moment:

$$M'_s = 48.00 \text{ kNm} \quad (121)$$

Structural bending check: $M'_s = 48.00 > 33.33 = M_{max} \Rightarrow OK$

Cantilevers					
C2,C5	LVL	2x5.25	14	SW_S1A and SW_S1B shear walls	
C1, C3, C4, C6	LVL	5.25	14	facades bearing walls	
C7, C8, C9, C10, C15	LVL	3.5	14	CMU wall	Bolted to masonry
C11, C12	LVL	5.25	14	facades bearing walls	
C13	LVL	5.25	18	SW_N2D shear wall	At shear wall bottom
C14	LVL	3.5	18	CMU wall	Bolted to masonry
C16	LVL	5.25	14	SW_N1A shear wall	

Table 12: Cantilever schedule.

Structural shear check. LSL 1.55E 3.5x18" design resisting shear:

$$V'_s = 76.60 \text{ kN} \quad (122)$$

Structural shear check: $V'_s = 76.60 > 35.08 = V_{max} \implies OK$

Bending stiffness. The deflection obtained under total load is:

$$\Delta_{TL} = 1.33 \text{ mm} = \frac{L}{717} < \frac{L}{360} \implies OK \quad (123)$$

8.6 Columns

8.6.1 Columns P3.1 to P3.6

Loads.

- Load from header: 4.8 kN

Internal forces. Maximum induced axial force:

$$N_{max} = 4.8 \text{ kN} \quad (124)$$

Compression check.

Mechanical properties

- Species: Spruce-pine-fir No.2
- $E_{min} = 2.55 \text{ GPa}$
- $F_c = 2.93 \text{ MPa}$
- Sections dimensions: (6x6"), effective (5.5x5.5")= 139.7 x 139.7 mm.
- Unbraced length x axis: 3.45 m
- Unbraced length y axis: 2.59 m
- Column stability factor: $C_P = 0.74$

$$N'_s = 42.46 \text{ kN} \quad (125)$$

Structural compression check: $N'_s = 42.46 > 4.8 = N_{max} \implies OK$

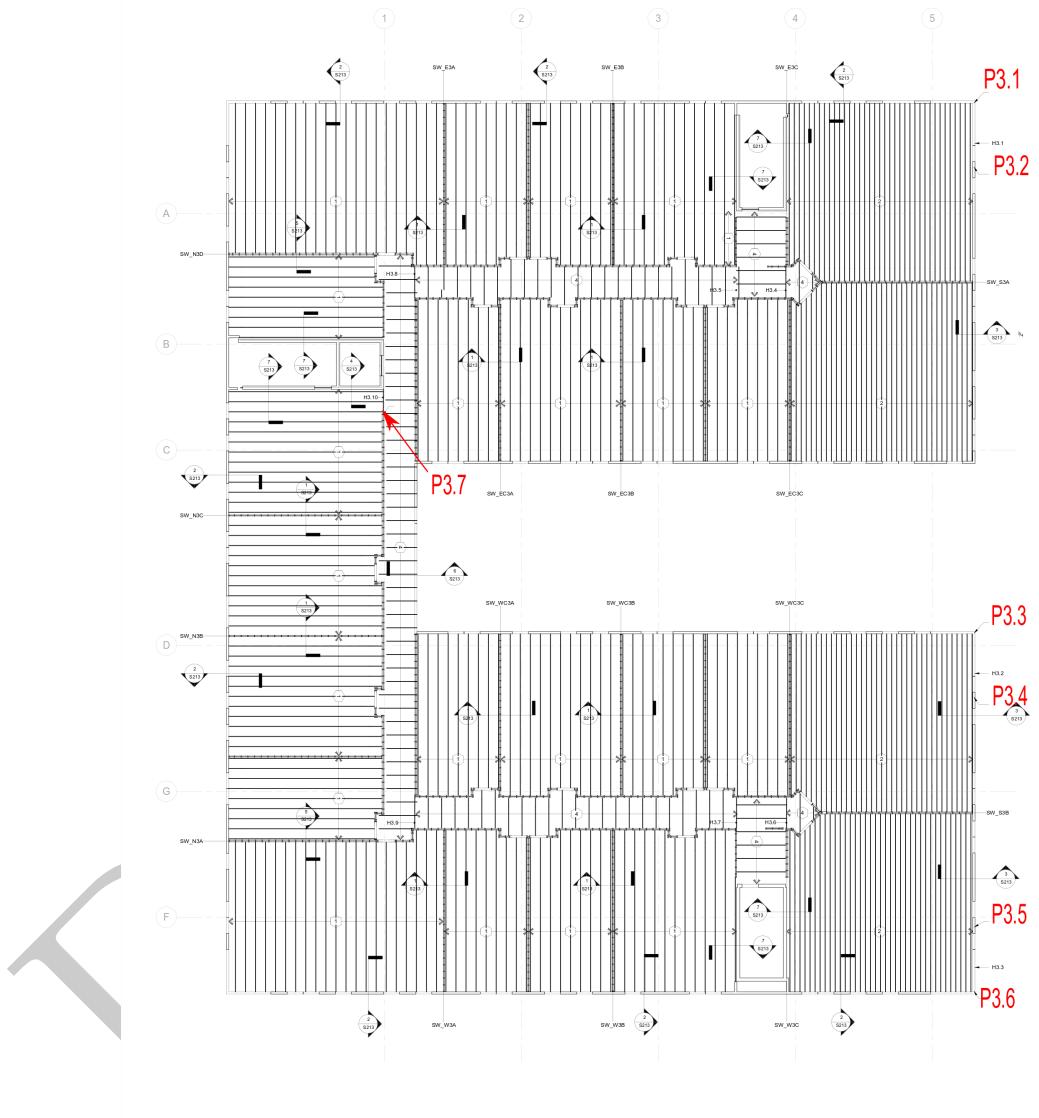


Figure 13: Columns key plan. Roof

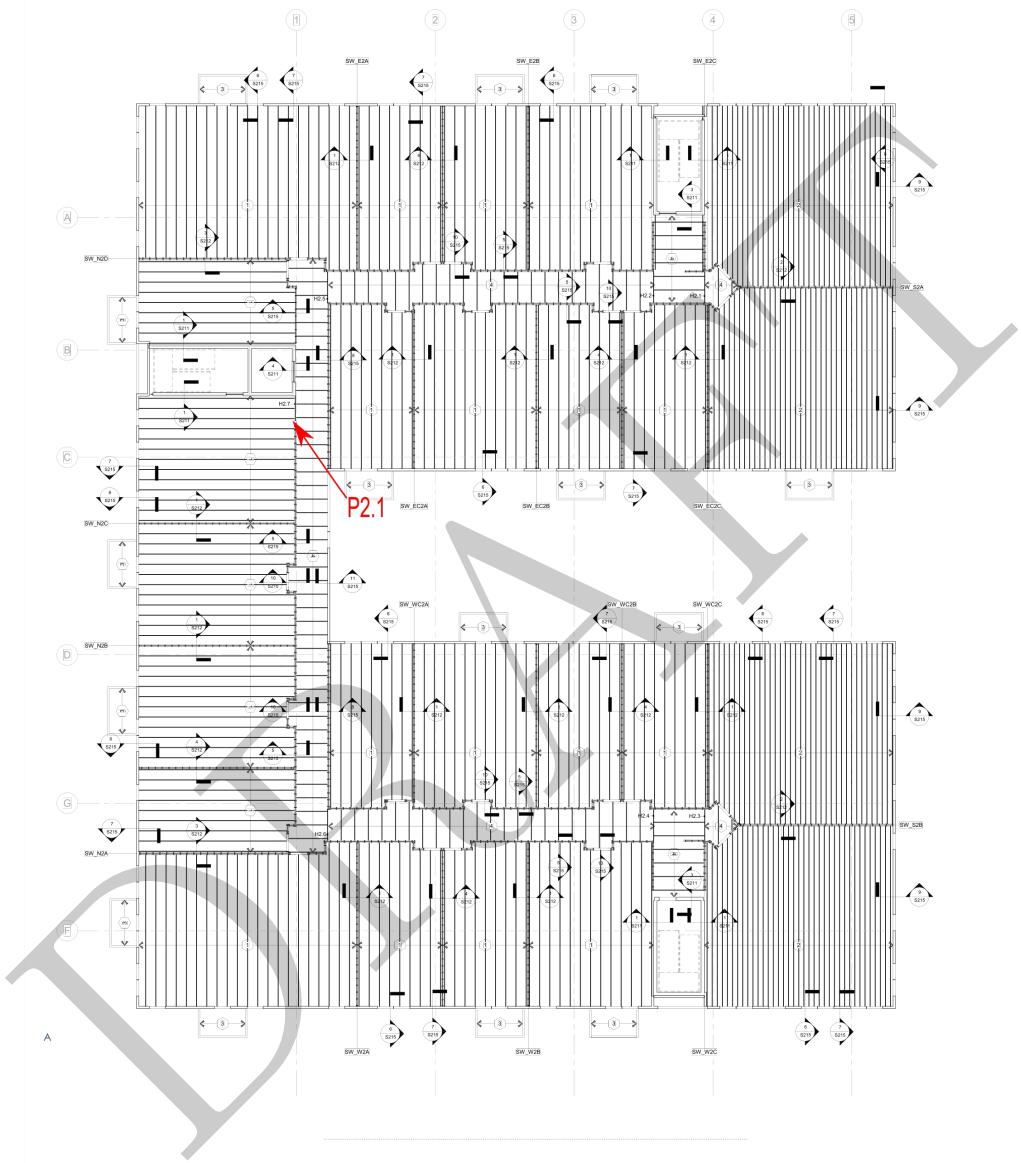


Figure 14: Columns key plan. Third floor

CALCULATION REPORT

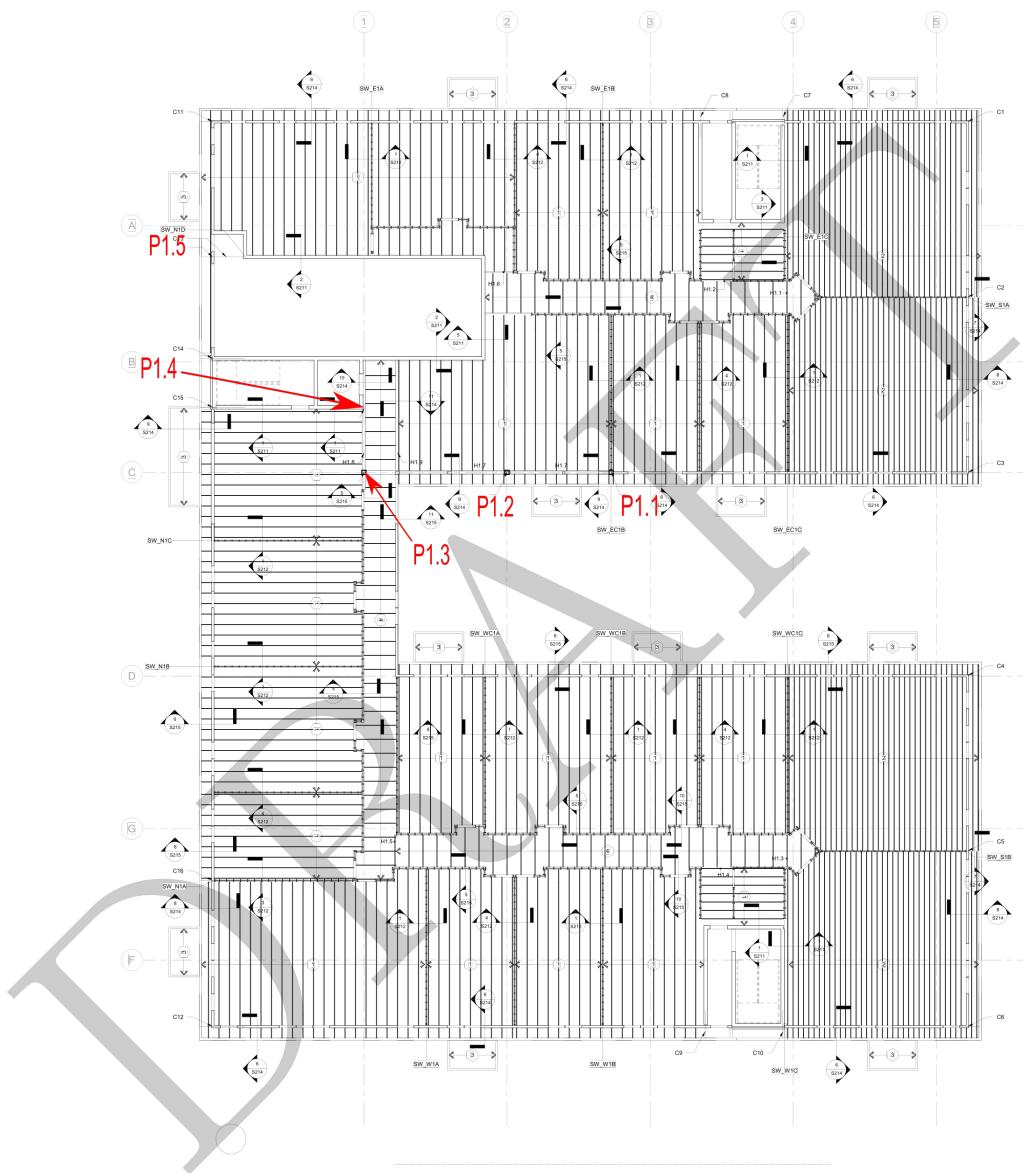


Figure 15: Columns key plan. Second floor

8.6.2 Column P3.7

Loads.

- Load from header 3.10: 27.61 kN

Internal forces. Maximum induced axial force:

$$N_{max} = 27.61 \text{ kN} \quad (126)$$

Compression check.

Mechanical properties

- Species: Douglas fir-Larch dense structural
- $E_{min} = 4.27 \text{ GPa}$
- $F_c = 9.31 \text{ MPa}$.
- Sections dimensions: (4x6"), effective (3.5x5.5") = 88.9 x 139.7 mm.
- Unbraced lenght x axis: 2.902 m
- Unbraced lenght y axis: 0.5 m
- Column stability factor: $C_P = 0.64$

$$N'_s = 74.34 \text{ kN} \quad (127)$$

Structural compression check: $N'_s = 74.34 > 27.61 = N_{max} \implies OK$

8.6.3 Column P2.1

Loads.

- Load from header 2.07 and post P3.10: 55.22 kN

Internal forces. Maximum induced axial force:

$$N_{max} = 55.22 \text{ kN} \quad (128)$$

Compression check.

Mechanical properties

- Species: Douglas fir-Larch dense structural
- $E_{min} = 4.27 \text{ GPa}$
- $F_c = 9.31 \text{ MPa}$.
- Sections dimensions: (4x6"), effective (3.5x5.5") = 88.9 x 139.7 mm.
- Unbraced lenght x axis: 2.902 m
- Unbraced lenght y axis: 0.5 m

- Column stability factor: $C_P = 0.64$

$$N'_s = 74.34 \text{ kN} \quad (129)$$

Structural compression check: $N'_s = 74.34 > 55.22 = N_{max} \implies OK$

8.6.4 2x6 wood stud capacity

Compression capacity.

Mechanical properties.

- Species: Hem-fir stud select structural.
- $E_{min} = 3.24 \text{ GPa}$
- $F_c = 8.27 \text{ MPa}$.
- Sections dimensions: (2x6"), effective (1.5x5.5") = 38.1 x 139.7 mm.
- Unbraced lenght x axis: 0.3 m
- Unbraced lenght y axis: 3.45 m
- Column stability factor: $C_P = 0.45$

$$N'_s = 19.90 \text{ kN} \quad (130)$$

8.6.5 Columns P1.1, P1.2 and P1.3

8.7 Lateral. Diaphragms/Shear walls

8.7.1 East and West facades shear walls

The shear walls of the East facade are those denoted by the letters "E" and "W" in figures 16 to 18. The wind load on each floor per unit length is as follows:

floor	wind force (kN/m)
roof	2.34
third	1.67
second	1.71

The shear values obtained for each wall are as follows:

floor	shear force (kN)		
	EA/WA	EB/WB	EC/WC
roof	68.76	-21.54	59.39
third	48.93	-15.32	42.26
second	118.86	44.95	31.49

And the cumulated values are:

floor	shear force (kN)		
	EA/WA	EB/WB	EC/WC
roof	68.76	-21.54	59.39
third	117.70	-36.86	101.65
second	118.86	8.09	133.14

leading to the following dimensions:

DRAFT

CALCULATION REPORT

Shear wall	Sheathing material	Panel thickness	Blocking	Minimum fastener penetration	Fastener type and size	Panel edge fastener spacing	Bottom plate attachment (foundation)		Bottom plate attachment (floor to floor)	
							Nominal unit shear capacity v_w	Hold-down anchor capacity	Number of bolts	Bolt spacing
ID	(in)	(in)		(in)	(plf)	(kip)		(in)		
SW_E3A	Wood structural panels - sheathing	19/32	YES	1-1/2	10d	4	1430	3	-	-
SW_E3B	Wood structural panels - sheathing	3/8	NO	1-3/8	8d	6	560	-	-	16d (d= 0.268 in) nails at 12 in. o/c; 30 fasteners in 1 row.
SW_E3C	Wood structural panels - sheathing	19/32	YES	1-1/2	10d	4	1430	6	-	SDWS log screw (d= 0.197 in) at 15 in. o/c; 32 fasteners in 2 rows.
SW_E2A	Wood structural panels - sheathing	19/32	YES	1-1/2	10d	3	1860	7	-	SDWS log screw (d= 0.197 in) at 11 in. o/c; 64 fasteners in 2 rows.
SW_E2B	Wood structural panels - sheathing	3/8	NO	1-3/8	8d	6	560	1	-	16d (d= 0.268 in) nails at 14 in. o/c; 51 fasteners in 2 rows.
SW_E2C	Wood structural panels - sheathing	19/32	YES	1-1/2	10d	2	2435	11	-	SDWS log screw (d= 0.197 in) at 9 in. o/c; 54 fasteners in 2 rows.
SW_E1A	Wood structural panels - sheathing	19/32	YES	1-1/2	10d	2	2435	13	7	36
SW_E1B	Wood structural panels - sheathing	3/8	NO	1-3/8	8d	6	560	-	11	36
SW_E1C	Wood structural panels - sheathing	19/32	YES	1-1/2	10d	2	2435	9	11	36
SW_W3A	Wood structural panels - sheathing	19/32	YES	1-1/2	10d	4	1430	3	-	wood screws 20 (d= 0.32 in) at 16 in. o/c; 46 fasteners in 2 rows.
SW_W3B	Wood structural panels - sheathing	3/8	NO	1-3/8	8d	6	560	-	-	16d (d= 0.268 in) nails at 12 in. o/c; 30 fasteners in 1 row.
SW_W3C	Wood structural panels - sheathing	19/32	YES	1-1/2	10d	4	1430	6	-	SDWS log screw (d= 0.197 in) at 15 in. o/c; 32 fasteners in 2 rows.
SW_W2A	Wood structural panels - sheathing	19/32	YES	1-1/2	10d	3	1860	7	-	SDWS log screw (d= 0.197 in) at 11 in. o/c; 64 fasteners in 2 rows.
SW_W2B	Wood structural panels - sheathing	3/8	NO	1-3/8	8d	6	560	1	-	16d (d= 0.268 in) nails at 14 in. o/c; 51 fasteners in 2 rows.
SW_W2C	Wood structural panels - sheathing	19/32	YES	1-1/2	10d	2	2435	11	-	SDWS log screw (d= 0.197 in) at 9 in. o/c; 54 fasteners in 2 rows.
SW_W1A	Wood structural panels - sheathing	19/32	YES	1-1/2	10d	2	2435	13	9	30
SW_W1B	Wood structural panels - sheathing	3/8	NO	1-3/8	8d	6	560	-	11	36
SW_W1C	Wood structural panels - sheathing	19/32	YES	1-1/2	10d	2	2435	9	11	36

8.7.2 Courtyard facades shear walls

The shear walls of the courtyard East and West facades are those denoted by the letters "EC" or "WC" in figures 16 to 18. The wind load on each floor per unit length is as follows:

floor	wind force (kN/m)
roof	2.50
third	1.98
second	2.03

8. WOOD FRAMING

The shear values obtained for each wall are as follows:

floor	shear force (kN)		
	ECA/WCA	ECB/WCB	ECC/WCC
roof	30.35	-4.77	59.26
third	24.06	-3.78	46.97
second	24.61	-3.87	48.04

And the cumulated values are:

floor	shear force (kN)		
	ECA/WCA	ECB/WCB	ECC/WCC
roof	30.35	-4.77	59.26
third	54.41	-8.56	106.22
second	79.02	-12.43	154.27

leading to the following dimensions:

Shear wall	Sheathing material	Panel thickness	Blocking	Minimum fastener penetration	Fastener type and size	Panel edge fastener spacing	Nominal unit shear capacity v_w	Hold-down anchor capacity	Bottom plate attachment (foundation)		Bottom plate attachment (floor to floor)	
									(in)	(in)	Number of bolts	Bolt spacing
ID		(in)	(in)			(in)	(plf)	(kip)				
SW_EC3A	Wood structural panels - sheathing	19/32	YES	1-1/2	10d	6	950	0	-	-	16d (d= 0.268 in) nails at 18 in. o/c; 42 fasteners in 2 rows.	
SW_EC3B	Wood structural panels - sheathing	3/8	NO	1-3/8	8d	6	560	-	-	-	16d (d= 0.268 in) nails at 60 in. o/c; 7 fasteners in 1 row.	
SW_EC3C	Wood structural panels - sheathing	19/32	YES	1-1/2	10d	6	950	3	-	-	wood screws 20 (d= 0.32 in) at 19 in. o/c; 40 fasteners in 2 rows.	
SW_EC2A	Wood structural panels - sheathing	19/32	YES	1-1/2	10d	3	1860	2	-	-	wood screws 20 (d= 0.32 in) at 21 in. o/c; 36 fasteners in 2 rows.	
SW_EC2B	Wood structural panels - sheathing	3/8	NO	1-3/8	8d	6	560	-	-	-	16d (d= 0.268 in) nails at 32 in. o/c; 12 fasteners in 1 row.	
SW_EC2C	Wood structural panels - sheathing	19/32	YES	1-1/2	10d	3	1860	6	-	-	SDWS log screw (d= 0.197 in) at 12 in. o/c; 58 fasteners in 2 rows.	
SW_EC1A	Wood structural panels - sheathing	19/32	YES	1-1/2	10d	2	2435	11	6	36	SDWS log screw (d= 0.197 in) at 9 in. o/c; 42 fasteners in 2 rows.	
SW_EC1B	Wood structural panels - sheathing	3/8	NO	1-3/8	8d	6	560	-	11	36	16d (d= 0.268 in) nails at 22 in. o/c; 17 fasteners in 1 row.	
SW_EC1C	Wood structural panels - sheathing	19/32	YES	1-1/2	10d	2	2435	11	11	36	SDWS log screw (d= 0.197 in) at 9 in. o/c; 82 fasteners in 2 rows.	
SW_WC3A	Wood structural panels - sheathing	19/32	YES	1-1/2	10d	6	950	0	-	-	16d (d= 0.268 in) nails at 18 in. o/c; 42 fasteners in 2 rows.	
SW_WC3B	Wood structural panels - sheathing	3/8	NO	1-3/8	8d	0	560	-	-	-	16d (d= 0.268 in) nails at 60 in. o/c; 7 fasteners in 1 row.	
SW_WC3C	Wood structural panels - sheathing	19/32	YES	1-1/2	10d	6	950	3	-	-	wood screws 20 (d= 0.32 in) at 19 in. o/c; 40 fasteners in 2 rows.	
SW_WC2A	Wood structural panels - sheathing	19/32	YES	1-1/2	10d	3	1860	2	-	-	wood screws 20 (d= 0.32 in) at 21 in. o/c; 36 fasteners in 2 rows.	
SW_WC2B	Wood structural panels - sheathing	3/8	NO	1-3/8	8d	6	560	-	-	-	16d (d= 0.268 in) nails at 32 in. o/c; 12 fasteners in 1 row.	
SW_WC2C	Wood structural panels - sheathing	19/32	YES	1-1/2	10d	3	1860	6	-	-	SDWS log screw (d= 0.197 in) at 12 in. o/c; 58 fasteners in 2 rows.	

CALCULATION REPORT

SW.WC1A	Wood structural panels – sheathing	19/32	YES	1-1/2	10d	2	2435	11	6	36	SDWS log screw (d= 0.197 in) at 9 in. o/c; 42 fasteners in 2 rows.
SW.WC1B	Wood structural panels – sheathing	3/8	NO	1-3/8	8d	6	560	-	11	36	16d (d= 0.268 in) nails at 22 in. o/c; 17 fasteners in 1 row.
SW.WC1C	Wood structural panels – sheathing	19/32	YES	1-1/2	10d	2	2435	11	11	36	SDWS log screw (d= 0.197 in) at 9 in. o/c; 82 fasteners in 2 rows.

8.7.3 South facades shear walls

The shear walls of the South facade are those denoted by the letter “S” in figures 16 to 18. The wind load on each floor per unit length is as follows:

floor	wind force (kN/m)
roof	2.50
third	1.98
second	2.03

The shear values obtained for each wall are as follows:

floor	shear force (kN) SA/SB
roof	54.95
third	43.56
second	44.55

And the cumulated values are:

floor	shear force (kN) SA/SB
roof	54.95
third	98.51
second	143.06

leading to the following dimensions:

Shear wall	Sheathing material	Panel thickness	Blocking	Minimum fastener penetration	Fastener type and size	Panel edge fastener spacing	Nominal unit shear capacity v_w	Hold-down anchor capacity	Number of bolts	Bolt spacing	Bottom plate attachment (foundation)	Bottom plate attachment (floor to floor)
ID		(in)		(in)	(in)	(plf)	(kip)	(in)				
SW.S3A	Wood structural panels – sheathing	19/32	YES	1-1/2	10d	6	950	2	-	-	wood screws 20 (d= 0.32 in) at 21 in. o/c; 36 fasteners in 2 rows.	
SW.S3B	Wood structural panels – sheathing	19/32	YES	1-1/2	10d	6	950	2	-	-	wood screws 20 (d= 0.32 in) at 21 in. o/c; 36 fasteners in 2 rows.	
SW.S2A	Wood structural panels – sheathing	19/32	YES	1-1/2	10d	3	1860	6	-	-	SDWS log screw (d= 0.197 in) at 13 in. o/c; 54 fasteners in 2 rows.	

8. WOOD FRAMING

SW_S2B	Wood structural panels – sheathing	19/32	YES	1-1/2	10d	3	1860	6	-	-	SDWS log screw (d= 0.197 in) at 13 in. o/c; 54 fasteners in 2 rows.
SW_S1A	Wood structural panels – sheathing	19/32	YES	1-1/2	10d	2	2435	11	10	36	SDWS log screw (d= 0.197 in) at 8 in. o/c; 76 fasteners in 2 rows.
SW_S1B	Wood structural panels – sheathing	19/32	YES	1-1/2	10d	2	2435	11	10	36	SDWS log screw (d= 0.197 in) at 8 in. o/c; 76 fasteners in 2 rows.

8.7.4 North facade shear walls

The shear walls of the North facade are those denoted by the letter "N" in figures 16 to 18. The wind load on each floor per unit length is as follows:

floor	wind force (kN/m)
roof	2.34
third	1.67
second	1.71

The shear values obtained for each wall are as follows:

floor	shear force (kN)			
	NA	NB	NC	ND
roof	44.84	11.72	25.01	45.63
third	31.91	8.34	17.79	32.47
second	32.64	8.53	18.20	33.22

And the cumulated values are:

floor	shear force (kN)			
	NA	NB	NC	ND
roof	44.84	11.72	25.01	45.63
third	76.75	20.06	42.80	78.11
second	109.39	28.59	61.01	111.33

leading to the following dimensions:

Shear wall	Sheathing material	Panel thickness	Blocking	Minimum fastener penetration	Fastener type and size	Panel edge fastener spacing	Nominal unit shear capacity v_w	Hold-down anchor capacity	Bottom plate attachment (foundation)		Bottom plate attachment (floor to floor)
									(in)	(kip)	
ID SW_N3A	Wood structural panels – sheathing	(in) 3/8	YES	(in) 1-3/8	8d	(in) 4	(plf) 840	(kip) 2	-	(in)	wood screws 20 (d= 0.32 in) at 25 in. o/c; 30 fasteners in 2 rows.
SW_N3B	Wood structural panels – sheathing	3/8	NO	1-3/8	8d	6	560	-	-	-	16d (d= 0.268 in) nails at 24 in. o/c; 16 fasteners in 1 row.
SW_N3C	Wood structural panels – sheathing	3/8	NO	1-3/8	8d	6	560	-	-	-	16d (d= 0.268 in) nails at 21 in. o/c; 35 fasteners in 2 rows.

CALCULATION REPORT

SW_N3D	Wood structural panels – sheathing	3/8	YES	1-3/8	8d	4	840	2	-	-	wood screws 20 (d= 0.32 in) at 25 in. o/c; 30 fasteners in 2 rows.
SW_N2A	Wood structural panels – sheathing	19/32	YES	1-1/2	10d	4	1430	4	-	-	wood screws 20 (d= 0.32 in) at 14 in. o/c; 52 fasteners in 2 rows.
SW_N2B	Wood structural panels – sheathing	19/32	YES	1-1/2	10d	6	950	-	-	-	16d (d= 0.268 in) nails at 13 in. o/c; 28 fasteners in 1 row.
SW_N2C	Wood structural panels – sheathing	19/32	YES	1-1/2	10d	6	950	1	-	-	16d (d= 0.268 in) nails at 12 in. o/c; 59 fasteners in 2 rows.
SW_N2D	Wood structural panels – sheathing	19/32	YES	1-1/2	10d	4	1430	4	-	-	wood screws 20 (d= 0.32 in) at 14 in. o/c; 52 fasteners in 2 rows.
SW_N1A	Wood structural panels – sheathing	19/32	YES	1-1/2	10d	3	1860	7	10	36	SDWS lag screw (d= 0.197 in) at 12 in. o/c; 58 fasteners in 2 rows.
SW_N1B	Wood structural panels – sheathing	19/32	YES	1-1/2	10d	6	950	-	11	36	16d (d= 0.268 in) nails at 19 in. o/c; 39 fasteners in 2 rows.
SW_N1C	Wood structural panels – sheathing	19/32	YES	1-1/2	10d	6	950	3	11	36	wood screws 20 (d= 0.32 in) at 19 in. o/c; 40 fasteners in 2 rows.
SW_N1D	Wood structural panels – sheathing	19/32	YES	1-1/2	10d	3	1860	7	10	36	SDWS lag screw (d= 0.197 in) at 12 in. o/c; 60 fasteners in 2 rows.

DRAFT

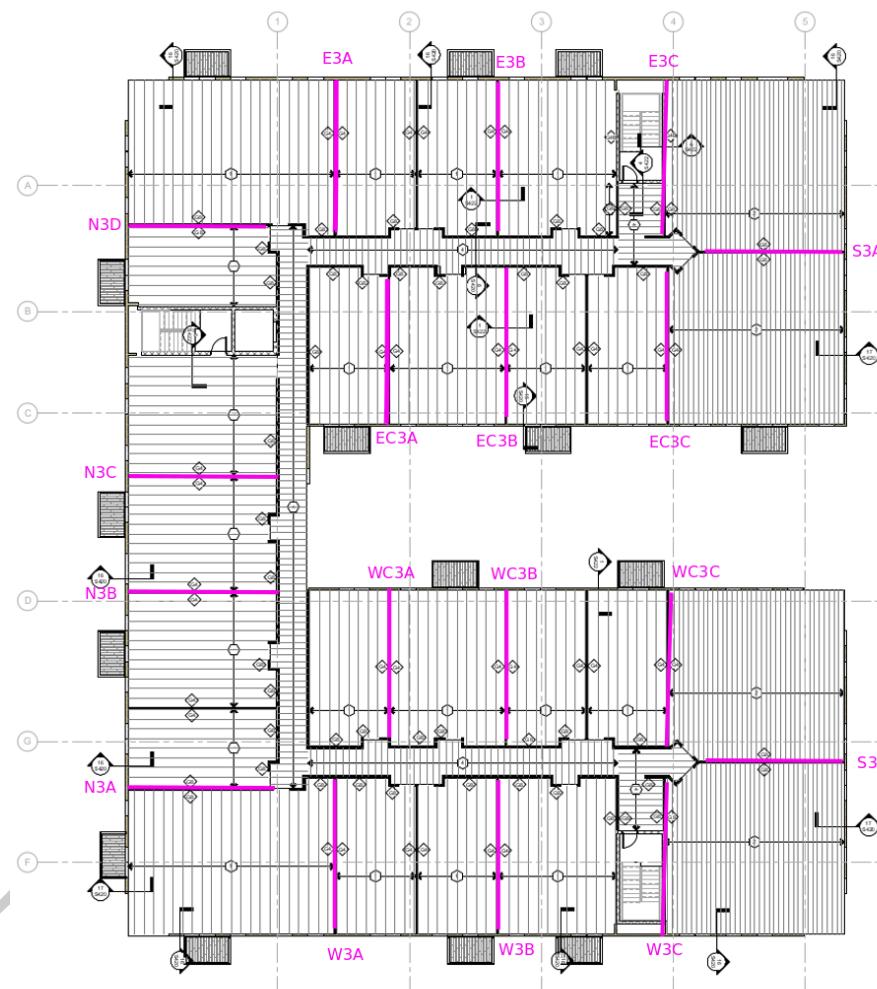


Figure 16: Shear walls on the third floor.

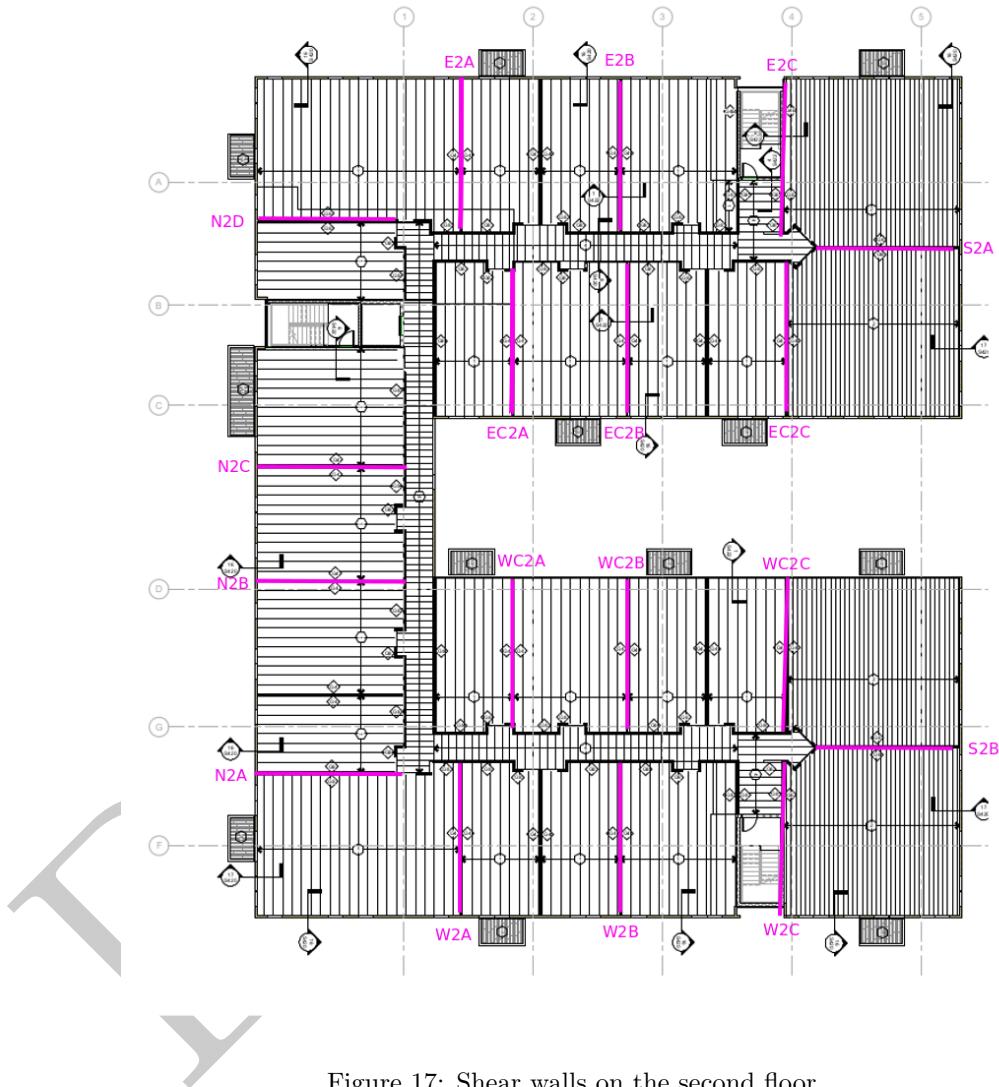


Figure 17: Shear walls on the second floor.

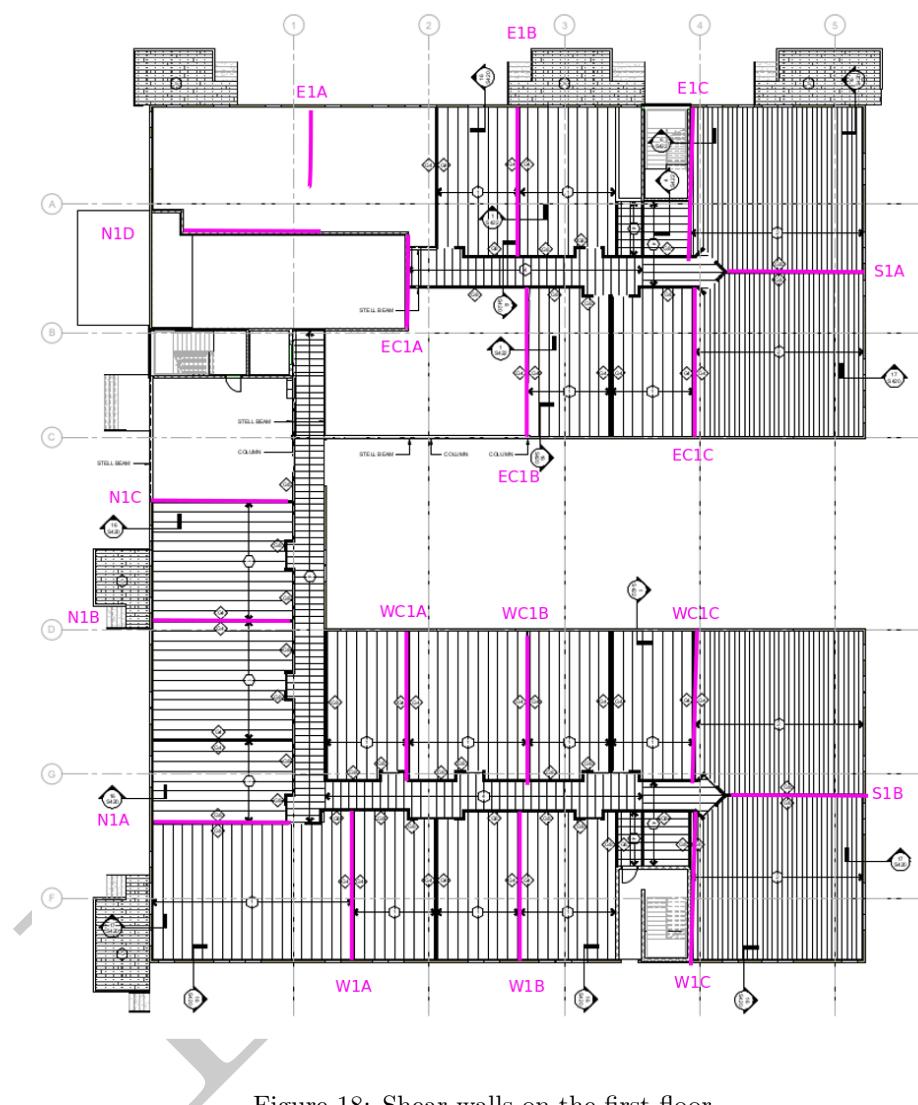


Figure 18: Shear walls on the first floor.

9 Basement

9.1 Structural model

A three-dimensional elastic computer model of the substructure is analyzed using XC. The model includes first floor frame and columns (see figure 19). The hollow core planks are modelled using shell elements, while beams and columns are modelled using frame elements. Loads transmitted by 2nd, 3rd floors and roof are applied to the 1st. Load layout is shown in figure 28. See in figures 20 to 27 load distribution for each load case.

Linear loads are expressed in kN/m and surface loads in kN/m², where:

$$\begin{aligned} 1 \text{ kN/m} &= 68.52178 \text{ lb/ft} \\ 1 \text{ kN/m}^2 &= 20.885434 \text{ psf} \end{aligned}$$

DRAFT

9. BASEMENT

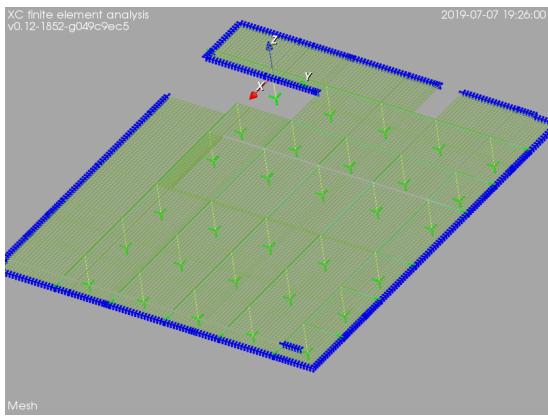


Figure 19: Elastic model, mesh.

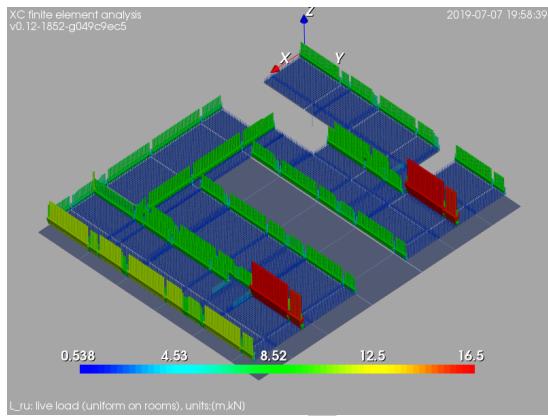


Figure 22: Load case Lrs: live load (staggered pattern on rooms) [units: kN,m].

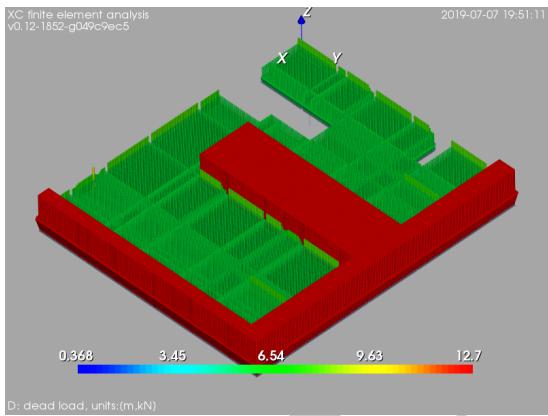


Figure 20: Load case D: dead load (include slab self-weight) [units: kN,m].

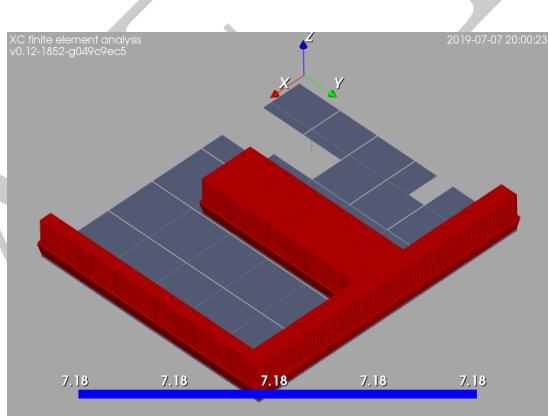


Figure 23: Load case Lpu: live load (uniform on patios) [units: kN,m].

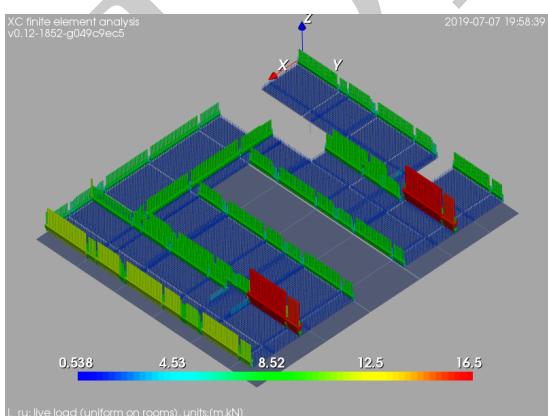


Figure 21: Load case Lru: live load (uniform on rooms) [units: kN,m].

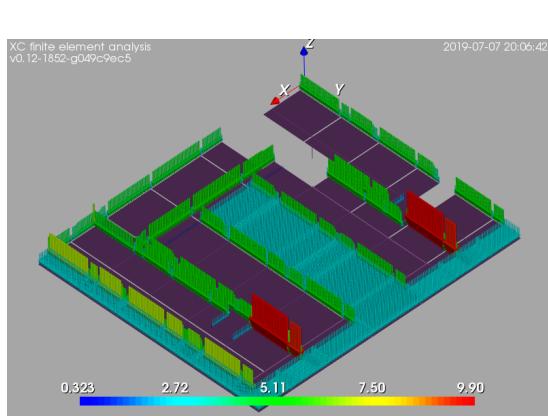


Figure 24: Load case S: snow [units: kN,m].

CALCULATION REPORT

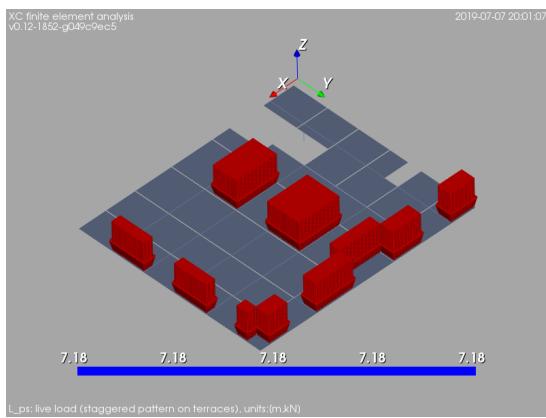


Figure 25: Load case Lps: live load (staggered pattern on patios) [units: kN,m].

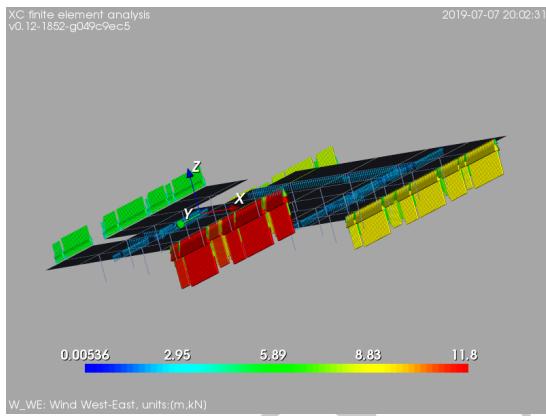


Figure 26: Load case W_WE: wind West-East [units: kN,m].

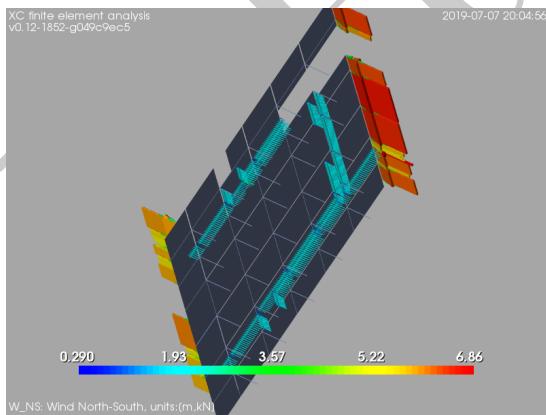


Figure 27: Load case W_NS: wind North-South [units: kN,m].

9. BASEMENT

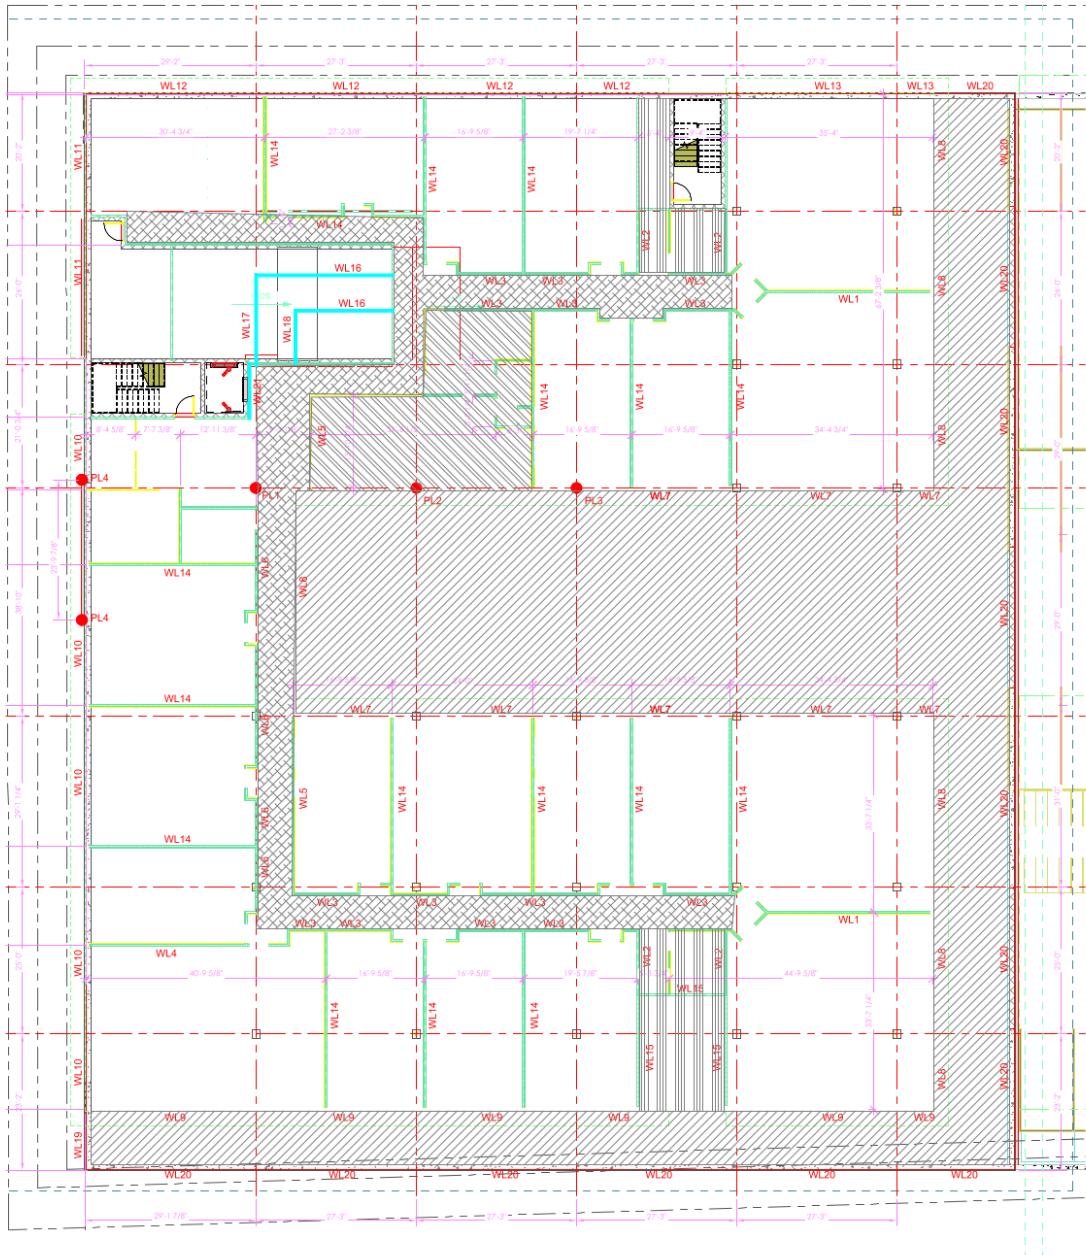


Figure 28: Load layout on first floor.

MARK	DIMENSIONS			BOTTOM REINFORCING		COLUMNS
	W	L	D	LONG	SHORT	
FT90a	9'-0"	9'-0"	1'-8"	(10)-#7	(10)-#7	A1 A2
FT90b	9'-0"	9'-0"	1'-8"	(10)-#8	(10)-#8	A3 A4 A5
FT96a	9'-6"	9'-6"	1'-8"	(10)-#7	(10)-#7	B2
FT96b	9'-6"	9'-6"	1'-8"	(10)-#8	(10)-#8	B3 B4 B5
FT100	10'-0"	10'-0"	2'-1"	(11)-#8	(11)-#8	F1 F2 F3 F4 F5
FT106	10'-6"	10'-6"	2'-3"	(11)-#8	(11)-#8	C1
FT110a	11'-0"	11'-0"	2'-1"	(12)-#8	(12)-#8	G2 G3 G4 G5
FT110b	11'-0"	11'-0"	2'-3"	(12)-#8	(12)-#8	D1 G1
FT116	11'-6"	11'-6"	2'-1"	(12)-#8	(12)-#8	C2 C3 C4 C5
FT120	12'-0"	12'-0"	2'-3"	(13)-#8	(13)-#8	D2 D3 D4 D5

COLUMN FOOTING SCHEDULE
1. REFER TO STRUCTURAL NOTES SHEET FOR LAPS IN STEEL REINFORCEMENT.
2. REFER TO FUNDATION PLAN FOR TOP OF FOOTING ELEVATIONS.
3. ALL FOOTING EXCAVATIONS SHALL BE INSPECTED AND APPROVED BY THE GEOTECHNICAL ENGINEER PRIOR TO PLACING CONCRETE

Table 17: Column footing schedule.

9.2 Footings

9.2.1 Loads

The loads acting on the footings are shown in §B.

9.2.2 Load combinations

The load combinations are shown in tables 7 and 8.

9.2.3 Footing dimensions and reinforcement

The dimensions and the reinforcement of the footings are indicated in the table 17. The position of the footing in the building grid is indicated at the last column.

9.2.4 Limit state checking

Allowable soil-bearing pressures. The results obtained for the verification of the soil-bearing capacity are shown in the table 18.

Flexure design. The capacity factor for the bending in the longitudinal and transverse directions are shown in figures 29 and 30.

Shear design. The results of the shear strength verification are shown in the table 19. The results of the punching shear strength verification are shown in table 20.

9.3 Basement walls

9.3.1 Introduction

The design is based in the following assumptions:

- Design wall with pinned base and pinned top.
- Neglect corner regions (wall spans one-way only).
- Top slab is in place and has achieved full strength prior to back-filling.
- Vehicular traffic around the building is represented by a uniform load of 250 psf (11.97 kN/m^2).

Foundation	Worst combination	Vertical load (kN)	Capacity factor
A1	SLS04_a	-356.20	0.33
A2	SLS02_a	-644.78	0.60
A3	SLS02_a	-950.92	0.88
A4	SLS02_a	-881.82	0.82
A5	SLS04_b	-933.03	0.86
B2	SLS02_a	-670.79	0.56
B3	SLS02_a	-1,030.65	0.86
B4	SLS02_a	-968.24	0.80
B5	SLS04_b	-972.32	0.81
C1	SLS02_a	-1,460.67	0.99
C2	SLS02_a	-1,742.45	0.99
C3	SLS02_a	-1,750.31	0.99
C4	SLS02_a	-1,751.62	0.99
C5	SLS02_a	-1,660.02	0.94
D1	SLS02_a	-1,648.12	1.02
D2	SLS04_a	-1,950.01	1.01
D3	SLS04_a	-1,959.12	1.02
D4	SLS04_a	-1,960.14	1.02
D5	SLS04_a	-1,838.69	0.96
F1	SLS02_a	-1,090.88	0.82
F2	SLS02_a	-997.32	0.75
F3	SLS02_a	-1,011.87	0.76
F4	SLS02_a	-1,005.30	0.75
F5	SLS04_b	-741.90	0.56
G1	SLS02_a	-1,496.86	0.93
G2	SLS02_a	-1,256.06	0.78
G3	SLS02_a	-1,227.94	0.76
G4	SLS02_a	-1,137.75	0.70
G5	SLS04_b	-1,167.26	0.72

Table 18: Soil bearing pressures. Capacity factors

Footing	Worst combination	Vertical load (kN)	thickness (m)	l (m)	d (m)	c (m)	Vd/l kN/m	Vu kN/m	CF
A1	SLS04_a	-356.20	0.51	2.74	0.46	0.41	33.66	280.00	0.12
A2	SLS02_a	-644.78	0.51	2.74	0.46	0.41	60.94	280.00	0.22
A3	SLS02_a	-950.92	0.51	2.74	0.46	0.41	89.87	280.00	0.32
A4	SLS02_a	-881.82	0.51	2.74	0.46	0.41	83.34	280.00	0.30
A5	SLS04_b	-933.03	0.51	2.74	0.46	0.41	88.18	280.00	0.31
B2	SLS02_a	-670.79	0.51	2.90	0.46	0.41	63.00	280.00	0.22
B3	SLS02_a	-1,030.65	0.51	2.90	0.46	0.41	96.79	280.00	0.35
B4	SLS02_a	-968.24	0.51	2.90	0.46	0.41	90.93	280.00	0.32
B5	SLS04_b	-972.32	0.51	2.90	0.46	0.41	91.31	280.00	0.33
C1	SLS02_a	-1,460.67	0.69	3.20	0.62	0.41	111.20	378.00	0.29
C2	SLS02_a	-1,742.45	0.64	3.51	0.57	0.41	138.68	350.00	0.40
C3	SLS02_a	-1,750.31	0.64	3.51	0.57	0.41	139.31	350.00	0.40
C4	SLS02_a	-1,751.62	0.64	3.51	0.57	0.41	139.42	350.00	0.40
C5	SLS02_a	-1,660.02	0.64	3.51	0.57	0.41	132.12	350.00	0.38
D1	SLS02_a	-1,648.12	0.69	3.35	0.62	0.41	125.50	378.00	0.33
D2	SLS04_a	-1,950.01	0.64	3.66	0.57	0.41	153.65	350.00	0.44
D3	SLS04_a	-1,959.12	0.64	3.66	0.57	0.41	154.37	350.00	0.44
D4	SLS04_a	-1,960.14	0.64	3.66	0.57	0.41	154.45	350.00	0.44
D5	SLS04_a	-1,838.69	0.64	3.66	0.57	0.41	144.88	350.00	0.41
F1	SLS02_a	-1,090.88	0.64	3.05	0.57	0.41	87.98	350.00	0.25
F2	SLS02_a	-997.32	0.64	3.05	0.57	0.41	80.44	350.00	0.23
F3	SLS02_a	-1,011.87	0.64	3.05	0.57	0.41	81.61	350.00	0.23
F4	SLS02_a	-1,005.30	0.64	3.05	0.57	0.41	81.08	350.00	0.23
F5	SLS04_b	-741.90	0.64	3.05	0.57	0.41	59.84	350.00	0.17
G1	SLS02_a	-1,496.86	0.69	3.35	0.62	0.41	113.98	378.00	0.30
G2	SLS02_a	-1,256.06	0.64	3.35	0.57	0.41	100.75	350.00	0.29
G3	SLS02_a	-1,227.94	0.64	3.35	0.57	0.41	98.50	350.00	0.28
G4	SLS02_a	-1,137.75	0.64	3.35	0.57	0.41	91.26	350.00	0.26
G5	SLS04_b	-1,167.26	0.64	3.35	0.57	0.41	93.63	350.00	0.27

Table 19: Shear design. Capacity factors

Footing	Worst combination	Vertical load (kN)	thickness (m)	L (m)	d (m)	c (m)	Vd/l kN/m	Vu kN/m	CF
A1	SLS04.a	-356.20	0.51	2.74	0.46	0.41	92.90	517.97	0.18
A2	SLS02.a	-644.78	0.51	2.74	0.46	0.41	168.16	517.97	0.32
A3	SLS02.a	-950.92	0.51	2.74	0.46	0.41	248.00	517.97	0.48
A4	SLS02.a	-881.82	0.51	2.74	0.46	0.41	229.98	517.97	0.44
A5	SLS04.b	-933.03	0.51	2.74	0.46	0.41	243.33	517.97	0.47
B1	SLS02.a	-429.53	0.51	2.90	0.46	0.41	113.28	517.97	0.22
B2	SLS02.a	-670.79	0.51	2.90	0.46	0.41	176.91	517.97	0.34
B3	SLS02.a	-1,030.65	0.51	2.90	0.46	0.41	271.82	517.97	0.52
B4	SLS02.a	-968.24	0.51	2.90	0.46	0.41	255.36	517.97	0.49
B5	SLS04.b	-972.32	0.51	2.90	0.46	0.41	256.43	517.97	0.50
C1	SLS02.a	-1,460.67	0.69	3.20	0.62	0.41	320.25	699.26	0.46
C2	SLS02.a	-1,742.45	0.64	3.51	0.57	0.41	410.79	647.47	0.63
C3	SLS02.a	-1,750.31	0.64	3.51	0.57	0.41	412.64	647.47	0.64
C4	SLS02.a	-1,751.62	0.64	3.51	0.57	0.41	412.95	647.47	0.64
C5	SLS02.a	-1,660.02	0.64	3.51	0.57	0.41	391.35	647.47	0.60
D1	SLS02.a	-1,648.12	0.69	3.35	0.62	0.41	365.00	699.26	0.52
D2	SLS04.a	-1,950.01	0.64	3.66	0.57	0.41	462.88	647.47	0.71
D3	SLS04.a	-1,959.12	0.64	3.66	0.57	0.41	465.05	647.47	0.72
D4	SLS04.a	-1,960.14	0.64	3.66	0.57	0.41	465.29	647.47	0.72
D5	SLS04.a	-1,838.69	0.64	3.66	0.57	0.41	436.46	647.47	0.67
F1	SLS02.a	-1,090.88	0.64	3.05	0.57	0.41	250.18	647.47	0.39
F2	SLS02.a	-997.32	0.64	3.05	0.57	0.41	228.72	647.47	0.35
F3	SLS02.a	-1,011.87	0.64	3.05	0.57	0.41	232.06	647.47	0.36
F4	SLS02.a	-1,005.30	0.64	3.05	0.57	0.41	230.55	647.47	0.36
F5	SLS04.b	-741.90	0.64	3.05	0.57	0.41	170.14	647.47	0.26
G1	SLS02.a	-1,496.86	0.69	3.35	0.62	0.41	331.50	699.26	0.47
G2	SLS02.a	-1,256.06	0.64	3.35	0.57	0.41	293.79	647.47	0.45
G3	SLS02.a	-1,227.94	0.64	3.35	0.57	0.41	287.22	647.47	0.44
G4	SLS02.a	-1,137.75	0.64	3.35	0.57	0.41	266.12	647.47	0.41
G5	SLS04.b	-1,167.26	0.64	3.35	0.57	0.41	273.02	647.47	0.42

Table 20: Two-way shear design. Capacity factors

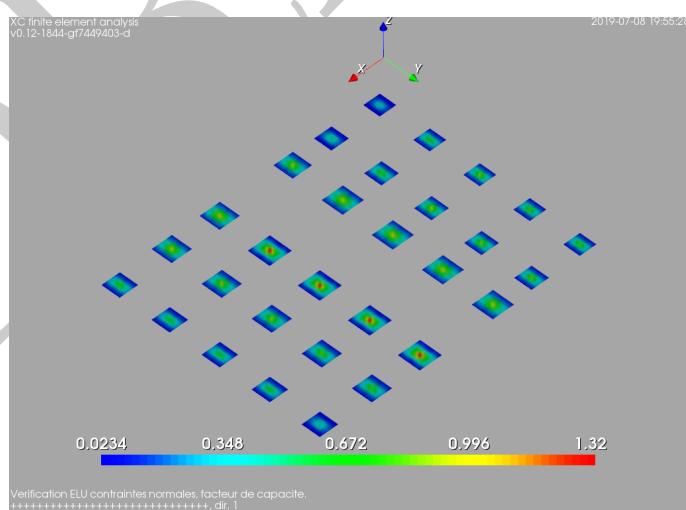


Figure 29: Flexure in the longitudinal direction. Capacity factor.

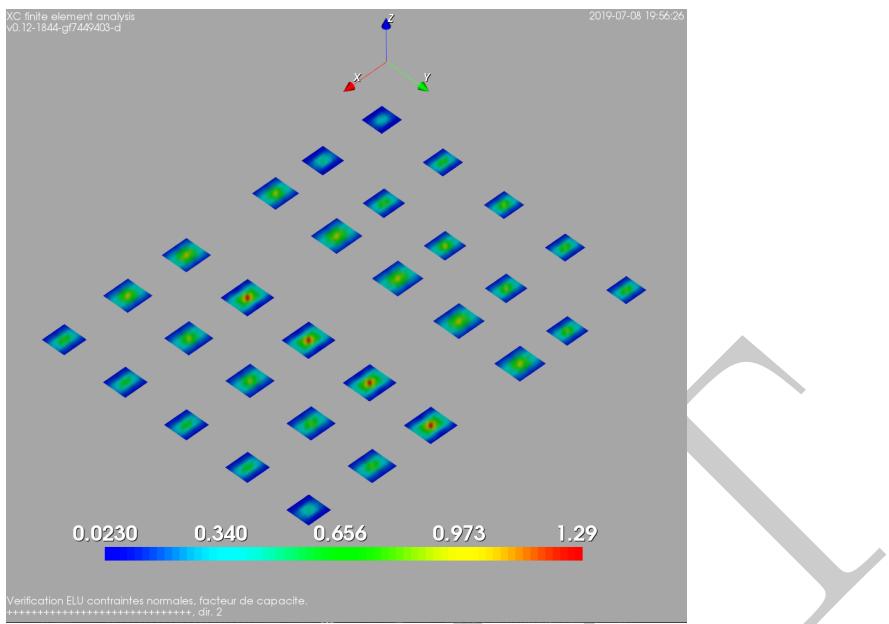


Figure 30: Flexure in the transverse direction. Capacity factor.

- The vertical response of the soil calculated using a Winkler model with a sub-grade reaction module of set of 200 pounds per cubic inch ($54.29 \times 10^6 \text{ N/m}^3$).
- Water table deep below structure.

9.3.2 Load determination

Self weight. The self weight of the reinforced concrete is calculated from its density: 2500 kg/m^3 .

Axial loads from building. The loads transferred by the top slab to the wall are as follows:

Building side	Load	Phase 1 (kN/m)	Phase 2 (kN/m)
North	SnowL	10.06	10.06
North	LiveL	21.67	21.67
North	Wind_NS	-15.12	-15.12
North	Wind_WE	-1.33	-1.33
North	DeadL	31.54	31.54
South	SnowL	8.04	16.08
South	LiveL	14.22	28.44
South	Wind_NS	4.97	9.95
South	Wind_WE	-0.23	-0.46
South	DeadL	20.58	41.15
East	SnowL	11.96	11.96
East	LiveL	23.75	23.75
East	Wind_NS	-0.07	-0.07
East	Wind_WE	12.97	12.97
East	DeadL	30.87	30.87
West	SnowL	15.02	15.02
West	LiveL	27.15	27.15
West	Wind_NS	-0.20	-0.20
West	Wind_WE	-13.20	-13.20
West	DeadL	29.81	29.81

9.3.3 Load combinations

Serviceability limit states		
Equation 16-8	EQ1608	1.0*selfWeight+1.0*deadLoad
Equation 16-9	EQ1609A	1.0*selfWeight+1.0*deadLoad+1.0*trafficLoad
Equation 16-9	EQ1609B	1.0*selfWeight+1.0*deadLoad+1.0*liveLoad
Equation 16-10	EQ1610	1.0*selfWeight+1.0*deadLoad+1.0*snowLoad
Equation 16-11	EQ1611A	1.0*selfWeight+1.0*deadLoad+0.75*trafficLoad+0.75*snowLoad
Equation 16-11	EQ1611B	1.0*selfWeight+1.0*deadLoad+0.75*liveLoad+0.75*snowLoad
Equation 16-12	EQ1612	1.0*selfWeight+1.0*deadLoad+0.6*windLoad
Equation 16-13	EQ1613A	1.0*selfWeight+1.0*deadLoad+0.45*windLoad+0.75*trafficLoad+0.75*snowLoad
Equation 16-13	EQ1613B	1.0*selfWeight+1.0*deadLoad+0.45*windLoad+0.75*liveLoad+0.75*snowLoad
Equation 16-14		doesn't apply
Equation 16-15	EQ1615	0.6*selfWeight+0.6*deadLoad+0.6*windLoad
Equation 16-16		doesn't apply

Ultimate limit states.		
Equation 16-1	EQ1601	1.4*selfWeight+1.4*deadLoad
Equation 16-2	EQ1602A	1.2*selfWeight+1.2*deadLoad+1.6*trafficLoad+0.5*snowLoad
Equation 16-2	EQ1602B	1.2*selfWeight+1.2*deadLoad+1.6*liveLoad+0.5*snowLoad
Equation 16-3	EQ1603A	1.2*selfWeight+1.2*deadLoad+1.6*snowLoad+0.5*trafficLoad
Equation 16-3	EQ1603B	1.2*selfWeight+1.2*deadLoad+1.6*snowLoad+0.5*liveLoad
Equation 16-3	EQ1603C	1.2*selfWeight+1.2*deadLoad+1.6*snowLoad+0.5*windLoad
Equation 16-4	EQ1604A	1.2*selfWeight+1.2*deadLoad+1.0*windLoad+0.5*trafficLoad+0.5*snowLoad
Equation 16-4	EQ1604B	1.2*selfWeight+1.2*deadLoad+1.0*windLoad+0.5*liveLoad+0.5*snowLoad
Equation 16-5	EQ1605A	1.2*selfWeight+1.2*deadLoad+0.5*trafficLoad+0.7*snowLoad
Equation 16-5	EQ1605B	1.2*selfWeight+1.2*deadLoad+0.5*liveLoad+0.7*snowLoad
Equation 16-6		doesn't apply
Equation 16-7		doesn't apply

Earth pressure. The soil pressure over the wall has been calculated using the lateral pressure at rest with a coefficient $K_0 = 0.5$.

CONCRETE WALL REINFORCING SCHEDULE					
MARK	TYPE	THICKNESS	REINFORCEMENT		REMARKS
			VERTICAL	HORIZONTAL	
W1	CONCRETE	10"	5#'s AT 18"o.c.	5#'s AT 12"o.c.	inside face
W2	CONCRETE	10"	5#'s AT 12"o.c.	5#'s AT 12"o.c.	inside face
W3	CONCRETE	10"	6#'s AT 12"o.c.	5#'s AT 12"o.c.	inside face
W4	CONCRETE	8"	4#'s AT 12"o.c.	3#'s AT 12"o.c.	centered in wall thickness

CONCRETE WALL REINFORCING SCHEDULE NOTES:
1. REFER TO STRUCTURAL NOTES SHEET FOR LAPS IN STEEL REINFORCEMENT.
2. COORDINATE AND VERIFY ALL DIMENSIONS WITH ARCHITECTURAL DRAWINGS AND EXIST. CONDITIONS

Table 21: Concrete walls reinforcing schedule

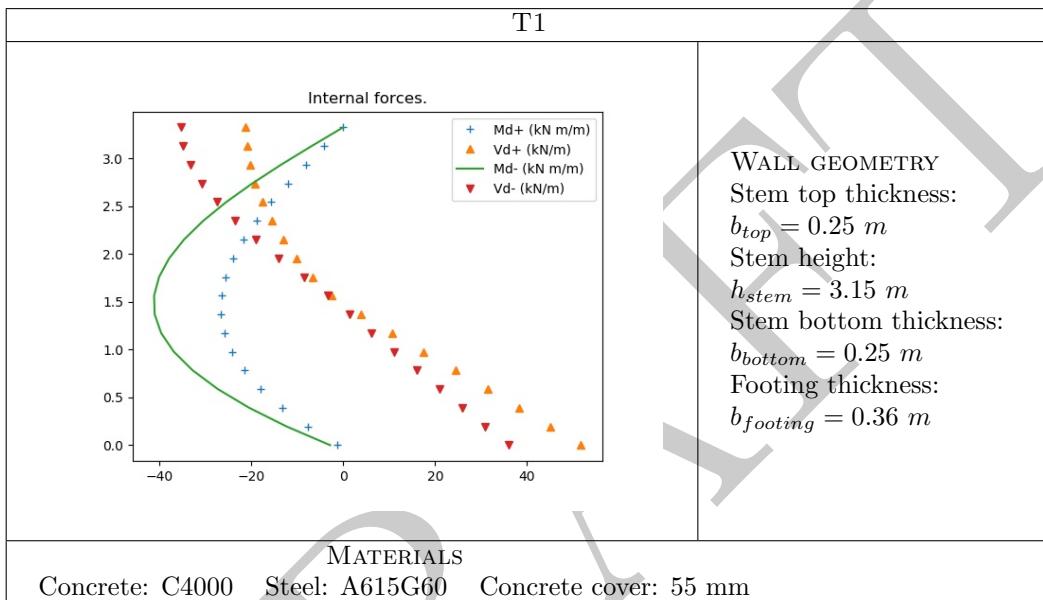


Table 22: Wall materials and dimensions T1

9.3.4 Stem dimensions and reinforcement

The thickness and the reinforcement for the walls are indicated in the table 21.

Wall types. For analysis purposes we have considered the following wall types:

Wall	Stem height (m)
T1	3.15
T2	2.74
T3	3.53
T4	3.12
T5	2.51
T6	3.43

Internal forces. The envelope of internal forces envelope for each of the walls are given in tables 22 to 27.

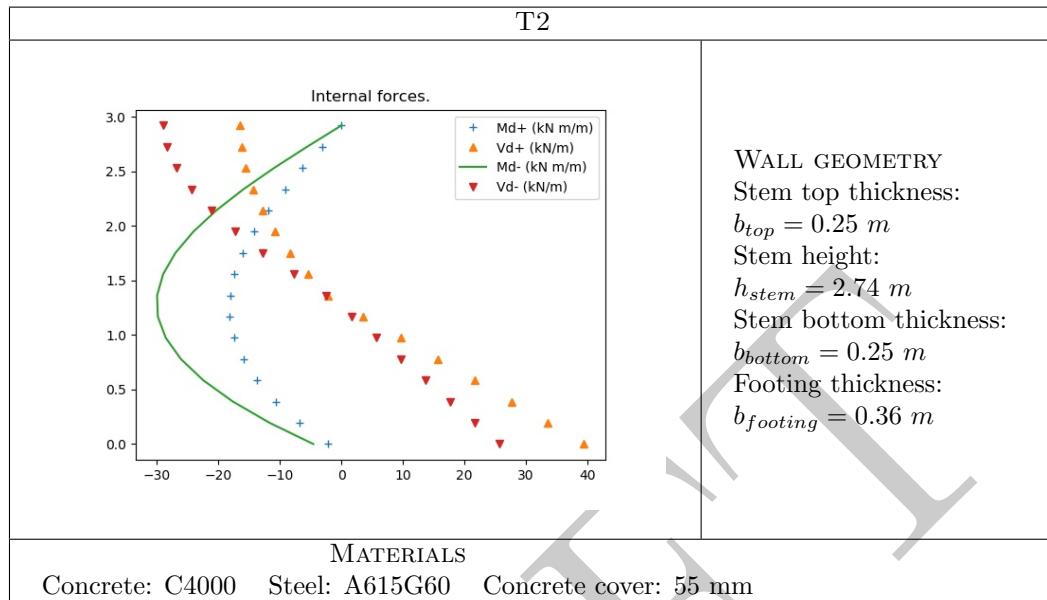


Table 23: Wall materials and dimensions T2

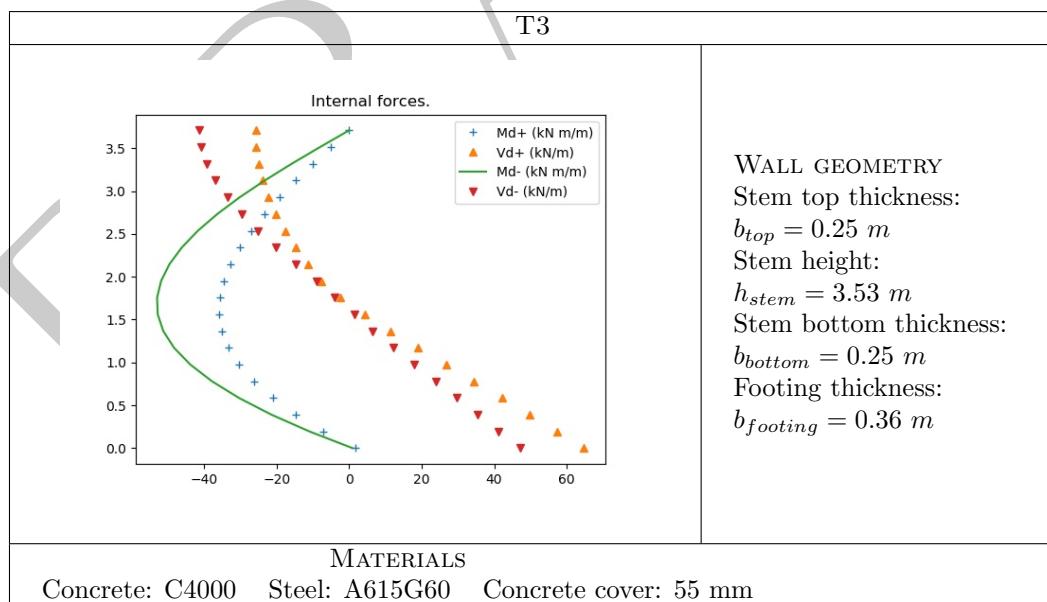


Table 24: Wall materials and dimensions T3

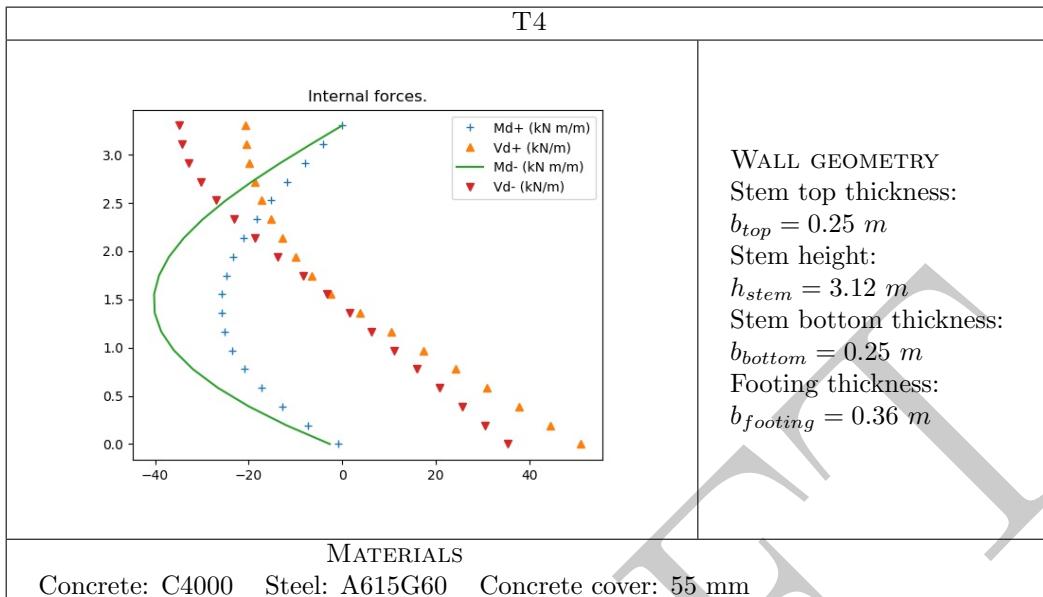


Table 25: Wall materials and dimensions T4

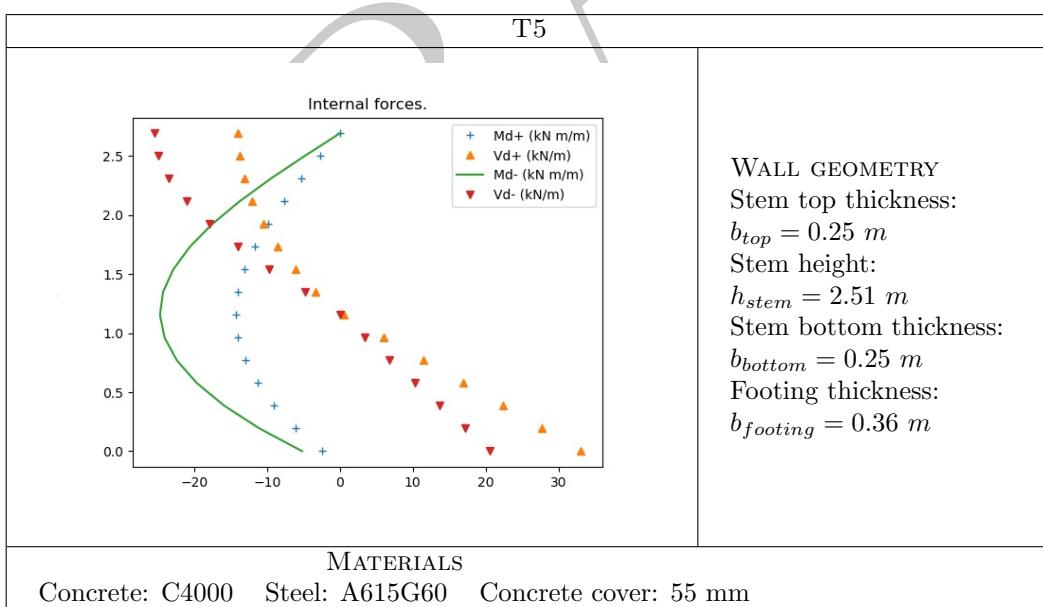


Table 26: Wall materials and dimensions T5

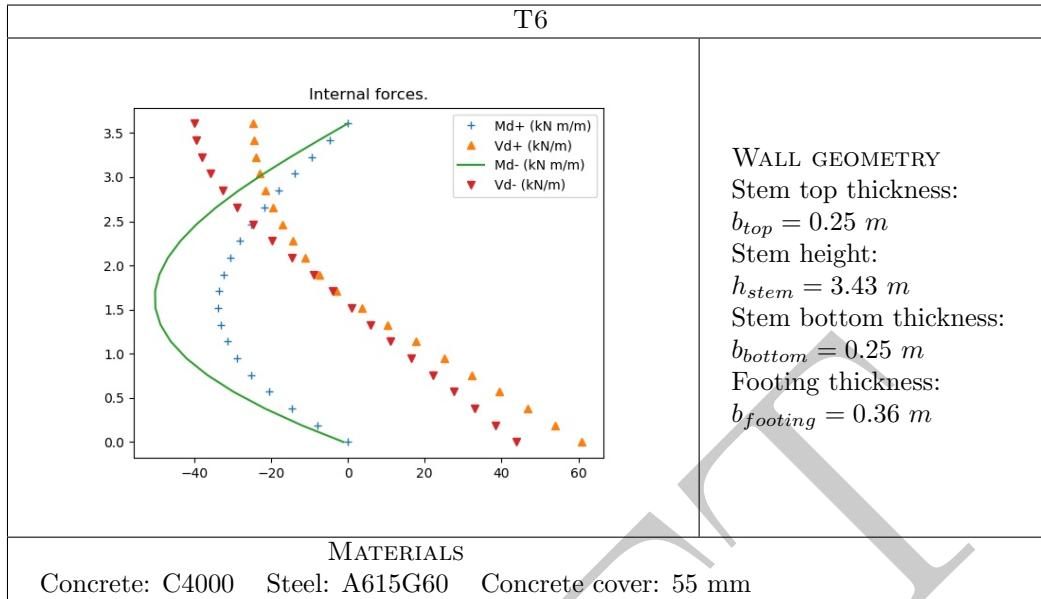


Table 27: Wall materials and dimensions T6

Reinforcement checks.

WALL VERTICAL REINFORCEMENTS	
T1 wall. Inside stem reinforcement:	RC section dimensions; $b= 1.00 \text{ m}$, $h= 0.25 \text{ m}$ diam: 16 mm, spacing: 300 mm reinf. development $L=0.34 \text{ m}$ (22 diameters). area: $As= 6.67 \text{ cm}^2/\text{m}$ areaMin: $4.56 \text{ cm}^2/\text{m}$ $F(As)= 1.46 \text{ OK!}$ Bending check: $Md= 40.09 \text{ kN m}$, $MR= 41.36 \text{kN m}$ $F(M)= 1.03 \text{ OK!}$ Shear check: $Vd= 7.61 \text{ kN}$, $VR= 199.37 \text{ kN}$ $F(V)= 26.21 \text{ OK!}$
T2 wall. Inside stem reinforcement:	RC section dimensions; $b= 1.00 \text{ m}$, $h= 0.25 \text{ m}$ diam: 16 mm, spacing: 400 mm reinf. development $L=0.34 \text{ m}$ (22 diameters). area: $As= 5.00 \text{ cm}^2/\text{m}$ areaMin: $4.56 \text{ cm}^2/\text{m}$ $F(As)= 1.10 \text{ OK!}$ Bending check: $Md= 29.02 \text{ kN m}$, $MR= 31.02 \text{kN m}$ $F(M)= 1.07 \text{ OK!}$ Shear check: $Vd= 6.84 \text{ kN}$, $VR= 199.37 \text{ kN}$ $F(V)= 29.15 \text{ OK!}$
T3 wall. Inside stem reinforcement:	RC section dimensions; $b= 1.00 \text{ m}$, $h= 0.25 \text{ m}$ diam: 19 mm, spacing: 300 mm reinf. development $L=0.61 \text{ m}$ (32 diameters). area: $As= 9.47 \text{ cm}^2/\text{m}$ areaMin: $4.56 \text{ cm}^2/\text{m}$ $F(As)= 2.08 \text{ OK!}$ Bending check: $Md= 51.88 \text{ kN m}$, $MR= 58.26 \text{kN m}$ $F(M)= 1.12 \text{ OK!}$ Shear check: $Vd= 7.98 \text{ kN}$, $VR= 199.37 \text{ kN}$ $F(V)= 24.98 \text{ OK!}$
T4 wall. Inside stem reinforcement:	RC section dimensions; $b= 1.00 \text{ m}$, $h= 0.25 \text{ m}$ diam: 16 mm, spacing: 300 mm reinf. development $L=0.34 \text{ m}$ (22 diameters). area: $As= 6.67 \text{ cm}^2/\text{m}$ areaMin: $4.56 \text{ cm}^2/\text{m}$ $F(As)= 1.46 \text{ OK!}$ Bending check: $Md= 39.19 \text{ kN m}$, $MR= 41.36 \text{kN m}$ $F(M)= 1.06 \text{ OK!}$
..../..	

WALL VERTICAL REINFORCEMENTS (CONT.)
Shear check: $V_d = 7.46 \text{ kN}$, $VR = 199.37 \text{ kN}$ $F(V) = 26.73 \text{ OK!}$
T5 wall. Inside stem reinforcement:
RC section dimensions; $b = 1.00 \text{ m}$, $h = 0.25 \text{ m}$ diam: 16 mm, spacing: 400 mm reinf. development $L = 0.34 \text{ m}$ (22 diameters). area: $A_s = 5.00 \text{ cm}^2/\text{m}$ areaMin: 4.56 cm^2/m $F(A_s) = 1.10 \text{ OK!}$ Bending check: $M_d = 23.62 \text{ kN m}$, $MR = 31.02 \text{kN m}$ $F(M) = 1.31 \text{ OK!}$ Shear check: $V_d = 6.42 \text{ kN}$, $VR = 199.37 \text{ kN}$ $F(V) = 31.05 \text{ OK!}$
T6 wall. Inside stem reinforcement:
RC section dimensions; $b = 1.00 \text{ m}$, $h = 0.25 \text{ m}$ diam: 19 mm, spacing: 300 mm reinf. development $L = 0.61 \text{ m}$ (32 diameters). area: $A_s = 9.47 \text{ cm}^2/\text{m}$ areaMin: 4.56 cm^2/m $F(A_s) = 2.08 \text{ OK!}$ Bending check: $M_d = 49.02 \text{ kN m}$, $MR = 58.26 \text{kN m}$ $F(M) = 1.19 \text{ OK!}$ Shear check: $V_d = 8.13 \text{ kN}$, $VR = 199.37 \text{ kN}$ $F(V) = 24.54 \text{ OK!}$

SHEAR CHECK
T1 wall. Shear check: Shear check: $V_d = 42.99 \text{ kN}$, $VR = 199.37 \text{ kN}$ $F(V) = 4.64 \text{ OK!}$
T2 wall. Shear check: Shear check: $V_d = 31.78 \text{ kN}$, $VR = 199.37 \text{ kN}$ $F(V) = 6.27 \text{ OK!}$
T3 wall. Shear check: Shear check: $V_d = 55.00 \text{ kN}$, $VR = 199.37 \text{ kN}$ $F(V) = 3.63 \text{ OK!}$
T4 wall. Shear check: Shear check: $V_d = 42.35 \text{ kN}$, $VR = 199.37 \text{ kN}$ $F(V) = 4.71 \text{ OK!}$
T5 wall. Shear check: Shear check: $V_d = 26.03 \text{ kN}$, $VR = 199.37 \text{ kN}$ $F(V) = 7.66 \text{ OK!}$
T6 wall. Shear check: Shear check: $V_d = 51.43 \text{ kN}$, $VR = 199.37 \text{ kN}$ $F(V) = 3.88 \text{ OK!}$

Wall foundations The results obtained for the verifications of the footing stability and the soil-bearing capacity. According to the geotechnical report the allowable soil bearing pressure is 3000 psf (143.64 kN/m^2).

WALL FOUNDATION: T1			
Verification:	F_{disp}	F_{req}	Combination
Overturning:	$\gg 1$	1.00	EQ1609A
Sliding:	1.23	1.00	EQ1609A
Adm. pressure:	1.09	1.00	EQ1613B
WALL FOUNDATION: T2			
Verification:	F_{disp}	F_{req}	Combination
Overturning:	$\gg 1$	1.00	EQ1613B
Sliding:	1.46	1.00	EQ1609A
Adm. pressure:	1.13	1.00	EQ1613B
WALL FOUNDATION: T3			
Verification:	F_{disp}	F_{req}	Combination
Overturning:	$\gg 1$	1.00	EQ1609A
Sliding:	1.13	1.00	EQ1609A
Adm. pressure:	1.12	1.00	EQ1613B
WALL FOUNDATION: T4			
Verification:	F_{disp}	F_{req}	Combination
Overturning:	$\gg 1$	1.00	EQ1613B
Sliding:	1.45	1.00	EQ1609A
Adm. pressure:	1.08	1.00	EQ1613B
WALL FOUNDATION: T5			
Verification:	F_{disp}	F_{req}	Combination
Overturning:	$\gg 1$	1.00	EQ1613B
Sliding:	1.69	1.00	EQ1609A
Adm. pressure:	1.22	1.00	EQ1613B
WALL FOUNDATION: T6			
Verification:	F_{disp}	F_{req}	Combination
Overturning:	$\gg 1$	1.00	EQ1609A
Sliding:	1.10	1.00	EQ1609A
Adm. pressure:	1.03	1.00	EQ1613B

$F_{avail.}$: available security.
 F_{req} : required security.

9.4 Ramp

9.4.1 Design criteria

Materials	Concrete: $f'_c = 4.0$ ksi Reinforcing steel: $f_y = 60$ ksi
Structural loads	Self weight reinforced concrete: 2500 kg/m^3 Live load garages (passenger vehicles): 40 psf Concentrated load vehicle : 3000 pound
Load cases	D: dead load (see fig. 33) Lunif: uniform live load (see fig. 34) LconcSpan1: concentrated live load on mid-span 1 (see fig. 35) LconcSpan2: concentrated live load on mid-span 2 (see fig. 36) LconcSpan3: concentrated live load on mid-span 3 (see fig. 37)
Ultim. Limit States	ULS01: $1.4*D$ ULS02: $1.2*D + 1.6*Lunif$ ULS03: $1.2*D + 1.6*LconcSpan1$ ULS04: $1.2*D + 1.6*LconcSpan2$ ULS05: $1.2*D + 1.6*LconcSpan3$
Structural model	3D elastic computer model (see fig. 32) analyzed using XC

9.4.2 Acceptance criteria

Figure 31 shows the design thickness of the ramp slab and the reinforcing layout.

The slab is checked for the load combinations summarized in section 9.4.1. The limit state checking was performed in general compliance with ACI 318, using the program XC. The representative plots for the results obtained are shown in figs. 38 to 40 for the normal stresses check, and figs. 41 to 44 for the shear check. In every case, all the elements have a demand to capacity ratio of 1.0 or less.

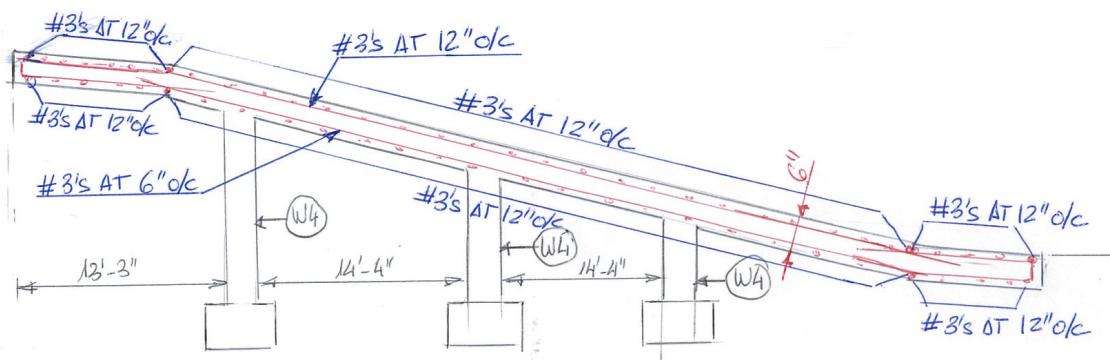


Figure 31: Ramp. Reinforcing layout.

CALCULATION REPORT

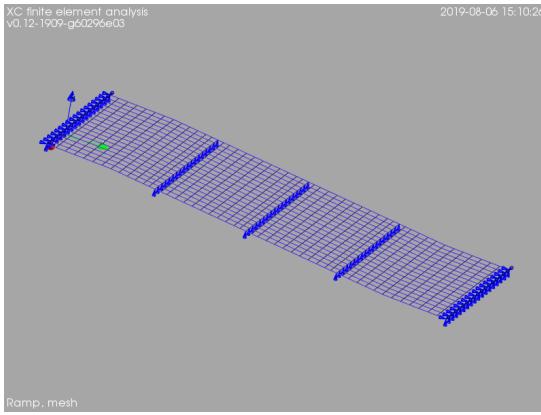


Figure 32: Ramp elastic model, mesh.

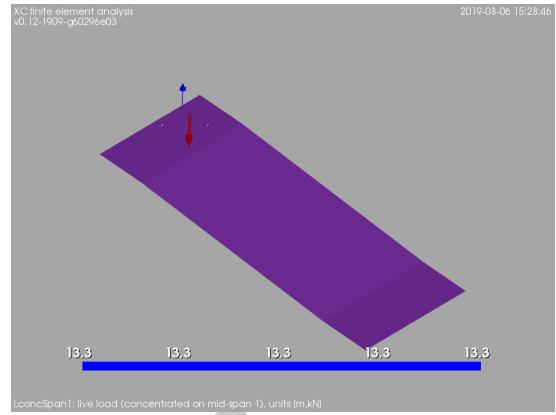


Figure 35: Load case $Lv_{conc,s1}$: concentrated live load (vehicles) on mid-span 1 [units: kN].

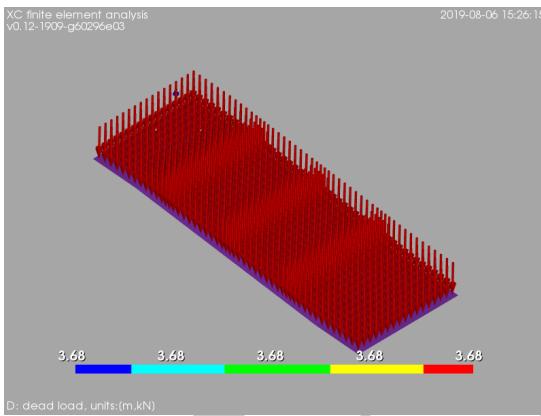


Figure 33: Load case D: dead load (include slab self-weight) [units: kN/m^2].

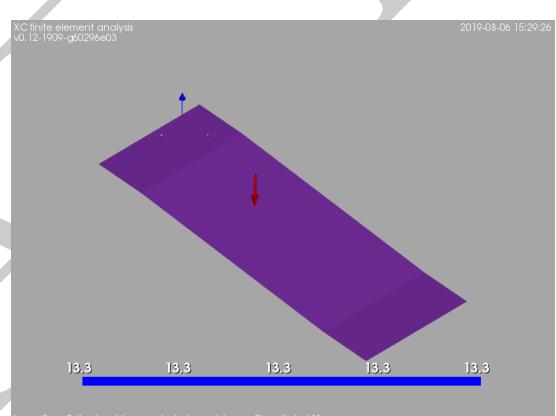


Figure 36: Load case $Lv_{conc,s2}$: concentrated live load (vehicles) on mid-span 2 [units: kN].

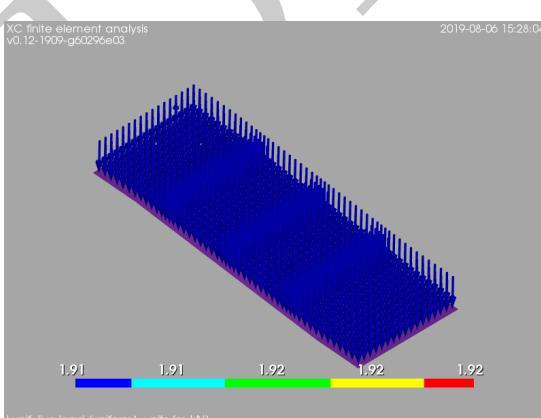


Figure 34: Load case Lv_{unif} : uniform live load (vehicles) [units: kN/m^2].

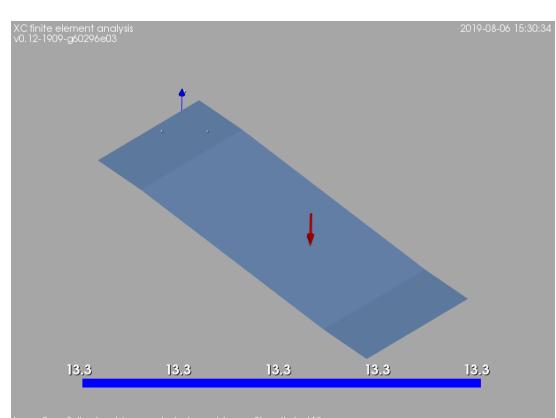


Figure 37: Load case $Lv_{conc,s3}$: concentrated live load (vehicles) on mid-span 3 [units: kN].

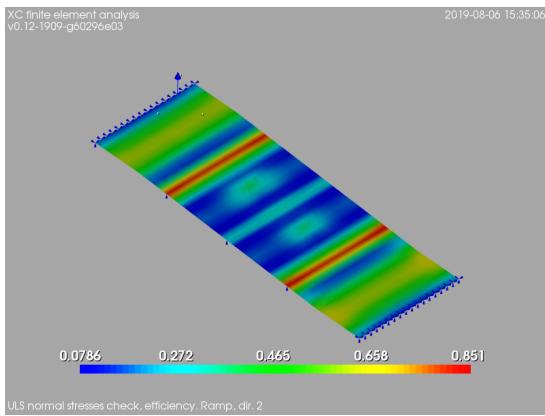


Figure 38: ULS normal stresses check. Efficiency in longitudinal direction

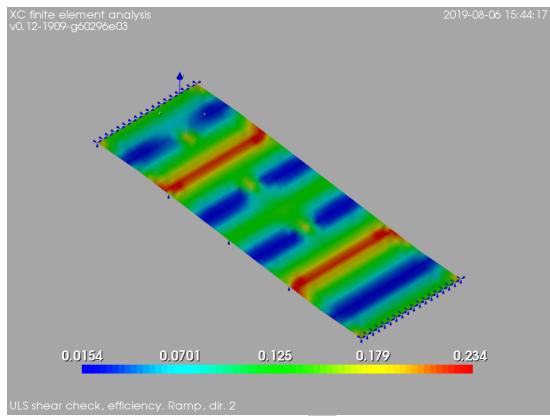


Figure 41: ULS shear check. Efficiency in longitudinal direction

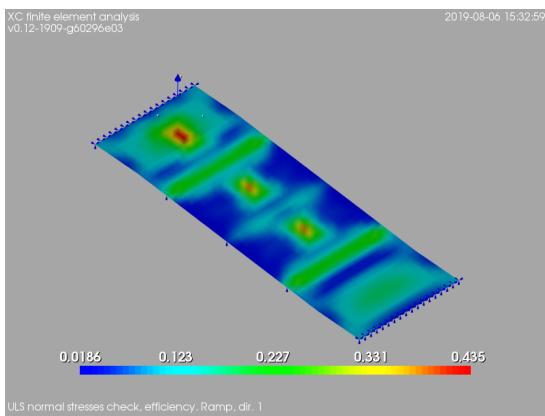


Figure 39: ULS normal stresses check. Efficiency in transversal direction

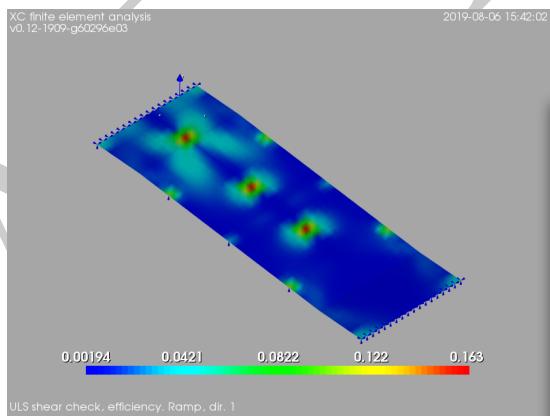


Figure 42: ULS shear check. Efficiency in transversal direction

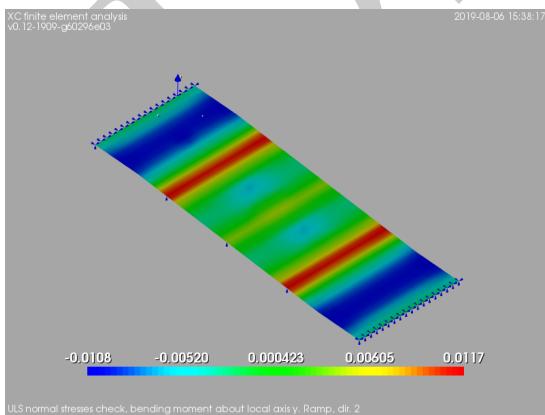


Figure 40: ULS normal stresses check. Bending moment in longitudinal direction [units: kN.m].

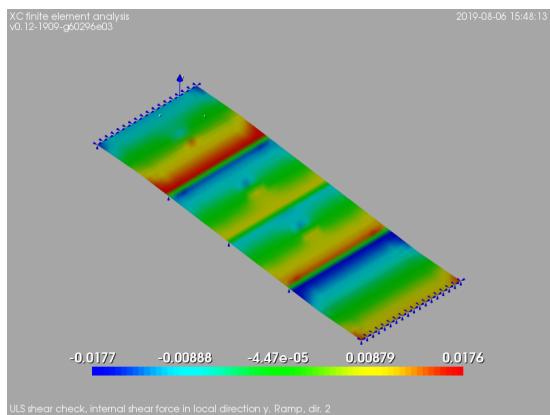


Figure 43: ULS shear check. Internal shear force in longitudinal direction [units: kN].

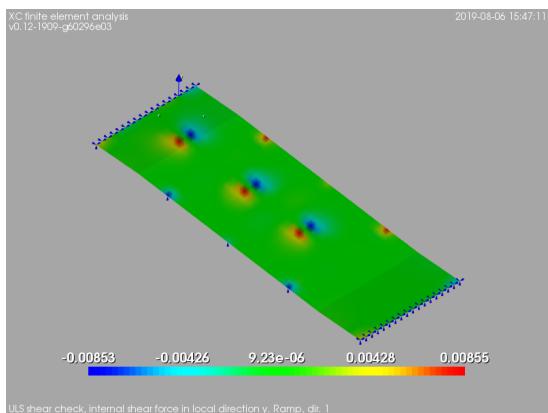


Figure 44: ULS shear check. Internal shear force in transversal direction [units: kN].

DRAFT

Appendices

A Loading criteria

A.1 Dead loads

Materials

Wood structural panel	$36.0 \text{ pcf} = 5655 \frac{\text{newton}}{\text{meter}^3}$
Concrete reinforced stone (including gravel)	$150.0 \text{ pcf} = 23563 \frac{\text{newton}}{\text{meter}^3}$
Steel	$489.0 \text{ pcf} = 76816 \frac{\text{newton}}{\text{meter}^3}$
Gypsum crete	$115.0 \text{ pcf} = 18065 \frac{\text{newton}}{\text{meter}^3}$
Gypsum,loose	$70.0 \text{ pcf} = 10996 \frac{\text{newton}}{\text{meter}^3}$
Earth (not submerged) sand and gravel (wet)	$120.0 \text{ pcf} = 18850 \frac{\text{newton}}{\text{meter}^3}$
Water	$62.4 \text{ pcf} = 9802 \frac{\text{newton}}{\text{meter}^3}$
Frame partitions	
Wood or steel studs, $\frac{1}{2}$ in gypsum board inside	8 psf = 383 pascal
Wood studs, 2x4 unplastered	4 psf = 192 pascal
Wood studs, 2x4 plastered one side	12 psf = 575 pascal
Wood studs, 2x4 plastered two sides	20 psf = 958 pascal
Movable steel partitions	4 psf = 192 pascal
Frame walls	
Exterior stud wall 2x4 @ 16in, $\frac{5}{8}$ gypsum insulated, $\frac{3}{8}$ in siding	11 psf = 526 pascal
Exterior stud wall 2x6 @ 16in, $\frac{5}{8}$ gypsum insulated, $\frac{3}{8}$ in siding	12 psf = 575 pascal
Exterior stud wall with brick veneer	48 psf = 2298 pascal
CMU wall 8in	60 psf = 9425 pascal
Window, glass, frame and sash	8 psf = 383 pascal
Cladding	
Fiber cement panels, large format 38.4in \times 102in	3.2 psf = 153 pascal
Fiber cement panels, small scale 9.6in \times 102in	3.2 psf = 153 pascal
Perforated metal panel at exterior HVAC location	
Floor truss	
Single chord @ 24in o.c. spacing	3.2 psf = 153 pascal
Double chord @ 24in o.c. spacing	4.25 psf = 203 pascal
Sheathing	
Roof sheathing	3.5 psf = 167 pascal
Floor sheathing	2.5 psf = 120 pascal
Ceilings	2.5 psf = 120 pascal
Deck composite sleepers (3in)	9.00 psf = 431 pascal

A.2 Live loads

Occupancy or use	Uniform	Concentrated	Notes
Private rooms and corridors serving them in multifamily dwelling	40.0 psf = 1915 pascal	-	IBC-2018 Table 1607.1
Stairs and exits	100.0 psf = 4788 pascal	300 pound = 1334 newton	IBC-2018 Table 1607.1. Concentrated load on stair treads applied on an area of 2 inches by 2 inches
Balconies and decks	same as occupancy served	-	IBC-2018 Table 1607.1
Garages (passenger vehicles only)	40.0 psf = 1915 pascal	-	IBC-2018 Table 1607.1
Cornices	60.0 psf = 2873 pascal	-	IBC-2018 Table 1607.1
Elevator machine room and control room grating	-	300 pound = 1334 newton	IBC-2018 Table 1607.1. Concentrated load applied on an area of 2 inches by 2 inches
Flat roof (not occupiable) + maintenance	20.0 psf = 958 pascal	300 pound = 1334 newton	IBC-2018 Table 1607.1
Yards and terraces, pedestrians	100.0 psf = 4788 pascal	-	IBC-2018 Table 1607.1
Sidewalks, vehicular driveways and yards, subject to trucking	250.0 psf = 11970 pascal	8000 pound = 35586 newton	IBC-2018 Table 1607.1
Corridors first floor	100.0 psf = 4788 pascal	-	IBC-2018 Table 1607.1
Store first floor	100.0 psf = 4788 pascal	-	IBC-2018 Table 1607.1

A.3 Snow loads

Ground snow load	$p_g = 60.0 \text{ psf} = 2873 \text{ pascal}$	ASCE 7. Figure 7.1
Exposure factor	$C_e = 1.0$	ASCE 7. Table 7-2. Terrain category B, roof partially exposed
Thermal factor	$C_t = 1.0$	ASCE 7. Table 7-3.
Snow load importance factor	$I_s = 1.0$	ASCE 7. Table 7-4. Structure risk category II
Snow load flat roof	$p_f = 0.7 \times C_e \times C_t \times I_s \times p_g = 0.7 \times 1.0 \times 1.0 \times 1.0 \times 60.0 = 42.0 \text{ psf} = 2873 \text{ pascal}$	ASCE 7. Sect. 7.3

A.4 Wind loads

Alternate all-heights method.

$$\text{Ultimate design wind speed } V_{ult} = 115 \frac{\text{miles}}{\text{hour}} = 51 \frac{\text{meters}}{\text{second}}$$

$$\text{Velocity pressure exposure coefficient } K_z = 0.72$$

$$\text{Topographic factor } K_{zt} = 1.0$$

IBC-2018, sect. 1609.6. Regularly shaped building, less than 75 feet in height, not sensitive to dynamic effects, not channeling effects or buffeting, simple diaphragm building

IBC-2018, figure 1609.3(1). Risk category II building

ASCE 7, table 27.3.1. Exposure B, height above ground level $z \approx 33$ feet

ASCE 7, sect. 26.8

Description	$C_{net} + \text{Internal pressure}$	$C_{net} - \text{Internal pressure}$
Windward wall	0.43	0.73
Leeward wall	-0.51	-0.21
Sidewall	-0.66	-0.35
Parapet windward wall	1.28	
Parapet leeward wall	-0.85	
Flat roof	-1.09	-0.79

IBC-2018, Table 1609.6.2, enclosed

Design wind pressures P_{net} . Main windforce-resisting frames and systems

$$P_{net} = 0.00256 \times V^2 \times K_z \times C_{net} \times K_{zt}$$

Description	$P_{net} + \text{Internal pressure}$	$P_{net} - \text{Internal pressure}$
Windward wall	10.5 psf = 501 pascal	17.8 psf = 852 pascal
Leeward wall	-12.4 psf = -595 pascal	-5.1 psf = -245 pascal
Sidewall	-16.1 psf = -770 pascal	-8.5 psf = -409 pascal
Parapet windward wall		31.2 psf = 1494 pascal
Parapet leeward wall		-20.7 psf = -992 pascal
Flat roof	-26.6 psf = -1272 pascal	-19.3 psf = -992 pascal

IBC-2018, sect. 1609.6.3

A.5 Earthquake loads

Parameter	0.2-second spectral response acceleration	$S_s = 0.045$	IBC-2018, figure 1613.3.1(1). Site class B
Parameter	1-second spectral response acceleration	$S_1 = 0.038$	IBC-2018, figure 1613.3.1(2). Site class B
Seismic design category		$S_1 \leq 0.04 \text{ and } S_s \leq 0.15 \rightarrow \text{SDS A}$	IBC-2018, sect. 1613.3.1
Site coefficients		$F_a = 1.0, F_v = 1.0$	IBC-2018, tables 1613.3.3(1) and 1613.3.3(2). Site class B
Maximum considered earthquake spectral response acceleration for short periods		$S_{MS} = F_a \cdot S_s = 0.045$	IBC-2018, sect. 163.3.3
Design spectral response acceleration parameters		$S_{M1} = F_a \cdot S_1 = 0.038$ $S_{DS} = \frac{2}{3}S_{MS} = 0.03$ $S_{D1} = \frac{2}{3}S_{M1} = 0.025$	IBC-2018, sect. 163.3.4 and $\text{IBC-2018, sect. 163.3.3}$

DRAFT

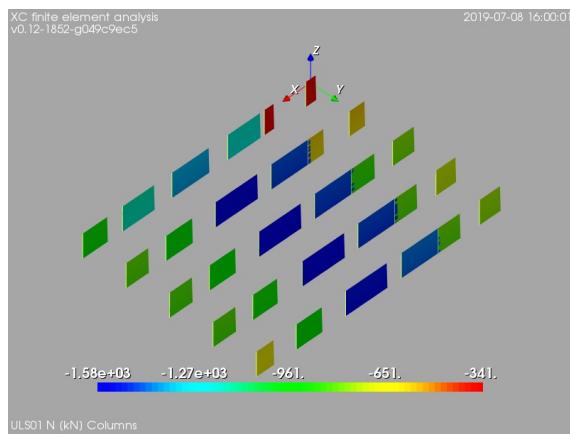


Figure 45: ULS01: 1.4*D. Columns, internal axial force [kN]

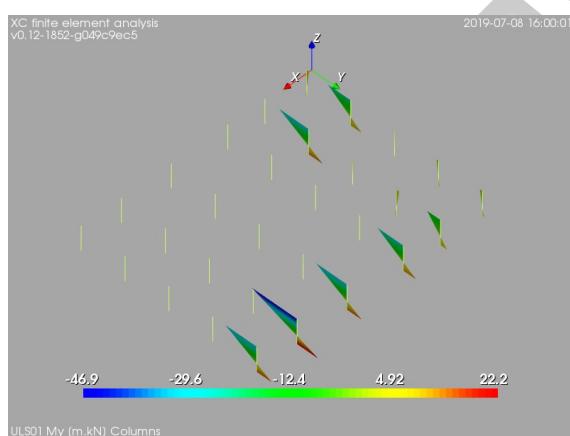


Figure 46: ULS01: 1.4*D. Columns, bending moment about local axis y [m.kN]

B Calculation results. Internal forces on columns

B.1 Ultimate limit states

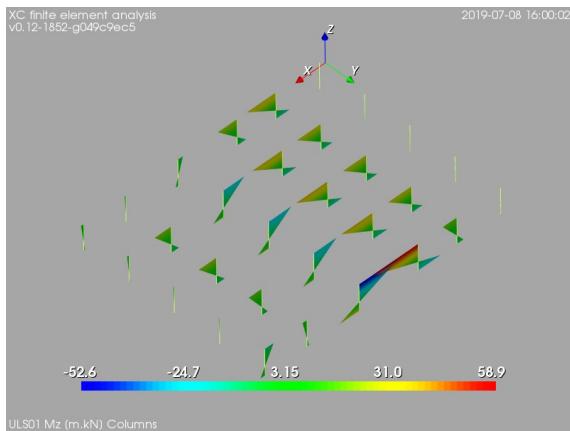


Figure 47: ULS01: 1.4*D. Columns, bending moment about local axis z [m.kN]

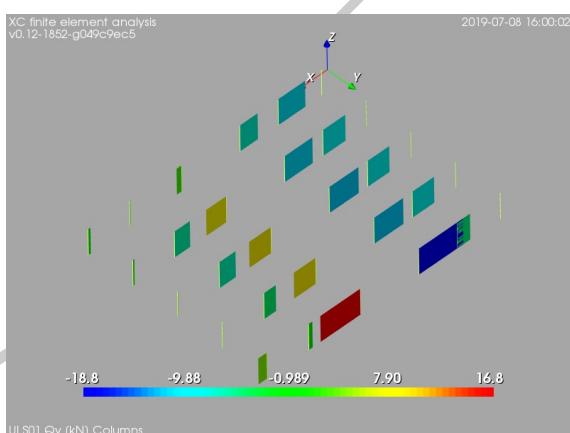


Figure 48: ULS01: 1.4*D. Columns, internal shear force in local direction y [kN]

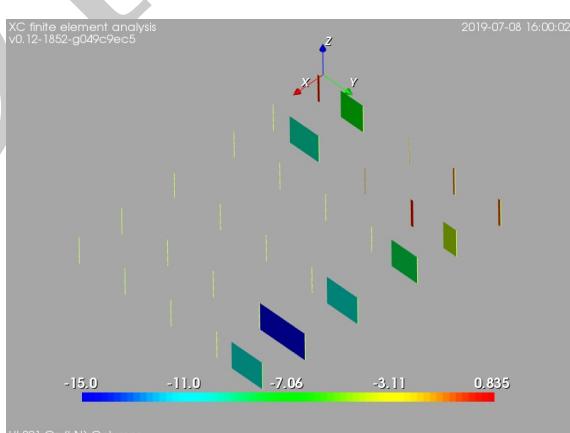


Figure 49: ULS01: 1.4*D. Columns, internal shear force in local direction z [kN]

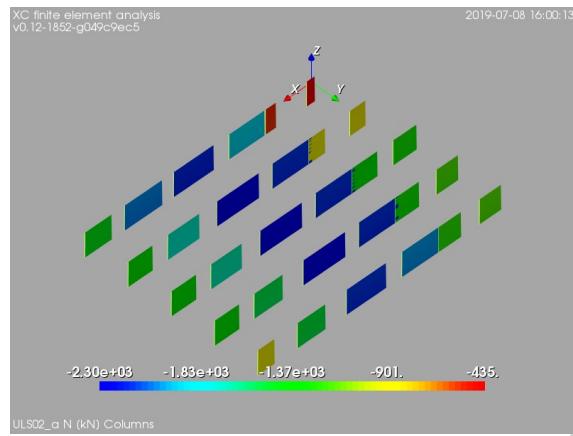


Figure 50: ULS02_a: $1.2*D + 1.6*L_{ru} + L_{pu} + 0.5*S$. Columns, internal axial force [kN]

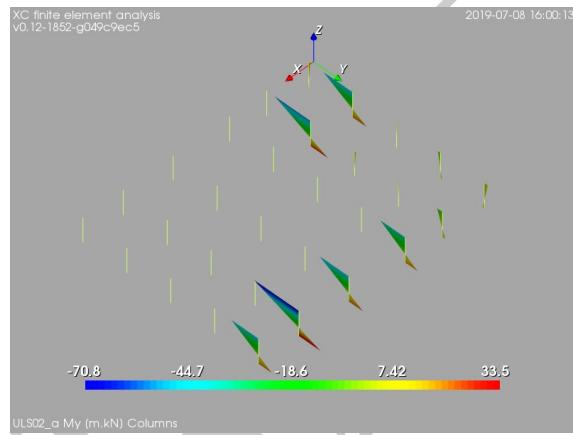


Figure 51: ULS02_a: $1.2*D + 1.6*L_{ru} + L_{pu} + 0.5*S$. Columns, bending moment about local axis y [m.kN]

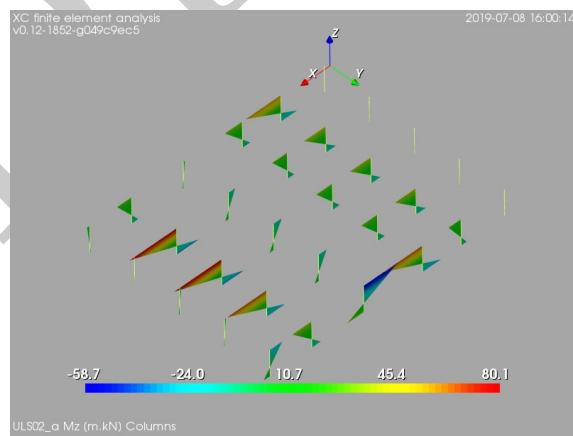


Figure 52: ULS02_a: $1.2*D + 1.6*L_{ru} + L_{pu} + 0.5*S$. Columns, bending moment about local axis z [m.kN]

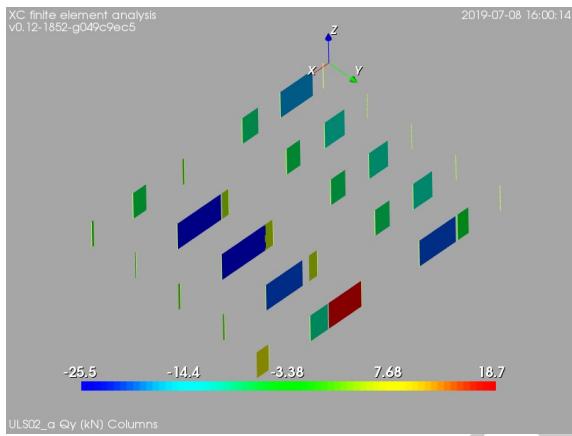


Figure 53: ULS02_a: $1.2*D + 1.6*Lru + Lpu + 0.5*S$. Columns, internal shear force in local direction y [kN]

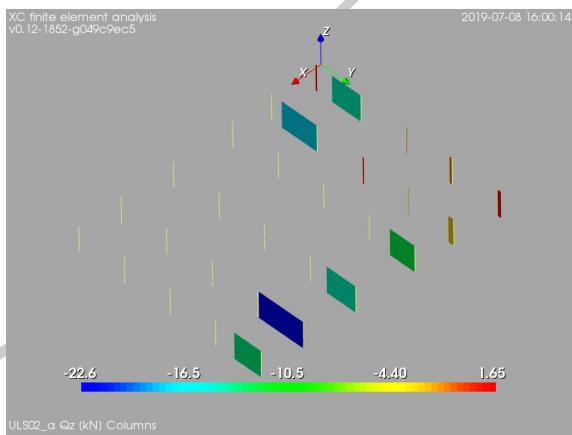


Figure 54: ULS02_a: $1.2*D + 1.6*Lru + Lpu + 0.5*S$. Columns, internal shear force in local direction z [kN]

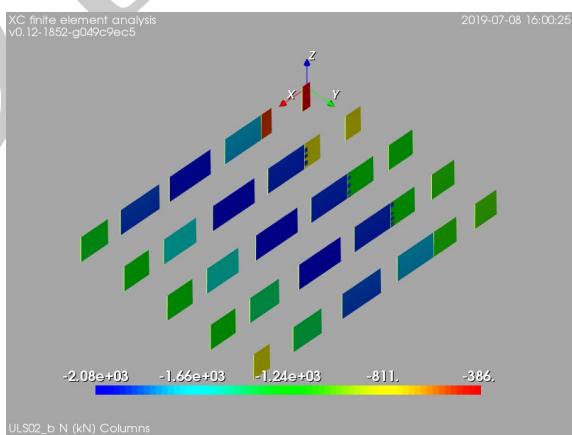


Figure 55: ULS02_b: $1.2*D + 1.6*Lrs + Lps + 0.5*S$. Columns, internal axial force [kN]

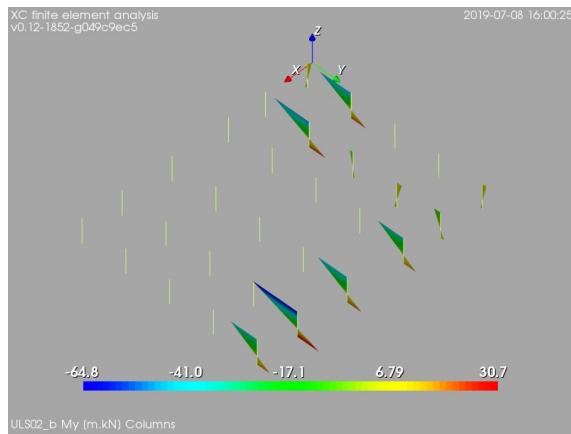


Figure 56: ULS02_b: $1.2*D + 1.6*Lrs + Lps + 0.5*S$. Columns, bending moment about local axis y [m.kN]

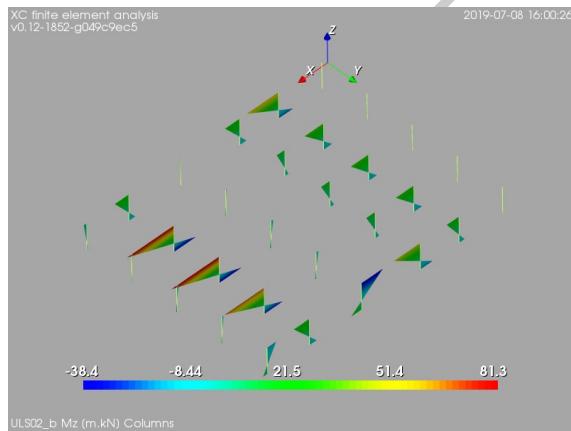


Figure 57: ULS02_b: $1.2*D + 1.6*Lrs + Lps + 0.5*S$. Columns, bending moment about local axis z [m.kN]

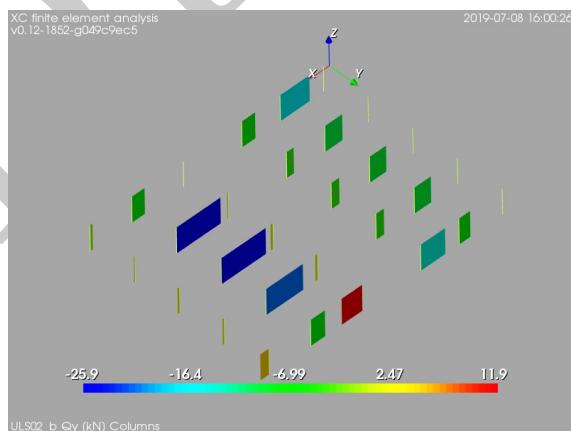


Figure 58: ULS02_b: $1.2*D + 1.6*Lrs + Lps + 0.5*S$. Columns, internal shear force in local direction y [kN]

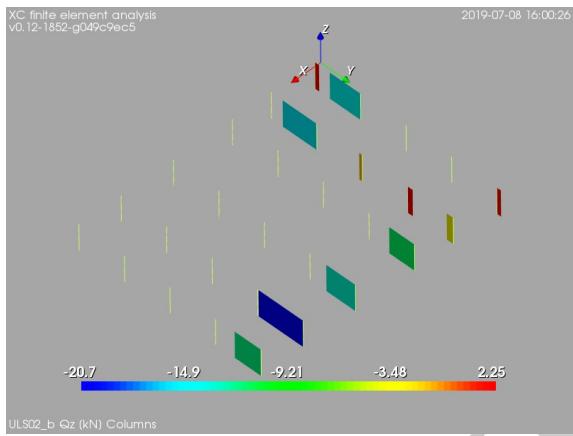


Figure 59: ULS02_b: $1.2*D + 1.6*Lrs + Lps + 0.5*S$. Columns, internal shear force in local direction z [kN]

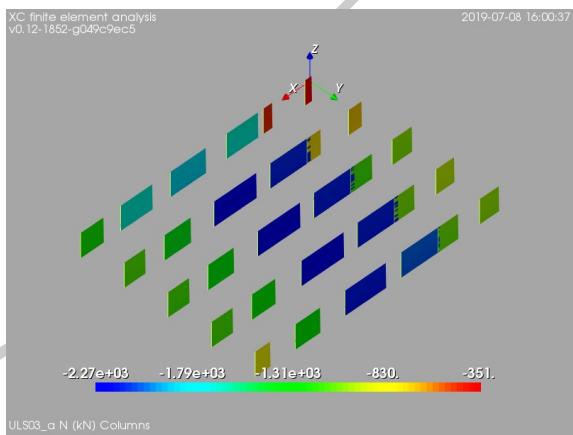


Figure 60: ULS03_a: $1.2*D + 1.6*S + 0.5*Lru + Lpu$. Columns, internal axial force [kN]

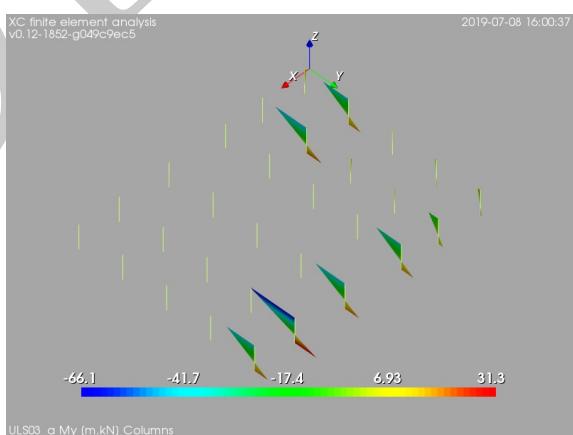


Figure 61: ULS03_a: $1.2*D + 1.6*S + 0.5*Lru + Lpu$. Columns, bending moment about local axis y [m.kN]

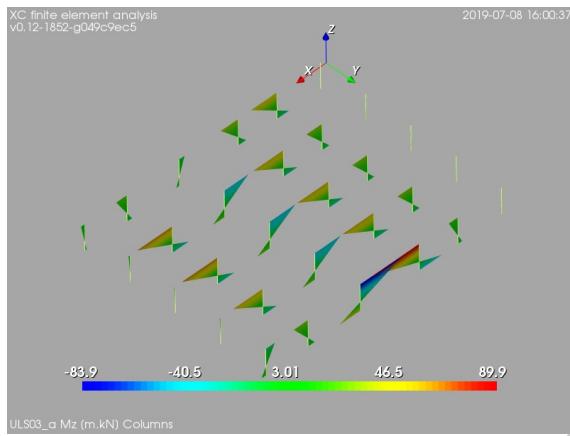


Figure 62: ULS03_a: $1.2*D + 1.6*S + 0.5*Lru + Lpu$. Columns, bending moment about local axis z [m.kN]




Figure 63: ULS03_a: $1.2*D + 1.6*S + 0.5*Lru + Lpu$. Columns, internal shear force in local direction y [kN]

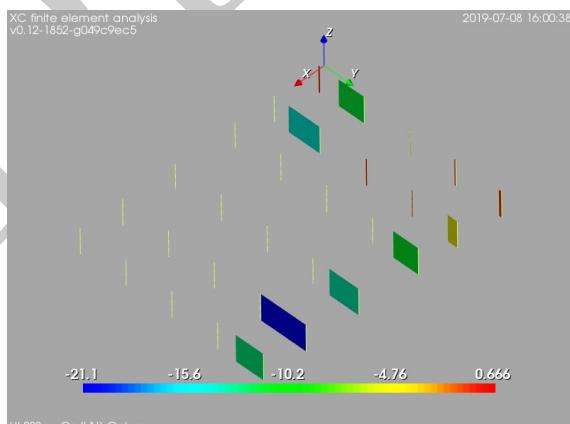


Figure 64: ULS03_a: $1.2*D + 1.6*S + 0.5*Lru + Lpu$. Columns, internal shear force in local direction z [kN]

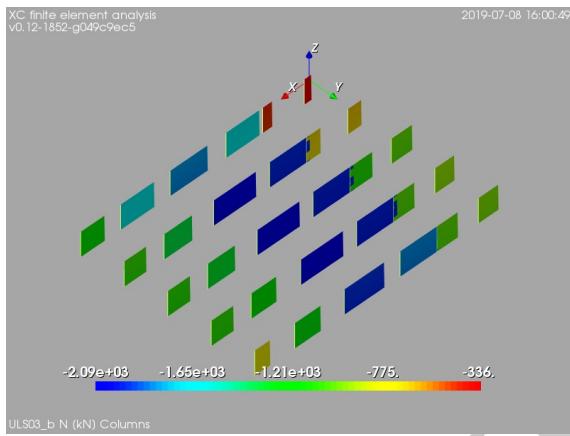


Figure 65: ULS03_b: $1.2*D + 1.6*S + 0.5*Lrs + Lps$. Columns, internal axial force [kN]

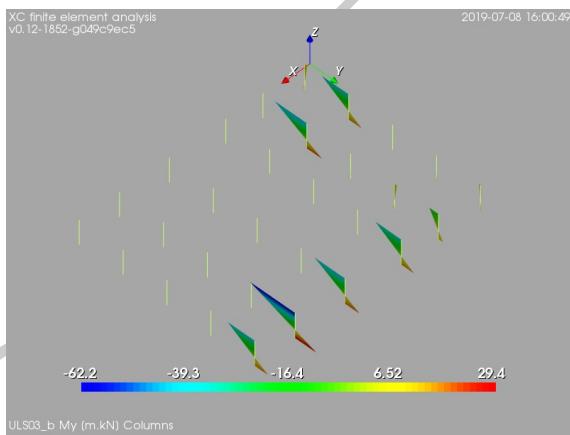


Figure 66: ULS03_b: $1.2*D + 1.6*S + 0.5*Lrs + Lps$. Columns, bending moment about local axis y [m.kN]

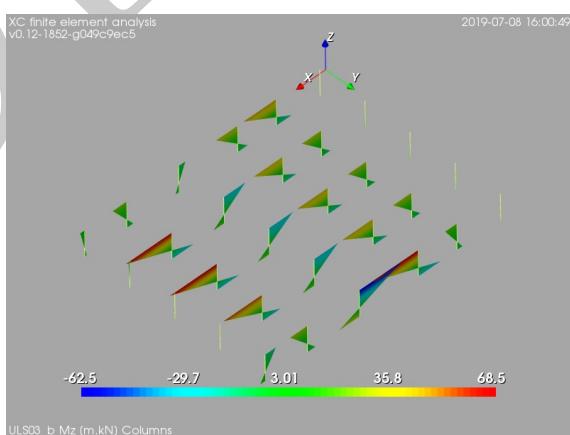


Figure 67: ULS03_b: $1.2*D + 1.6*S + 0.5*Lrs + Lps$. Columns, bending moment about local axis z [m.kN]

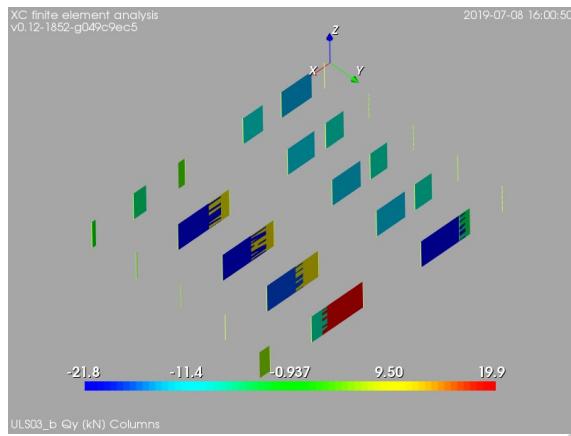


Figure 68: ULS03_b: $1.2*D + 1.6*S + 0.5*Lrs + Lps$. Columns, internal shear force in local direction y [kN]

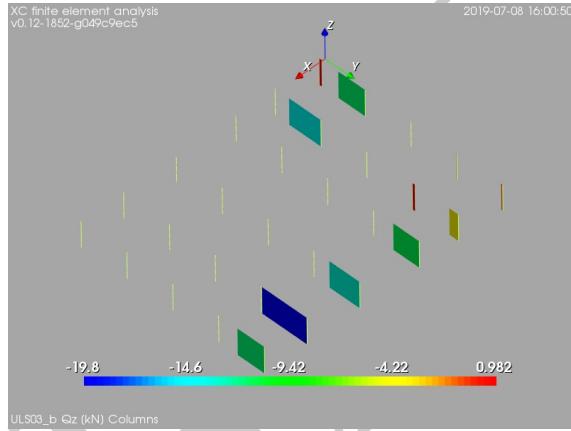


Figure 69: ULS03_b: $1.2*D + 1.6*S + 0.5*Lrs + Lps$. Columns, internal shear force in local direction z [kN]

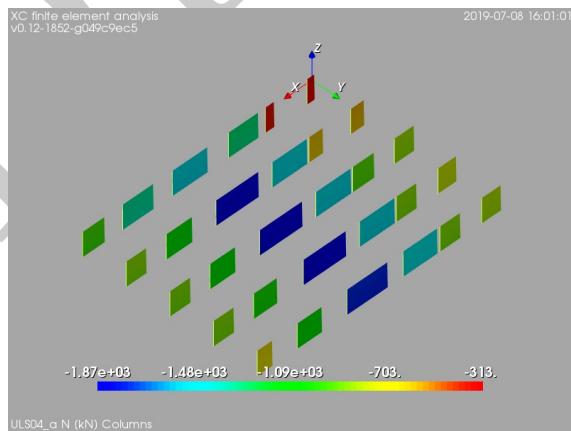


Figure 70: ULS04_a: $1.2*D + 1.6*S + 0.5*W_WE$. Columns, internal axial force [kN]

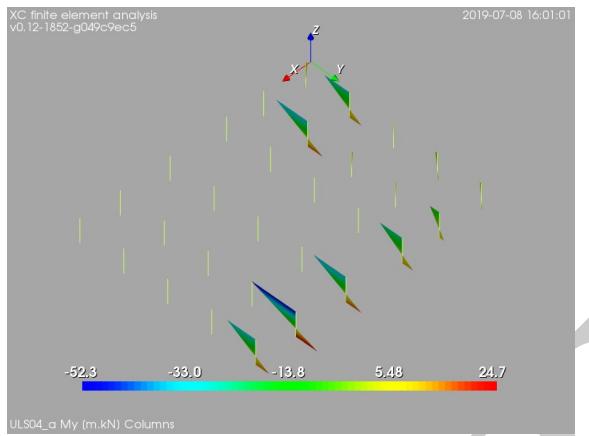


Figure 71: ULS04_a: $1.2*D + 1.6*S + 0.5*W_WE$. Columns, bending moment about local axis y [m.kN]

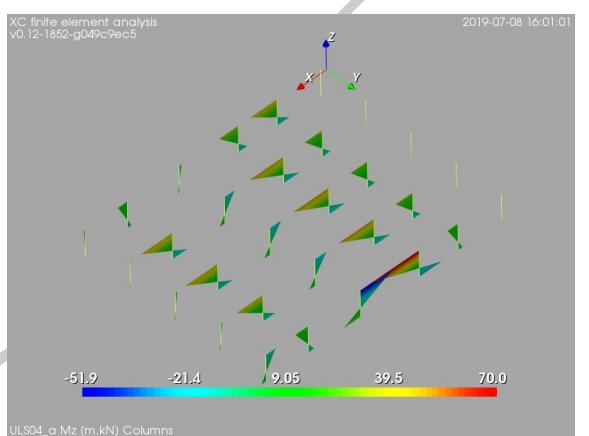


Figure 72: ULS04_a: $1.2*D + 1.6*S + 0.5*W_WE$. Columns, bending moment about local axis z [m.kN]

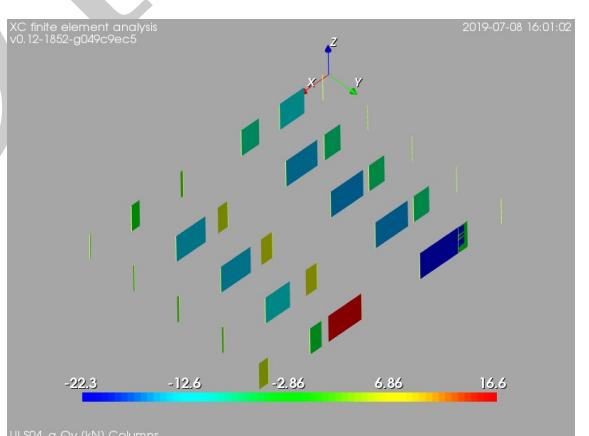


Figure 73: ULS04_a: $1.2*D + 1.6*S + 0.5*W_WE$. Columns, internal shear force in local direction y [kN]

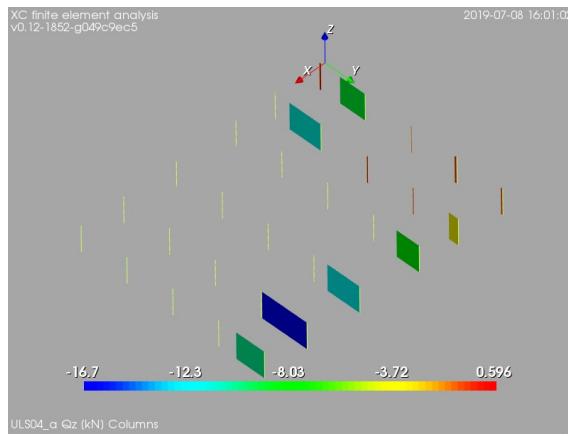


Figure 74: ULS04_a: $1.2*D + 1.6*S + 0.5*W_WE$. Columns, internal shear force in local direction z [kN]

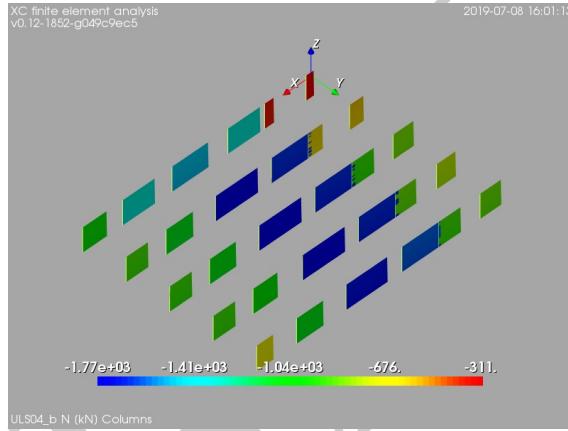


Figure 75: ULS04_b: $1.2*D + 1.6*S + 0.5*W_NS$. Columns, internal axial force [kN]

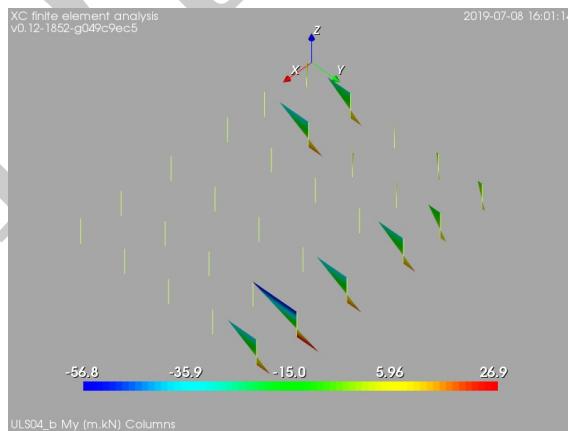


Figure 76: ULS04_b: $1.2*D + 1.6*S + 0.5*W_NS$. Columns, bending moment about local axis y [m.kN]

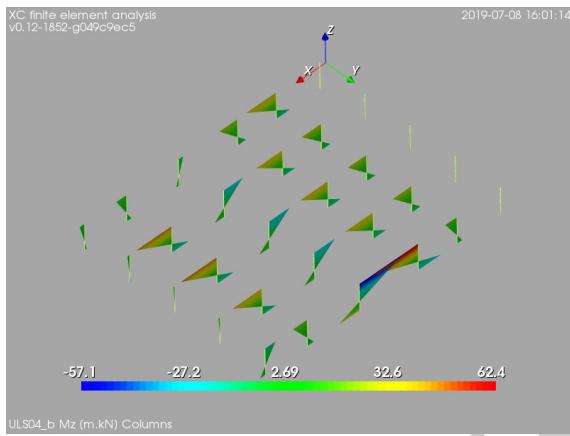


Figure 77: ULS04_b: $1.2*D + 1.6*S + 0.5*W_{NS}$. Columns, bending moment about local axis z [m.kN]

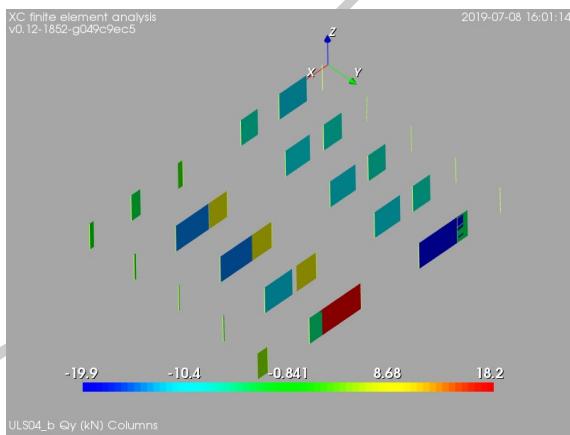


Figure 78: ULS04_b: $1.2*D + 1.6*S + 0.5*W_{NS}$. Columns, internal shear force in local direction y [kN]

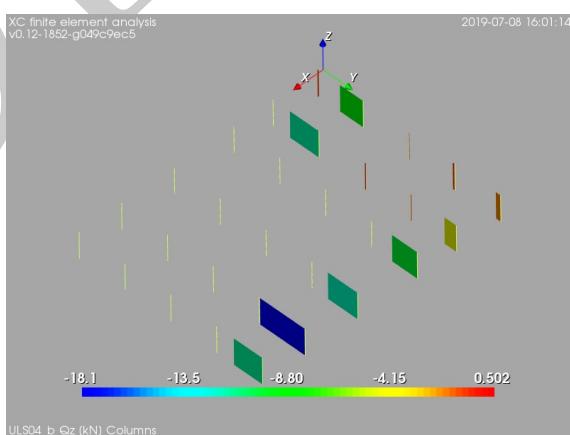


Figure 79: ULS04_b: $1.2*D + 1.6*S + 0.5*W_{NS}$. Columns, internal shear force in local direction z [kN]

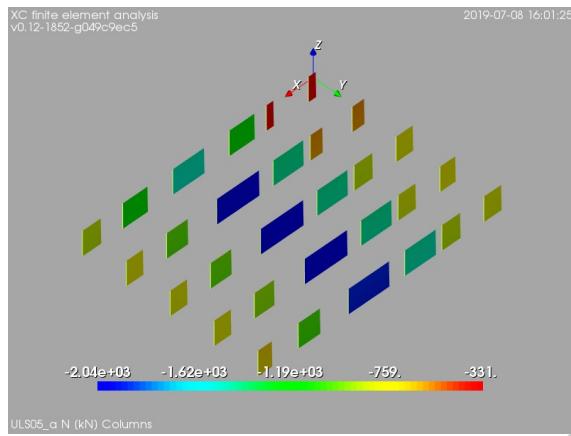


Figure 80: ULS05_a: 1.2*D + W_WE + 0.5*Lru + Lpu. Columns, internal axial force [kN]

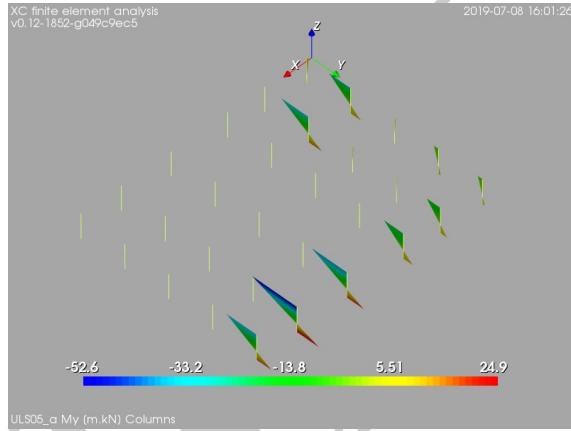


Figure 81: ULS05_a: 1.2*D + W_WE + 0.5*Lru + Lpu. Columns, bending moment about local axis y [m.kN]

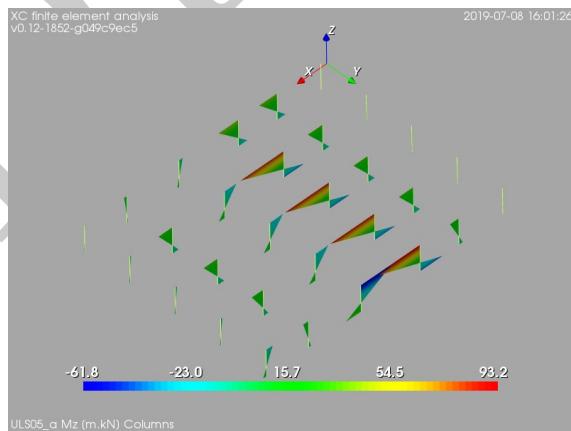


Figure 82: ULS05_a: 1.2*D + W_WE + 0.5*Lru + Lpu. Columns, bending moment about local axis z [m.kN]

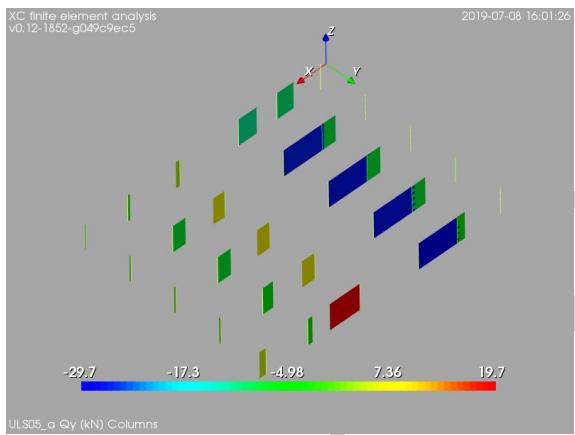


Figure 83: ULS05_a: $1.2*D + W_WE + 0.5*Lru + Lpu$. Columns, internal shear force in local direction y [kN]

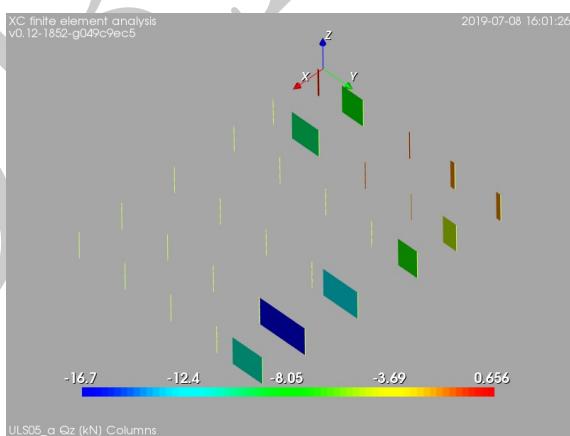


Figure 84: ULS05_a: $1.2*D + W_WE + 0.5*Lru + Lpu$. Columns, internal shear force in local direction z [kN]

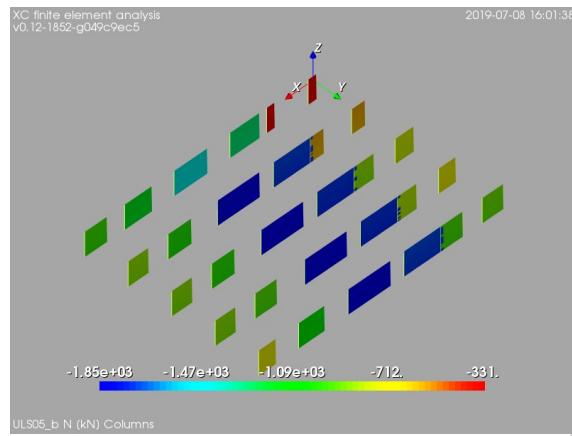


Figure 85: ULS05_b: $1.2*D + W_{NS} + 0.5*L_{ru} + L_{pu}$. Columns, internal axial force [kN]

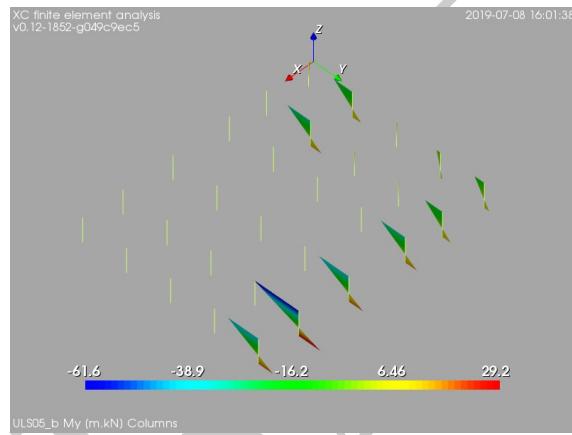


Figure 86: ULS05_b: $1.2*D + W_{NS} + 0.5*L_{ru} + L_{pu}$. Columns, bending moment about local axis y [m.kN]

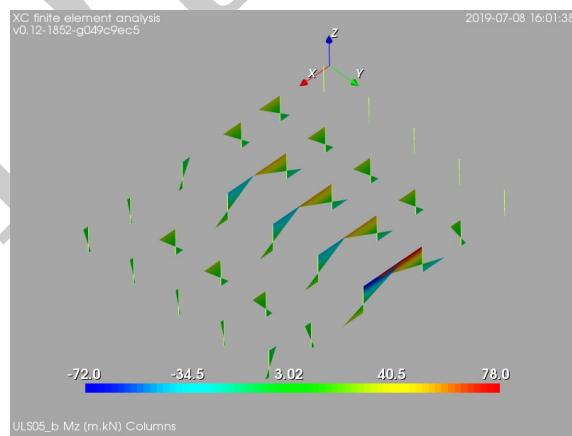


Figure 87: ULS05_b: $1.2*D + W_{NS} + 0.5*L_{ru} + L_{pu}$. Columns, bending moment about local axis z [m.kN]

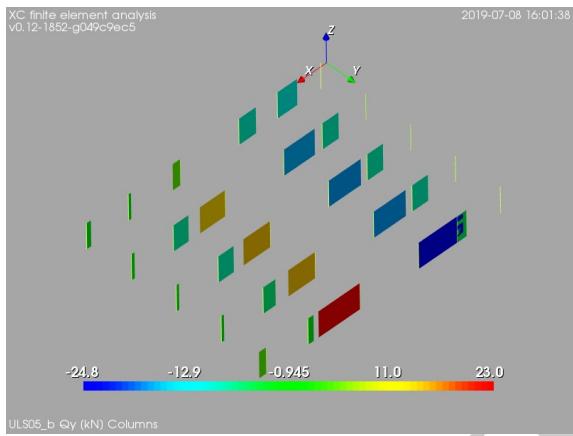


Figure 88: ULS05_b: $1.2*D + W_NS + 0.5*Lru + Lpu$. Columns, internal shear force in local direction y [kN]

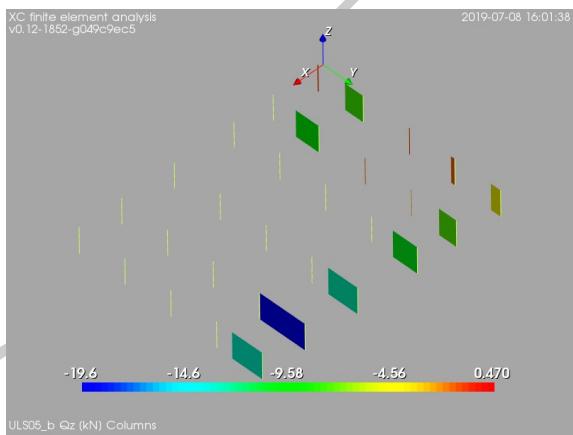


Figure 89: ULS05_b: $1.2*D + W_NS + 0.5*Lru + Lpu$. Columns, internal shear force in local direction z [kN]

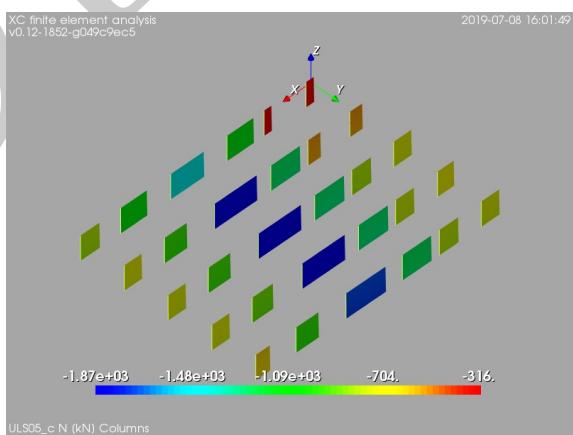


Figure 90: ULS05_c: $1.2*D + W_WE + 0.5*Lrs + Lps$. Columns, internal axial force [kN]

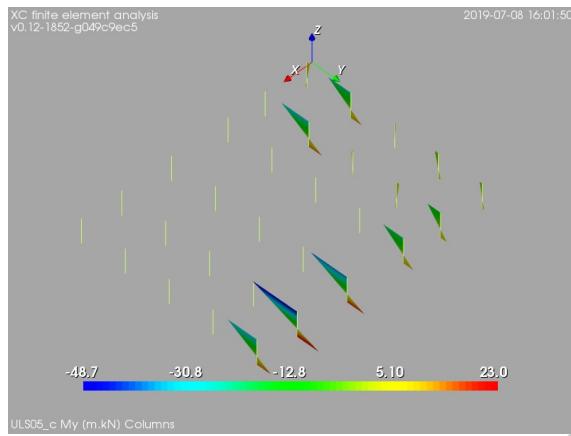


Figure 91: ULS05_c: 1.2*D + W_WE + 0.5*Lrs + Lps. Columns, bending moment about local axis y [m.kN]

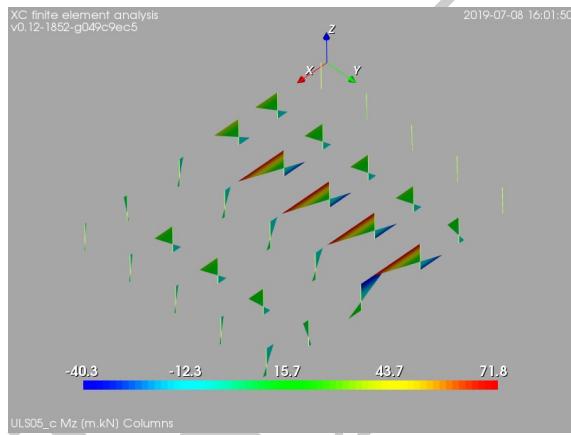


Figure 92: ULS05_c: 1.2*D + W_WE + 0.5*Lrs + Lps. Columns, bending moment about local axis z [m.kN]

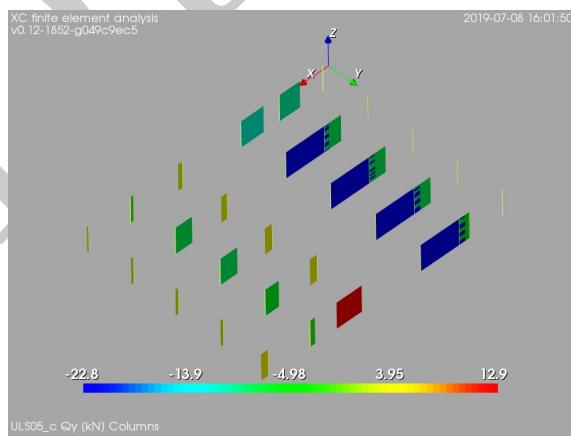


Figure 93: ULS05_c: 1.2*D + W_WE + 0.5*Lrs + Lps. Columns, internal shear force in local direction y [kN]

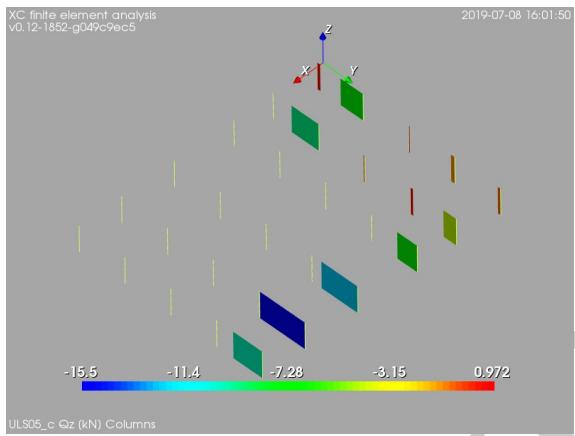


Figure 94: ULS05_c: $1.2*D + W_WE + 0.5*Lrs + Lps$. Columns, internal shear force in local direction z [kN]

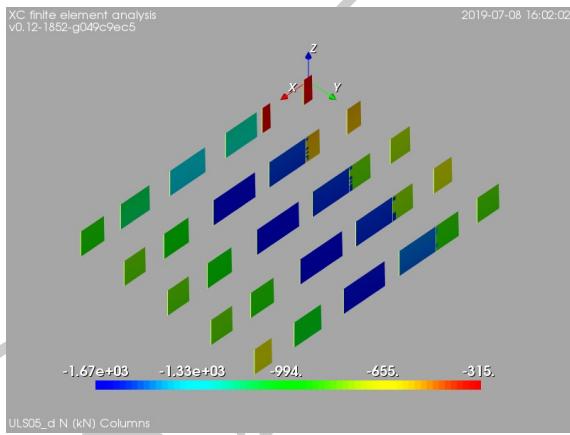


Figure 95: ULS05_d: $1.2*D + W_NS + 0.5*Lrs + Lps$. Columns, internal axial force [kN]

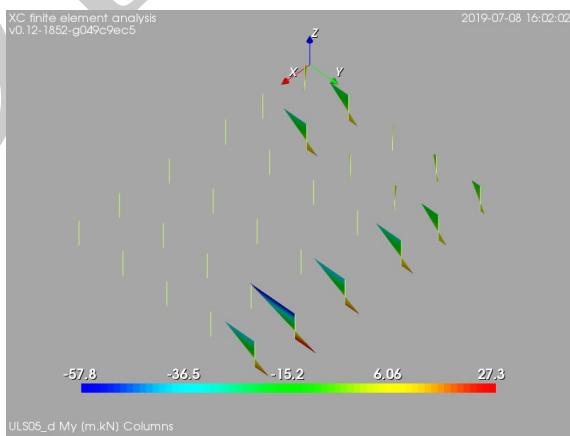


Figure 96: ULS05_d: $1.2*D + W_NS + 0.5*Lrs + Lps$. Columns, bending moment about local axis y [m.kN]

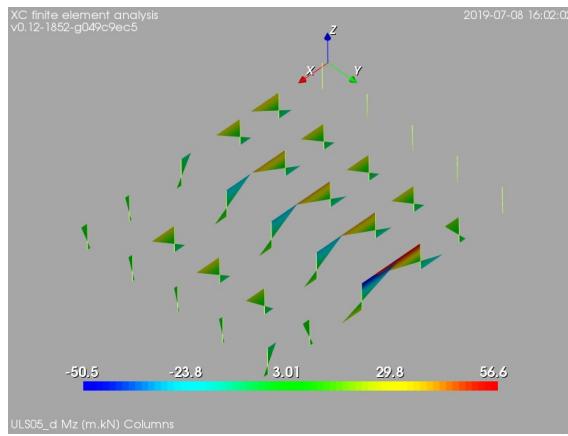


Figure 97: ULS05_d: 1.2*D + W_NS + 0.5*Lrs + Lps. Columns, bending moment about local axis z [m.kN]

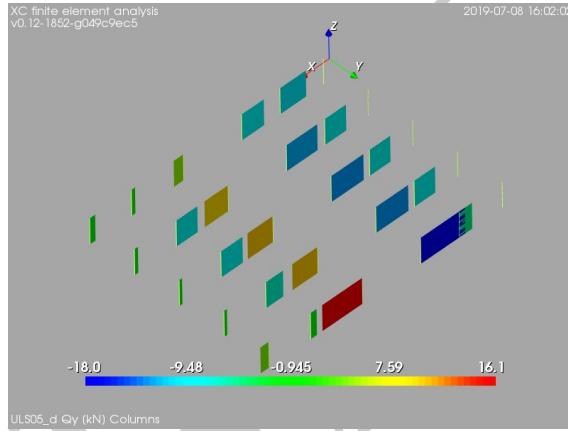


Figure 98: ULS05_d: 1.2*D + W_NS + 0.5*Lrs + Lps. Columns, internal shear force in local direction y [kN]

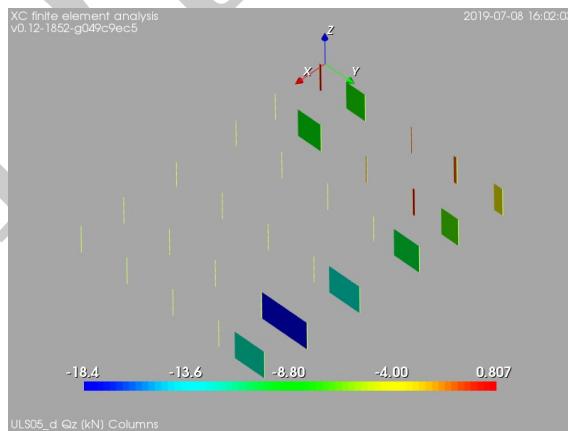


Figure 99: ULS05_d: 1.2*D + W_NS + 0.5*Lrs + Lps. Columns, internal shear force in local direction z [kN]

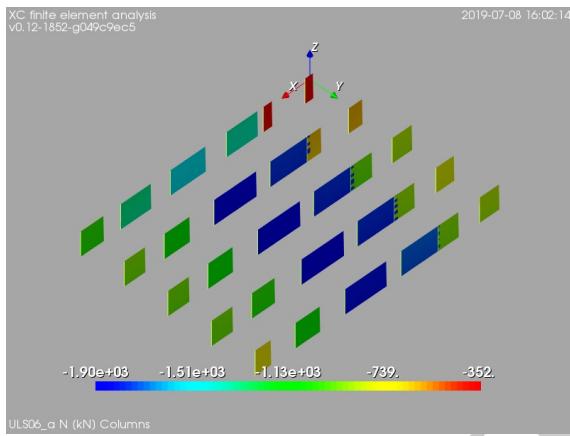


Figure 100: ULS06_a: $1.2*D + 0.5*Lru + Lpu + 0.2*S$. Columns, internal axial force [kN]

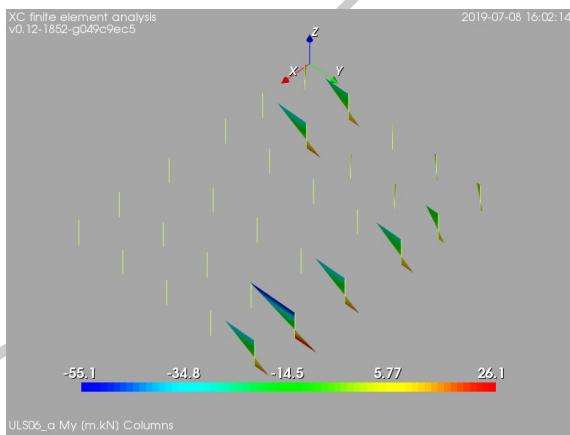


Figure 101: ULS06_a: $1.2*D + 0.5*Lru + Lpu + 0.2*S$. Columns, bending moment about local axis y [m.kN]

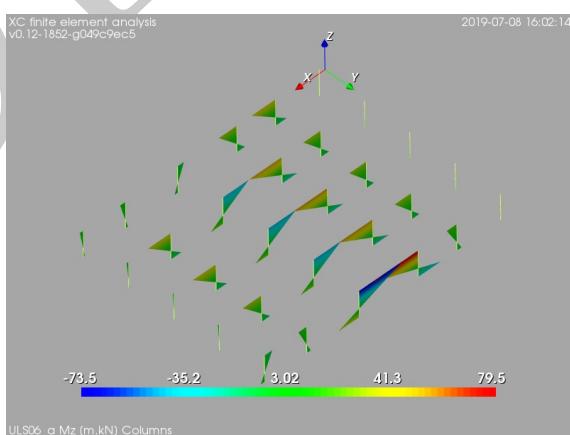


Figure 102: ULS06_a: $1.2*D + 0.5*Lru + Lpu + 0.2*S$. Columns, bending moment about local axis z [m.kN]

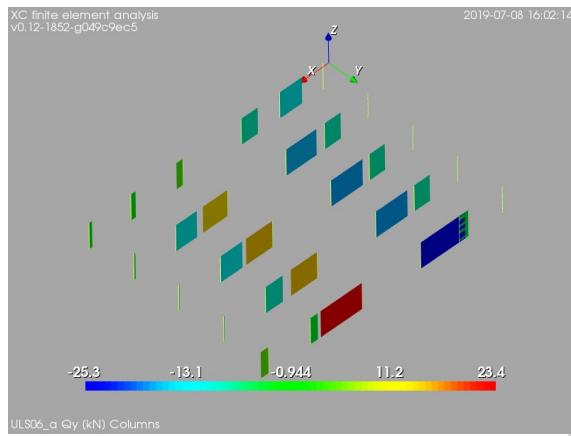


Figure 103: ULS06_a: $1.2*D + 0.5*Lru + Lpu + 0.2*S$. Columns, internal shear force in local direction y [kN]

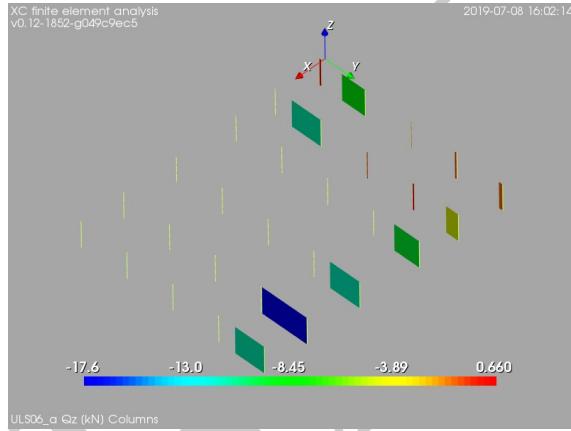


Figure 104: ULS06_a: $1.2*D + 0.5*Lru + Lpu + 0.2*S$. Columns, internal shear force in local direction z [kN]

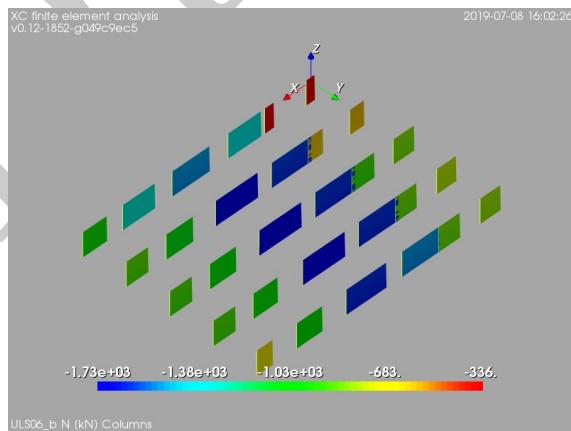


Figure 105: ULS06_b: $1.2*D + 0.5*Lrs + Lps + 0.2*S$. Columns, internal axial force [kN]

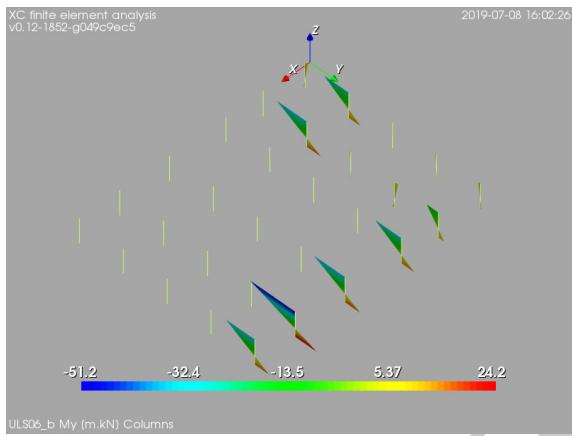


Figure 106: ULS06_b: $1.2*D + 0.5*Lrs + Lps + 0.2*S$. Columns, bending moment about local axis y [m.kN]

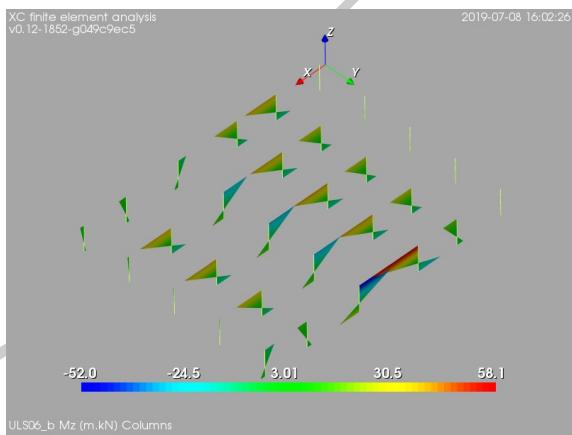


Figure 107: ULS06_b: $1.2*D + 0.5*Lrs + Lps + 0.2*S$. Columns, bending moment about local axis z [m.kN]

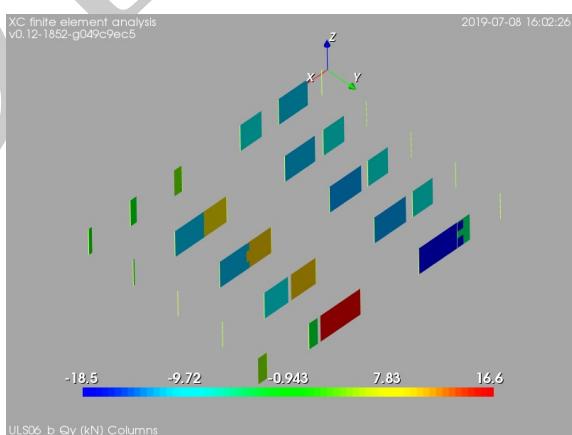


Figure 108: ULS06_b: $1.2*D + 0.5*Lrs + Lps + 0.2*S$. Columns, internal shear force in local direction y [kN]

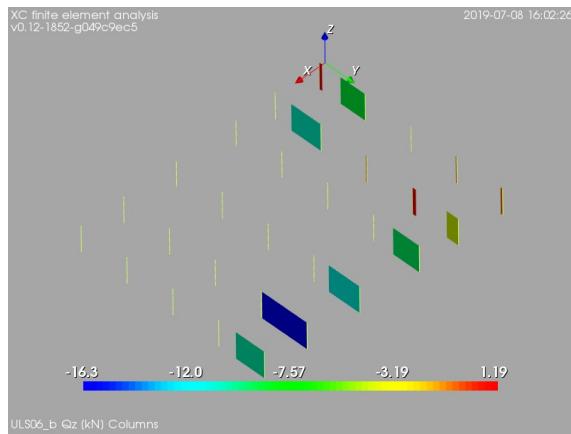


Figure 109: ULS06_b: $1.2*D + 0.5*Lrs + Lps + 0.2*S$. Columns, internal shear force in local direction z [kN]

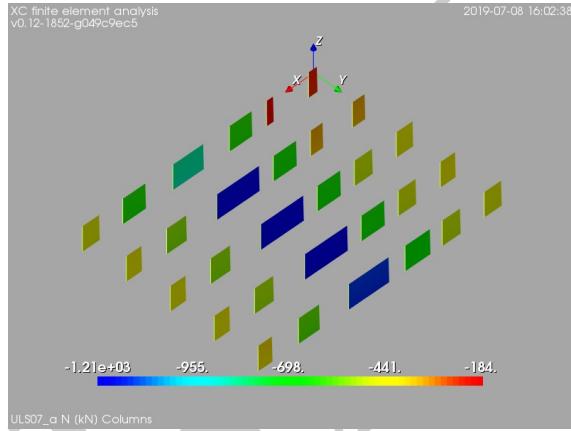


Figure 110: ULS07_a: $0.9*D + W_WE$. Columns, internal axial force [kN]

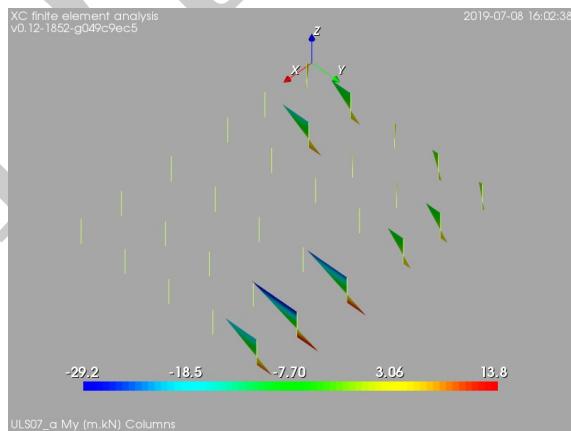


Figure 111: ULS07_a: $0.9*D + W_WE$. Columns, bending moment about local axis y [m.kN]

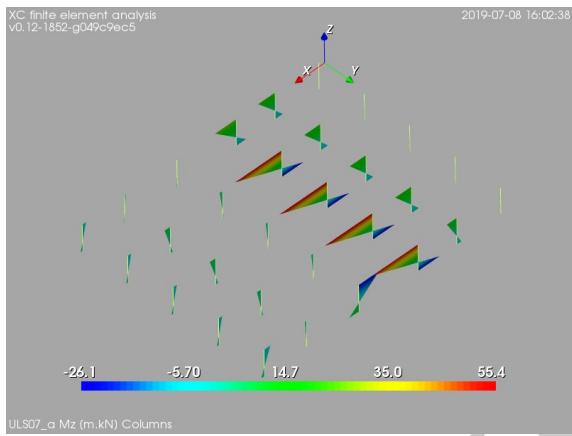


Figure 112: ULS07_a: 0.9*D + W_WE. Columns, bending moment about local axis z [m.kN]

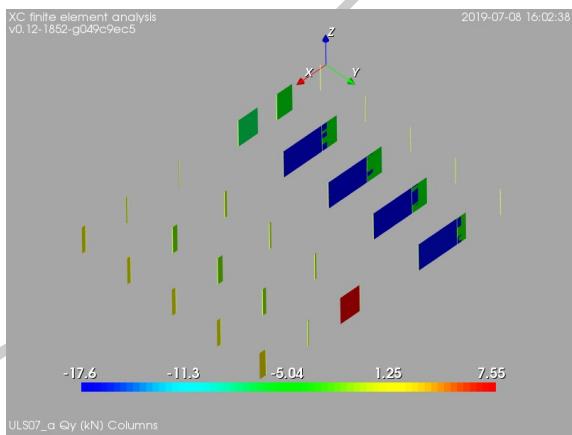


Figure 113: ULS07_a: 0.9*D + W_WE. Columns, internal shear force in local direction y [kN]

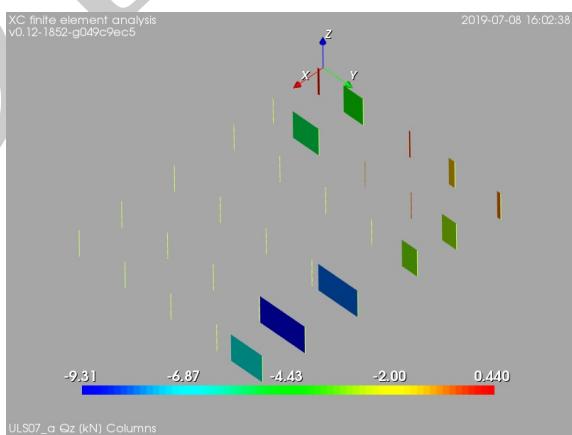


Figure 114: ULS07_a: 0.9*D + W_WE. Columns, internal shear force in local direction z [kN]

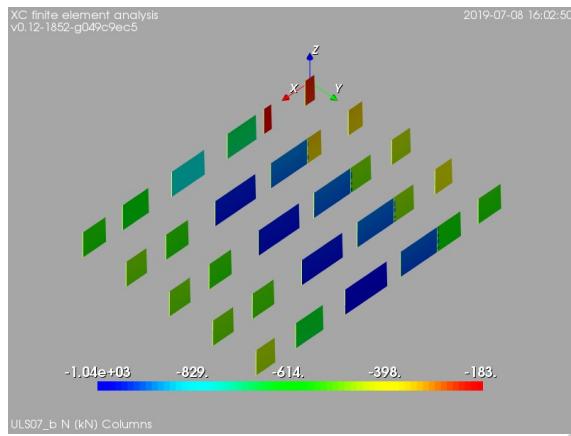


Figure 115: ULS07_b: $0.9*D + W_{NS}$. Columns, internal axial force [kN]

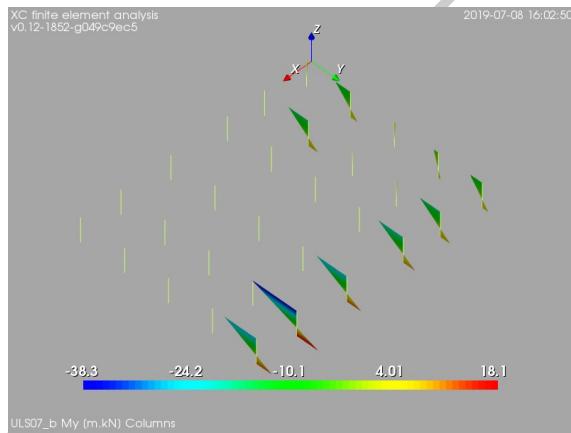


Figure 116: ULS07_b: $0.9*D + W_{NS}$. Columns, bending moment about local axis y [m.kN]

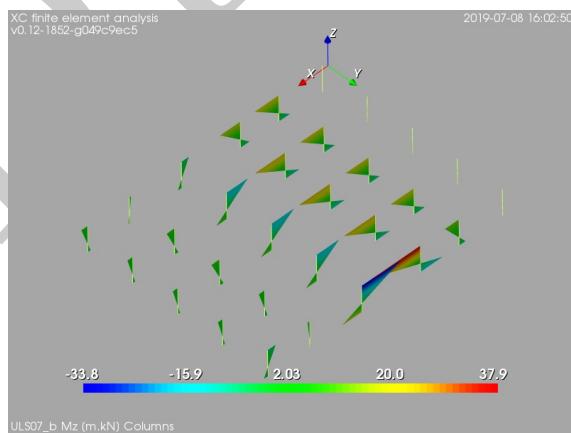


Figure 117: ULS07_b: $0.9*D + W_{NS}$. Columns, bending moment about local axis z [m.kN]

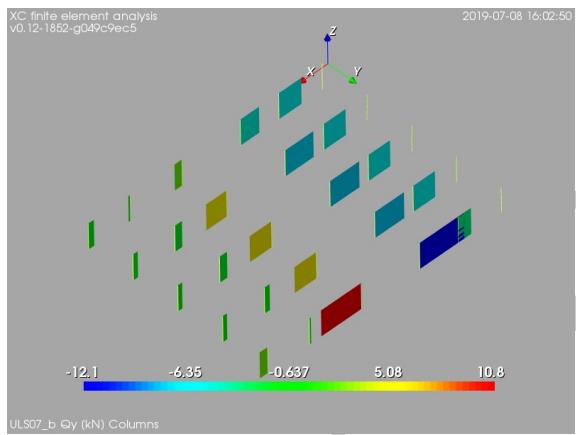


Figure 118: ULS07_b: 0.9*D + W_NS. Columns, internal shear force in local direction y [kN]

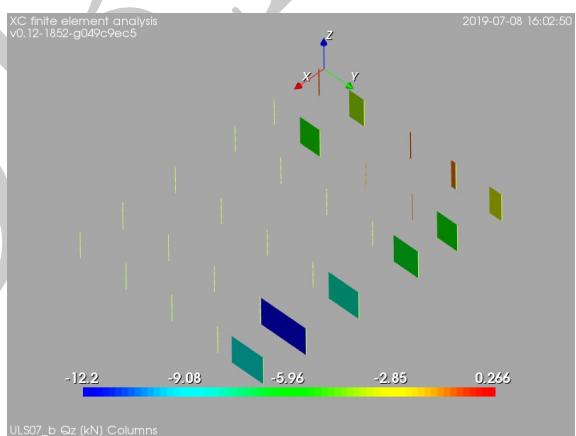


Figure 119: ULS07_b: 0.9*D + W_NS. Columns, internal shear force in local direction z [kN]

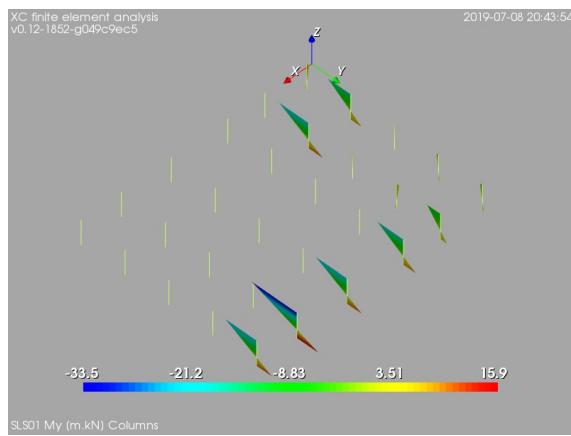


Figure 120: SLS01: 1.0*D. Columns, bending moment about local axis y [m.kN]

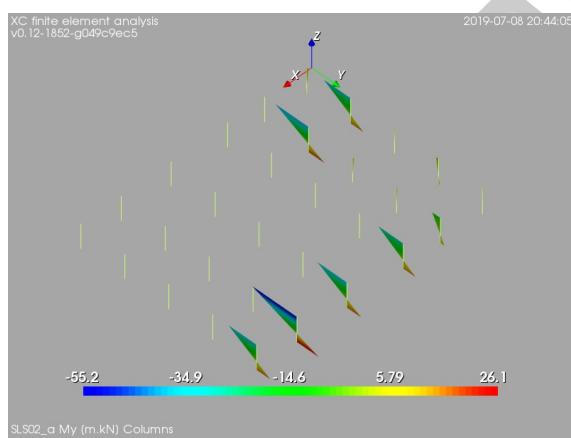


Figure 121: SLS02_a: 1.0*D + 1.0*Lru + Lpu + 0.3*S. Columns, bending moment about local axis y [m.kN]

B.2 Serviceability limit states

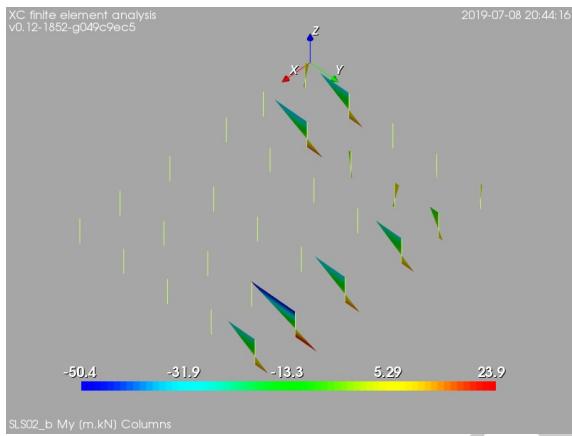


Figure 122: SLS02_b: $1.0*D + 1.0*Lrs + Lps + 0.3*S$. Columns, bending moment about local axis y [m.kN]

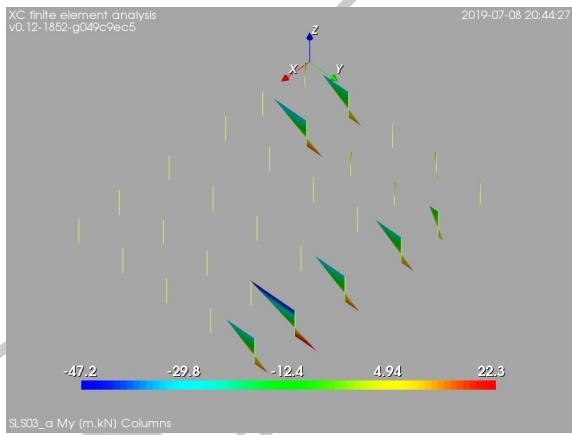


Figure 123: SLS03_a: $1.0*D + 1.0*S + 0.3*Lru + 0.3*Lpu$. Columns, bending moment about local axis y [m.kN]

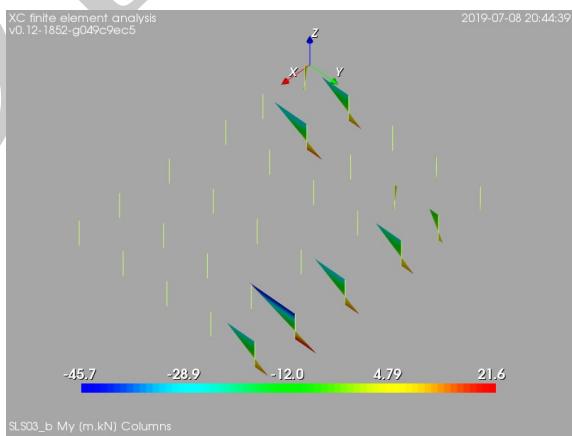


Figure 124: SLS03_b: $1.0*D + 1.0*S + 0.3*Lrs + 0.3*Lps$. Columns, bending moment about local axis y [m.kN]

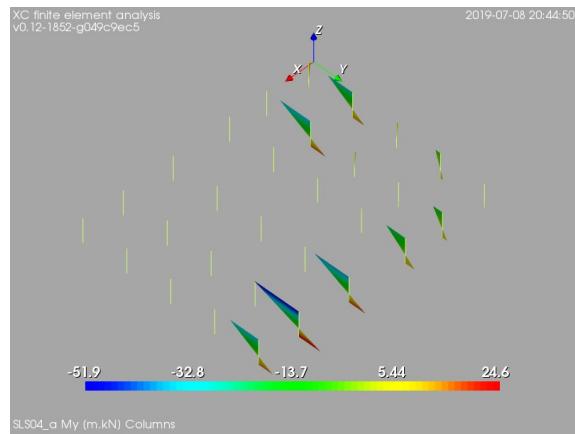


Figure 125: SLS04_a: 1.0*D + W_WE + 1.0*Lru + Lpu. Columns, bending moment about local axis y [m.kN]

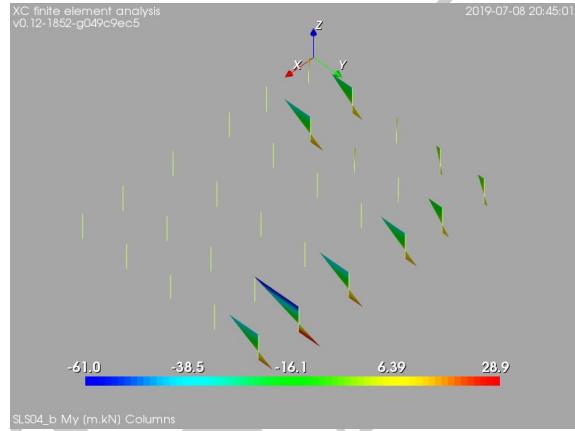


Figure 126: SLS04_b: 1.0*D + W_NS + 1.0*Lru + Lpu. Columns, bending moment about local axis y [m.kN]

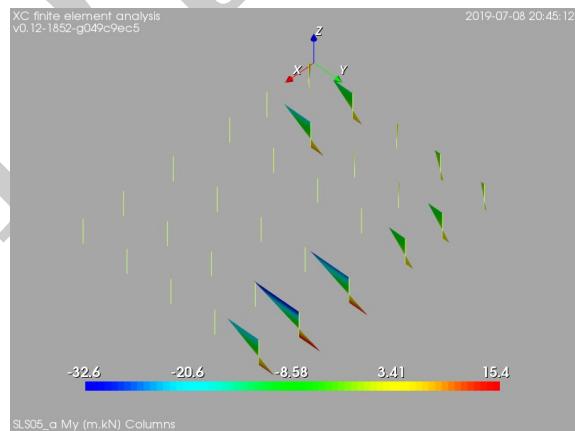


Figure 127: SLS05_a: 1.0*D + W_WE. Columns, bending moment about local axis y [m.kN]

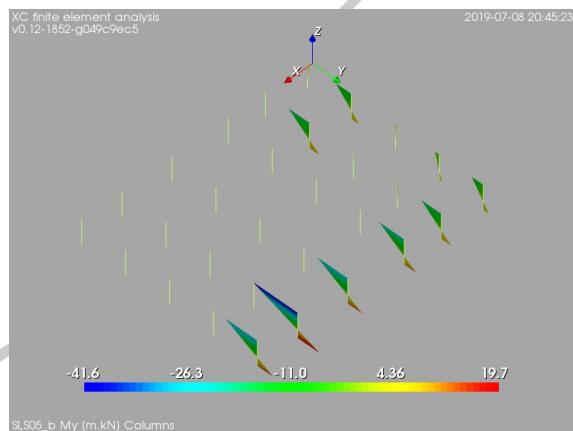


Figure 128: SLS05_b: 1.0*D + W_NS. Columns, bending moment about local axis y [m.kN]