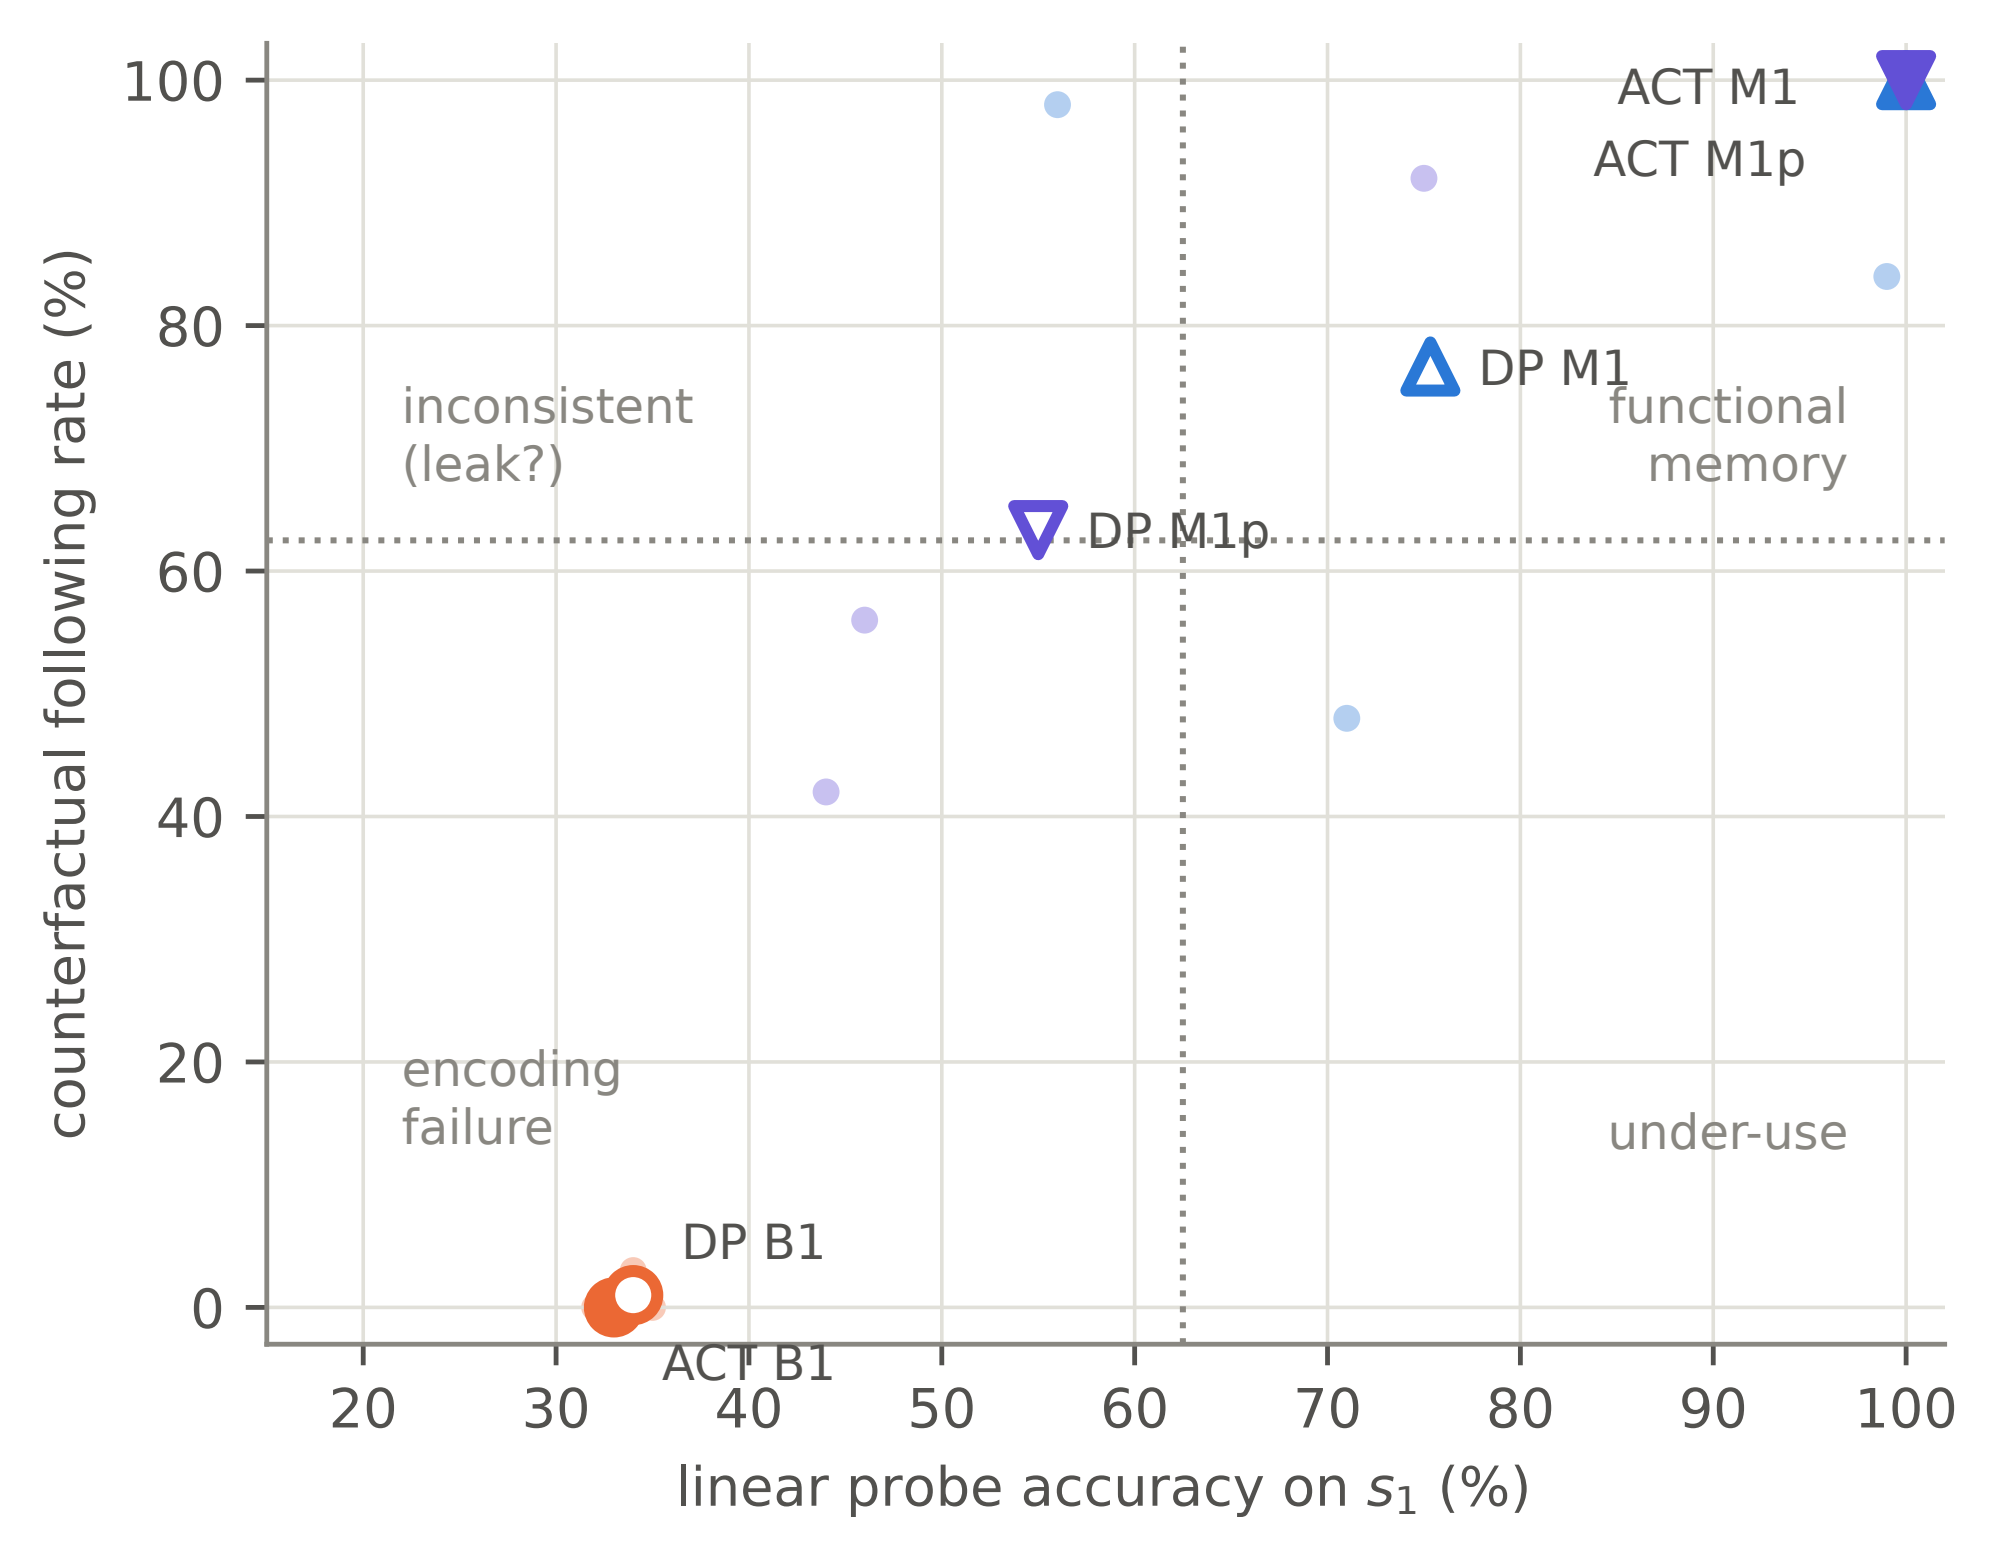
ACT M1
ACT M1p
DP M1
DP M1p
DP B1
ACT B1
inconsistent
(leak?)
functional
memory
encoding
failure
under-use
counterfactual following rate (%)
linear probe accuracy on s_1 (%)
0
20
40
60
80
100
20
30
40
50
60
70
80
90
100