



Government Polytechnic Gonda

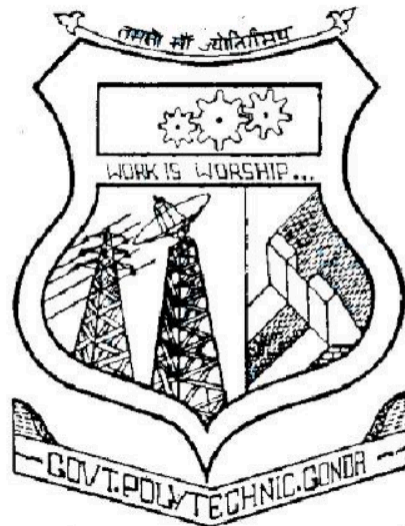

Session : 2025-26

Field Exposure Report

220/33/11 kV Sub. station, Jail road, Gonda

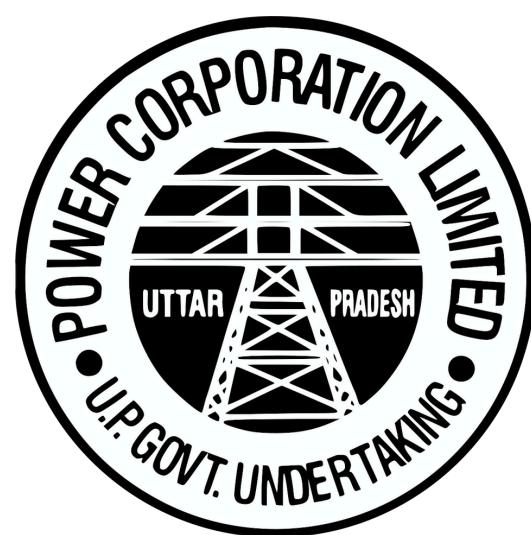

Submitted By:

Anand Kumar

Electrical Engineering (IC)

Enrollment No. E23220932900034

Submitted to:

Mr. OP Chaudhary

Electrical Engineering