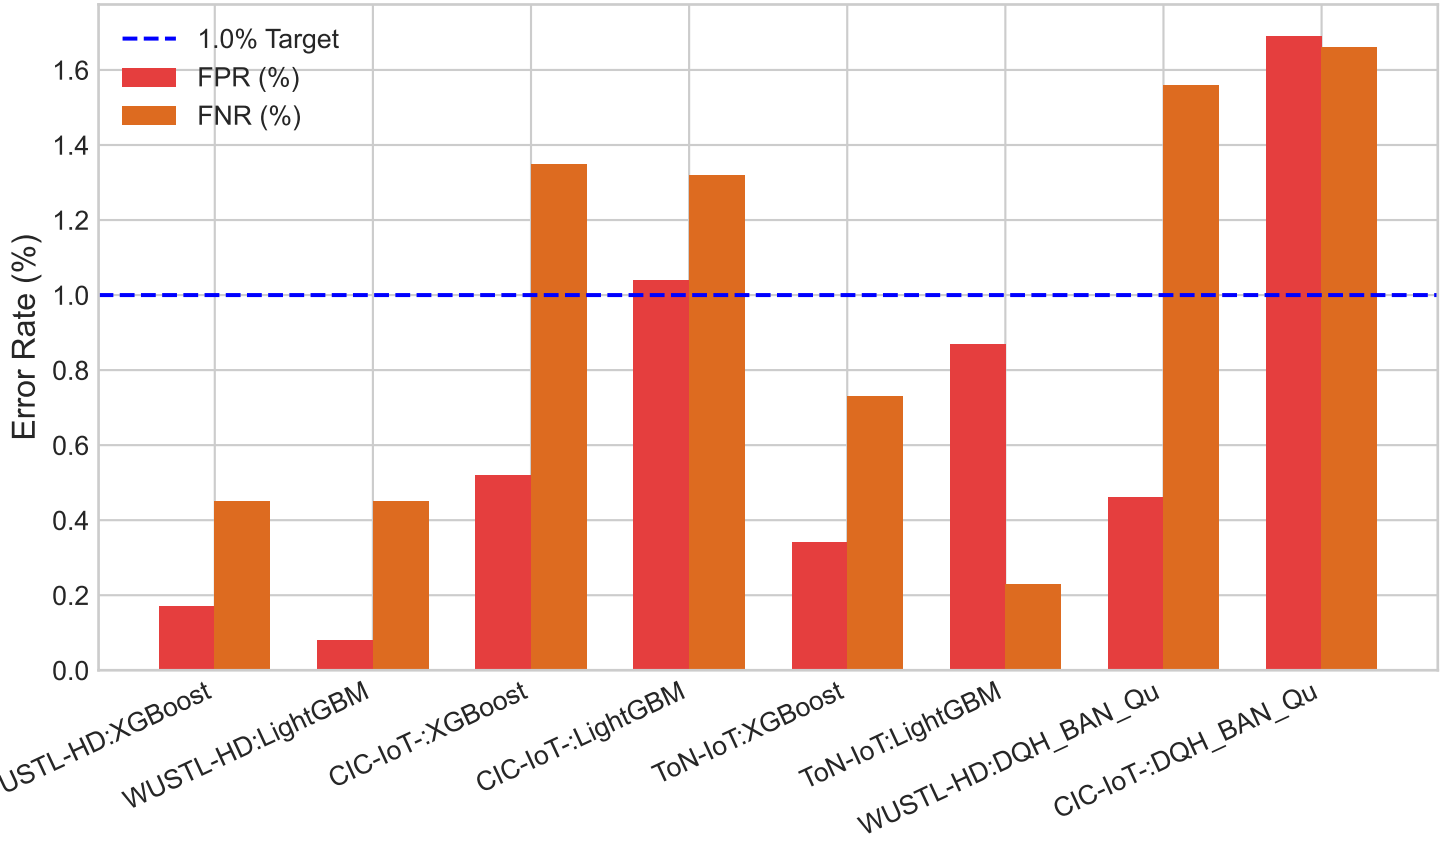Figure 13: Measured False Positive Rate (FPR) and False Negative Rate (FNR)