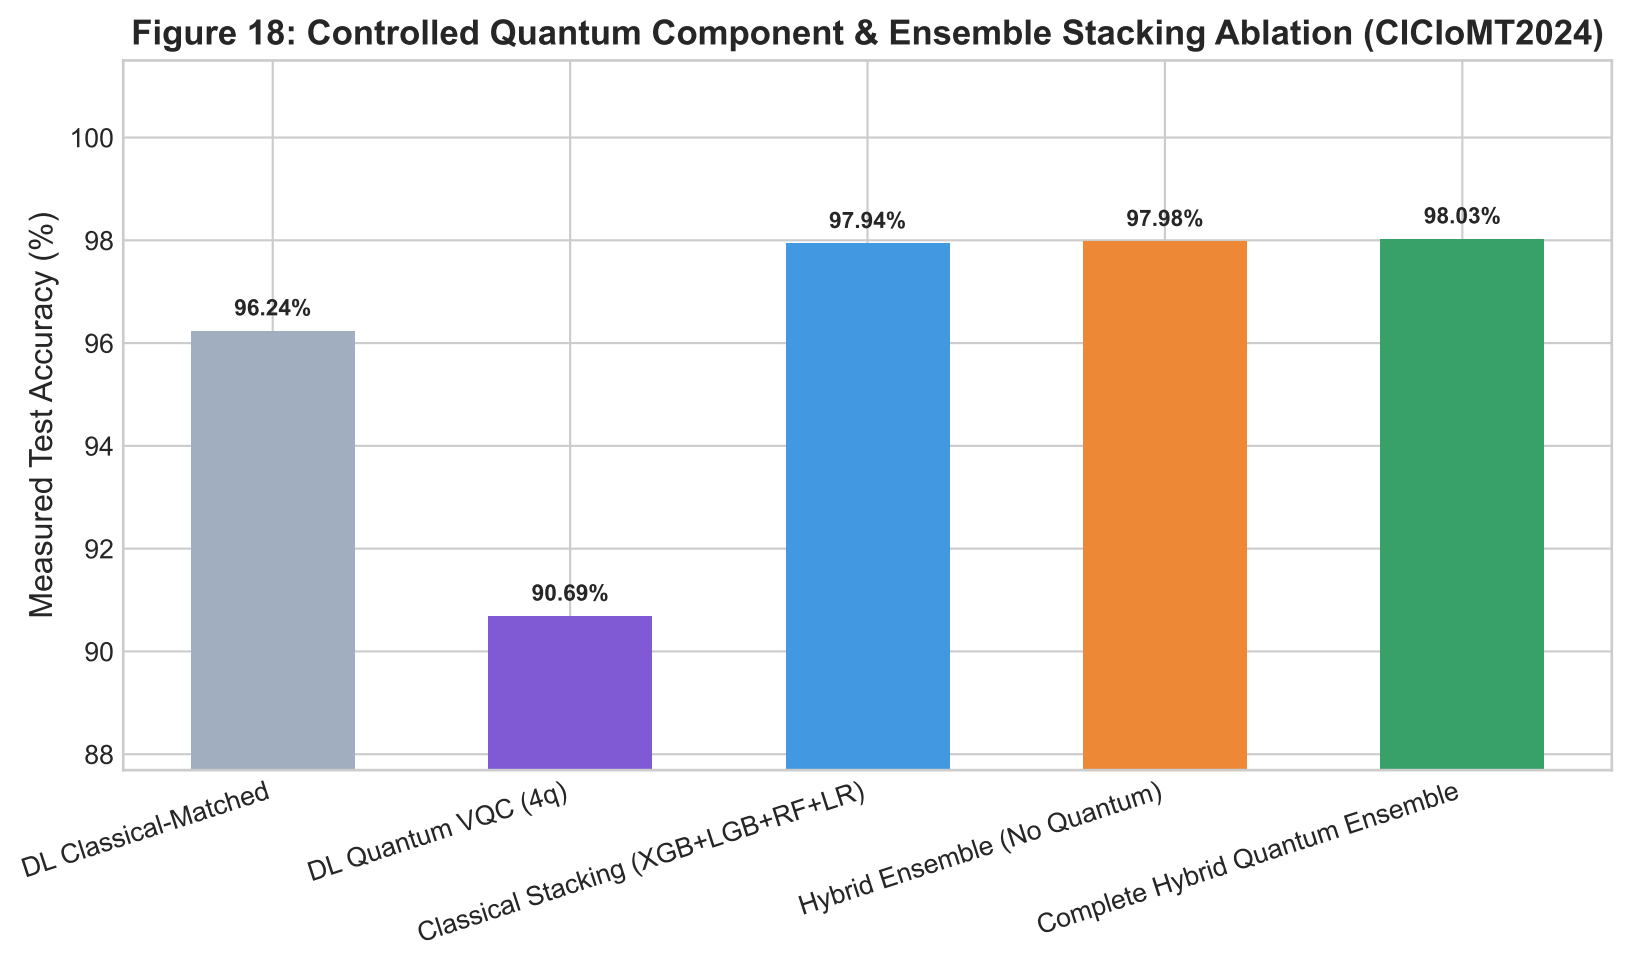
Figure 18: Controlled Quantum Component & Ensemble Stacking Ablation (CICIoMT2024)
Measured Test Accuracy (%)
100
98
96
94
92
90
88
96.24%
90.69%
97.94%
97.98%
98.03%
DL Classical-Matched
DL Quantum VQC (4q)
Classical Stacking (XGB+LGB+RF+LR)
Hybrid Ensemble (No Quantum)
Complete Hybrid Quantum Ensemble