

EQUIPMENT SUBMITTAL

Engine Generators

Project: Meridian Data Centre Campus - Phase 1

Reference Section: 26 32 13

Package ID: SUB-263213-01-R0

Revision: R0

Reviewed Spec Revision: Rev 2024

Date: 01-01-2025


ACTIVE

Rev	Date	Description
R0	01-01-2025	Initial / Updated Submittal

Technical Parameters

Parameter	Claimed Value
Block Load Acceptance	100%
Day Tank Capacity	990 L
Electric Starter Configuration	Single starter
Fuel Autonomy	48 h
Fuel Consumption at 100% Load	520 L/h
Governor Classification	Class G3
Power Factor	0.8
Reference Ambient Temperature	40 C
Engine Speed	1500 RPM
Standby Rating	2500 kVA @ 40 deg C
Voltage	11 kV

¹ Sound Pressure Level is 88 dBA (at 1 meter in free field)

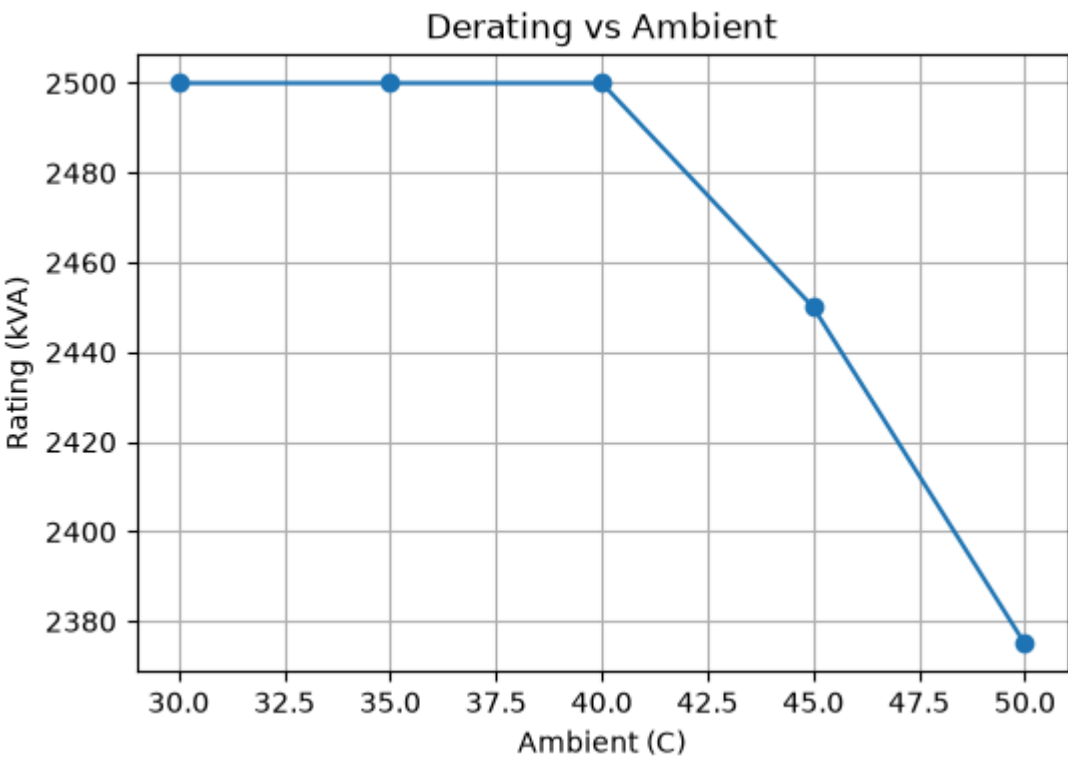

Clause ID	Requirement Summary	Response
26 32 13 Part 2.2.1.A	Generator standby power rating shall be a minimum of 2500 kVA. The standby rating shall be verified ...	Comply
26 32 13 Part 2.2.1.B	After applying the manufacturer's published ambient temperature derating factors for operation at 45...	Comply
26 32 13 Part 2.3.5.A	Generator controller shall be the current model EMCP 4.4 digital electronic control panel, or approv...	EMCP 3.2
26 32 13 Part 3.2.1.F	Adequate ventilation shall be provided in the generator room to prevent heat buildup and ensure prop...	room ventilation is adequate
26 32 13 Part 2.3.8.C	Each generator shall be provided with a local day tank sized to provide a minimum of 2.0 hours of co...	Comply
26 32 13 Part 2.2.4.D	Fuel consumption rate at 50% load shall be submitted in the vendor performance data table. Omission ...	Comply
26 32 13 Part 2.3.3.A	Generator shall be equipped with dual starter motors in redundant configuration, each with indepen...	Comply
26 32 13 Part 2.4.3.B	With the acoustic enclosure and silencer installed, the generator set sound pressure level shall not...	Comply
26 32 13 Part 2.2.1.C	Generator power factor rating shall be 0.8 lagging. Generator shall be capable of delivering rated k...	Comply
26 32 13 Part 2.2.1.D	Generator output voltage shall be 11 kV, 3-phase, 50 Hz. Voltage regulation shall be within +/- 0.5%...	Comply

Clause ID	Requirement Summary	Response
26 32 13 Part 2.2.1.E	Generator operating speed shall be 1500 RPM synchronous for 50 Hz output. Speed governing shall meet...	Comply
26 32 13 Part 2.2.2	Generator shall accept 100% block load in a single step and recover to steady-state voltage and freq...	Comply
26 32 13 Part 2.3.2.A	Engine speed governor shall be electronic type, meeting ISO 8528-5 performance class G3 requirements...	Comply

CERTIFICATE OF COMPLIANCE

This certifies that the equipment complies with standard testing requirements.

Issued by: Third Party Testing Laboratory