

EQUIPMENT SUBMITTAL

Static UPS

Project: Meridian Data Centre Campus - Phase 1

Reference Section: 26 33 53

Package ID: SUB-263353-01-R0

Revision: R0

Reviewed Spec Revision: Rev 2020

Date: 01-01-2025

SUPERSEDED


Rev	Date	Description
R0	01-01-2025	Initial / Updated Submittal

Technical Parameters

Parameter	Claimed Value
Battery Chemistry	VRLA
Battery Runtime	10 min
UPS Module Capacity	1200 kW
Cooling Airflow Configuration	Rear-exhaust
Efficiency at 100% Load	96.2%
Efficiency at 75% Load	96%
Enclosure Paint Finish	RAL 9005
Input Harmonic Distortion	4.2%
Input Voltage	415 V
Output Voltage	415 V
Inverter Overload Capacity	125% for 5 minutes
Parallel Redundancy Configuration	N+1
Power Factor	1

¹ Efficiency at 50% Load is 96.1% (double-conversion mode)

² Efficiency reduces to 95.1% under VFI mode when harmonic filters are active at 50% load

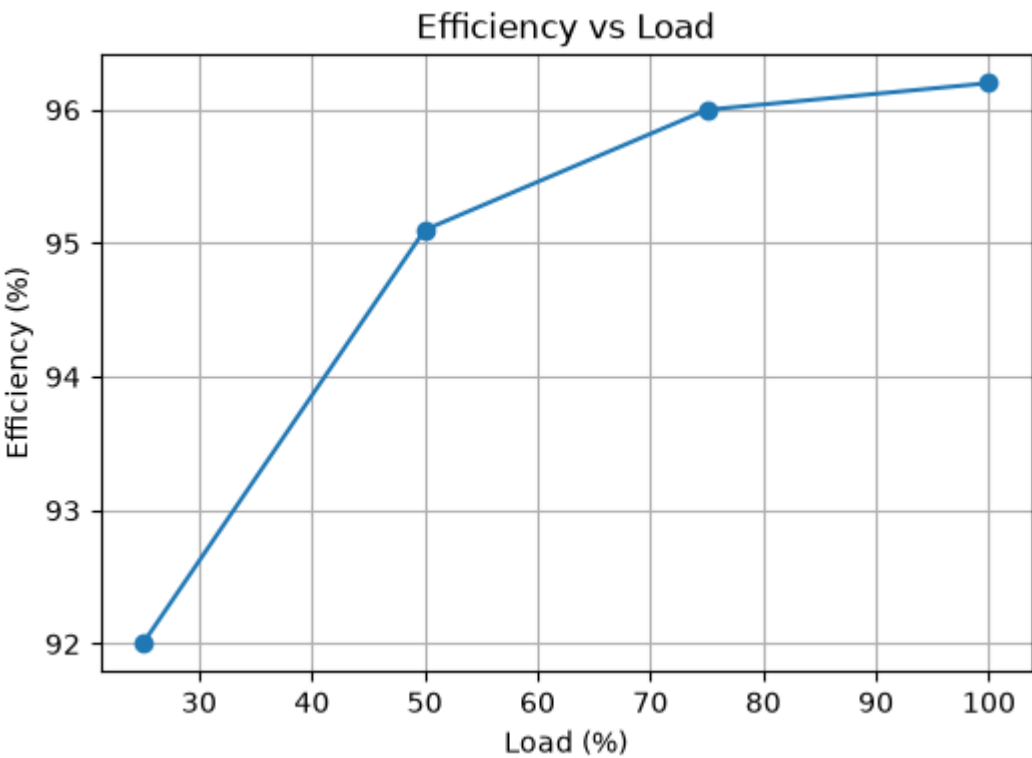

Clause ID	Requirement Summary	Response
26 33 53 Part 2.2.2.B	Double-conversion online mode efficiency at 75% and 50% rated load shall each be a minimum of 96.0%....	Comply
26 33 53 Part 2.1.2.A	UPS system modules shall be configured in a minimum N+2 parallel redundant configuration to ensure s...	Comply
26 33 53 Part 1.4.1.C	UPS equipment shall be tested and certified in accordance with IEC 62040-3 (Method of Specifying the...	IEC 62040-3
26 33 53 Part 1.3.1	The Contractor shall submit the equipment submittal package referencing the current active project s...	Comply
26 33 53 Part 2.2.8	The static bypass switch transfer time shall not exceed 4 milliseconds for any transfer between inve...	Comply
26 33 53 Part 2.2.5.A	UPS module shall sustain 125% of rated load for a minimum of 10 minutes continuously without transfe...	Comply
26 33 53 Part 2.4.2	UPS module cooling airflow shall be configured for front-inlet and top-exhaust to support hot aisle/...	Comply
26 33 53 Part 2.4.5.C	UPS module enclosure paint finish shall be RAL 7035 (Light Grey) polyester powder coating, minimum 6...	Comply
26 33 53 Part 2.2.1.A	Each UPS module shall have a minimum continuous output power rating of 1200 kW at unity power factor...	Comply
26 33 53 Part 2.2.1.B	UPS module output power factor shall be unity (1.0 PF) at full rated load. No derating for power fac...	Comply

Clause ID	Requirement Summary	Response
26 33 53 Part 2.2.1.D	Input total harmonic current distortion (THDi) shall not exceed 5.0% at full rated load without exte...	Comply
26 33 53 Part 2.2.2.A	Double-conversion online mode efficiency at 100% rated load shall be a minimum of 96.0%. Efficiency ...	Comply
26 33 53 Part 2.2.2.B	Double-conversion online mode efficiency at 75% and 50% rated load shall each be a minimum of 96.0%....	Comply

CERTIFICATE OF COMPLIANCE

This certifies that the equipment complies with standard testing requirements.

Issued by: Third Party Testing Laboratory