

# EQUIPMENT SUBMITTAL TRANSMITTAL

APPROVED

|                 |                                      |               |                |
|-----------------|--------------------------------------|---------------|----------------|
| Transmittal No: |                                      | Date:         |                |
| Project:        | Meridian Data Centre Campus, Phase 1 | Spec Section: | 26 13 26       |
| Vendor:         | Trident Switchgear                   | Revision:     |                |
| Status:         | FOR REVIEW                           | EPC Lead:     | YOU Electrical |

## Submittal Item Description

We submit for engineering review and approval the product datasheet, compliance matrix, and test certifications for the following equipment:

| Model Number   | Description                                                  | Qty | Manufacturer       |
|----------------|--------------------------------------------------------------|-----|--------------------|
| Trident T-2000 | Trident T-2000 Metal-Clad Air-Insulated MV Switchgear Panels | 10  | Trident Switchgear |

## Review Comments / Action Taken

**Engineering Review Result:** APPROVED  
**Comments:**  
- Approved with no major comments. All values check compliant.

## Product Datasheet: Trident T-2000

The Trident T-2000 is a modular, type-tested metal-clad air-insulated medium voltage switchgear panel rated for 12kV service, continuous bus current of 2000A, and short circuit withstand rating of 31.5kA for 3 seconds.

### Technical Parameter Specifications


| Parameter Name             | Claimed Value | Claimed Condition      | Spec Limit    |
|----------------------------|---------------|------------------------|---------------|
| Voltage kv                 | 12.0 kV       | rated maximum          | 12.0 kV       |
| Busbar current a           | 2000.0 A      | continuous service     | 2000.0 A      |
| Short circuit withstand ka | 31.5 kA       | 3s rating              | 31.5 kA       |
| Short circuit duration s   | 3.0 s         | short circuit limit    | 3.0 s         |
| Ip rating                  | IP4X          | standard enclosure     | IP4X          |
| Internal arc class         | AFLR          | 1s arc withstand       | AFLR          |
| Certification              | IEC 62271-200 | standard certification | IEC 62271-200 |

**Notes:**

1. Switchgear panel complies fully with IEC 62271-200. Degree of protection is IP4X external, IP2X internal partitions. Internal Arc Classification (IAC) is AFLR rated.

## Equipment Performance Curves

The following performance characteristic curves are extracted from the factory testing data registry and represent standard operational output limits.

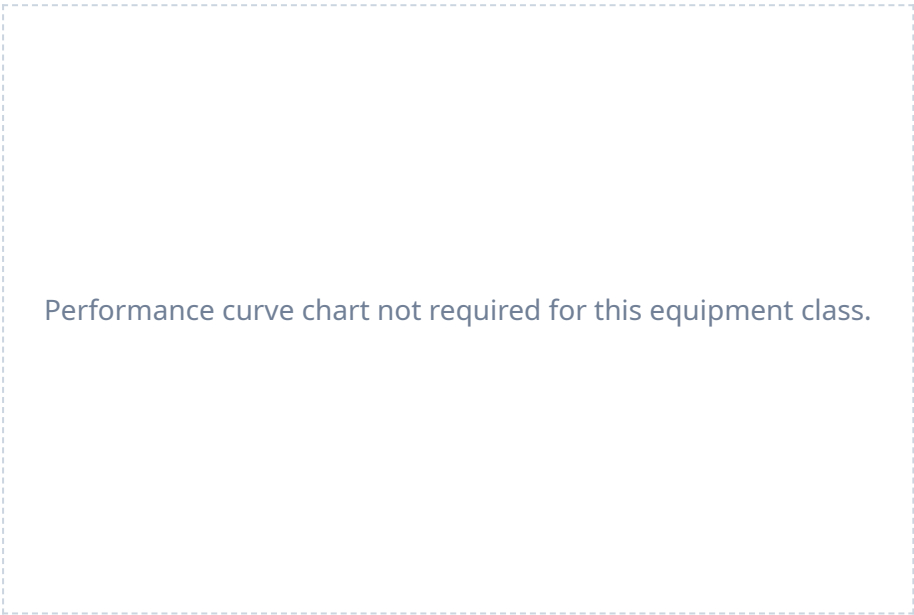

\* Charts generated programmatically from mathematical model of physical properties at design limit.

## Clause-by-Clause Conformance Statement

Below is our conformance statement indicating compliance with each clause of Section 26 13 26 of the construction specifications.

| Spec Clause              | Parameter / Requirement | Conformance Claim | Remarks / Evidence                                                                                        |
|--------------------------|-------------------------|-------------------|-----------------------------------------------------------------------------------------------------------|
| 26 13 26<br>Part 1.4.2   | SWG-IEC-CERT            | C                 | Conforms. Switchgear includes ASTA/KEMA type test certificates for compliance with IEC 62271-200.         |
| 26 13 26<br>Part 1.4.5   | SWG-OPERATING-TEMP      | C                 | Conforms. Switchgear operating temperature range is -5°C to 45°C, meeting design basis.                   |
| 26 13 26<br>Part 2.2.1.A | SWG-VOLTAGE             | C                 | Conforms. Switchgear rated voltage is 12 kV, which meets the specified minimum of 12 kV.                  |
| 26 13 26<br>Part 2.2.1.B | SWG-MAIN-BUS-CURRENT    | C                 | Conforms. Switchgear main busbar current rating is 2000 A, which meets the specified minimum of 2000 A.   |
| 26 13 26<br>Part 2.2.2.A | SWG-SHORT-CIRCUIT-KA    | C                 | Conforms. Short-circuit withstand is 31.5 kA, which meets the specified minimum of 31.5 kA.               |
| 26 13 26<br>Part 2.2.2.B | SWG-SHORT-CIRCUIT-TIME  | C                 | Conforms. Short-circuit duration rating is 3 seconds, which meets the specified minimum of 3 seconds.     |
| 26 13 26<br>Part 2.2.3   | SWG-MAKING-CAPACITY     | C                 | Conforms. Rated short-circuit making capacity is 66 kA peak, meeting the specified minimum 66 kA.         |
| 26 13 26<br>Part 2.2.4   | SWG-IMPULSE-BIL         | C                 | Conforms. Lightning impulse withstand voltage (BIL) is 75 kV, matching the specified 75 kV requirement.   |
| 26 13 26<br>Part 2.3.1.A | SWG-IP-RATING           | C                 | Conforms. Enclosure IP rating is IP4X, which meets the specified minimum IP4X.                            |
| 26 13 26<br>Part 2.3.1.E | SWG-IAC-RATING          | C                 | Conforms. Internal Arc Classification is AFLR, which meets the specified classification of AFLR.          |
| 26 13 26<br>Part 2.3.1.F | SWG-LSC-RATING          | C                 | Conforms. Loss of service continuity is LSC-2B, which meets LSC-2B specification.                         |
| 26 13 26<br>Part 2.3.2.A | SWG-BUS-MATERIAL        | C                 | Conforms. Busbar material is high conductivity copper, meeting the specification.                         |
| 26 13 26<br>Part 2.3.3.B | SWG-EARTH-BUS           | C                 | Conforms. Earthing busbar is copper and sized for full short circuit rating, meeting the spec.            |
| 26 13 26<br>Part 2.3.7.A | SWG-CT-ACCURACY         | C                 | Conforms. Current transformers have metering accuracy class 0.5s and protection class 5P20, meeting spec. |

# CERTIFICATE OF CONFORMANCE

Factory Quality Assurance Department

We hereby certify that the equipment listed below has been manufactured, tested, and inspected in accordance with all active factory testing specifications and international standards.

**Equipment Model:** Trident T-2000  
**Serial Numbers:** TRI-2026-2601 to 08  
**Test Standards:** IEC 62040-3, IEC 62271-200, ISO 8528-5 as applicable.  
**Quality Inspector:** Dr. H. Bose (Director of QA)  
**Date of Inspection:** January 8, 2026

Quality Inspector Signature

Plant Manager Signature