

FEEDWATER PIPE CROSS-SECTION

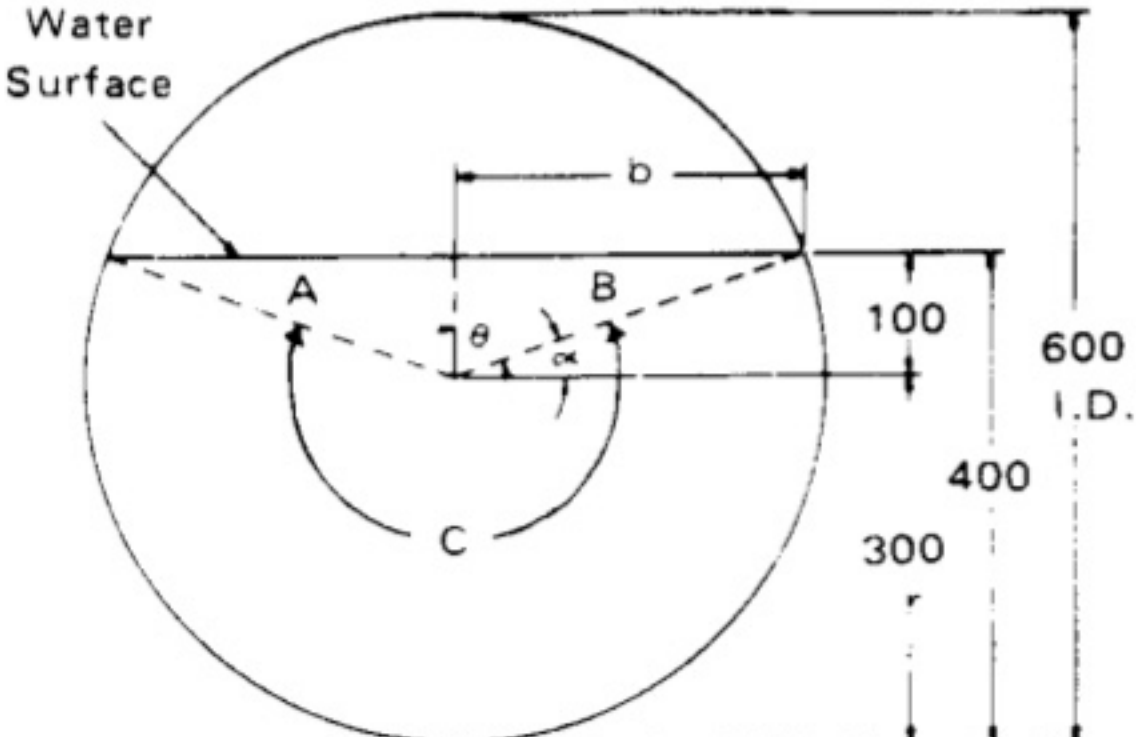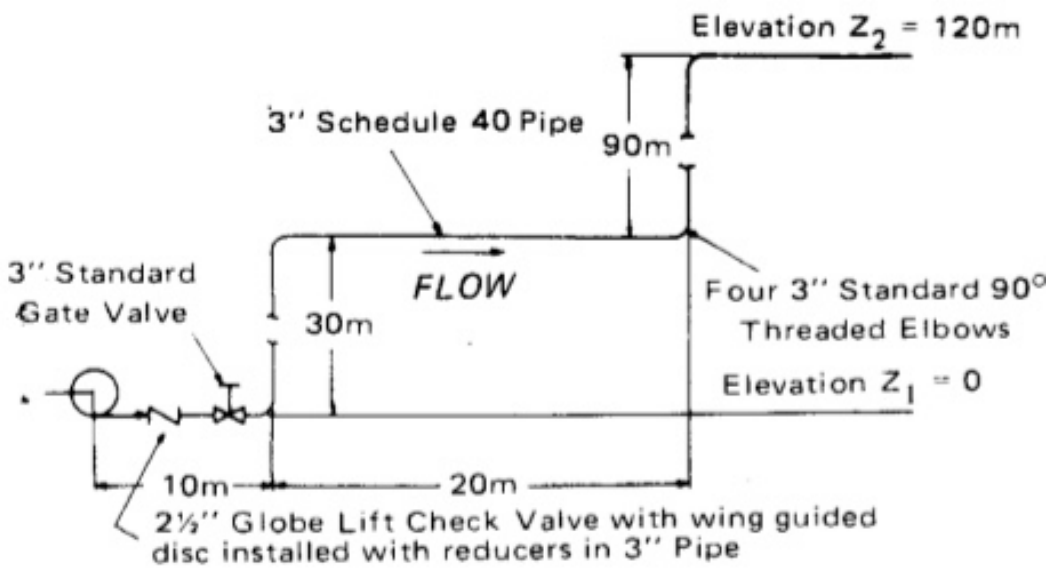

Dimensions in millimeters (mm)


Elevation Z_2 = 120m
3" Schedule 40 Pipe
90m
3" Standard
Gate Valve
FLOW
30m
Four 3" Standard 90°
Threaded Elbows
Elevation Z_1 = 0
10m
20m
2½" Globe Lift Check Valve with wing guided
disc installed with reducers in 3" Pipe