

GENERAL NOTES

[illegible]

KEY NOTE SYMBOL

MULTIPLE KEY NOTES APPLYING TO THE SAME ITEM

DRAWING NUMBER

DETAIL NUMBER WHERE DRAWN

SECTION LETTER

DRAWING NUMBER WHERE SHOWN

BUILDING NO. WHERE EQUIPMENT IS LOCATED.

EQUIPMENT ABBREVIATION (PUMP)

PUMP NO. 3 IN BUILDING NO. 26

TYPICAL UNIT NO.

PIPE SYSTEM

RISER NUMBER

1 HR. FIRE RATED BARRIER

2 HR. FIRE RATED BARRIER

SMOKE BARRIER

AREA OF WORK


R-001

GENERAL SHEET NOTES:


1. REFER TO DRAWING P-001 FOR PLUMBING ABBREVIATIONS, GENERAL NOTES AND SYMBOLS.
2. REFER TO DRAWING P-501 FOR PLUMBING DETAILS.
3. REFER TO DRAWING GC101 AND GC102 FOR GENERAL PHASING PLAN.
4. WORK AREAS WERE SURVEYED TO IDENTIFY HAZARDOUS MATERIALS. REFER TO MABBETT & ASSOCIATES REGULATED BUILDING MATERIALS SURVEY REPORT FOR VA PROJECT NO. 646-20-109, PITTSBURGH VMC MAIN CHILLER PLANT - A/E DESIGN SERVICES FOR PITTSBURGH VMC 10 CHILLER CAPACITY AND CONTROLS UPGRADE DATED APRIL 2, 2021 FOR ADDITIONAL INFORMATION. NOT ALL AREAS MAY HAVE BEEN ACCESSIBLE AND HAZARDOUS MATERIALS MAY EXIST WHICH HAVE NOT BEEN IDENTIFIED. IF SUSPECT MATERIALS ARE DISCOVERED WHICH HAVE NOT BEEN PREVIOUSLY IDENTIFIED, THE CONTRACTOR SHALL NOT DISTURB THESE MATERIALS AND SHALL IMMEDIATELY NOTIFY THE VMC CIO.
5. OSHA LEAD REGULATIONS WILL APPLY TO ANY DEMOLITION OPERATION (I.E. SAWING, SCRAPING, CUTTING, AND WELDING) THAT WOULD EXPOSE PAINTED SURFACES WHICH CONTAIN LEAD. OCCUPATIONAL EXPOSURE TO LEAD IS REGULATED BY OSHA (29CFR 1910.1205) AS WELL AS APPLICABLE STATE REGULATIONS. DISPOSAL OF MATERIALS CONTAINING LEAD IS SUBJECT TO THE USEPA RESOURCE CONSERVATION AND RECOVERY ACT (RCRA) REGULATIONS. REFER TO SPECIFICATIONS FOR FURTHER INFORMATION.

SHEET KEYNOTES:

1. PROVIDE DRIP PANS BELOW EXISTING DRAIN PIPING ABOVE ELECTRICAL EQUIPMENT OF LIGHT GAGE GALVANIZED STEEL WITH 1" SIDES AND APPROXIMATELY 2" DEEPER THAN PIPE ON EACH SIDE AND EXTENDING 4" BEYOND ELECTRIC EQUIPMENT AND SLOPED TO A 1/4" HIGH DRAIN HOLE FOR VISIBLE EVIDENCE OF PIPE LEAKS OR CONDENSATE ISSUES. THESE REQUIREMENTS APPLY AT EACH LOCATION OF THIS KEYNOTE AND AT ANY LOCATION ELECTRICAL EQUIPMENT IS INSTALLED UNDER EXISTING PIPING, REGARDLESS OF PRESENCE OF KEYNOTE.
2. AVOID INSTALLING ANY PIPING OVER ELECTRICAL EQUIPMENT. ANY PIPING THAT HAS TO BE INSTALLED, MUST RECEIVE APPROVAL FROM THE VA CIO. IF APPROVED, PROVIDE DRIP PANS BELOW PIPING ABOVE ELECTRICAL AS PER ABOVE NOTE.

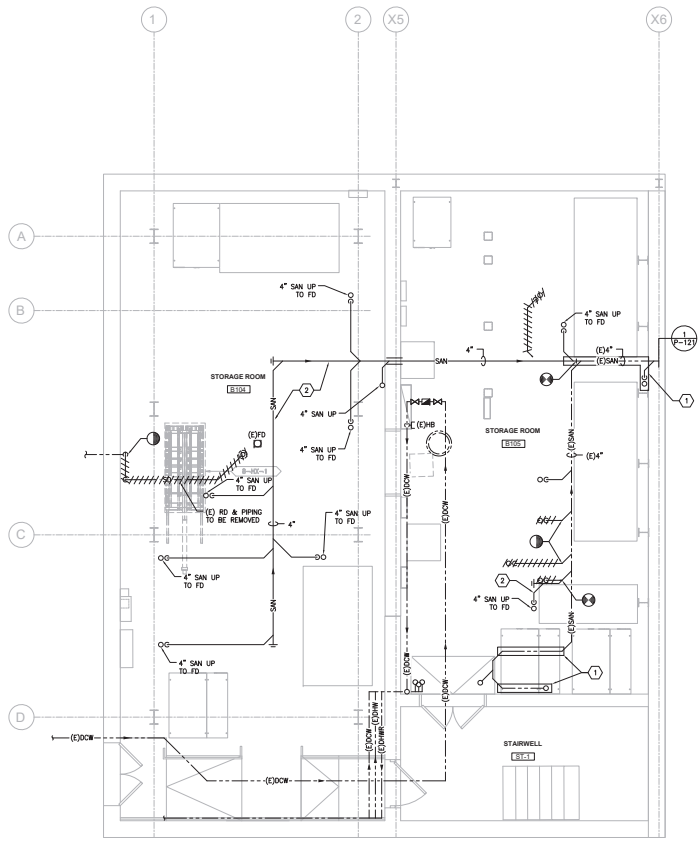

1 PLUMBING PLAN - FIRST LEVEL
SCALE: 1/4" = 1'-0"



ALL STRUCTURAL AND ARCHITECTURAL INFORMATION USED TO DEVELOP BACKGROUNDS FOR THIS PROJECT WAS REFERENCED FROM THE DRAWINGS DEVELOPED BY H.F. LENZ COMPANY (DVA PROJECT No. 646-09-126 JUNE 23, 2011).

PRINTS OF THIS DRAWING SHALL NOT BE USED FOR ANY PURPOSE WHATSOEVER WITHOUT THE SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER.		
NO.	DESCRIPTION	DATE

CONSULTANT

LaBella
Powered by partnership.

300 State Street
Suite 200
Pittsburgh, PA 15222
P: (412) 424-6110
www.labella.com

Engineering
Architecture
Environmental
Planning

ENGINEER OF RECORD

Miller-Remick LLC
Mechanical, Electrical, Plumbing & Structural Engineering

1010 KINGS HIGHWAY SOUTH
CHERRY HILL, NEW JERSEY 08034
PHONE: (856) 429-4000
FAX: (856) 429-5000
MR PROJECT NO: 0507-0014

MILLER-REMIK LLC
PROFESSIONAL ENGINEER

ANTHONY PACARO
P.E.
1010 KINGS HIGHWAY SOUTH
CHERRY HILL, NEW JERSEY 08034
PHONE: (856) 429-4000
FAX: (856) 429-5000
MR PROJECT NO: 0507-0014

Office of
Construction and
Facilities
Management

VA U.S. Department
of Veterans Affairs

Drawing Title
**PLUMBING
PLAN
FIRST LEVEL**

Approved: Project Director

Phase
**CONSTRUCTION BID
DOCUMENTS**

NON-SPRINKLERED

Project Title
UD CHILLER CAPACITY UPGRADE

Location
**UNIVERSITY DRIVE CAMPUS
PITTSBURGH, PENNSYLVANIA**

Issue Date
2022-05-11


Checked
BH

Drawn
AHTM


Project Number
646-20-109

Building Number
8

Drawing Number
P-111

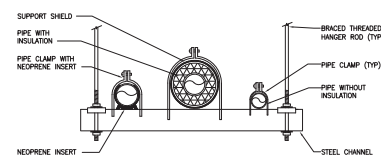

6 TYPICAL TRAPEZE PIPE SUPPORT DETAIL
SCALE: NONE

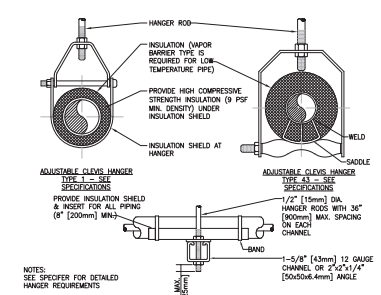


NOTES:
SEE SPECIFIER FOR DETAILED HANGER REQUIREMENTS

SIZE VIEW TRAPEZE HANGER FOR UP TO 1000 LB. (450 kg) LINE LOAD


MAXIMUM PIPE/TUBING SUPPORT SPACING		1	2	3	4	5	6	8	10
PIPE	1/2"	17	17	17	17	17	17	17	17
	3/4"	25	25	25	25	25	25	25	25
TUBING	1/2"	17	17	17	17	17	17	17	17
	3/4"	25	25	25	25	25	25	25	25

NOTE: FOR TRAPEZE HANGER TAKE SPACING OF SMALLEST SIZE ON TRAPEZE.


5 PIPE HANGER DETAIL
SCALE: NONE

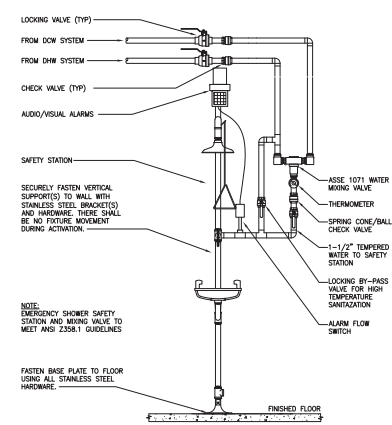

4 EMERGENCY SHOWER DETAIL
SCALE: NONE

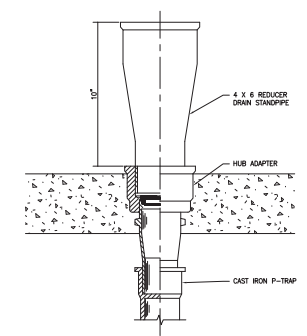


3 HUB DRAIN DETAIL
SCALE: NONE

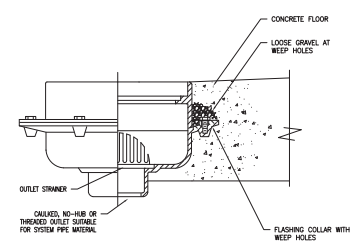

- NOTES:
1. SLOPE MEMBRANE LINER 2% TO DRAIN.
2. PROVIDE FLASHING MEMBRANE WHEN DRAIN IS INSTALLED IN A NON-MEMBRANE FLOOR.

2 TYPE "E" FLOOR DRAIN DETAIL
SCALE: NONE

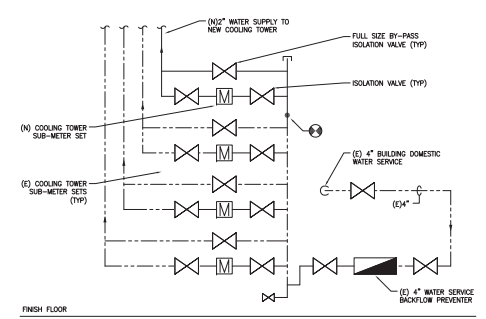

1 SUB-METER DETAIL
SCALE: NONE

PRINTS OF THIS DRAWING SHALL NOT BE USED FOR ANY PURPOSE WHATSOEVER WITHOUT THE SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER.

NO.	DESCRIPTION	DATE

CONSULTANT LaBella Powered by partnership. 300 State Street Suite 201 Rochester, NY 14614 P: (585) 424-4111 www.labellagc.com	ENGINEER OF RECORD Miller-Remick LLC Mechanical, Electrical, Plumbing, & Structural Engineering 1010 KINGS HIGHWAY SOUTH CHERRY HILL, NEW JERSEY 08034 PHONE: (856) 429-4000 FAX: (856) 429-5000 MR PROJECT NO: 0507-0014	Office of Construction and Facilities Management U.S. Department of Veterans Affairs	Drawing Title PLUMBING DETAILS	Phase CONSTRUCTION BID DOCUMENTS	Project Title UD CHILLER CAPACITY UPGRADE	Project Number 646-20-109
			Approved: Project Director	NON-SPRINKLERED	Location UNIVERSITY DRIVE CAMPUS PITTSBURGH, PENNSYLVANIA	Building Number 8
			Issue Date 2022-05-11	Checked PD	Drawn AHMT	Drawing Number P-501